

Harnett County Department of Public Health

PERMIT # SFD2102-0123

Operation Permit

91703

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 35 PLANTERS LN. (RED HILL CH. RD.)

Name: (owner) SMITH DOUGLAS HOMES SUBDIVISION CANR MILL ESTS LOT # 1

System Installer: ATE ENTERPRISE

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 250 REDUCTION SYS. IIB Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

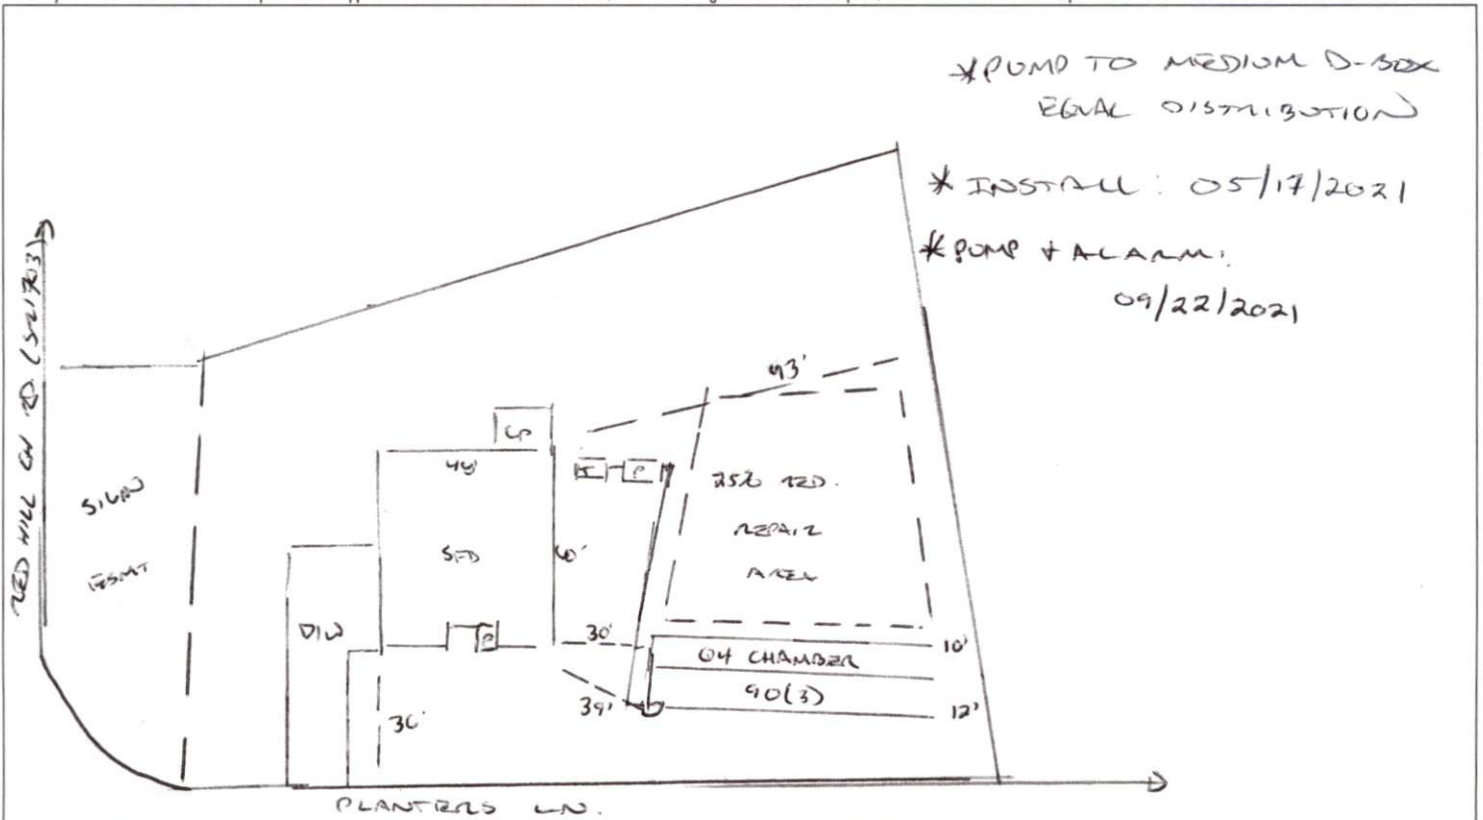

*PUMP TO MEDIUM D-BOX
EQUAL DISTRIBUTION

*INSTALL: 05/17/2021

*PUMP + ALARM:

09/22/2021

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: _____
- V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2OLine _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Q4 CHAMBER IIB Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 90 feet ditches 3 feet ditches 24 inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 09/22/2021