

Harnett County Department of Public Health

PERMIT # SFD 2103-003

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 511703 74th Hill Ct Rd

Name: (owner) Victoria Wickes

SUBDIVISION Cane Mill Estates

LOT # 17

System Installer: ATR Enterprises, Ricky Noto

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Pmp to 25% reduction II B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.
Charles Ave 4

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

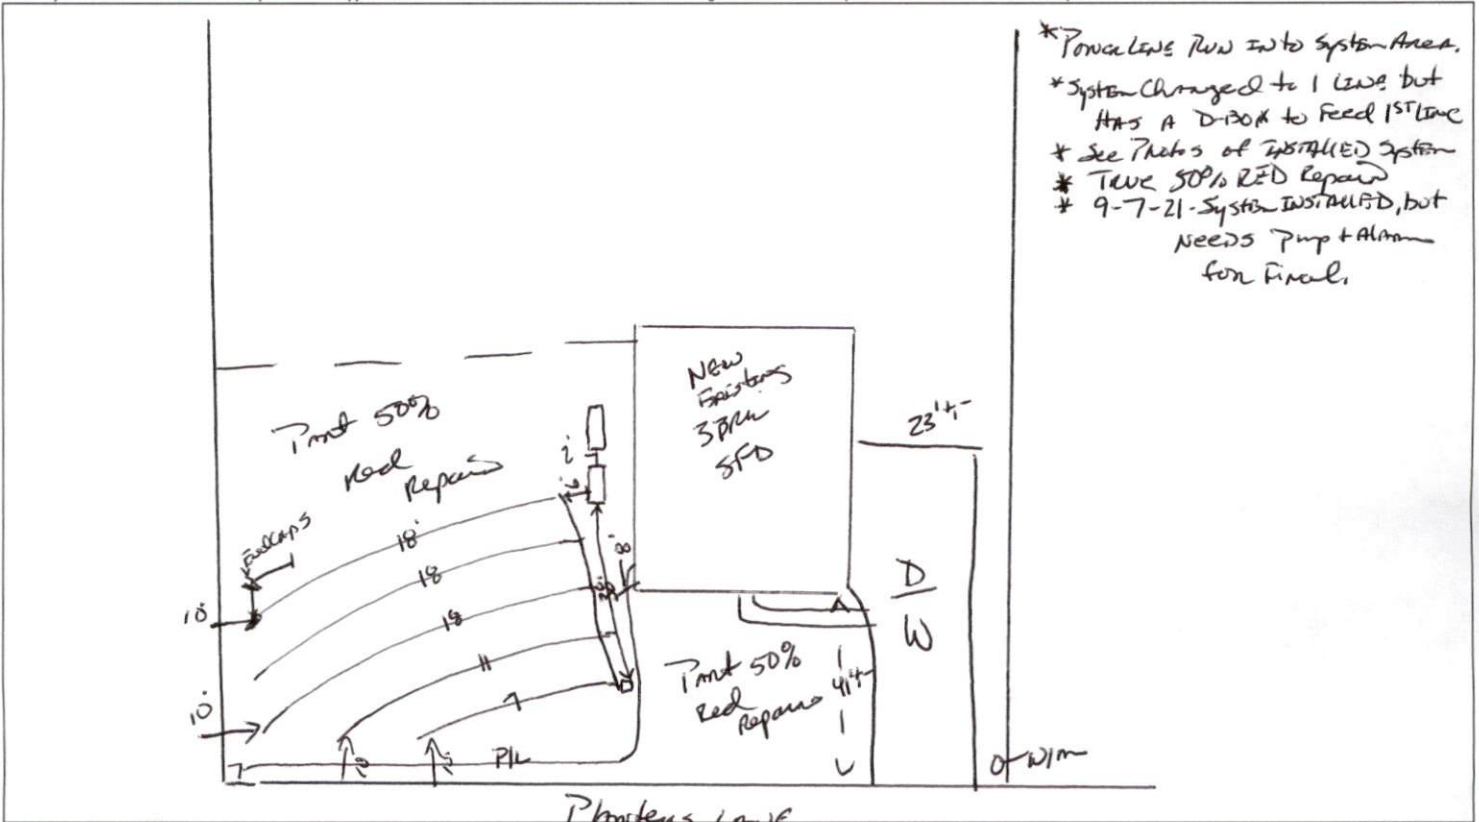

* Pvc Line Run into System Area.
* System changed to 1 line but HAS A D-BOX to feed 1st line
* See Photos of installed system
* TAKE SFP/RED Repair
* 9-7-21-System INSTALLED, but needs Pmp + Alarm for final.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% reduction (Charles) Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 1 of each ditch 300 feet ditches 3 feet ditches 22-18 inches
French Drain Required: _____ Linear feet

Authorized State Agent James C. Manhart Date 10-20-21