

NOTICE TO CONTRACTOR
All construction must comply with current NC Building Code
and is subject to field inspection and enforcement.

APPROVED
Limited building only review
Permit holder responsible for

04/12/2021



AFS - 3LG
Rear Porch

**PLANS DESIGNED TO THE
2018 NORTH CAROLINA STATE
RESIDENTIAL BUILDING CODE**

MEAN ROOF HEIGHT: 19'-9" HEIGHT TO RIDGE: 27'-5"

CLIMATE ZONE	ZONE 3A	ZONE 4A	ZONE 5A
PENETRATION U-FACTOR	0.35	0.35	0.35
SKYLIGHT U-FACTOR	0.55	0.55	0.55
GLAZED PENETRATION SHGC	0.30	0.30	0.30
CEILING R-VALUE	38 or 30ci	38 or 30ci	38 or 30ci
WALL R-VALUE	15	15	19
FLOOR R-VALUE	19	19	30
* BASEMENT WALL R-VALUE	5/13	10/15	10/15
** SLAB R-VALUE	0	10	10
** CRAWL SPACE WALL R-VALUE	5/13	10/15	10/19

* TYP. MEANS R-15 SHEATHING INSULATION OR R-13 CAVITY INSULATION
** INSULATION DEPTH WITH MIN. NOM. THICK. 3/4" OR FROM INSPECTION GAP TO BOTTOM OF FOOTING. INSULATION DEPTH WITH STEM WALL 5/8" 24" OR TO BOTTOM OF FOUNDATION WALL

DESIGNED FOR WIND SPEED OF 120 MPH, 3 SECOND GUST (3 FASTEST MILE) EXPOSURE "B"
COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS:
MEAN ROOF: UP TO 30' 30'-1" TO 35' 35'-1" TO 40' 40'-1" TO 45'
ZONE 1 14.2 -18.0 14.9 -18.8 15.5 -16.4 15.9 -20.2
ZONE 2 14.2 -18.0 14.9 -18.9 15.5 -19.6 15.9 -20.2
ZONE 3 14.2 -18.0 14.9 -18.9 15.5 -19.6 15.9 -20.2
ZONE 4 15.5 -16.0 16.3 -16.8 16.9 -17.4 17.4 -17.9
ZONE 5 15.5 -20.0 16.3 -21.0 16.9 -21.8 17.4 -22.4

DESIGNED FOR WIND SPEED OF 120 MPH, 3 SECOND GUST (3 FASTEST MILE) EXPOSURE "B"
COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS:
MEAN ROOF: UP TO 30' 30'-1" TO 35' 35'-1" TO 40' 40'-1" TO 45'
ZONE 1 16.7 -18.0 17.5 -18.9 18.2 -19.6 18.7 -20.2
ZONE 2 16.7 -21.0 17.5 -22.1 18.2 -22.9 18.7 -23.5
ZONE 3 16.7 -21.0 17.5 -22.1 18.2 -22.9 18.7 -23.5
ZONE 4 18.2 -19.0 19.1 -20.0 19.8 -20.7 20.4 -21.3
ZONE 5 18.2 -24.0 19.1 -25.2 19.8 -26.2 20.4 -26.9

GUARD RAIL NOTES

SECTION R312
R312.1 Where required. Guards shall be located along open-sided walking surfaces, including stairs, ramps and landings, that are located more than 30 inches (762 mm) measured vertically to the floor or grade below at any point within 36 inches (914 mm) horizontally to the edge of the open side. Insect screening shall not be considered as a guard.
R312.2 Height. Required guards at open-sided walking surfaces, including stairs, porches, balconies or landings, shall be not less than 36 inches (914 mm) high measured vertically above the adjacent walking surface, adjacent fixed seating or the line connecting the leading edges of the treads.
Exceptions:
1. Guards on the open sides of stairs shall have a height not less than 34 inches (864 mm) measured vertically from a line connecting the leading edges of the treads.
2. Where the top of the guard also serves as a handrail on the open sides of stairs, the top of the guard shall not be not less than 34 inches (864 mm) and not more than 38 inches (965 mm) measured vertically from a line connecting the leading edges of the treads.
R312.3 Opening limitations. Required guards shall not have openings from the walking surface to the required guard height which allow passage of a sphere 4 inches (102 mm) diameter.
Exceptions:
1. The triangular openings at the open side of a stair, formed by the riser, tread and bottom rail of a guard, shall not allow passage of a sphere 6 inches (153 mm) in diameter.
2. Guards on the open sides of stairs shall not have openings which allow passage of a sphere 4 3/8 inches (111 mm) in diameter.

ROOF VENTILATION

SECTION R806
SQUARE FOOTAGE OF ROOF TO BE VENTED = 2,477 SQ. FT.
NET FREE CROSS VENTILATION NEEDED:
WITHOUT 50% TO 80% OF VENTING 3'-0" ABOVE EAVE = 16.51 SQ. FT.
WITH 50% TO 80% OF VENTING 3'-0" ABOVE EAVE, OR WITH CLASS 1 OR II VAPOR RETARDER ON WARM-IN-WINTER SIDE OF CEILING = 8.26 SQ. FT.




FRONT ELEVATION
SCALE 1/4" = 1'-0"

SQUARE FOOTAGE


HEATED	1766 SQ. FT.
FIRST FLOOR	1766 SQ. FT.
PLAYROOM	400 SQ. FT.
TOTAL	2166 SQ. FT.
HEATED OPTIONAL	48 SQ. FT.
CAROLINA ROOM	48 SQ. FT.
RECREATION ROOM	304 SQ. FT.
TOTAL	452 SQ. FT.
UNHEATED	188 SQ. FT.
FRONT PORCH	488 SQ. FT.
GARAGE	676 SQ. FT.
TOTAL	1164 SQ. FT.
UNHEATED OPTIONAL	160 SQ. FT.
SCREENED PORCH	160 SQ. FT.
DECK / PATIO	188 SQ. FT.
THIRD GARAGE	292 SQ. FT.
TOTAL	560 SQ. FT.

AIR LEAKAGE

Section N1102.4
N1102.4.1 Building thermal envelope. The building thermal envelope shall be curably sealed with an air barrier system to limit infiltration. The sealing methods between dissimilar materials shall allow for differential expansion and contraction. For all joints, where present, the following shall be caulked, gasketed, weather stripped or otherwise sealed with an air barrier material or solid material consistent with Appendix E-2.4 of this code:
1. Blocking and sealing floor/ceiling systems and under knee walls open to unconditioned or exterior space.
2. Capping and sealing shafts or chases, including flue shafts.
3. Capping and sealing soffit or dropped ceiling areas.

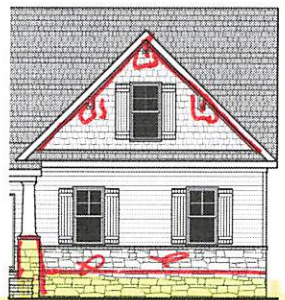


WINDOWS WITH SIDE LOAD
SCALE 1/8" = 1'-0"

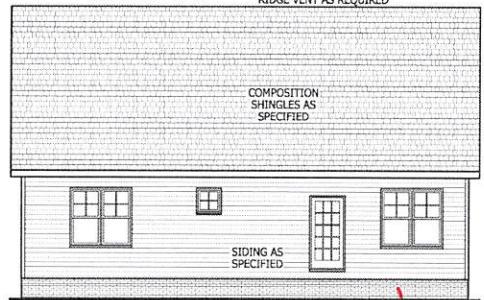

REAR ELEVATION
SCALE 1/8" = 1'-0"



LEFT SIDE ELEVATION
SCALE 1/8" = 1'-0"

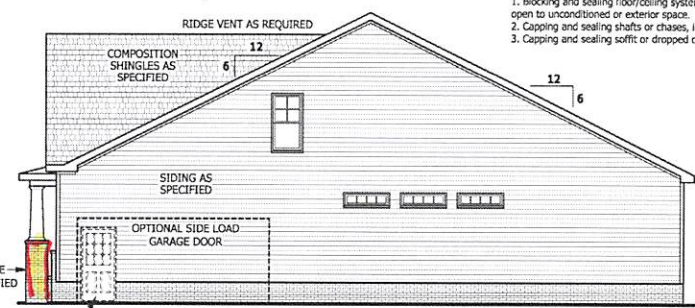

RIGHT SIDE ELEVATION
SCALE 1/8" = 1'-0"

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS.
HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR PRACTICES AND PROCEDURES.
EDGES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION.
THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

ELEVATION
The Lauren H

HAYNES WEAVER
HOMES
910.630.2100 • 910.606.4000

HAYNES WEAVER
HOME PLANS, INC.
201 BOB TOZ, LAKE FOREST, NC 27588 919-356-6180 FAX 919-356-6185

SQUARE FOOTAGE

HEATED	1766 SQ. FT.
FIRST FLOOR	1766 SQ. FT.
PLAYROOM	400 SQ. FT.
TOTAL	2166 SQ. FT.
HEATED OPTIONAL	48 SQ. FT.
CAROLINA ROOM	48 SQ. FT.
RECREATION ROOM	304 SQ. FT.
TOTAL	452 SQ. FT.
UNHEATED	188 SQ. FT.
FRONT PORCH	488 SQ. FT.
GARAGE	676 SQ. FT.
TOTAL	1164 SQ. FT.
UNHEATED OPTIONAL	160 SQ. FT.
SCREENED PORCH	160 SQ. FT.
DECK / PATIO	188 SQ. FT.
THIRD GARAGE	292 SQ. FT.
TOTAL	560 SQ. FT.

ROOF TRUSS REQUIREMENTS

TRUSS DESIGN. Trusses to be designed and engineered in accordance with these drawings. Any variation with these drawings must be brought to Haynes Home Plans, Inc. attention before construction begins.

KNEE WALL AND CEILING HEIGHTS. All finished knee wall heights and ceiling heights are shown turned down 10" from roof decking for insulation. If for any reason the truss manufacturer fails to meet or exceed designated heel heights, finished knee wall heights, or finished ceiling heights shown on these drawings the finished square footage may vary. Any discrepancy must be brought to Haynes Home Plans, Inc. attention, so a suitable solution can be reached before construction begins. Any variation due to these conditions not being met is the responsibility of the truss manufacturer.

ANCHORAGE. All required anchors for trusses due to uplift or bearing shall meet the requirements as specified on the truss schematics.

BEARING. All trusses shall be designed for bearing on SPF #2 plates or ledgers unless noted otherwise.

Plate Heights & Floor Systems. See elevation page(s) for plate heights and floor system thicknesses.

STRUCTURAL NOTES

All construction shall conform to the latest requirements of the 2018 North Carolina Residential Building Code, plus all local codes and regulations. This document in no way shall be construed to supersede the code.

JOB SITE PRACTICES AND SAFETY: Haynes Home Plans, Inc. assumes no liability for contractor practices and procedures or safety program. Haynes Home Plans, Inc. takes no responsibility for the contractor's failure to carry out the construction work in accordance with the contract documents. All members shall be framed, anchored, and braced in accordance with good construction practice and the building code.

DESIGN LOADS	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (LL)
Attics without storage	10	L/240	
Attics with limited storage	20	10	L/360
Attics with fixed stairs	40	10	L/360
Balconies and decks	40	10	L/360
Fire escapes	40	10	L/360
Guardrails and handrails	200	--	--
Guardrail in-fill components	50	--	--
Passenger vehicle garages	50	10	L/360
Rooms other than sleeping	40	10	L/360
Sleeping rooms	30	10	L/360
Stairs	40	--	L/360
Snow	20	--	--

FRAMING LUMBER: All non treated framing lumber shall be SPF #2 (Fb = 875 PSI) or SYP #2 (Fb = 750 PSI) and all treated lumber shall be SYP #2 (Fb = 750 PSI) unless noted otherwise.

ENGINEERED WOOD BEAMS:
Laminated veneer lumber (LVL) = Fb=2600 PSI, Fv=285 PSI, E=1.9x10⁶ PSI
Parallel strand lumber (PSL) = Fb=2900 PSI, Fv=290 PSI, E=2.0x10⁶ PSI
Laminated strand lumber (LSL) Fb=2250 PSI, Fv=400 PSI, E=1.55x10⁶ PSI
Install all connections per manufacturer's instructions.

TRUSS AND I-JOIST MEMBERS: All roof truss and I-joist layouts shall be prepared in accordance with this document. Trusses and I-joists shall be installed according to the manufacturer's specifications. Any change in truss or I-joist layout shall be coordinated with Haynes Home Plans, Inc.

LINTELS: Brick lintels shall be 3 1/2" x 3 1/2" x 1/4" steel angle for up to 6'-0" span. 6" x 4" x 5/16" steel angle with 6" leg vertical for spans up to 9'-0" unless noted otherwise. 3 1/2" x 3 1/2" x 1/4" steel angle with 1/2" bolts at 2'-0" on center for spans up to 18'-0" unless noted otherwise.

FLOOR SHEATHING: OSB or CDX floor sheathing minimum 1/2" thick for 16" on center joist spacing, minimum 5/8" thick for 19.2" on center joist spacing, and minimum 3/4" thick for 24" on center joist spacing.

ROOF SHEATHING: OSB or CDX roof sheathing minimum 3/8" thick for 16" on center rafters and 7/16" for 24" on center rafters.

CONCRETE AND SOILS: See foundation notes.

ATTIC ACCESS

SECTION R807

R807.1 Attic access. An attic access opening shall be provided to attic areas that exceed 400 square feet (37.16 m²) and have a vertical height of 60 inches (1524 mm) or greater. The net clear opening shall not be less than 20 inches by 30 inches (508 mm by 762 mm) and shall be located in a hallway or other readily accessible location. A 30-inch (762 mm) minimum unobstructed headroom in the attic space shall be provided at some point above the access opening. See Section M1305.1.3 for access requirements where mechanical equipment is located in attics.

Exceptions:

1. Concaved areas not located over the main structure including porches, areas behind knee walls, dormers, bay windows, etc. are not required to have access.
2. Pull down stair treads, stringers, handrails, and hardware may protrude into the net clear opening.


EXTERIOR HEADERS

- (2) 2 X 6 WITH 1 JACK STUD EACH END UNLESS NOTED OTHERWISE
- KING STUDS EACH END PER TABLE BELOW

HEADER SPAN	< 3'	3'-4'	4'-8'	8'-12'	12'-16'
KING STUD(S)	1	2	3	5	6

INTERIOR HEADERS

- LOAD BEARING HEADERS (2) 2 X 6 WITH 1 JACK STUD AND 1 KING STUD EACH END UNLESS NOTED OTHERWISE
- NON LOAD BEARING HEADERS TO BE LADDER FRAMED

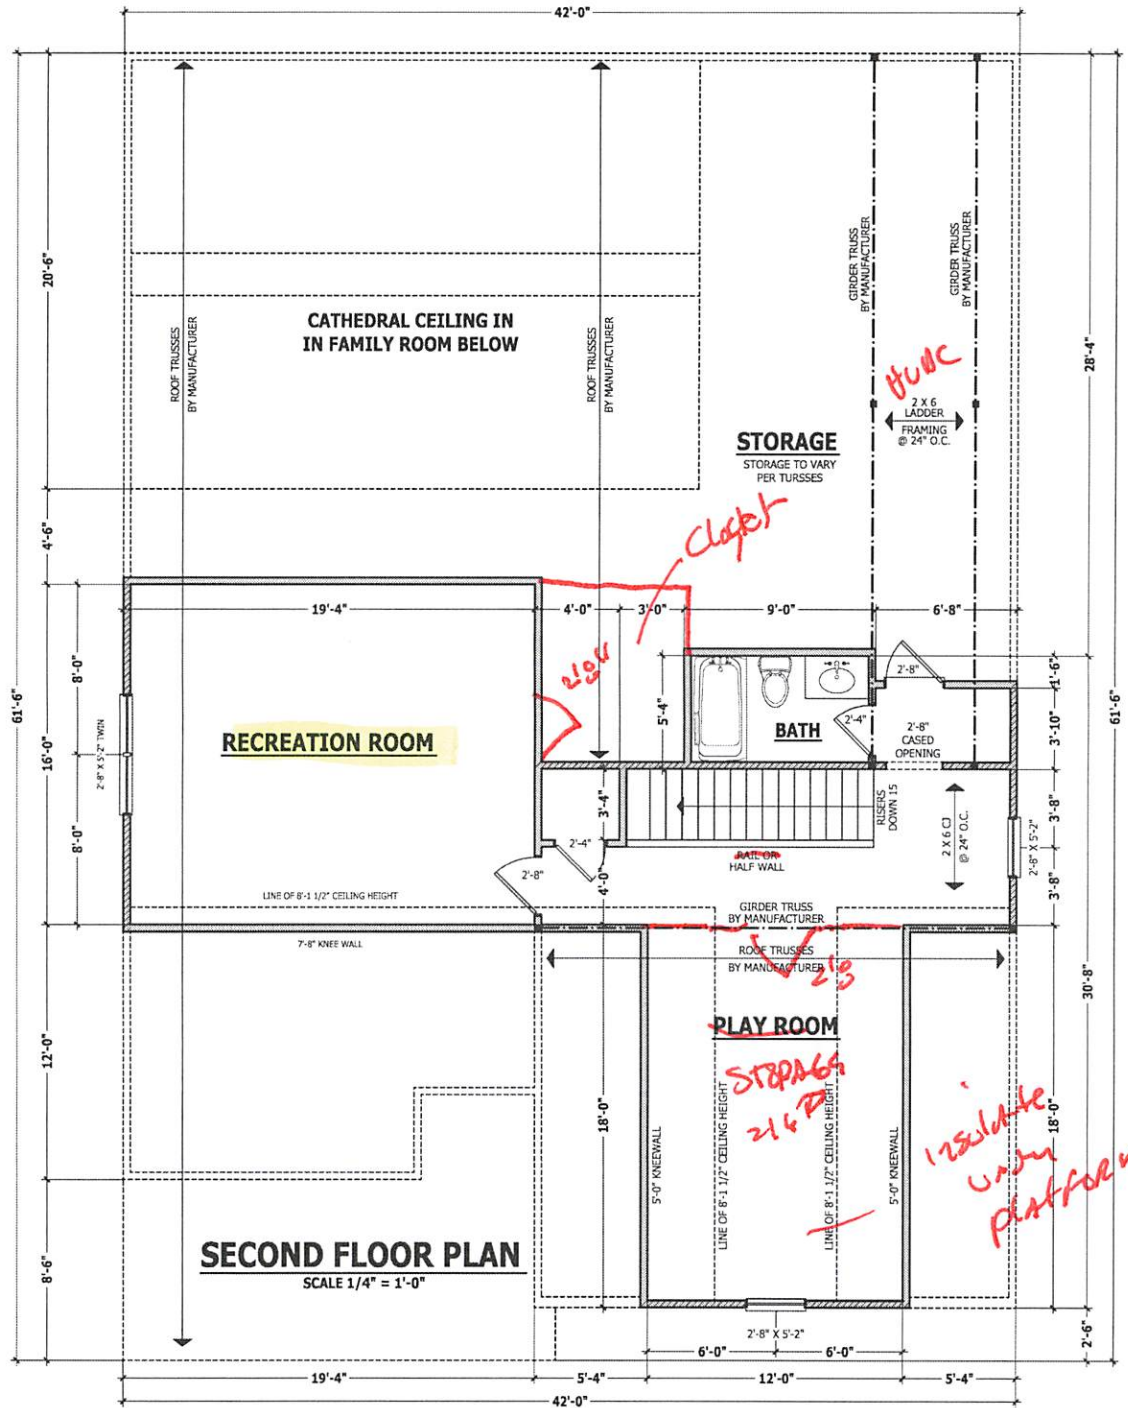

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR'S PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INTENTIVE OF DESIGN AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.


SECOND FLOOR PLAN
The Lauren H

HAYNES WEAVER
HOMES


HAYNES HOME PLANS, INC.
910.630.2100 • 910.606.4006
FAX: 910.630.2102 • LICENSE NO. 27888 • 914-05-1801 FAX: 1-888-491-0366

SQUARE FOOTAGE	
HEATED	1766 SQ. FT.
UNHEATED	216 SQ. FT.
TOTAL	1982 SQ. FT.
HEATED OPTIONALS	146 SQ. FT.
UNHEATED OPTIONALS	216 SQ. FT.
TOTAL	362 SQ. FT.
SCREENED PORCH	180 SQ. FT.
SCREENED PATIO	180 SQ. FT.
SCREENED DECK	180 SQ. FT.
SCREENED PORCH	180 SQ. FT.
SCREENED PATIO	180 SQ. FT.
SCREENED DECK	180 SQ. FT.
TOTAL	540 SQ. FT.


© Copyright 2020
Haynes Home Plans, Inc.
2/24/2020
200219B
PAGE 5 OF 7

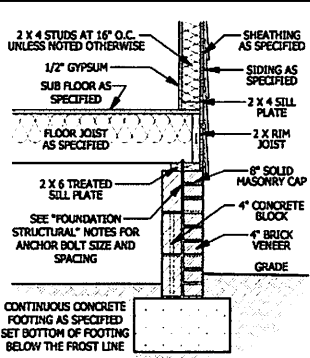


A CRAWL SPACE WALL
SCALE 3/4" = 1'-0"

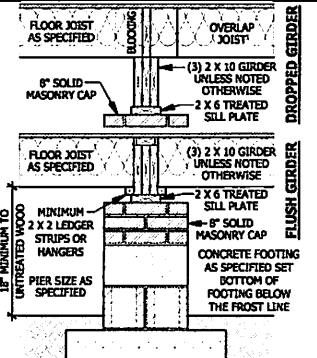


B DROPPED/ FLUSH PIER
SCALE 3/4" = 1'-0"

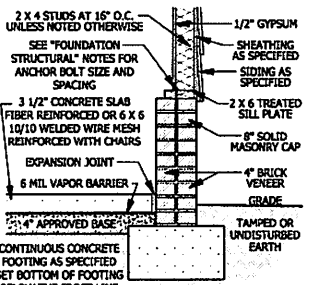


C CRAWL SPACE AT GARAGE
SCALE 3/4" = 1'-0"

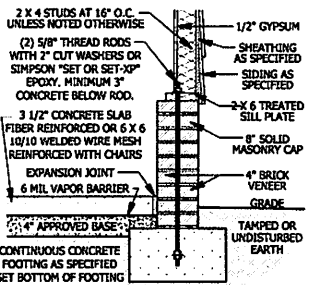


D GARAGE STEM WALL
SCALE 3/4" = 1'-0"

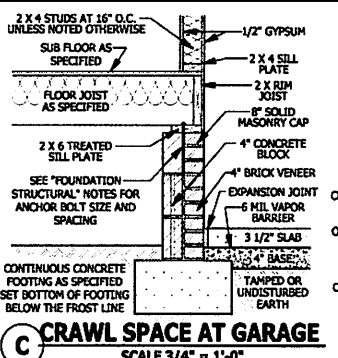


E FILLED PORCH SECTION WITH VENT
SCALE 1/2" = 1'-0"

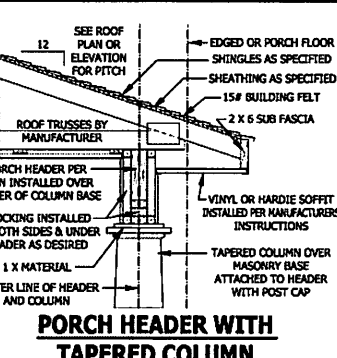


F DECK ATTACHMENT
SCALE 1/2" = 1'-0"

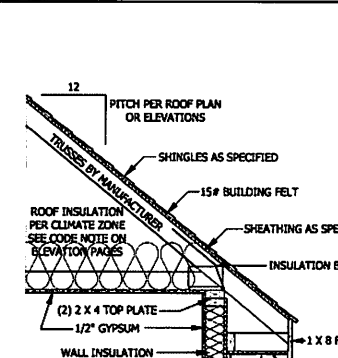


G PORCH HEADER WITH TAPERED COLUMN
SCALE 3/4" = 1'-0"

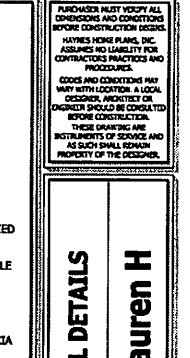

H TYPICAL WALL DETAIL
SCALE 3/4" = 1'-0"

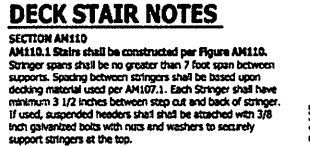


I DECK STAIR NOTES

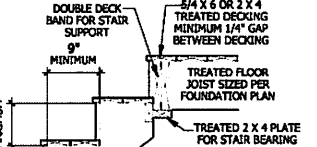


J <48" GARAGE WING WALL
SCALE 3/4" = 1'-0"




K SMOKE ALARMS

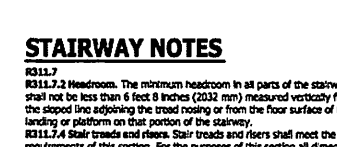


L CARBON MONOXIDE ALARMS

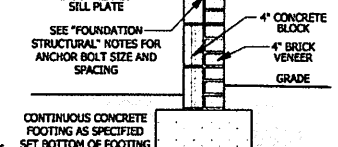


M STAIRWAY NOTES

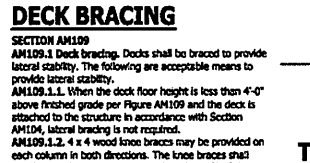


N DECK BRACING

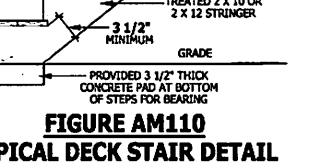

O FIGURE AM110 TYPICAL DECK STAIR DETAIL
SCALE 3/4" = 1'-0"

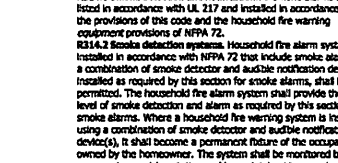

P WEEP SCREEDS

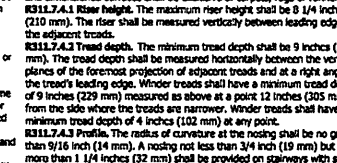

Q TYPICAL STAIR DETAIL
SCALE 1/4" = 1'-0"

DECK STAIR NOTES

SECTION AM110

AM110.1 Stairs shall be constructed per Figure AM110. Stringers shall be no greater than 7 foot span between supports. Spacing between stringers shall be based upon decking material used per AM107.1. Each stringer shall have minimum 3 1/2 inches between top and back of stringer. If used, suspended headers shall be attached with 3/8 inch galvanized bolts with nuts and washers to secure support stringers at the top.

DECK BRACING

SECTION AM109

AM109.1 Deck bracing. Decks shall be braced to provide lateral stability. The following are acceptable means to provide lateral stability.

AM109.1.1 When the deck floor height is less than 4'-0" above finished grade per Figure AM109 and the deck is attached to the structure in accordance with Section AM104, lateral bracing is not required.


AM109.1.2 4 x 4 wood knee braces may be provided on each column in both directions. The knee braces shall attach to each post at a point not less than 1/3 of the post length from the top of the post, and the braces shall be angled between 45 degrees and 60 degrees from the horizontal. Knee braces shall be bolted to the post and the girders/double band with one 3/8 inch hot dipped galvanized bolt with nut and washer at both ends of the brace per Figure AM109.1

AM109.1.3 For freestanding decks without knee braces or diagonal bracing, lateral stability may be provided by embedding the post in accordance with Figure AM109.2 and the following:


POST SIZE	MIN. EMBEDMENT DEPTH	MIN. POST HEIGHT	MIN. CONCRETE DIAMETER	
4 x 4	48 SF	4'-0"	2'-6"	1'-0"
6 x 6	120 SF	6'-0"	3'-6"	1'-8"

AM109.1.4 2 x 6 diagonal vertical cross bracing may be provided in two perpendicular directions for freestanding decks or parallel to the structure at the exterior column line for attached decks. The 2 x 6's shall be attached to the posts with one 5/8 inch hot dipped galvanized bolt with nut and washer at each end of each bracing member per Figure AM109.3.


AM109.1.5 For embedment of piles in Coastal Regions, see Chapter 45.

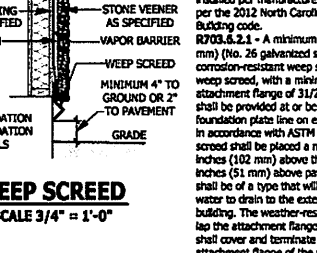


R WEEP SCREED
SCALE 3/4" = 1'-0"

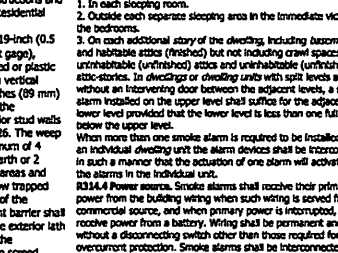

S DECK ATTACHMENT
SCALE 1/2" = 1'-0"

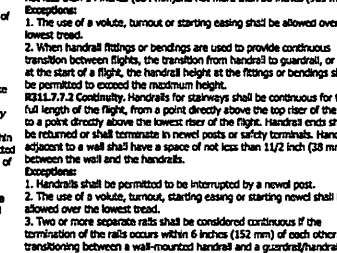

T CARBON MONOXIDE ALARMS

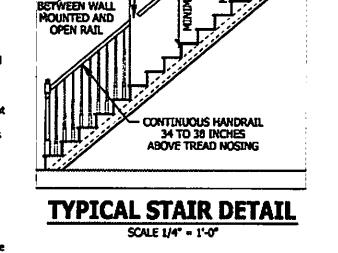

U TYPICAL STAIR DETAIL
SCALE 1/4" = 1'-0"

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES WEAVER PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR PRACTICES AND PROCEDURES.

CODES AND CONDITIONS MAY VARY WITH LOCALITY. A LOCAL CODES, ADOPTED BY THE CONTRACTOR, SHOULD BE CONSULTED BEFORE CONSTRUCTION.

THESE DRAWINGS ARE NOT BE SEEN AS SUCH SHALL BEHOLD PROPERTY OF THE DESIGNER.

TYPICAL DETAILS

The Lauren H

HAYNES WEAVER

HOME PLANS, INC.

910.630.2100 • 910.630.4506

SMOKE ALARMS

SECTION R314

R314.1 Smoke detection and notification. All smoke alarms shall be listed in accordance with UL 217 and installed in accordance with the provisions of this code and the household fire warning equipment provisions of NFPA 72.

R314.2 Smoke detection systems. Household fire alarm systems installed in accordance with NFPA 72 that include smoke alarms, or a combination of smoke detector and audible notification device installed as required by this section for smoke alarms, shall be permitted. The household fire alarm system shall provide the same level of smoke detection and alarm as required by this section for smoke alarms. Where a household fire warning system is installed using notification of smoke detection and audible notification device(s), it shall become a permanent feature of the occupancy and owned by the homeowner. The system shall be monitored by an approved supervising station and be maintained in accordance with NFPA 72.

Exception: Where smoke alarms are provided meeting the requirements of Section R314.4.

R314.3 Location. Smoke alarms shall be installed in the following locations:


1. In each sleeping room.
2. Outside each separate sleeping area in the immediate vicinity of the bedrooms.
3. On each additional story of the dwelling, including basements and habitable attics (finished) but not including crawl spaces, unfinished (unfinished) attics and unfinished (unfinished) attic stories. In dwellings or dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall surface for the adjacent lower level provided that the lower level is less than one full story below the upper level.

When more than one smoke alarm is required to be installed within an individual dwelling unit the alarm devices shall be interconnected in such a manner that the actuation of one alarm will activate all of the alarms in the individual unit.

R314.4 Power source. Smoke alarms shall receive their primary power from the building wiring when such wiring is provided from a commercial source, and when primary power is interrupted, shall receive power from a battery. Wiring shall be permanent and without a disconnecting switch other than those required for overcurrent protection. Smoke alarms shall be interconnected.


SQUARE FOOTAGE RELATED TO DECKING

DECKING TYPE	MIN. DEPTH	MIN. POST HEIGHT	MIN. CONCRETE DIAMETER
UNGRADED OPTIMAL	48 SF	4'-0"	2'-6"
GRADED OPTIMAL	120 SF	6'-0"	3'-6"
UNGRADED OPTIMAL	48 SF	4'-0"	2'-6"
GRADED OPTIMAL	120 SF	6'-0"	3'-6"

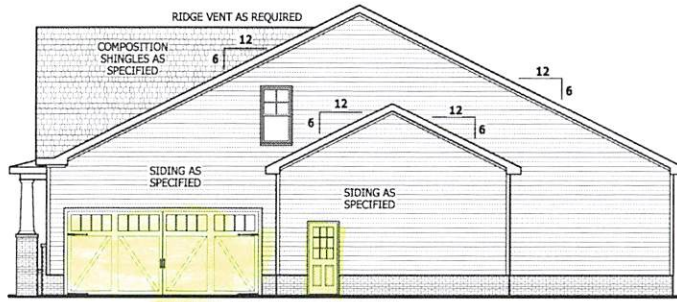


SIDE ELEVATION

SCALE 1/8" = 1'-0"

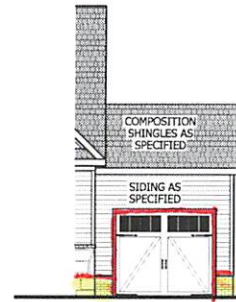

FRONT ELEVATION


SCALE 1/8" = 1'-0"

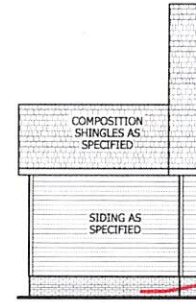

REAR ELEVATION


SCALE 1/8" = 1'-0"

PARC 2

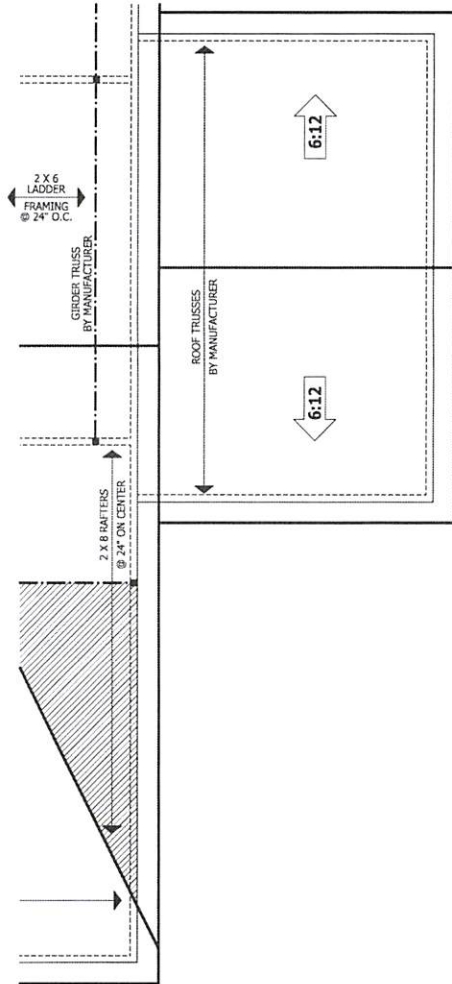


ROOF PLAN

SCALE 1/4" = 1'-0"

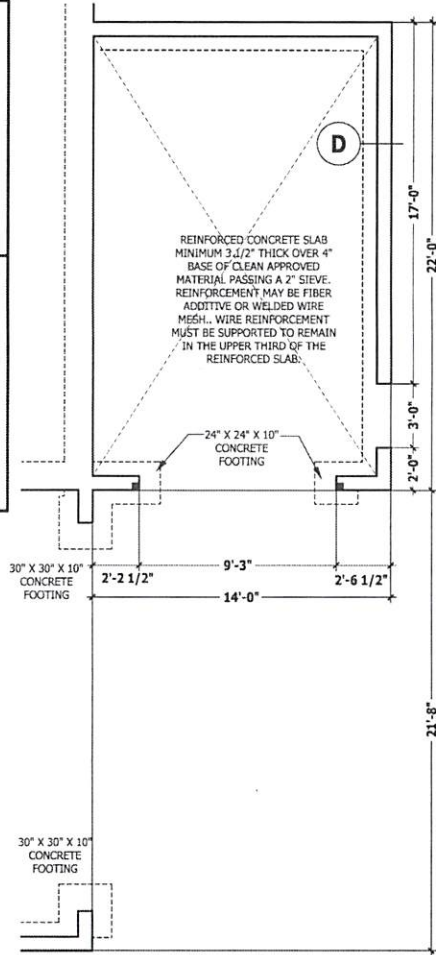


MONOLITHIC SLAB PLAN

SCALE 1/4" = 1'-0"

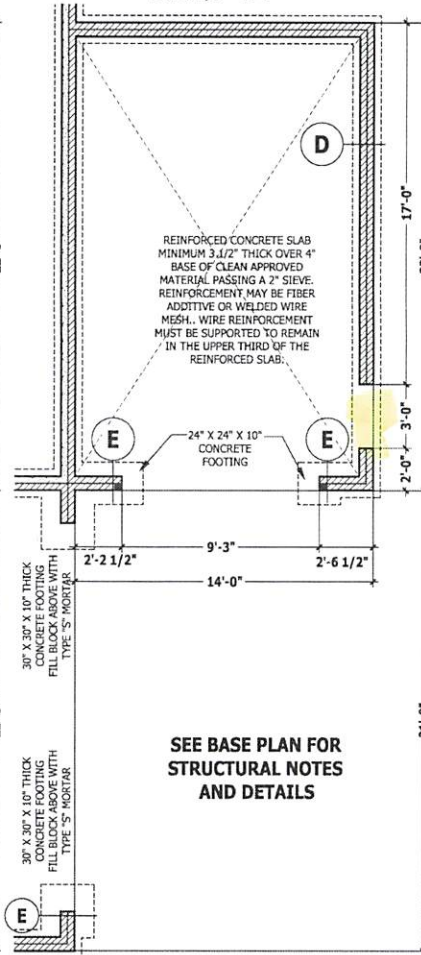

CRAWL SPACE / STEM WALL

SCALE 1/4" = 1'-0"

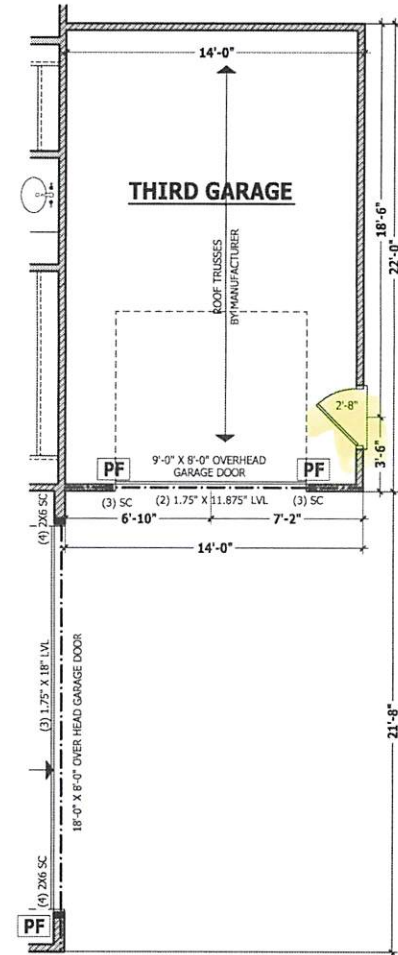

FIRST FLOOR PLAN

SCALE 1/4" = 1'-0"

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR'S PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCALITIES. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

FRONT LOAD THIRD CAR
The Lauren H

HAYNES WEAVER
HOME PLANS, INC.
910.630.2100 • 910.606.4696

HAYNES WEAVER
HOME PLANS, INC.
P.O. BOX 702, WAKE FOREST, NC 27588 919.454.1181 FAX 919.454.1055

SQUARE FOOTAGE	
HEATED	
FIRST FLOOR	176 SQ. FT.
TOTAL	176 SQ. FT.
UNHEATED	
OVERHEAD GARAGE	140 SQ. FT.
TOTAL	316 SQ. FT.
HEATED OPTIONAL	
CAROLINA ROOM	140 SQ. FT.
OVERHEAD GARAGE	140 SQ. FT.
TOTAL	280 SQ. FT.
UNHEATED OPTIONAL	
SCREENED PORCH	140 SQ. FT.
DECK (PATIO)	140 SQ. FT.
THIRD GARAGE	140 SQ. FT.
TOTAL	560 SQ. FT.

© Copyright 2020
Haynes Home Plans, Inc.
2/24/2020
200219B
ADDENDUM

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.


SCREENED PORCH ADDENDUM
The Lauren H

HAYNES WEAVER HOMES
910-630-2100 • 910-606-4906
3114 Laurel Drive • Greenville, SC 29615

HAYNES HOME PLANS, INC.
P.O. Box 102, Lake Forest, NC 27558 • 919-436-6180 • FAX 919-436-1436

SQUARE FOOTAGE	
HEATED FIRST FLOOR	1766 SQ. FT.
HEATED SECOND FLOOR	1562 SQ. FT.
TOTAL HEATED	3328 SQ. FT.
UNHEATED CAROLINA ROOM	144 SQ. FT.
UNHEATED PORCH	492 SQ. FT.
TOTAL UNHEATED	636 SQ. FT.
UNHEATED FRONT PORCH	188 SQ. FT.
UNHEATED GARAGE	478 SQ. FT.
TOTAL UNHEATED	666 SQ. FT.
UNHEATED OPTIONAL SCREENED PORCH	152 SQ. FT.
UNHEATED THIRD GARAGE	282 SQ. FT.
TOTAL UNHEATED OPTIONAL	434 SQ. FT.

© Copyright 2020
Haynes Home Plans, Inc.
2/24/2020
200219B
ADDENDUM

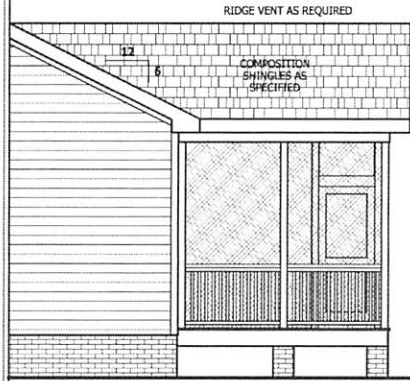


RIGHT SIDE ELEVATION
SCALE 1/4" = 1'-0"




REAR ELEVATION
SCALE 1/4" = 1'-0"




LEFT SIDE ELEVATION
SCALE 1/4" = 1'-0"

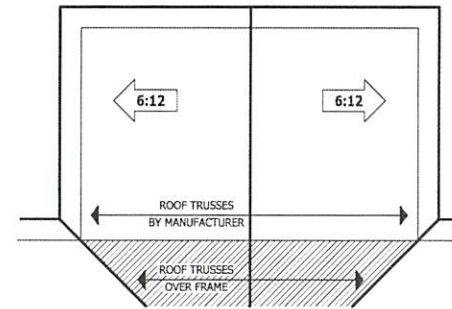


ROOF PLAN
SCALE 1/8" = 1'-0"

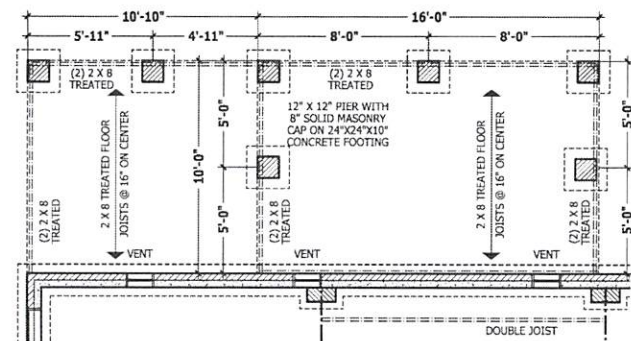


CRAWL SPACE PLAN
SCALE 1/4" = 1'-0"

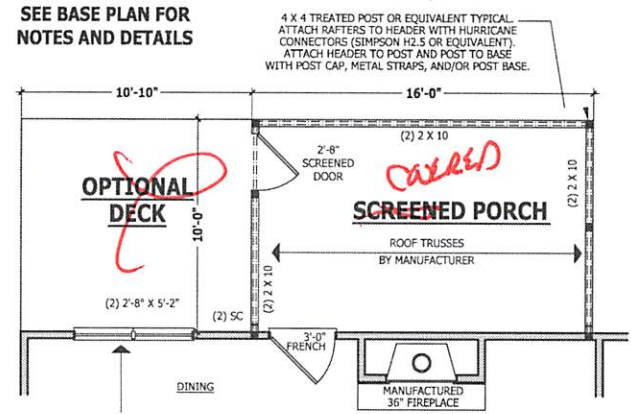

FIRST FLOOR PLAN
SCALE 1/4" = 1'-0"

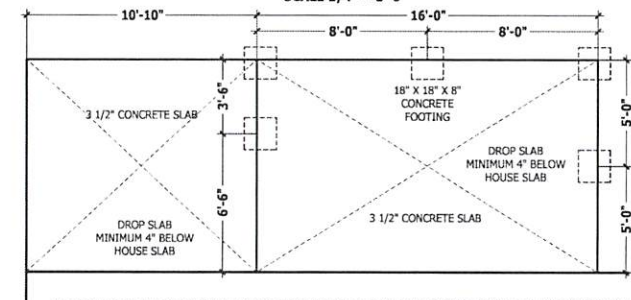

MONOLITHIC SLAB PLAN
SCALE 1/4" = 1'-0"

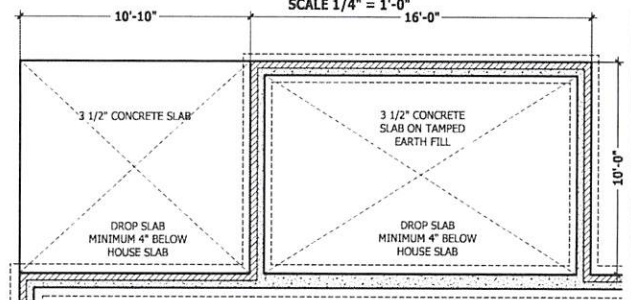


STEM WALL SLAB
SCALE 1/4" = 1'-0"

RAIL AS NEEDED PER CODE

SEE BASE PLAN FOR NOTES AND DETAILS

4 X 4 TREATED POST OR EQUIVALENT TYPICAL ATTACH RAFTERS TO HEADER WITH HURRICANE CONNECTORS (SIMPSON H2.5 OR EQUIVALENT). ATTACH HEADER TO POST AND POST TO BASE WITH POST CAP, METAL STRAPS, AND/OR POST BASE.

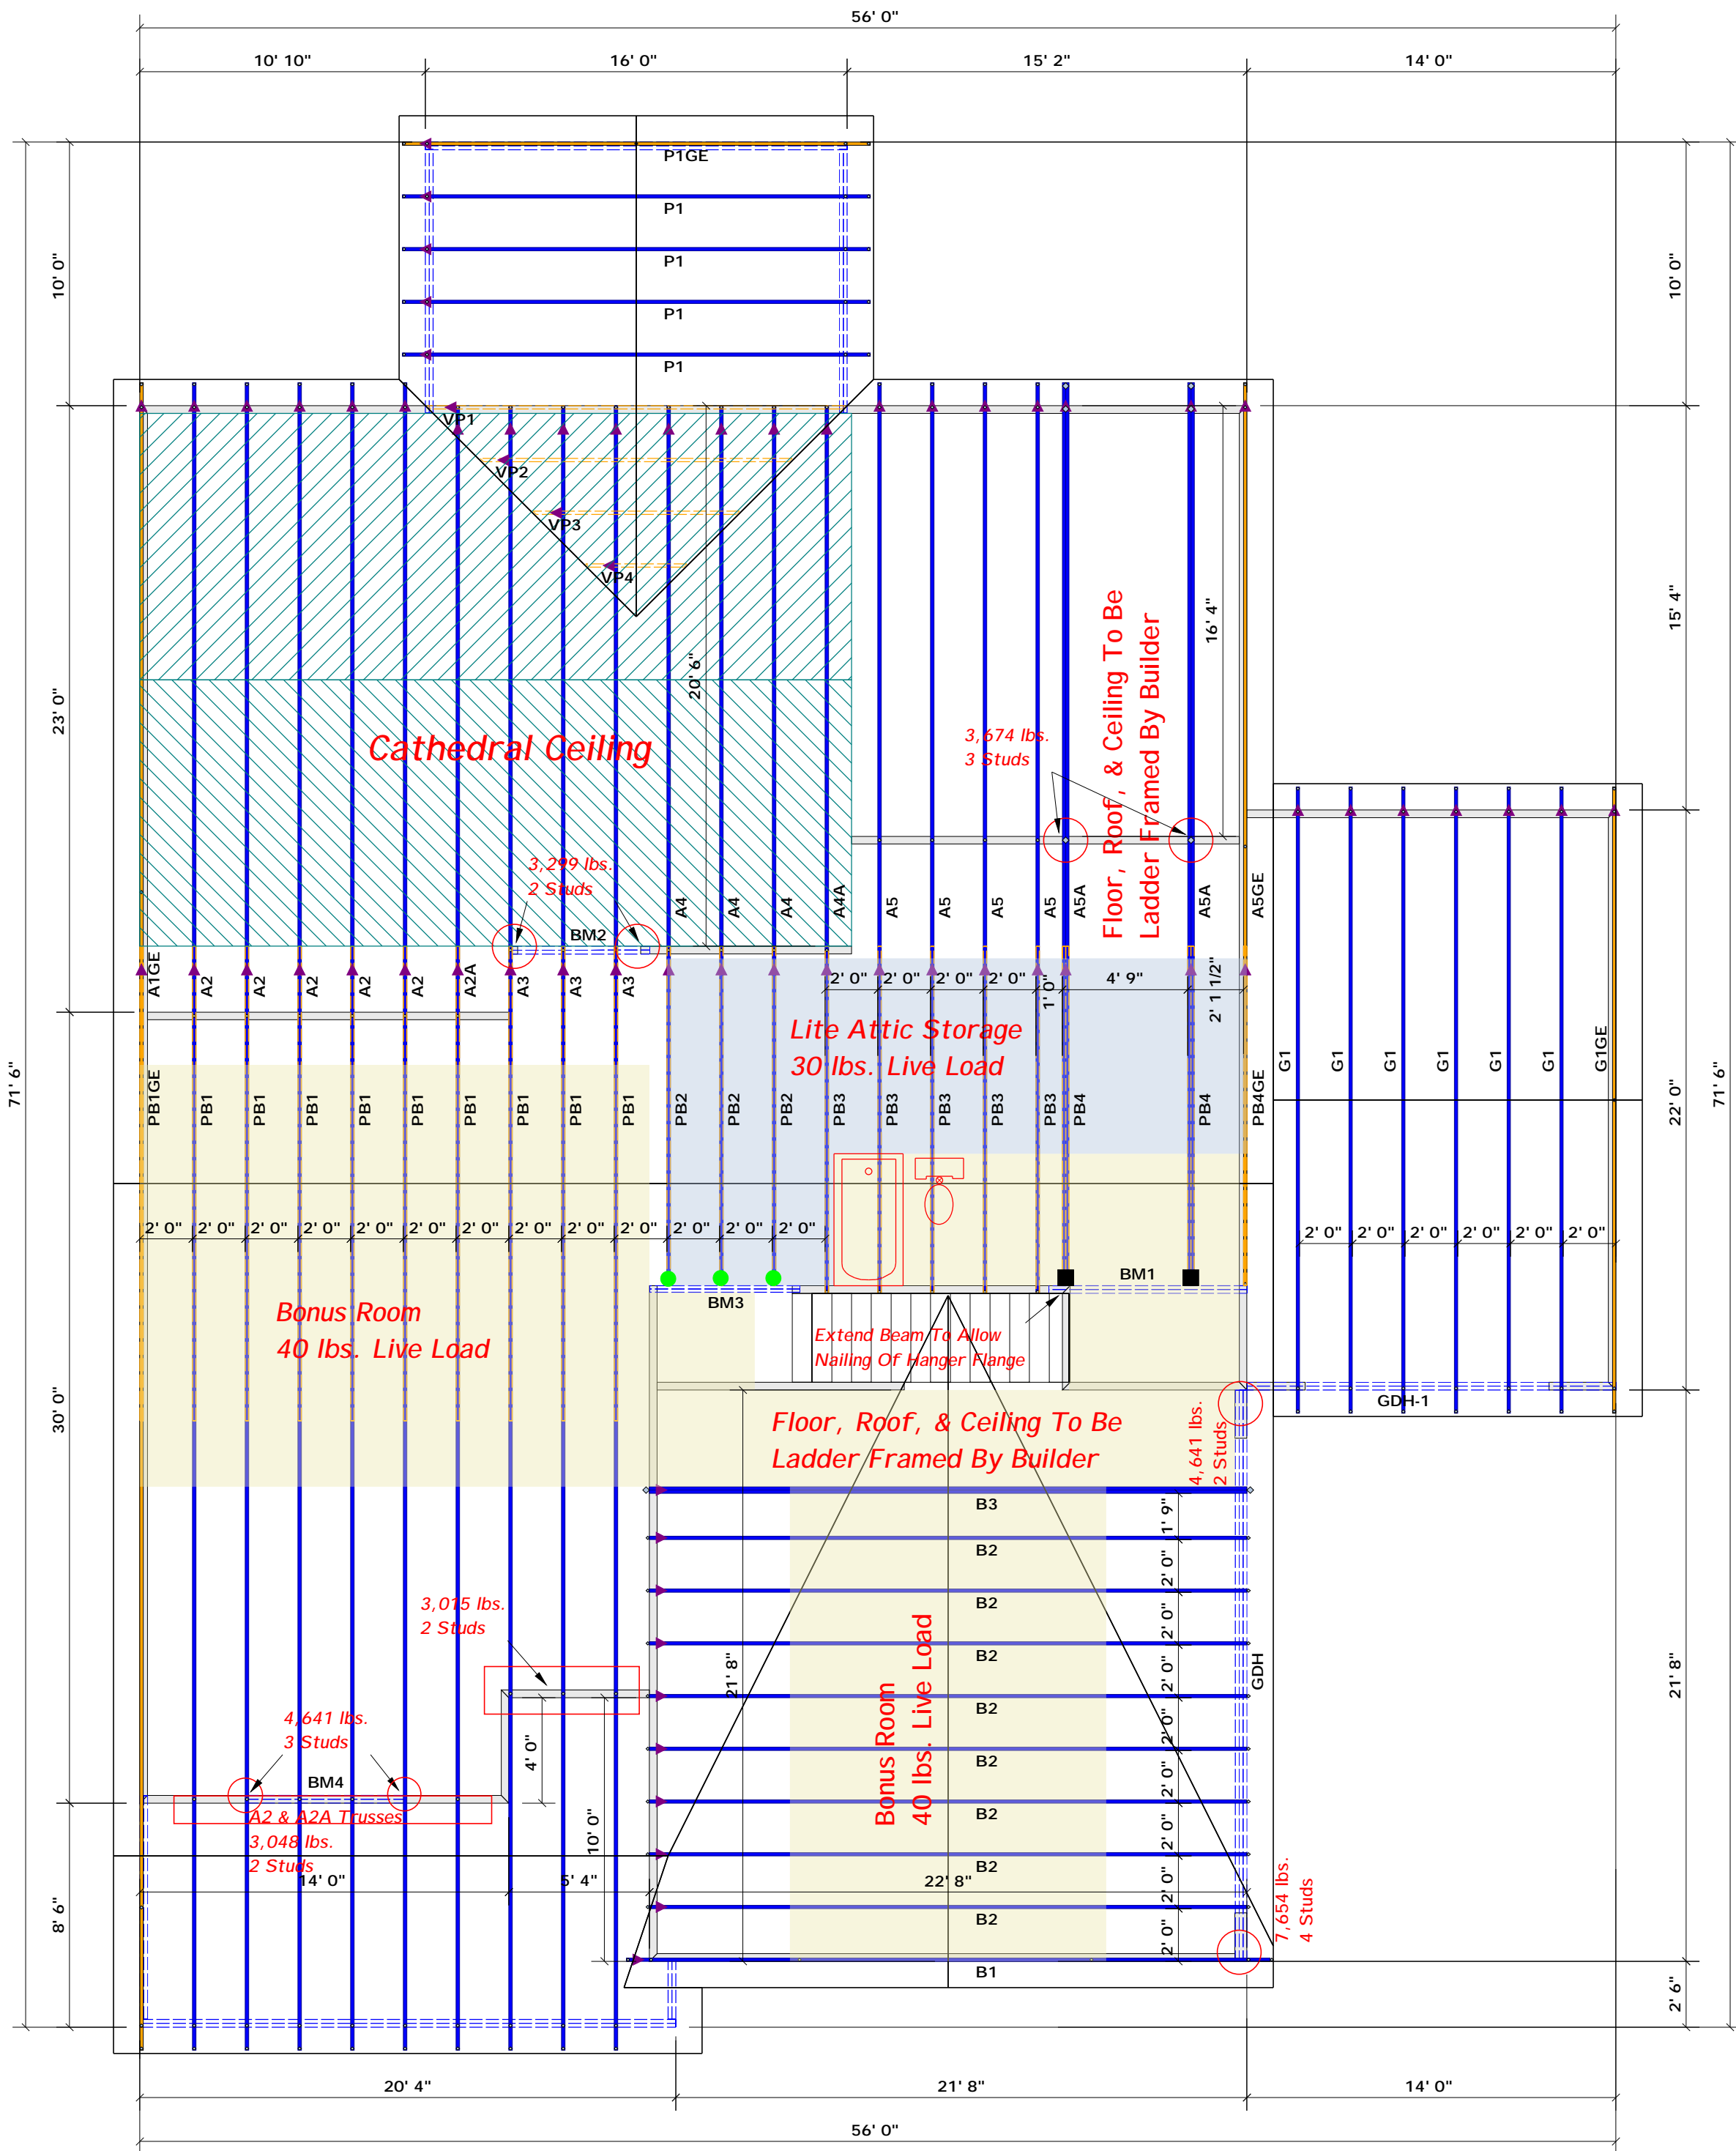

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

-- Denotes Reaction Greater than 3,000 lbs.

▲ = Denotes Left End of Truss (Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

Truss Placement Plan
SCALE: 3/16" = 1'

HANGER LEGEND

■	= USP THD28-2 / Double 2x Hanger
●	= USP HUS26 / Single 2x Hanger

Beam Legend

PlotID	Length	Product	Plies	Net Qty
BM1	8' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM4	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM2	6' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH-1	14' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2
GDH	22' 0"	1-3/4"x 18" LVL Kerto-S	3	3
BM3	6' 0"	2x10 SPF No.2	2	2

LOAD CHART FOR JACK STUDS

MEMBER	SPACING	LOAD	MEMBER	SPACING	LOAD
1700	1	2550	1	3400	
3400	2	5100	2	6500	
5100	3	7650	3	10500	
6800	4	13200	4	13600	
8500	5	12750	5	17000	
10200	6	15300	6		
11900	7				
13600	8				
15300	9				


BUILDER	Weaver Development	CITY / CO.	Harnett Co. / Harnett
JOB NAME	Lot 5 Atkins Farm	ADDRESS	Lot 5 Atkins Farm
PLAN	The Lauren H / BR / 3 Car / SL	MODEL	Roof
SEAL DATE	2/24/20	DATE REV.	02/24/21
QUOTE #	Quote #	DRAWN BY	Curtis Quick
JOB #	J0221-0761	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature Curtis Quick
Curtis Quick

comtech
ROOF & FLOOR TRUSSES & BEAMS
Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

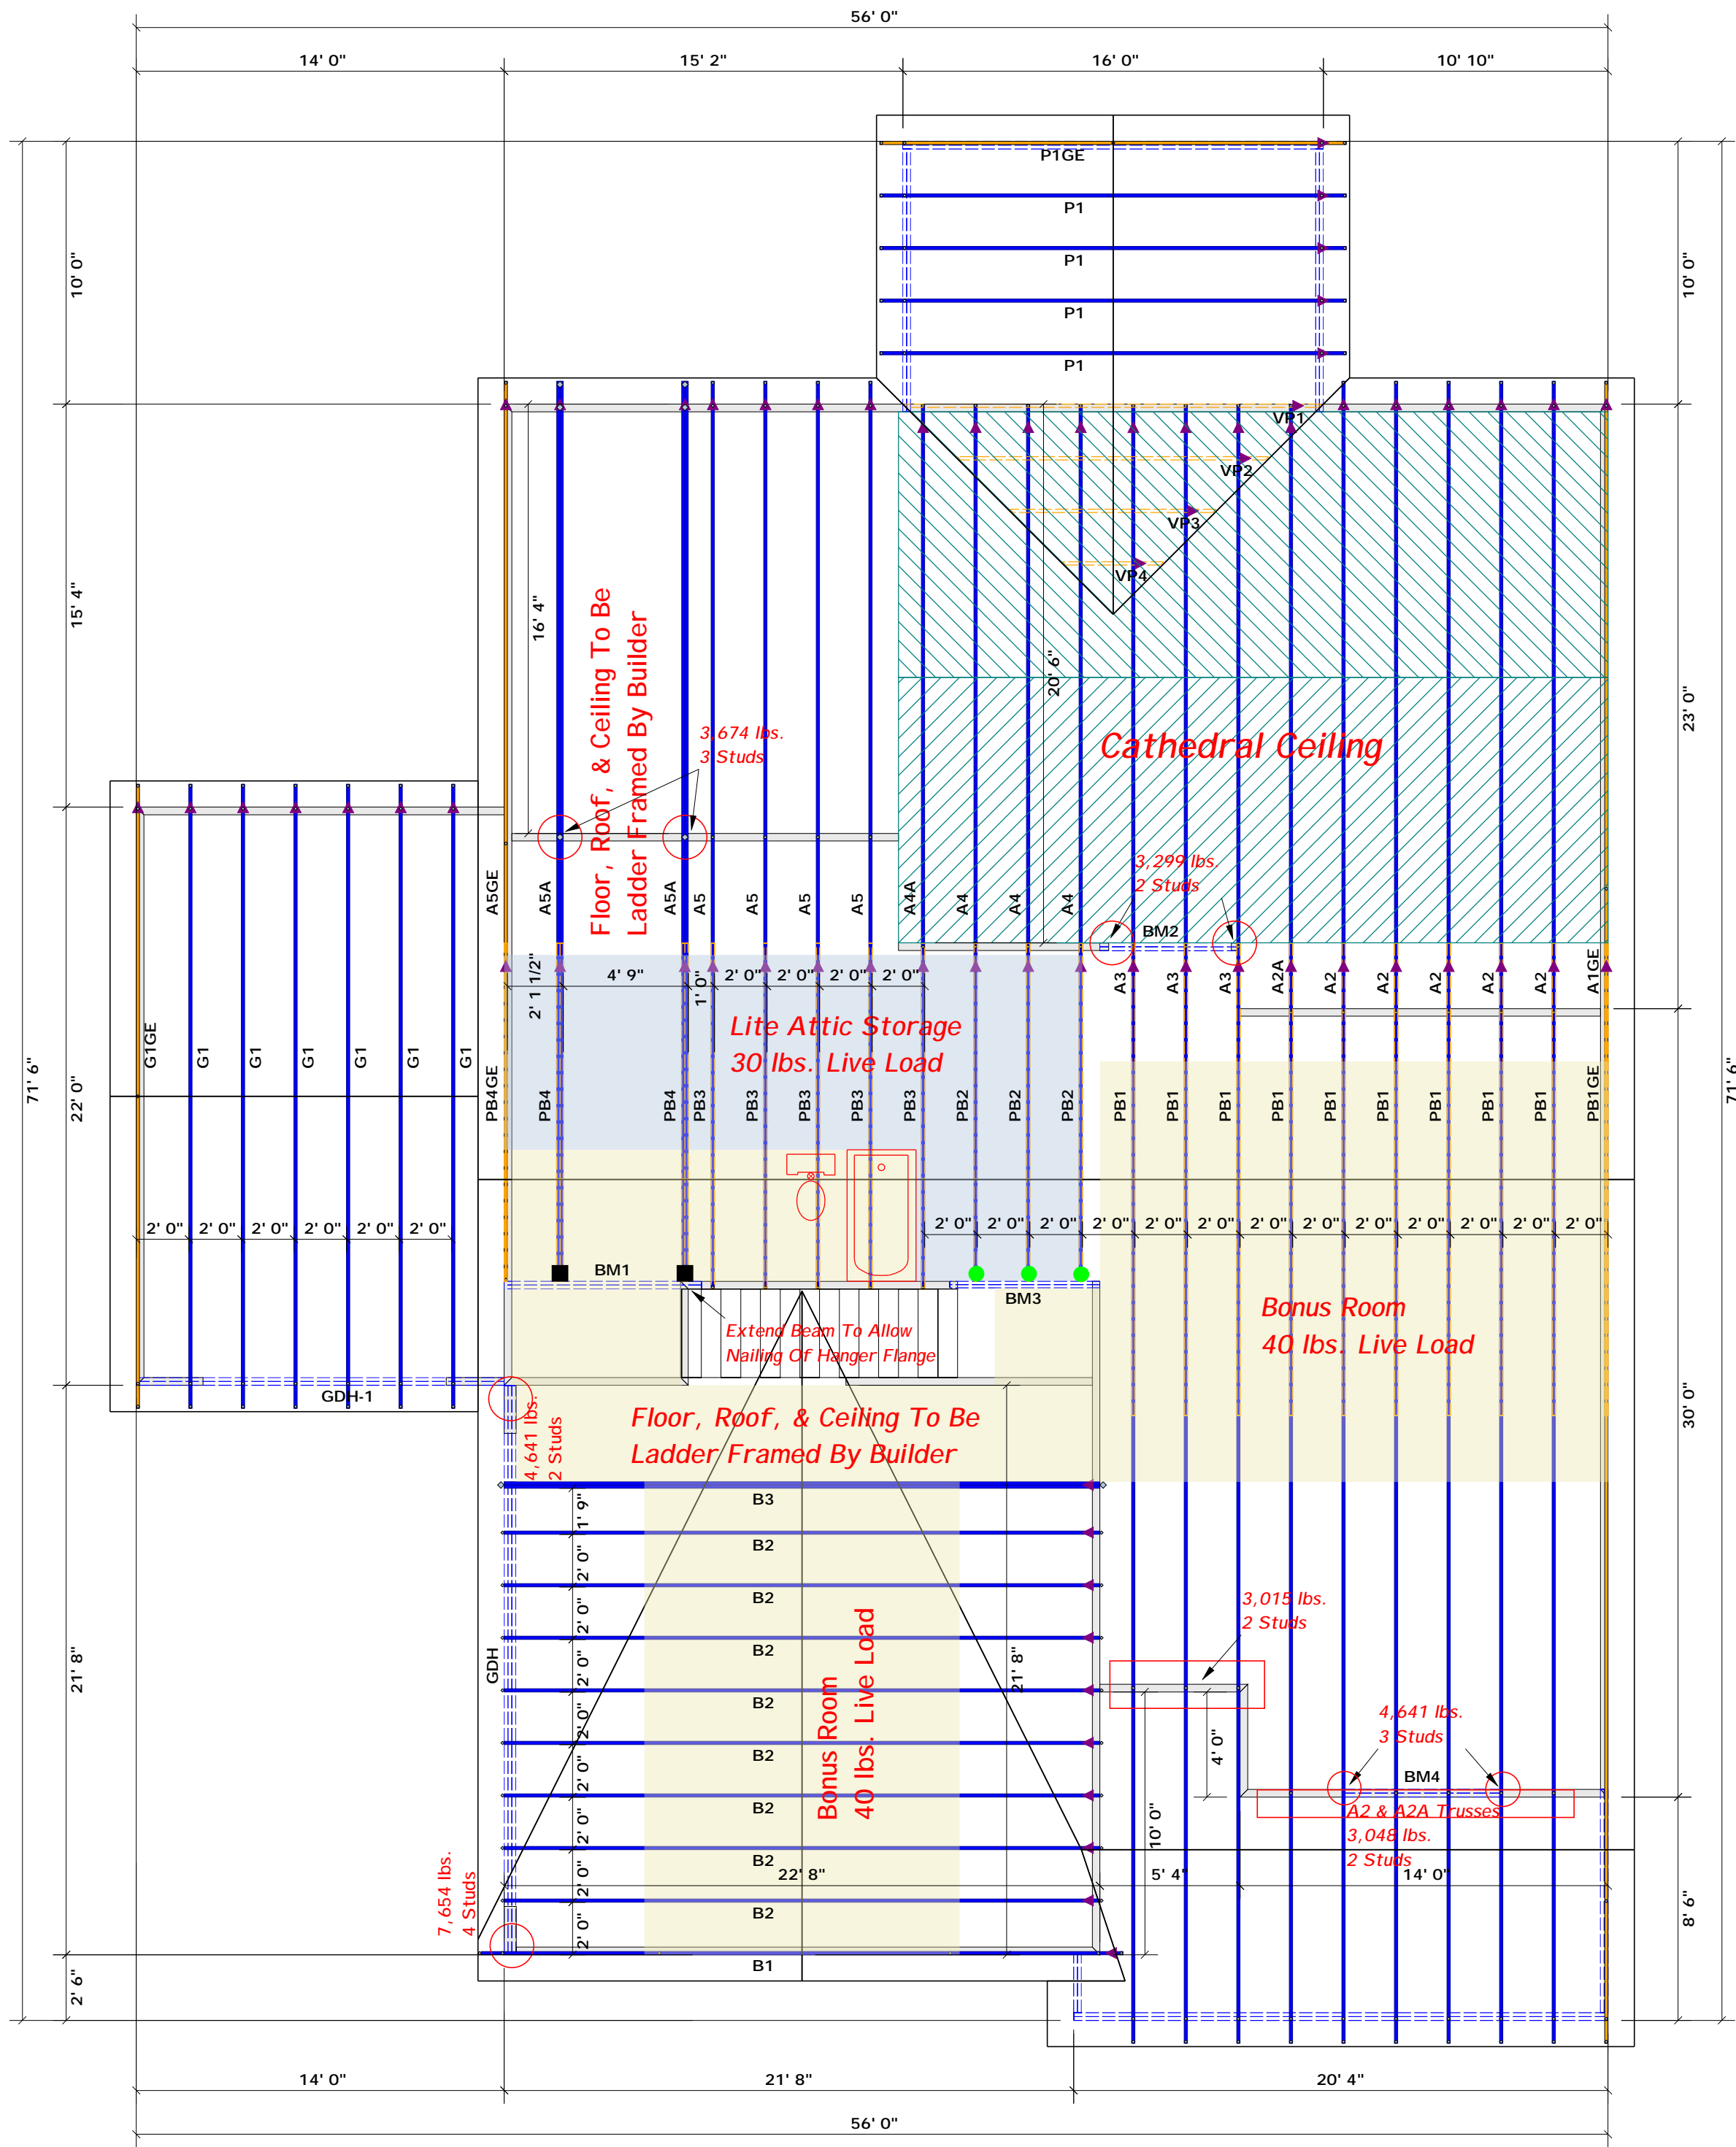

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

-- Denotes Reaction Greater than 3,000 lbs.

▲ = Denotes Left End of Truss (Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

Truss Placement Plan
SCALE: 3/16" = 1'

HANGER LEGEND

■	= USP THD28-2 / Double 2x Hanger
●	= USP HUS26 / Single 2x Hanger

Beam Legend

PlotID	Length	Product	Plies	Net Qty
BM1	8' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM4	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM2	6' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH-1	14' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2
GDH	22' 0"	1-3/4"x 18" LVL Kerto-S	3	3
BM3	6' 0"	2x10 SPF No.2	2	2

LOAD CHART FOR JACK STUDS

INT. SPACING (ft)	REACT. (lb)	REACT. (lb)	INT. SPACING (ft)	REACT. (lb)
1700	1	2550	1	3400
3400	2	5100	2	6800
5100	3	7650	3	10200
6800	4	10200	4	13600
8500	5	12750	5	17000
10200	6	15300	6	
11900	7			
13600	8			
15300	9			




BUILDER	Weaver Development	CITY / CO.	Harnett Co. / Harnett
JOB NAME	Lot 5 Atkins Farm	ADDRESS	Lot 5 Atkins Farm
PLAN	The Lauren H / BR / 3 Car / SL	MODEL	Roof
SEAL DATE	2/24/20	DATE REV.	02/24/21
QUOTE #	Quote #	DRAWN BY	Curtis Quick
JOB #	J0221-0761	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Curtis Quick
Curtis Quick

ROOF & FLOOR TRUSSES & BEAMS
Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

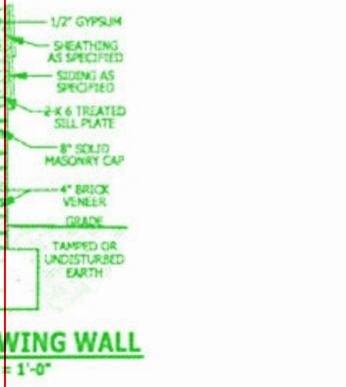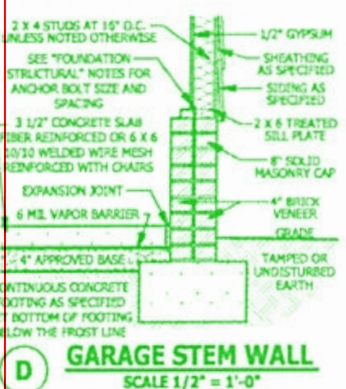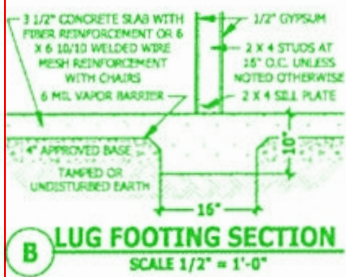

STRUCTURAL
 2 to 2 1/2 story)
 side and 8" thick minimum. 20" wide
 extended 2" to either side of supported wall.
 as noted otherwise.
 solid masonry cap on 30" X 30" X 10"
 per height of 64" with hollow masonry and
 significant point load and should have solid
 ton wall.
 TS: 1/2" diameter anchor bolts embedded
 center, within 12" of plate ends, and
 site.
 diameter anchor bolts embedded minimum
 12" of plate ends, and minimum two
 a minimum 28 day strength of 3000 psi
 trained per table 402.2. All concrete shall be
 All samples for pumping shall be taken
 ure assumed to be 2000 PSF. The
 chical engineer and a structural engineer if
 ns are encountered. The surface area
 shall be provided with adequate drainage,
 surface water away from foundation walls.

LL SLAB PLAN
 SCALE 1/4" = 1'-0"

▲ = Denotes Left End of Truss
 (Reference Engineered Truss Drawing)
 Do Not Erect Trusses Backwards

All Truss Reactions are Less
 than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs.

Truss Placement Plan
 SCALE: 3/16" = 1'

LOAD CHART FOR JACK STUDS
 (BASED ON 4x8x16 SPACING @ 16" ON CENTER)

TRUSS SPACING (ON CENTER)	TRUSS WIDTH (ON CENTER)	MAXIMUM UNIFORM LOAD (PSF)
1700	1	2580
1700	2	1500
1700	3	7650
1700	4	13600
1700	5	12750
1700	6	15500
1700	7	
1700	8	
1700	9	


BUILDER	Weaver Development	CITY / CO.	Harnett Co. / Harnett
JOB NAME	Lot 5 Atkins Farm	ADDRESS	Lot 5 Atkins Farm
PLAN	The Lauren H / BR / 3 Car / SL	MODEL	Roof
SEAL DATE	2/24/20	DATE REV.	02/24/21
QUOTE #	Quote #	DRAWN BY	Curtis Quick
JOB #	J0221-0761	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Curtis Quick
 Curtis Quick

comtech
ROOF & FLOOR TRUSSES & BEAMS
 Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

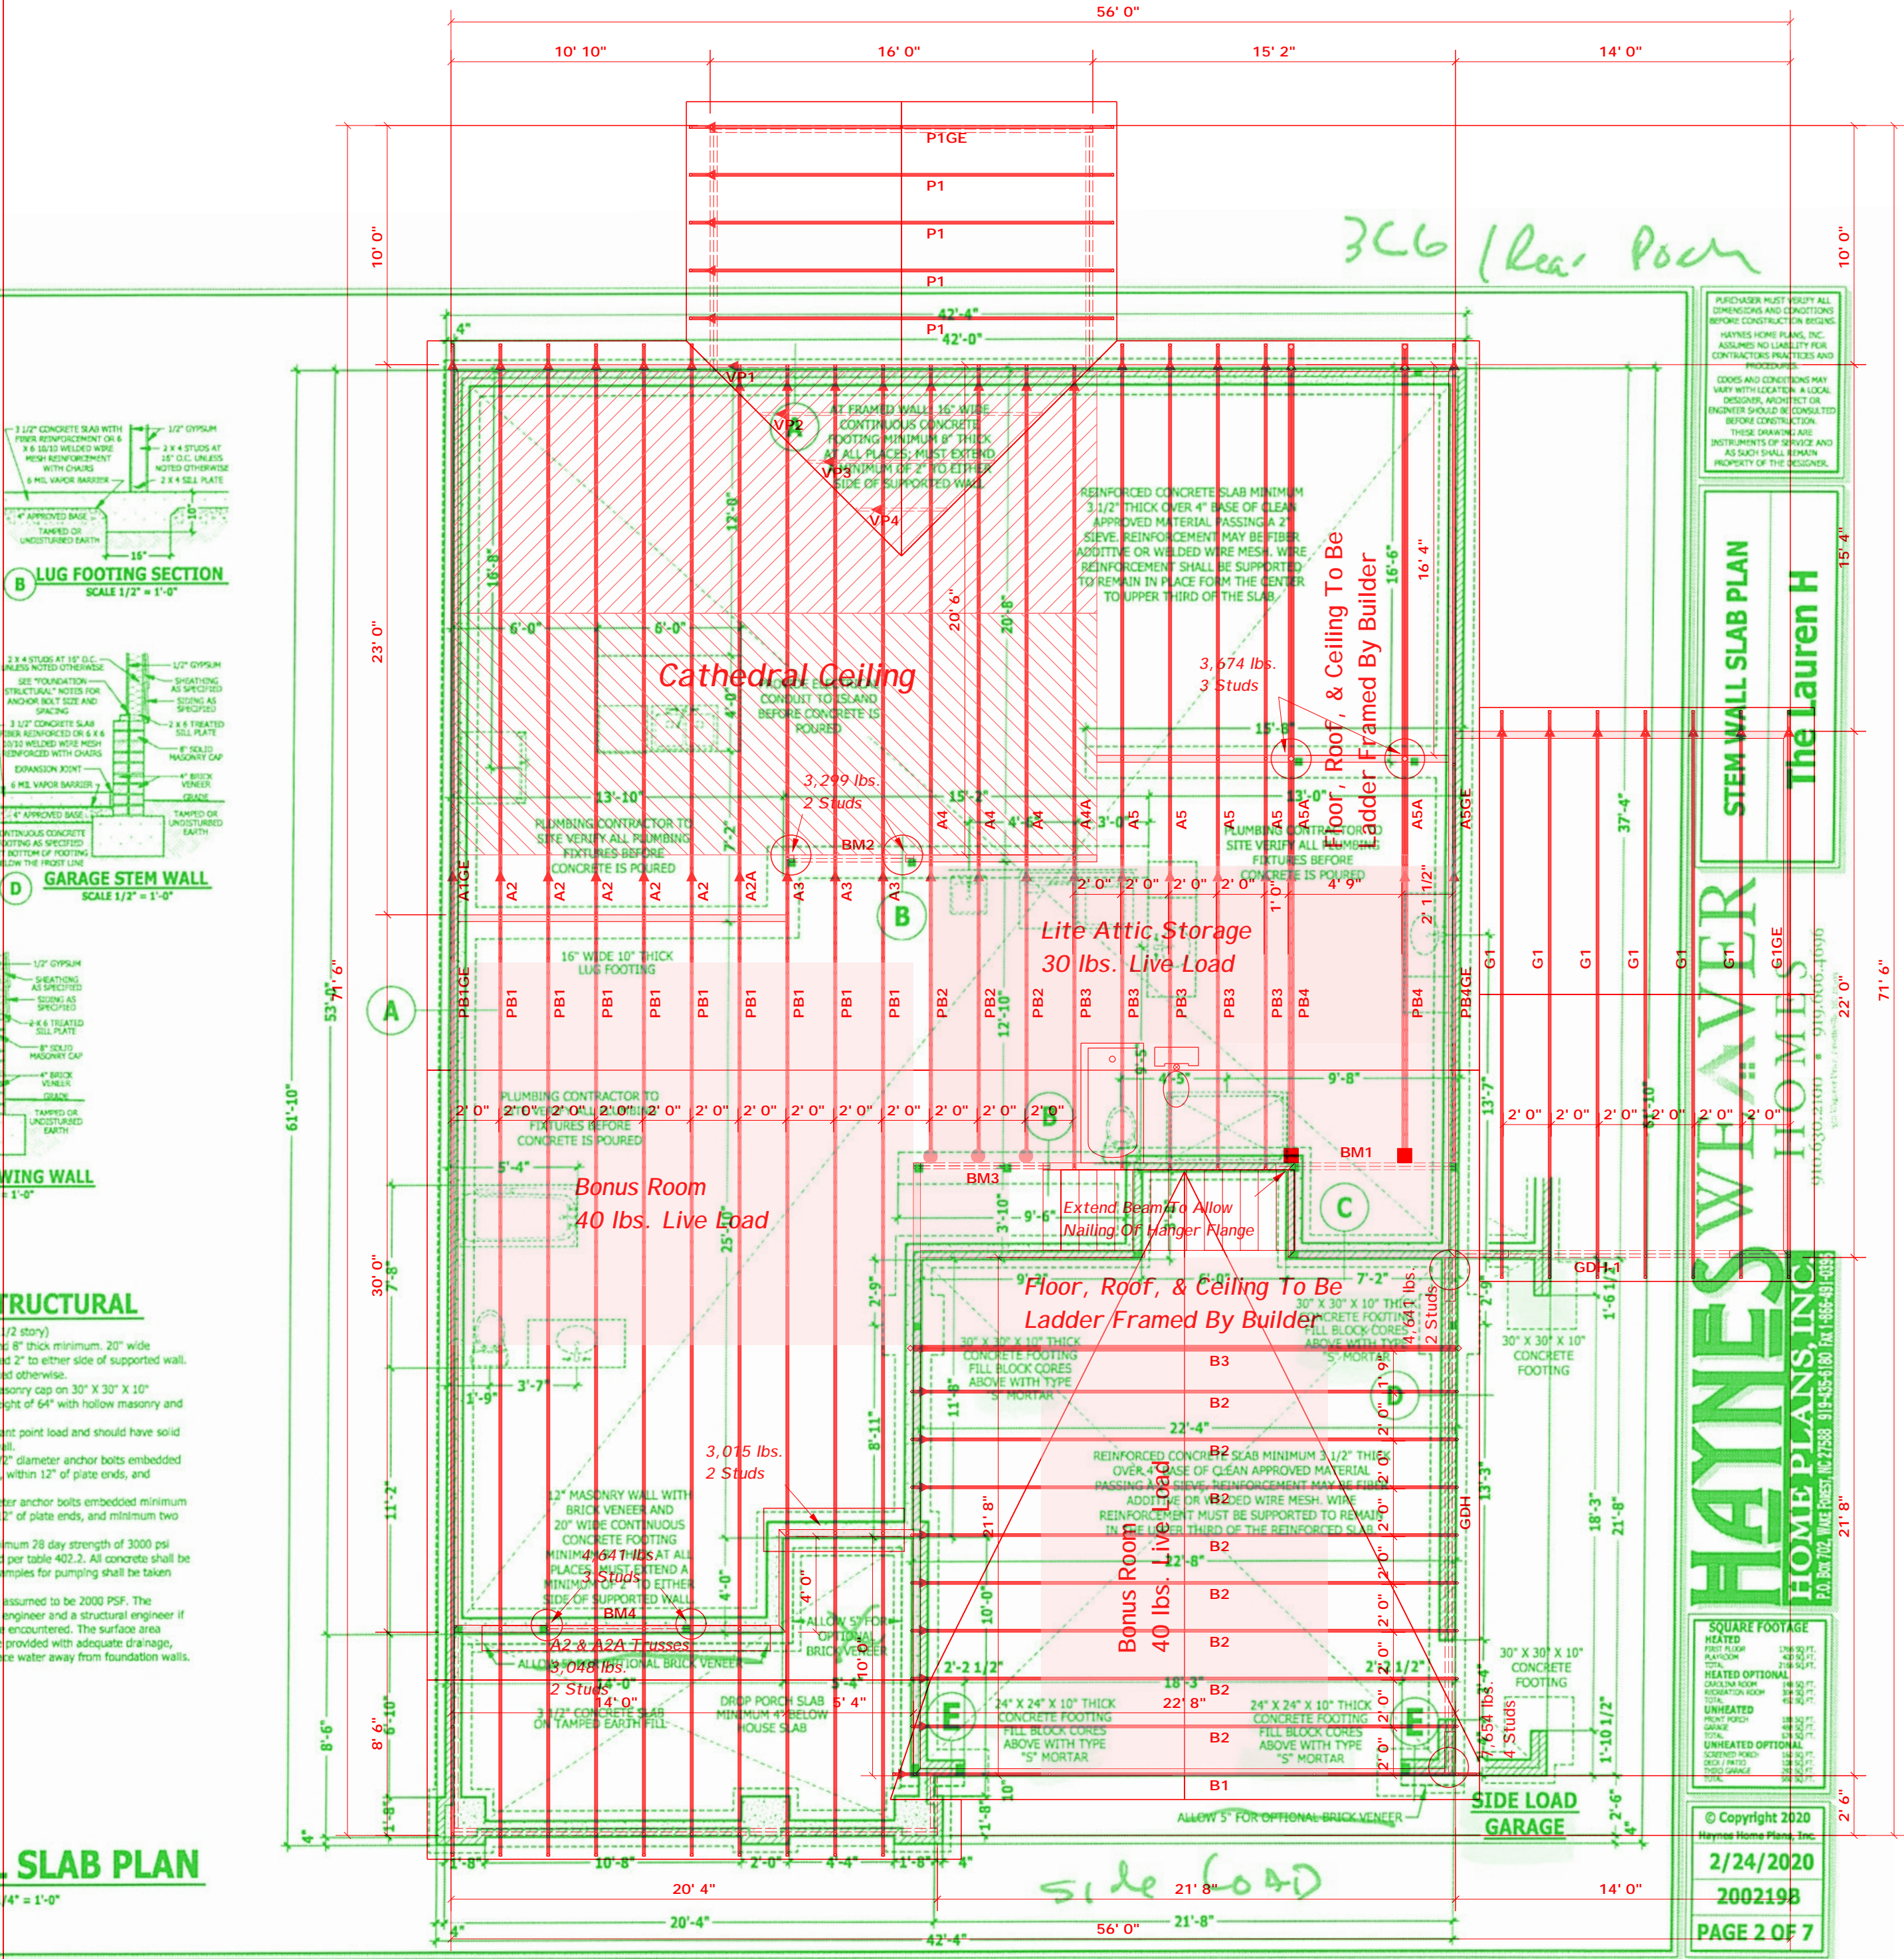

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR PRACTICES AND PROCEDURES.

LOADS AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

STEM WALL SLAB PLAN
The Lauren H

HAYNES WEAVER HOMES
 HOME PLANS, INC.
 9100-2420 HWY 101, SUITE 100
 FAYETTEVILLE, NC 28309
 910-454-1800 FAX 910-454-1805

SQUARE FOOTAGE

HEATED	HEATED OPTIONAL	UNHEATED	UNHEATED OPTIONAL
FIRST FLOOR	CARPORT	SCREENED PORCH	SCREENED PORCH
2ND FLOOR	SCREENED PORCH	SCREENED PORCH	SCREENED PORCH
TOTAL	TOTAL	TOTAL	TOTAL

© Copyright 2020
 Haynes Home Plans, Inc.
 2/24/2020
 2002198
 PAGE 2 OF 7

HANGER LEGEND

■	= USP THD28-2 / Double 2x Hanger
●	= USP HUS26 / Single 2x Hanger

Beam Legend

PlotID	Length	Product	Plies	Net Qty
BM1	8' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM4	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM2	6' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH-1	14' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2
GDH	22' 0"	1-3/4"x 18" LVL Kerto-S	3	3
BM3	6' 0"	2x10 SPF No.2	2	2