

# FRR-000-015

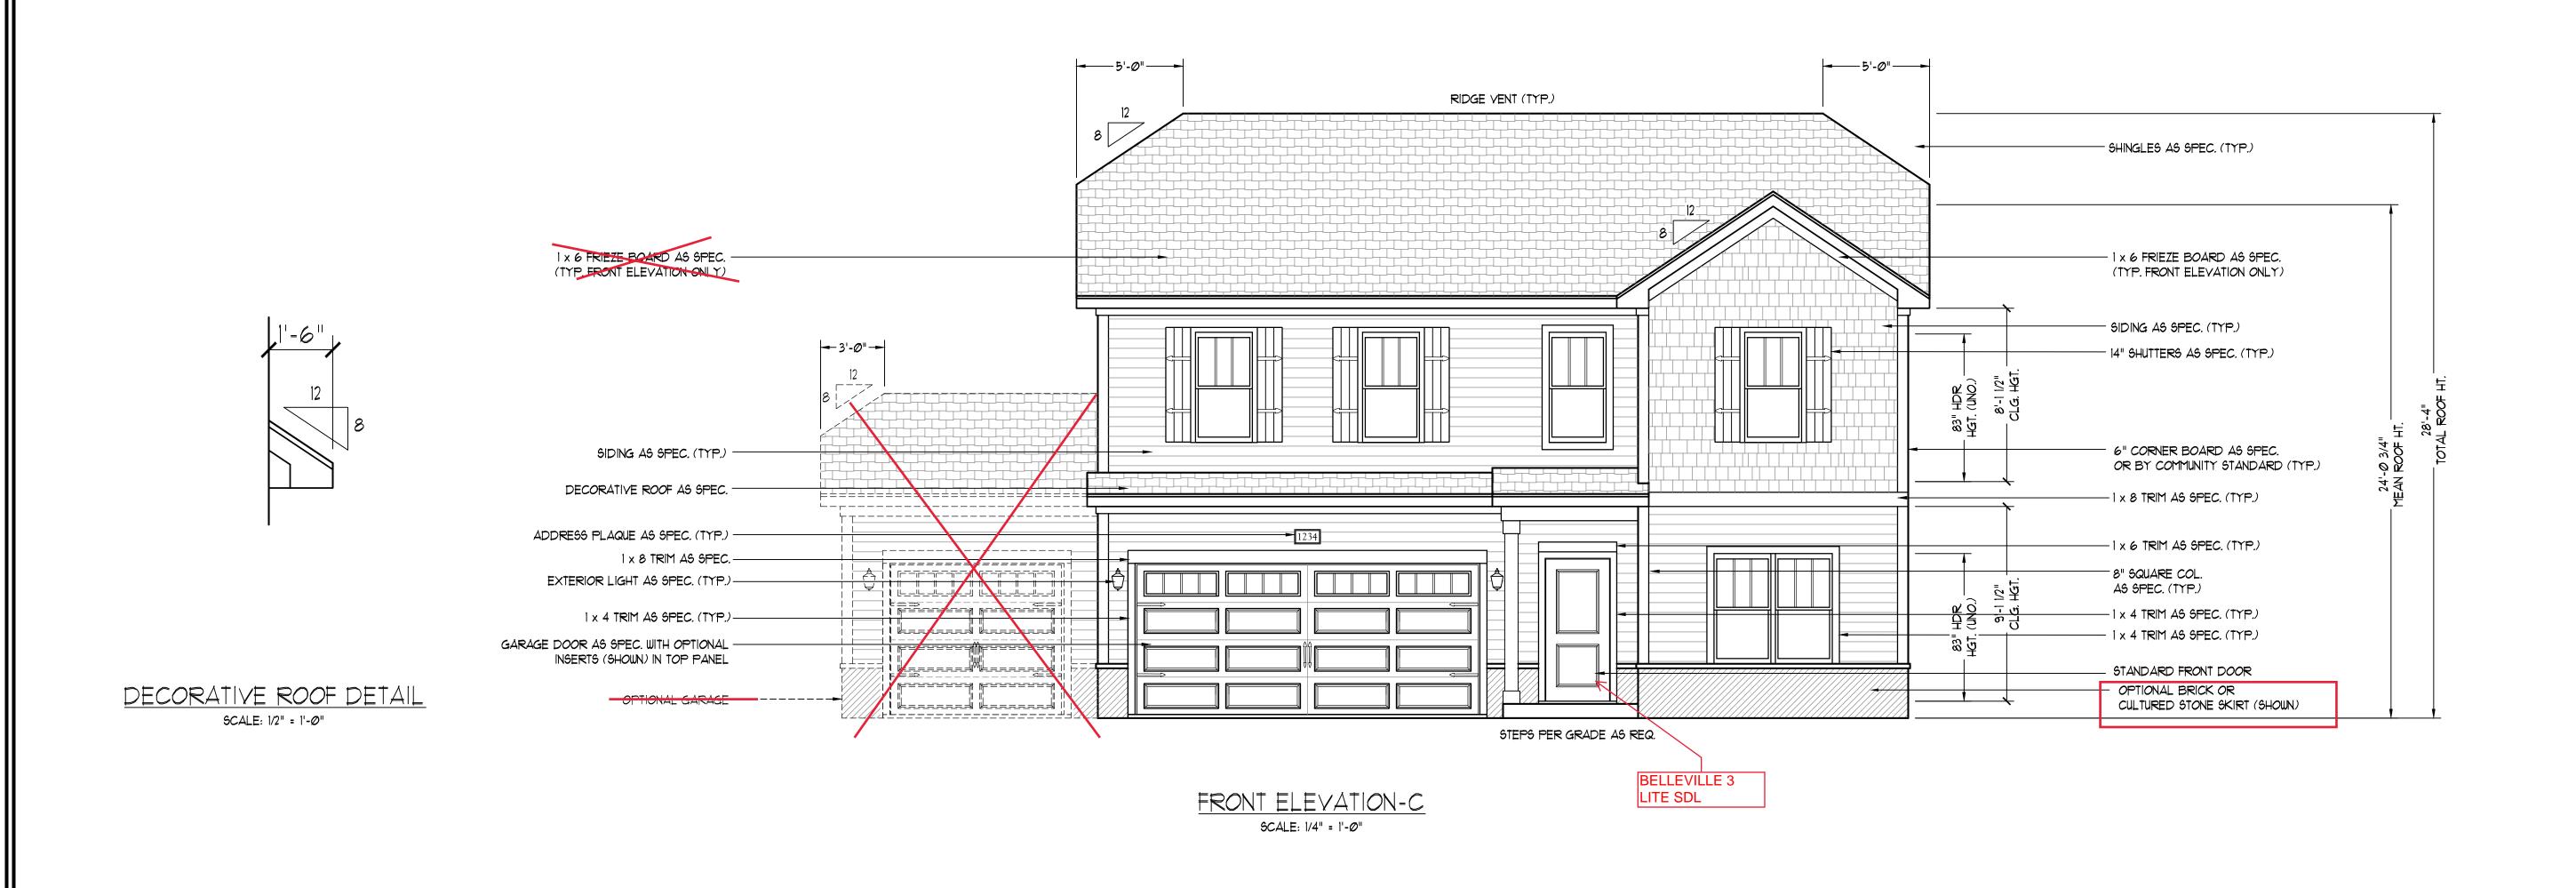



RENAISSANCE

RESIDENTIAL DESIGN, INC. RALEIGH, NC (919) 649-4128 WWW.RRDCAROLINA.COM "The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC. RESERVES THE RIGHT TO MAKE MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE.


THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY. RENAISSANCE RESIDENTIAL DESIGN, INC.

HEREBY EXPRESSLY RESERVES ITS

COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE

THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT. J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104

RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 S.C. CERTIFICATE NO.: 4679



A&G RESIDENTIAL GREENVILLE DRIVE LEFT

DATE: OCTOBER 15, 2020

SCALE: AS NOTED


DRAWN BY: WG ENGINEERED BY: WFB

REVIEWED BY: MGS

C - ELEVATIONS


A-3

RIGHT ELEVATION SCALE: 1/8" = 1'-0"

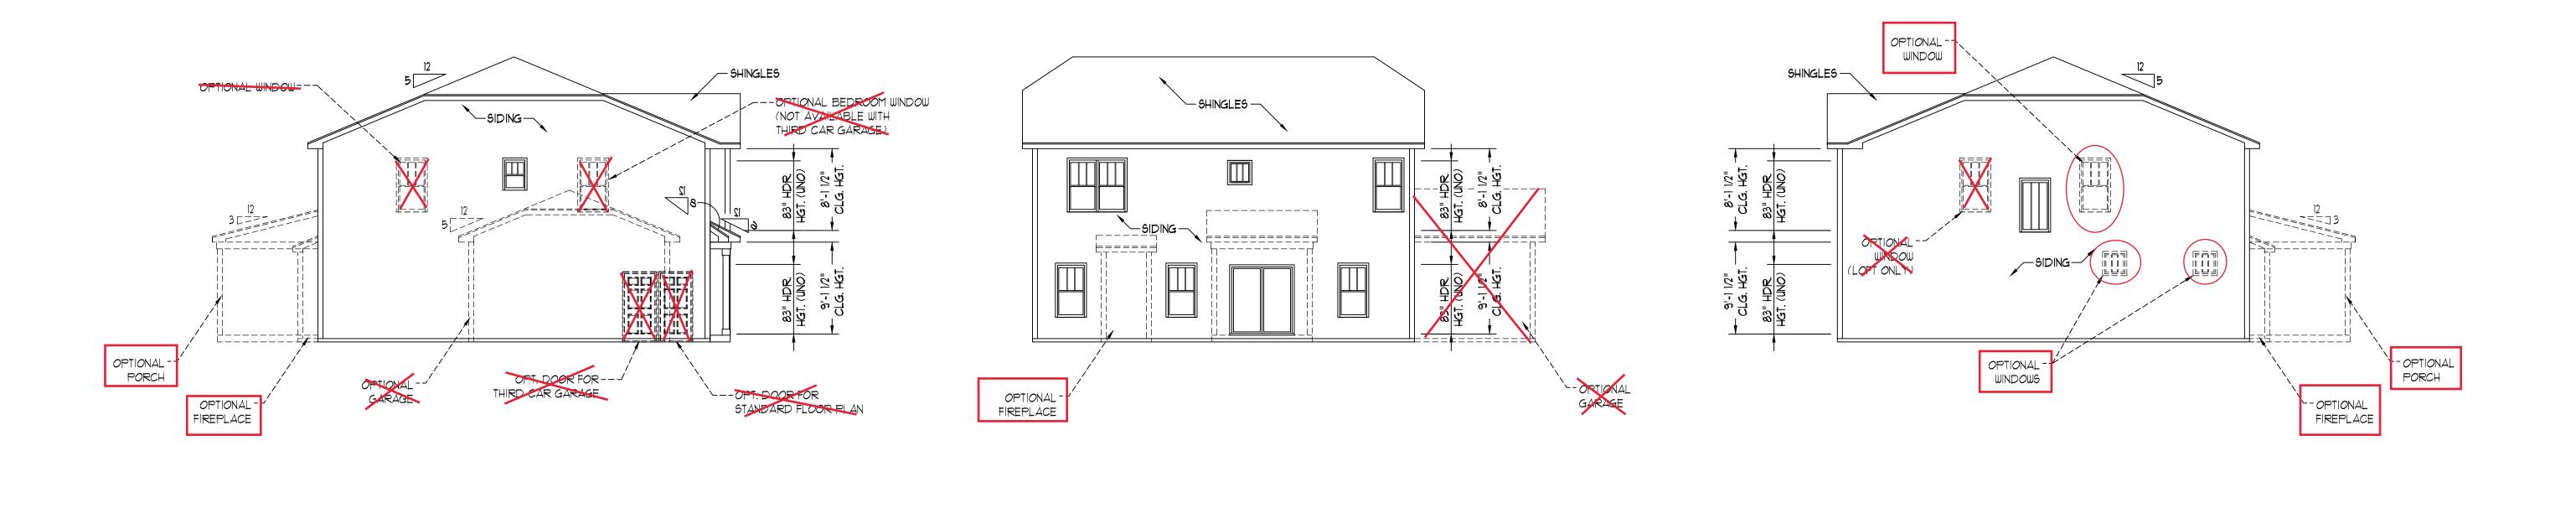

REAR ELEVATION SCALE: 1/8" = 1'-0"

<u>LEFT ELEVATION</u> SCALE: 1/8" = 1'-0"

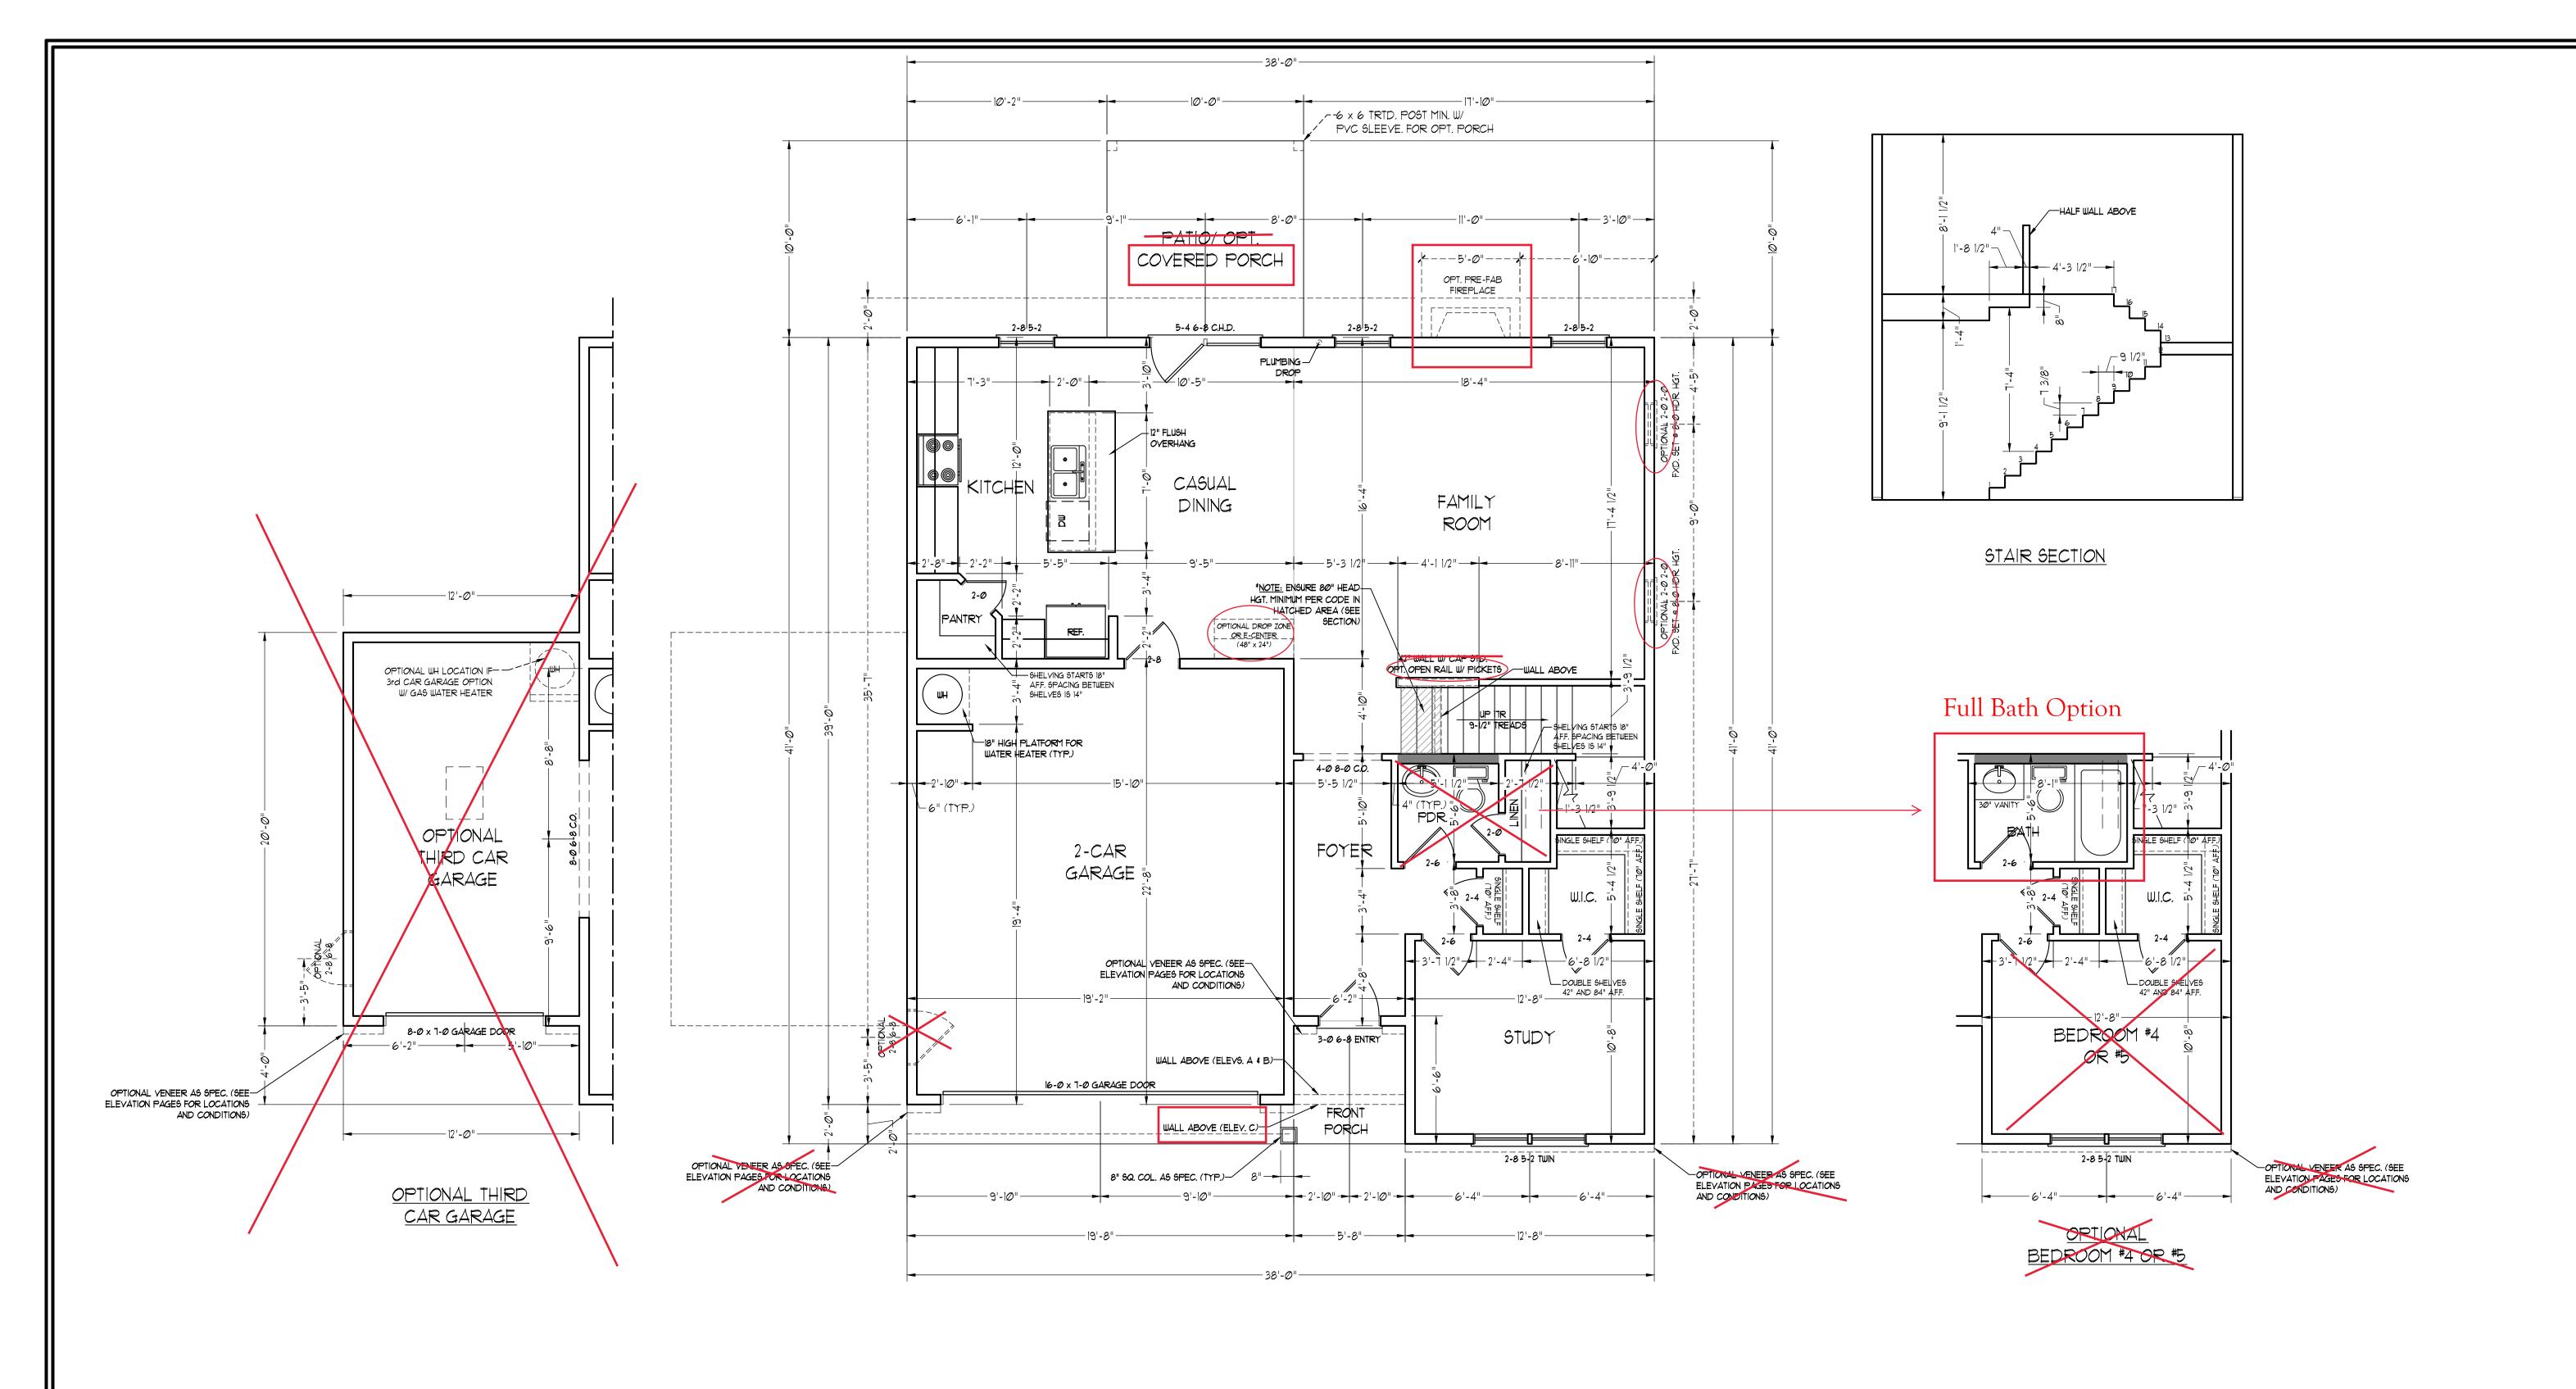

<u>SQUARE FOOTAGE (STANDARD)</u>

1st FLOOR: 2nd FLOOR: TOTAL: GARAGE: FRONT PORCH:

1058 SQ. FT. 1507 SQ. FT. 2565 SQ. FT. 427 SQ. FT. 35 SQ. FT. 100 SQ. FT. 24Ø SQ. FT. OPT. 3rd CAR GARAGE:

ENGINEERED BY: WFB REVIEWED BY: MGS

> FIRST FLOOR PLAN

A&G RESIDENTIAL GREENVILLE DRIVE LEFT

DATE: OCTOBER 15, 2020

SCALE: 1/4"=1'-0"

DRAWN BY: WG

RENAISSANCE

RESIDENTIAL DESIGN, INC.

RALEIGH, NC (919) 649-4128

WWW.RRDCAROLINA.COM "The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC. RESERVES THE RIGHT TO MAKE MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND

SPECIFICATIONS WITHOUT NOTICE. THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY. RENAISSANCE RESIDENTIAL DESIGN, INC.

HERBY EXPRESSLY RESERVES ITS
COMMON LAW COPYRIGHT AND OTHER
PROPERTY RIGHTS IN THESE PLANS.
THESE PLANS AND DRAWINGS ARE NOT
TO BE REPRODUCED, CHANGED, OR

COPIED IN ANY FORM OR MANNER
WITHOUT FIRST OBTAINING THE EXPRESS
WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE

THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104

RALEIGH, NC 27605 PHONE: (919) 789-9919

FAX: (919) 789-9921


S.C. CERTIFICATE NO.: 4679


A-4

\*NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 6 @ 16" O.C. (UNO). ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

2x6 WALL

\* SHADED INTERIOR WALLS ARE TO BE 2 x 6 @ 16" O.C. (LOAD BEARING) OR 2 x 6 @ 24" O.C. (NON-LOAD BEARING)

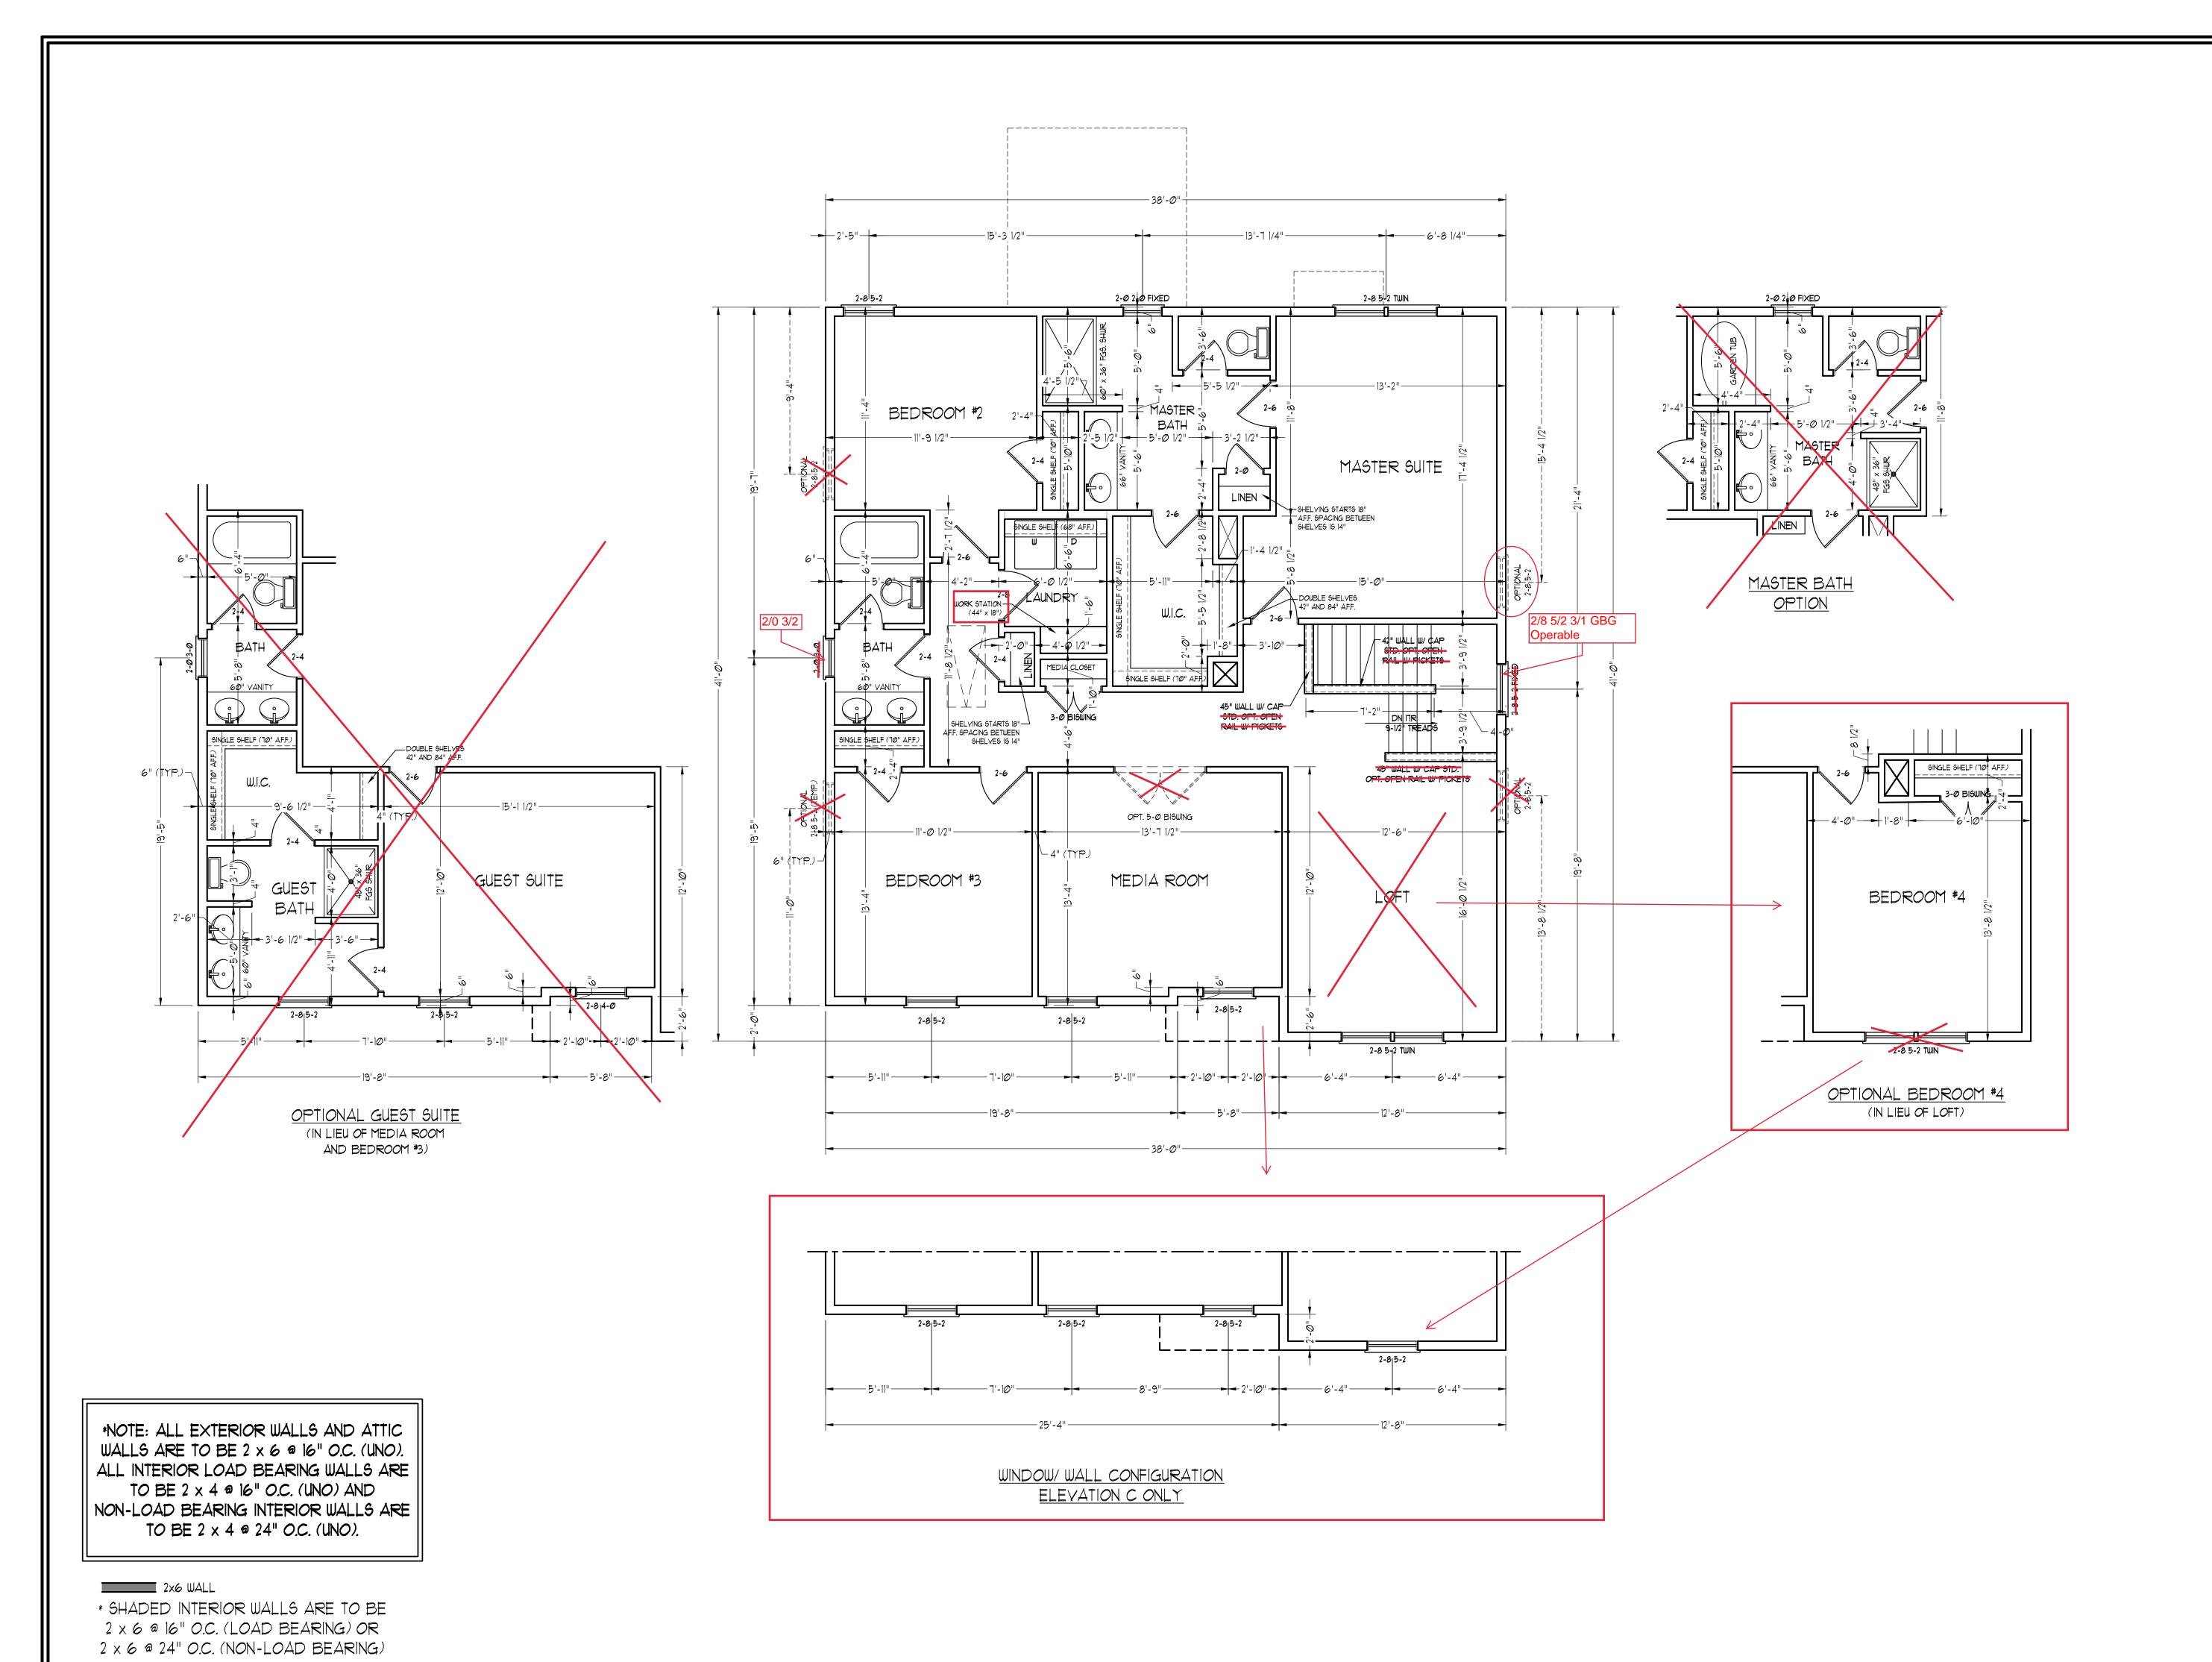



# RENAISSANCE

RESIDENTIAL DESIGN, INC.
RALEIGH, NC (919) 649-4128
WWW.RRDCAROLINA.COM
"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE
PURPOSE OF CONVEYING AN

ARCHITECTURAL CONCEPT ONLY.


RENAISSANCE RESIDENTIAL DESIGN, INC
HEREBY EXPRESSLY RESERVES ITS

COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS.
THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE

RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921

S.C. CERTIFICATE NO.: 4679



PRICES, PHOMO I IONS, INCENTIVES, FEATURES, OPTIONS, FLOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. UARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY BY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ON LOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT AN. FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED ROPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION, OR DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW HOME SALES CONSULTANT FOR

A&G RESIDENTIAL GREENVILLE

DATE: OCTOBER 15, 2020

KEV.:

SCALE: 1/4"=1'-0"

DRAWN BY: WG


ENGINEERED BY: WFB

REVIEWED BY: MGS

SECOND FLOOR PLAN

A-5

C:\Users\Wade\Documents\Projects\A&G\Greenville\Greenville\_GL\_10-15-20.dwg, 11/2/2020 5:34:02 PM

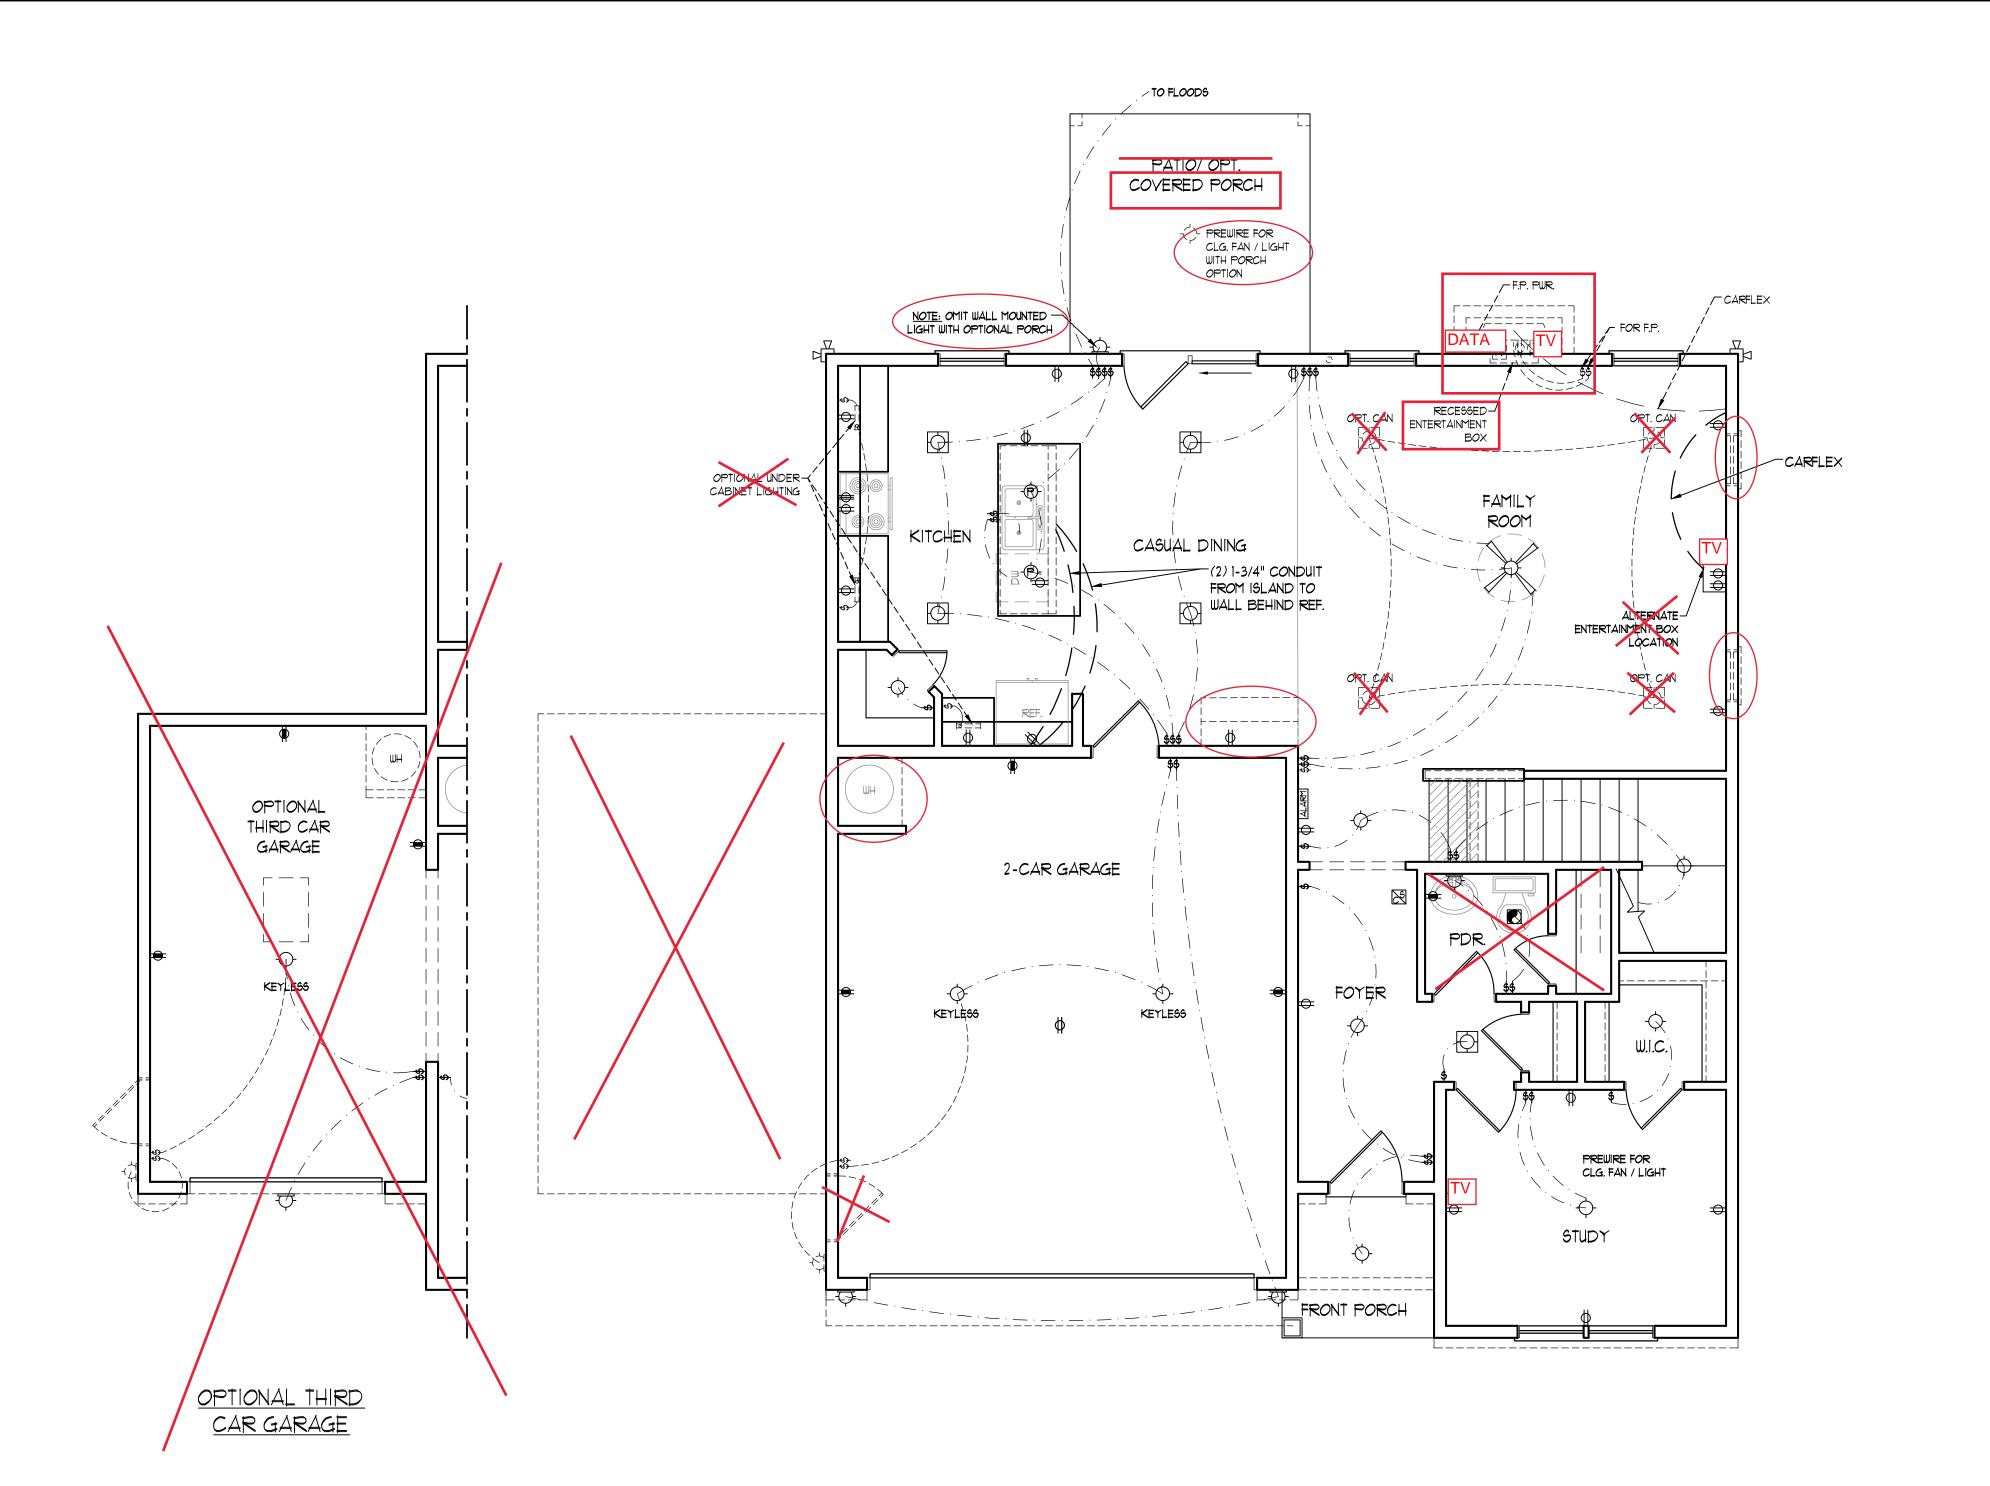



RESIDENTIAL DESIGN, INC. RALEIGH, NC (919) 649-4128 WWW.RRDCAROLINA.COM

"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC. RESERVES THE RIGHT TO MAKE MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE.

THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY. RENAISSANCE RESIDENTIAL DESIGN, INC.

HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE

THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 S.C. CERTIFICATE NO.: 4679



▲ TELEPHONE

 $\triangle$  data

▲ TELEPHONE AND DATA

TV/ DATA

CD- CONDUIT FOR COMPONENT WIRING

MOV SMOKE/ CM DETECTOR

SD 110 V SMOKE DETECTOR


EXHAUST FAN

LOW VOLTAGE PANEL ALARM PANEL





# FULL BATH OPTION

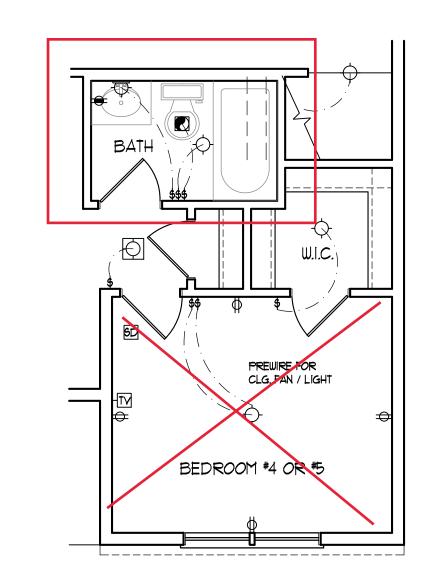



ELECTRICAL LEGEND

ELECTRICAL LAYOUT NOTES:

1.) BLOCK AND WIRE FOR ALL CELING FANS PER PLAN.

2.) VANITY LIGHTS TO BE SET

3.) ADDITIONAL EXTERIOR OUTLETS

4.) PLACE SWITCHES 8" (MIN.) FROM

REQUIRED BY CODE TO BE LOCATED BY ELECTRICIAN.

@ 90" A.F.F. (TYP.)

ROUGH OPENINGS.

→ IIØ Y OUTLET

 ⇒
 IIØ ∨ GFI OUTLET

= 110 V SWITCHED OUTLET BB 👄 110 V BASEBOARD OUTLET

4-PLEX

COUNTER OR FLOOR MOUNTED

COUNTER OR FLOOR MOUNTED 110V GF1

₩EATHERPROOF **⇒** 22*0* ∨ *O*UTLET

Ø 110 V DEDICATED CIRCUIT

# 220 V DEDICATED CIRCUIT

PH SPECIAL PURPOSE (240 V, ETC.) - WALL MOUNT LIGHT

- CEILING MOUNT LIGHT

(P)- PENDANT LIGHT

RECESSED CAN LIGHT

MINI CAN LIGHT

EYEBALL LIGHT FLUORESCENT LIGHT

undercabinet light FLOOD LIGHT

\$ SWITCH

\$D DIMMER SWITCH

TV- TV CONNECTION

SP SPEAKER



DATE: OCTOBER 15, 2020

REV.:


SCALE: 1/4"=1'-0" DRAWN BY: WG

ENGINEERED BY: WFB


REVIEWED BY: MGS

FIRST FLOOR ELECTRICAL PLAN

 $\label{lem:c:wadelde} C:\Users\Wade\Documents\Projects\A\&G\Greenville\Greenville\_GL\_10-15-20.dwg,\ 11/2/2020\ 5:34:03\ PM$ 

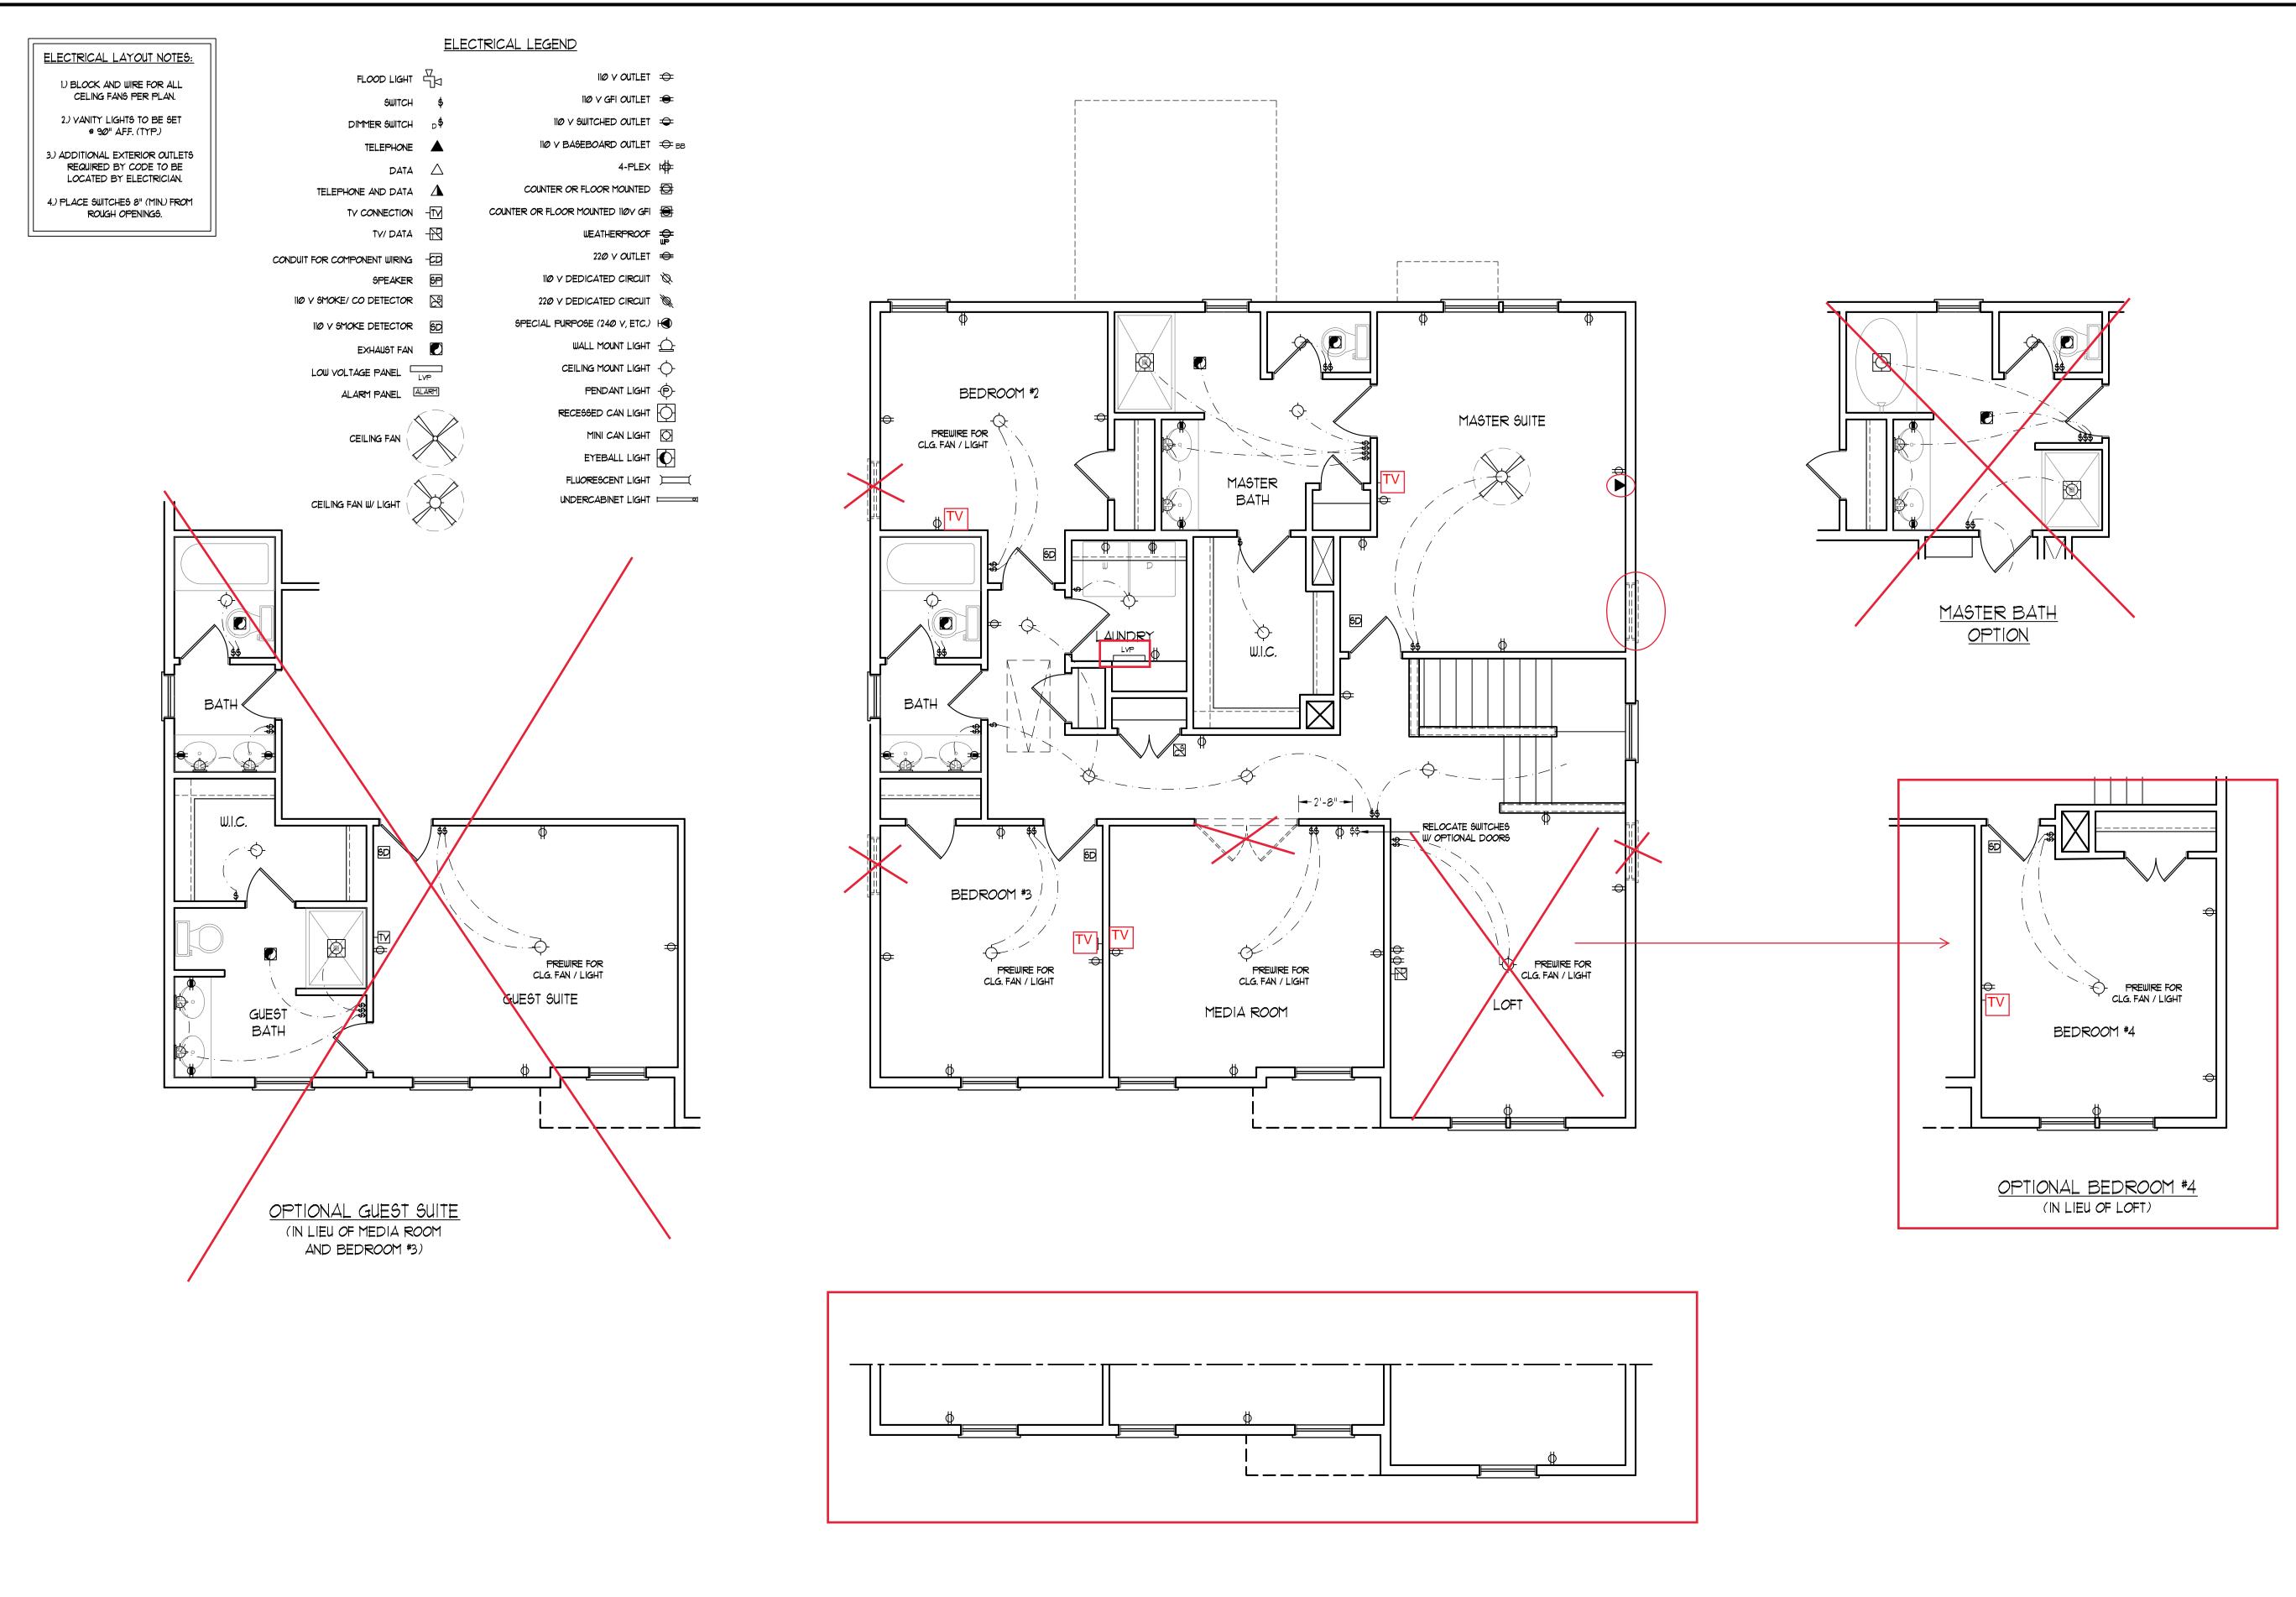

WINDOW CONFIGURATION ELEVATION C ONLY



RENAISSANCE

RESIDENTIAL DESIGN, INC.
RALEIGH, NC (919) 649-4128
WWW.RRDCAROLINA.COM
"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.


THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS.

THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921

S.C. CERTIFICATE NO.: 4679



PRICES, PROMOTIONS, INCENTIVES, FEATURES, OPTIONS, FLOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. SQUARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY VARY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ON LOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT PLAN. FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED PROPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION, OR DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW HOME SALES CONSULTANT FOR AUGUST AND ADAPTATION.

A&G RESIDENTIAL GREENVILLE

DATE: OCTOBER 15, 2020

REV.:

SCALE: 1/4"=1'-0"

DRAWN BY: WG

ENGINEERED BY: WFB


REVIEWED BY: MGS

SECOND FLOOR ELECTRICAL

E-2

PLAN

C:\Users\Wade\Documents\Projects\A&G\Greenville\Greenville\_GL\_10-15-20.dwg, 11/2/2020 5:34:04 PM

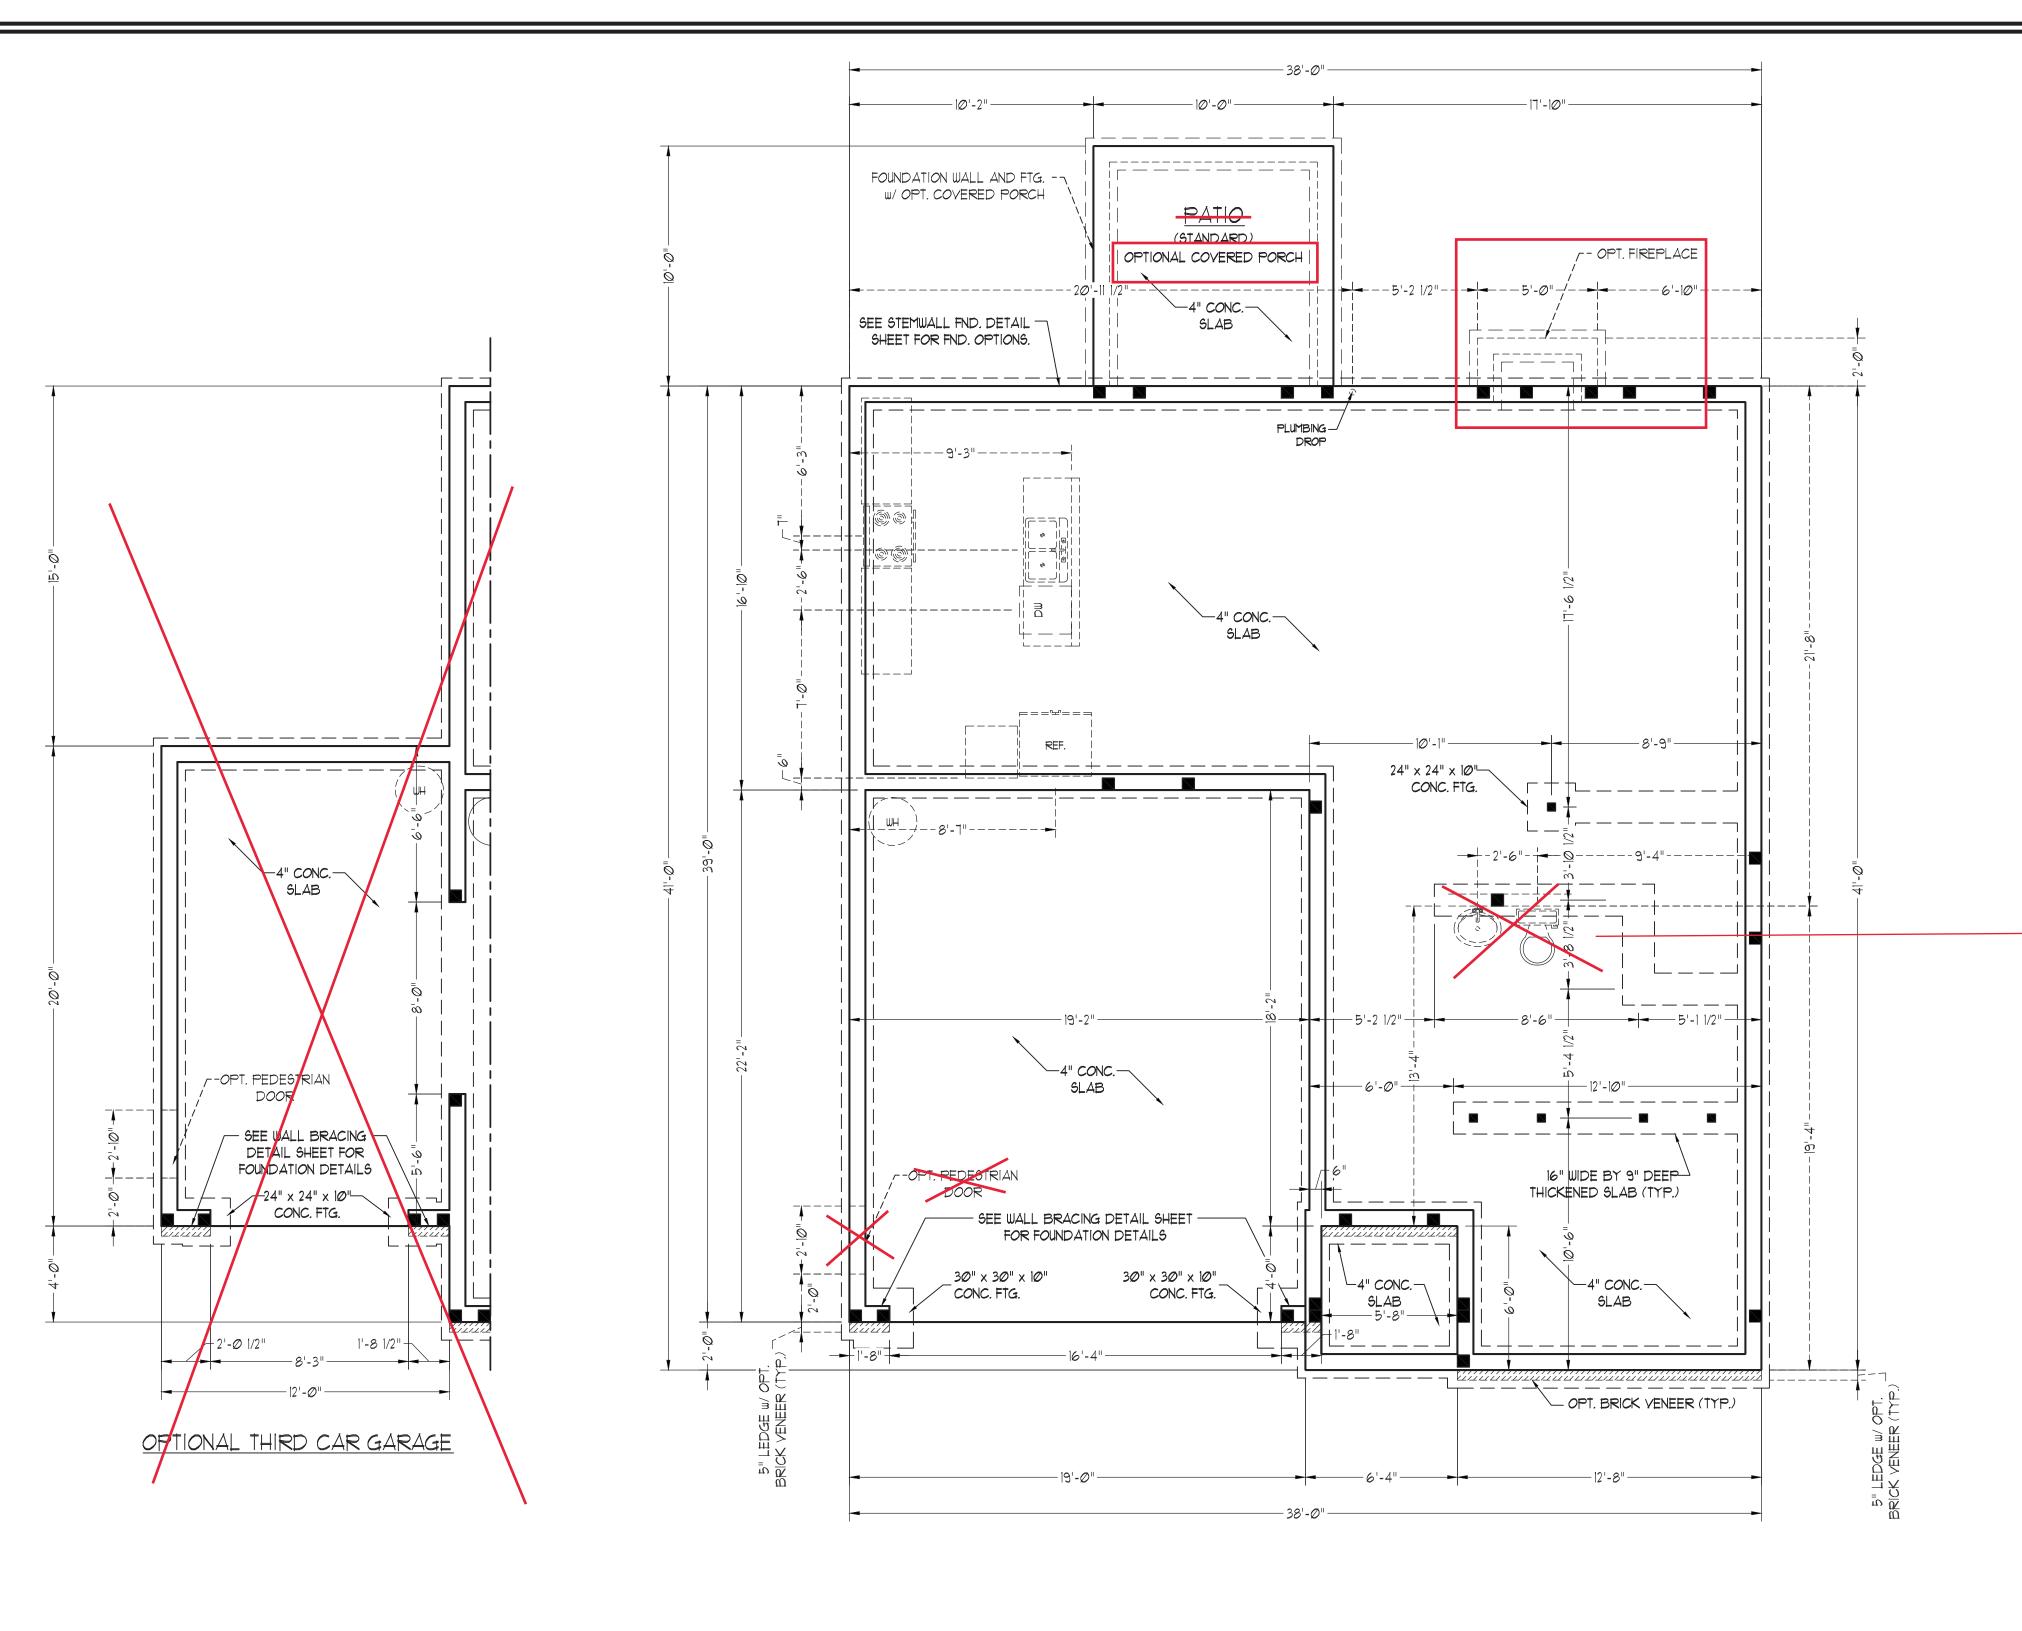

NOTES FOR LESS THAN 30' MEAN ROOF HEIGHT:

ENGINEER'S SEAL APPLIES ONLY TO DOES NOT CERTIFY DIMENSIONAL

- ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM. STRUCTURAL DESIGN PER NORTH CAROLINA
- INSTALL 1/2" ANCHOR BOLTS 4'-0" O.C. AND WITHIN 1'-0" FROM END OF EACH CORNER. ANCHOR BOLTS MUST EXTEND A MINIMUM OF 1" INTO MASONRY OR CONCRETE, LOCATE BOLT WITHIN MIDDLE THIRD OF PLATE WIDTH 4. MEAN ROOF HEIGHT IS LESS THAN 30 FEET.
- AND -24 PSF (+/- INDICATE POSITIVE /
- ROOF CLADDING DESIGNED FOR +16.7 PSF AND +10.5 PSF AND -43 PSF FOR ROOF PITCHED 2.25/12 TO 7/12.
- INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NCRC, 2018 EDITION.

130 MPH ULTIMATE DESIGN WIND SPEED

STRUCTURAL COMPONENTS. ENGINEER'S SEAL

- RESIDENTIAL CODE, 2018 EDITION.
- 5. EXTERIOR WALLS DESIGNED FOR 130 MPH
- 6. WALL CLADDING DESIGNED FOR +182 PSF
- NEGATIVE PRESSURE (TYP). AND -21 PSF FOR ROOF PITCHES 1/12 TO 12/12
- 3. INSTALL 1/16" OSB SHEATHING ON ALL EXTERIOR WALLS OF ALL STORIES IN ACCORDANCE WITH SECTION R602.10.3 OF THE NCRC, 2018 EDITION. SEE THE WALL BRACING NOTES AND DETAILS SHEET FOR MORE INFORMATION.
- B. ENERGY EFFICIENCY COMPLIANCE AND
- IØ. REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

120 MPH ULTIMATE DESIGN WIND SPEED

NOTES FOR LESS THAN 30' MEAN ROOF HEIGHT:

STRUCTURAL COMPONENTS. ENGINEER'S SEAL

ENGINEER'S SEAL APPLIES ONLY TO

DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT

FULL BATH OPTION

~4" CONC.—

PLUMBING W/ OPTIONAL BEDROOM 4 OR 5

2'-7 1/2"

RENAISSANCE

RESIDENTIAL DESIGN, INC. RALEIGH, NC (919) 649-4128 WWW.RRDCAROLINA.COM "The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC. RESERVES THE RIGHT TO MAKE MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE. THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN

ARCHITECTURAL CONCEPT ONLY. RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR

COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF BENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919

FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



- 5. EXTERIOR WALLS DESIGNED FOR 120 MPH
- 6. WALL CLADDING DESIGNED FOR +15.5 PSF AND -20 PSF (+/- INDICATE POSITIVE / NEGATIVE PRESSURE (TYP).
- 1. ROOF CLADDING DESIGNED FOR +14.2 PSF AND -18 PSF FOR ROOF PITCHES 1/12 TO 12/12 AND +10 PSF AND -36 PSF FOR ROOF PITCHED 2.25/12 TO 1/12.
- EXTERIOR WALLS OF ALL STORIES IN ACCORDANCE WITH SECTION R602.10.3 OF THE NCRC, 2018 EDITION. SEE THE WALL BRACING NOTES AND DETAILS SHEET FOR
- 9. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NCRC, 2018 EDITION.
- 10. REFER TO NOTES AND DETAIL SHEETS FOR

A&G RESIDENTIAL GREENVILLE DRIVE LEFT

DATE: OCTOBER 15, 2020

SCALE: 1/4"=1'-0"

DRAWN BY: WG ENGINEERED BY: WFB

REVIEWED BY: MGS

STEMWALL SLAB FOUNDATION PLAN

S-1

2. STRUCTURAL DESIGN PER NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION. 3. INSTALL 1/2" ANCHOR BOLTS 6'-0" O.C. AND WITHIN 1'-0" FROM END OF EACH CORNER. ANCHOR BOLTS MUST EXTEND A MINIMUM OF 1" INTO MASONRY OR CONCRETE. LOCATE BOLT WITHIN MIDDLE THIRD OF PLATE WIDTH. 4. MEAN ROOF HEIGHT IS LESS THAN 30 FEET.

INCLUDING ROOF SYSTEM.

8. INSTALL 7/16" OSB SHEATHING ON ALL

MORE INFORMATION.

ADDITIONAL STRUCTURAL INFORMATION.

**SEAL** 33736

11/3/2020

INSTALL 2x10 BLOCKING

ATTACH 2 x 10 BAND TO -

BOLTS @ 12" O.C.

REQUIRED

END (TYP.)

CANOPY DETAIL

(NTS)

BLOCKING WITH 1/2" THRU

INSTALL 2XIØ BLOCKING AS-

FASTEN w/ (4) 12d NAILS EA.

NOTE: CANOPY IS NOT DESIGNED FOR MAN LOAD

ATTACH 2 x IØ BAND TO BLOCKING.

WITH 1/2" DIA. LAG SCREWS @ 12" O.C.

AS REQUIRED

SIMPSON L50 ANGLE

EA. SIDE OF RAFTER


- ATTACH RAFTER TO

CEILING JOIST w/ (6)

-2 x 8 CEILING JOIST

- SIMPSON LUS28

12d NAILS

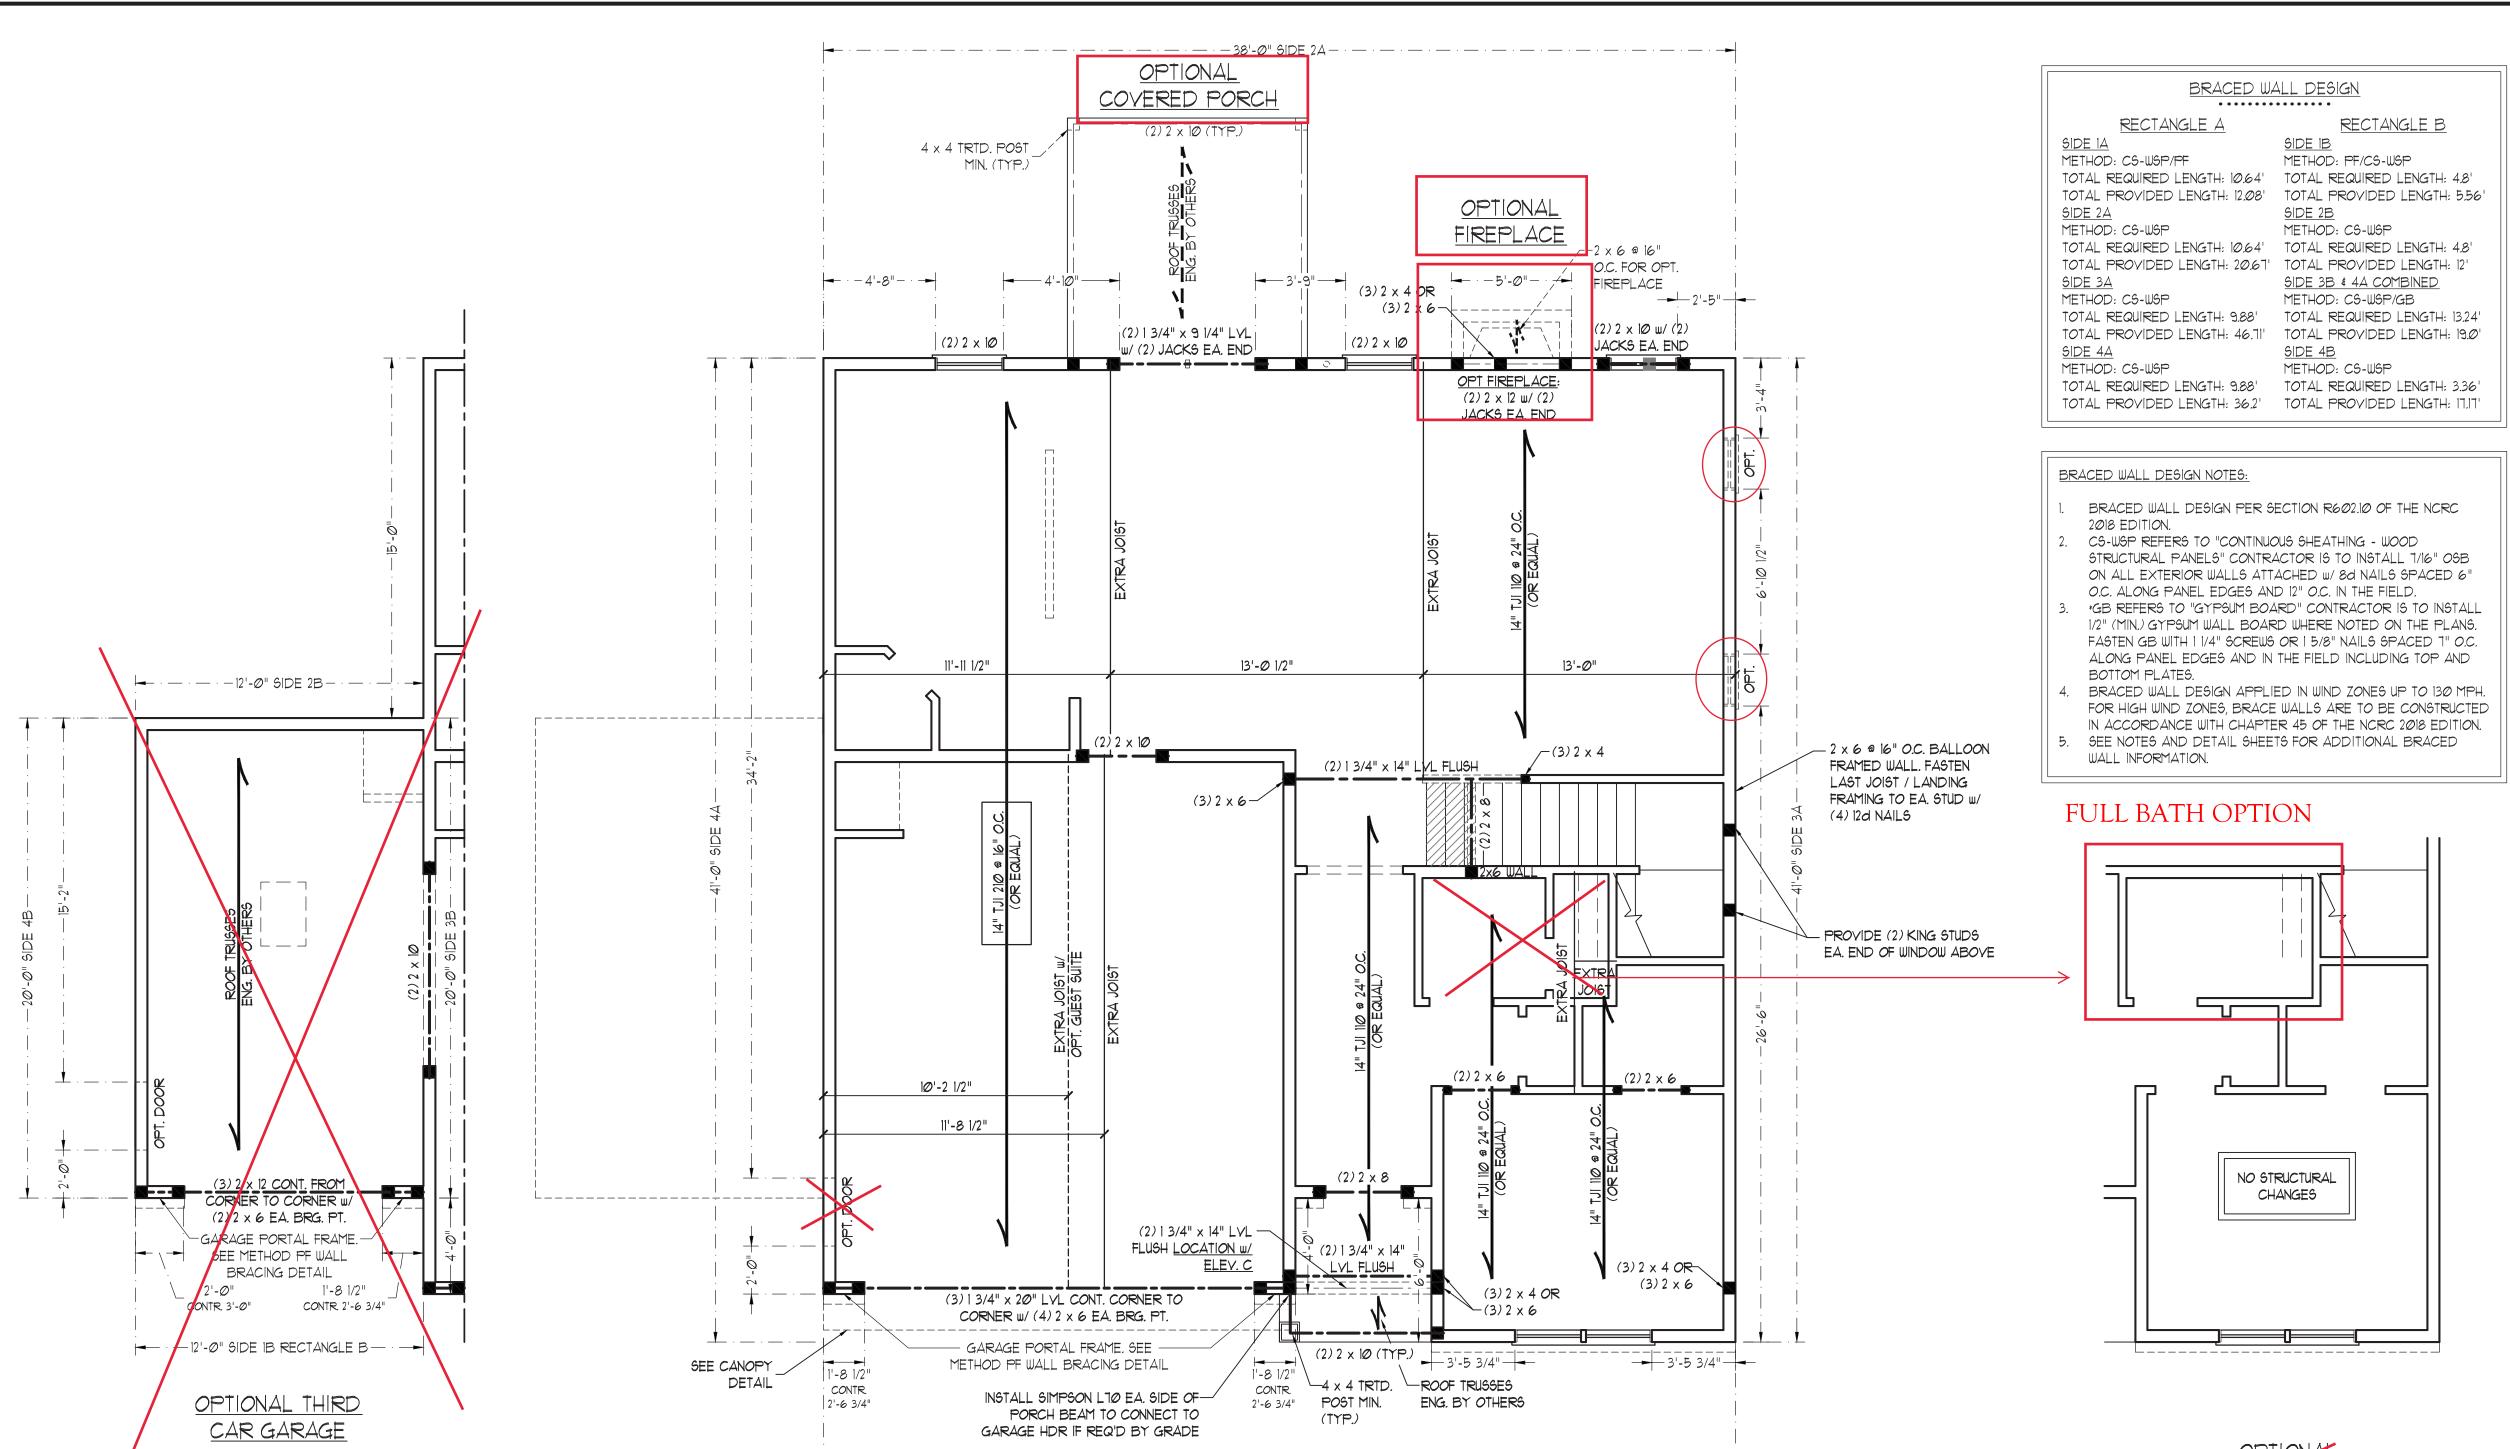



MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS						
HEADER SPAN (FEET)	MAXIMUM STUD SPACING (INCHES) (PER TABLE R6023(5)					
(1 == 1)	16	24				
UP TO 3'	1	1				
4'	2	1				
8'	3	2				
12'	5	3				
16'	6	4				

## STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE SPF #2 (UNO). ALL TREATED LUMBER TO BE SYP #2 (UNO.)
- ALL LOAD BEARING HEADERS TO BE (2) 2 x 6 (UNO).
- INSTALL AN EXTRA JOIST UNDER WALLS PARALLEL TO FLOOR JOISTS
- WHERE NOTED ON THE PLANS.
  WINDOW AND DOOR HEADERS TO BE
  SUPPORTED W/ (1) JACK STUD AND (1)
  KING STUD EA. END (UNO.). SEE TABLE
  R602.1.5 FOR ADDITIONAL KING STUD
- REQUIREMENTS.

  SQUARES DENOTE POINT LOADS

  WHICH REQUIRE SOLID BLOCKING TO

  GIRDER OR FOUNDATION ALL
- GIRDER OR FOUNDATION. ALL SQUARES TO BE (2) STUDS (UNO.) 5. ALL 4 x 4 POSTS SHALL BE
- ANCHORED TO SLABS W/
  SIMPSON ABU44 POST BASES (OR
  EQUAL) AND 6 x 6 POSTS W/ ABU66
  POST BASES (OR EQUAL) (UNO). ALL
  4 x 4 AND 6 x 6 POSTS TO BE
  INSTALLED WITH 100 LB CAPACITY
- UPLIFT CONNECTORS AT TOP (UNO.)
  FOR FIBERGLASS, ALUMINUM, OR
  COLUMN ENG. BY OTHERS, SECURE TO
  SLAB W/(2) METAL ANGLES USING 2"
  CONC. SCREWS. FASTEN ANGLES TO
  COLUMNS W/ I/4" THROUGH BOLTS W/
  NUTS AND WASHERS. LOCATE ANGLES
  ON OPPOSITE SIDES OF COLUMN.
  THROUGH BOLTS MUST BE INSTALLED
  PRIOR TO SETTING COLUMN.
- REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

A&G RESIDENTIAL GREENVILLE DRIVE LEFT

RENAISSANCE

RESIDENTIAL DESIGN, INC.

RALEIGH, NC (919) 649-4128

WWW.RRDCAROLINA.COM

"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC.

MODIFICATIONS TO FLOOR PLANS,

DIMENSIONS, MATERIALS, AND

SPECIFICATIONS WITHOUT NOTICE.

THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY. RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS

COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT

TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER

WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE

RESIDENTIAL DESIGN, INC. NOR ARE

THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID

WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON

ENGINEERING, INC

606 WADE AVE., SUITE 104

RALEIGH, NC 27605

PHONE: (919) 789-9919

FAX: (919) 789-9921

N.C. LICENSE NO.: C-1733

RESERVES THE RIGHT TO MAKE

DATE: OCTOBER 15, 2020

SCALE: 1/4"=1'-0"

REV.:

DRAWN BY: WG

ICINEEDED BV. W

ENGINEERED BY: WFB

REVIEWED BY: MGS

SECOND FLOOR FRAMING PLAN

S-2




BCI 45006-1.8 I-JOISTS MAY BE INSTALLED
IN LIEU OF TJI 110 I-JOISTS AT THE DEPTH
AND SPACING INDICATED ON THE PLAN

BCI 50006-1.8 I-JOISTS MAY BE
INSTALLED IN LIEU OF TJI 210 I-JOISTS AT
THE DEPTH AND SPACING INDICATED ON
THE PLAN

\*NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 6 @ 16" O.C. (UNO). 2 x 4 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 6 WALLS (UNO). ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).



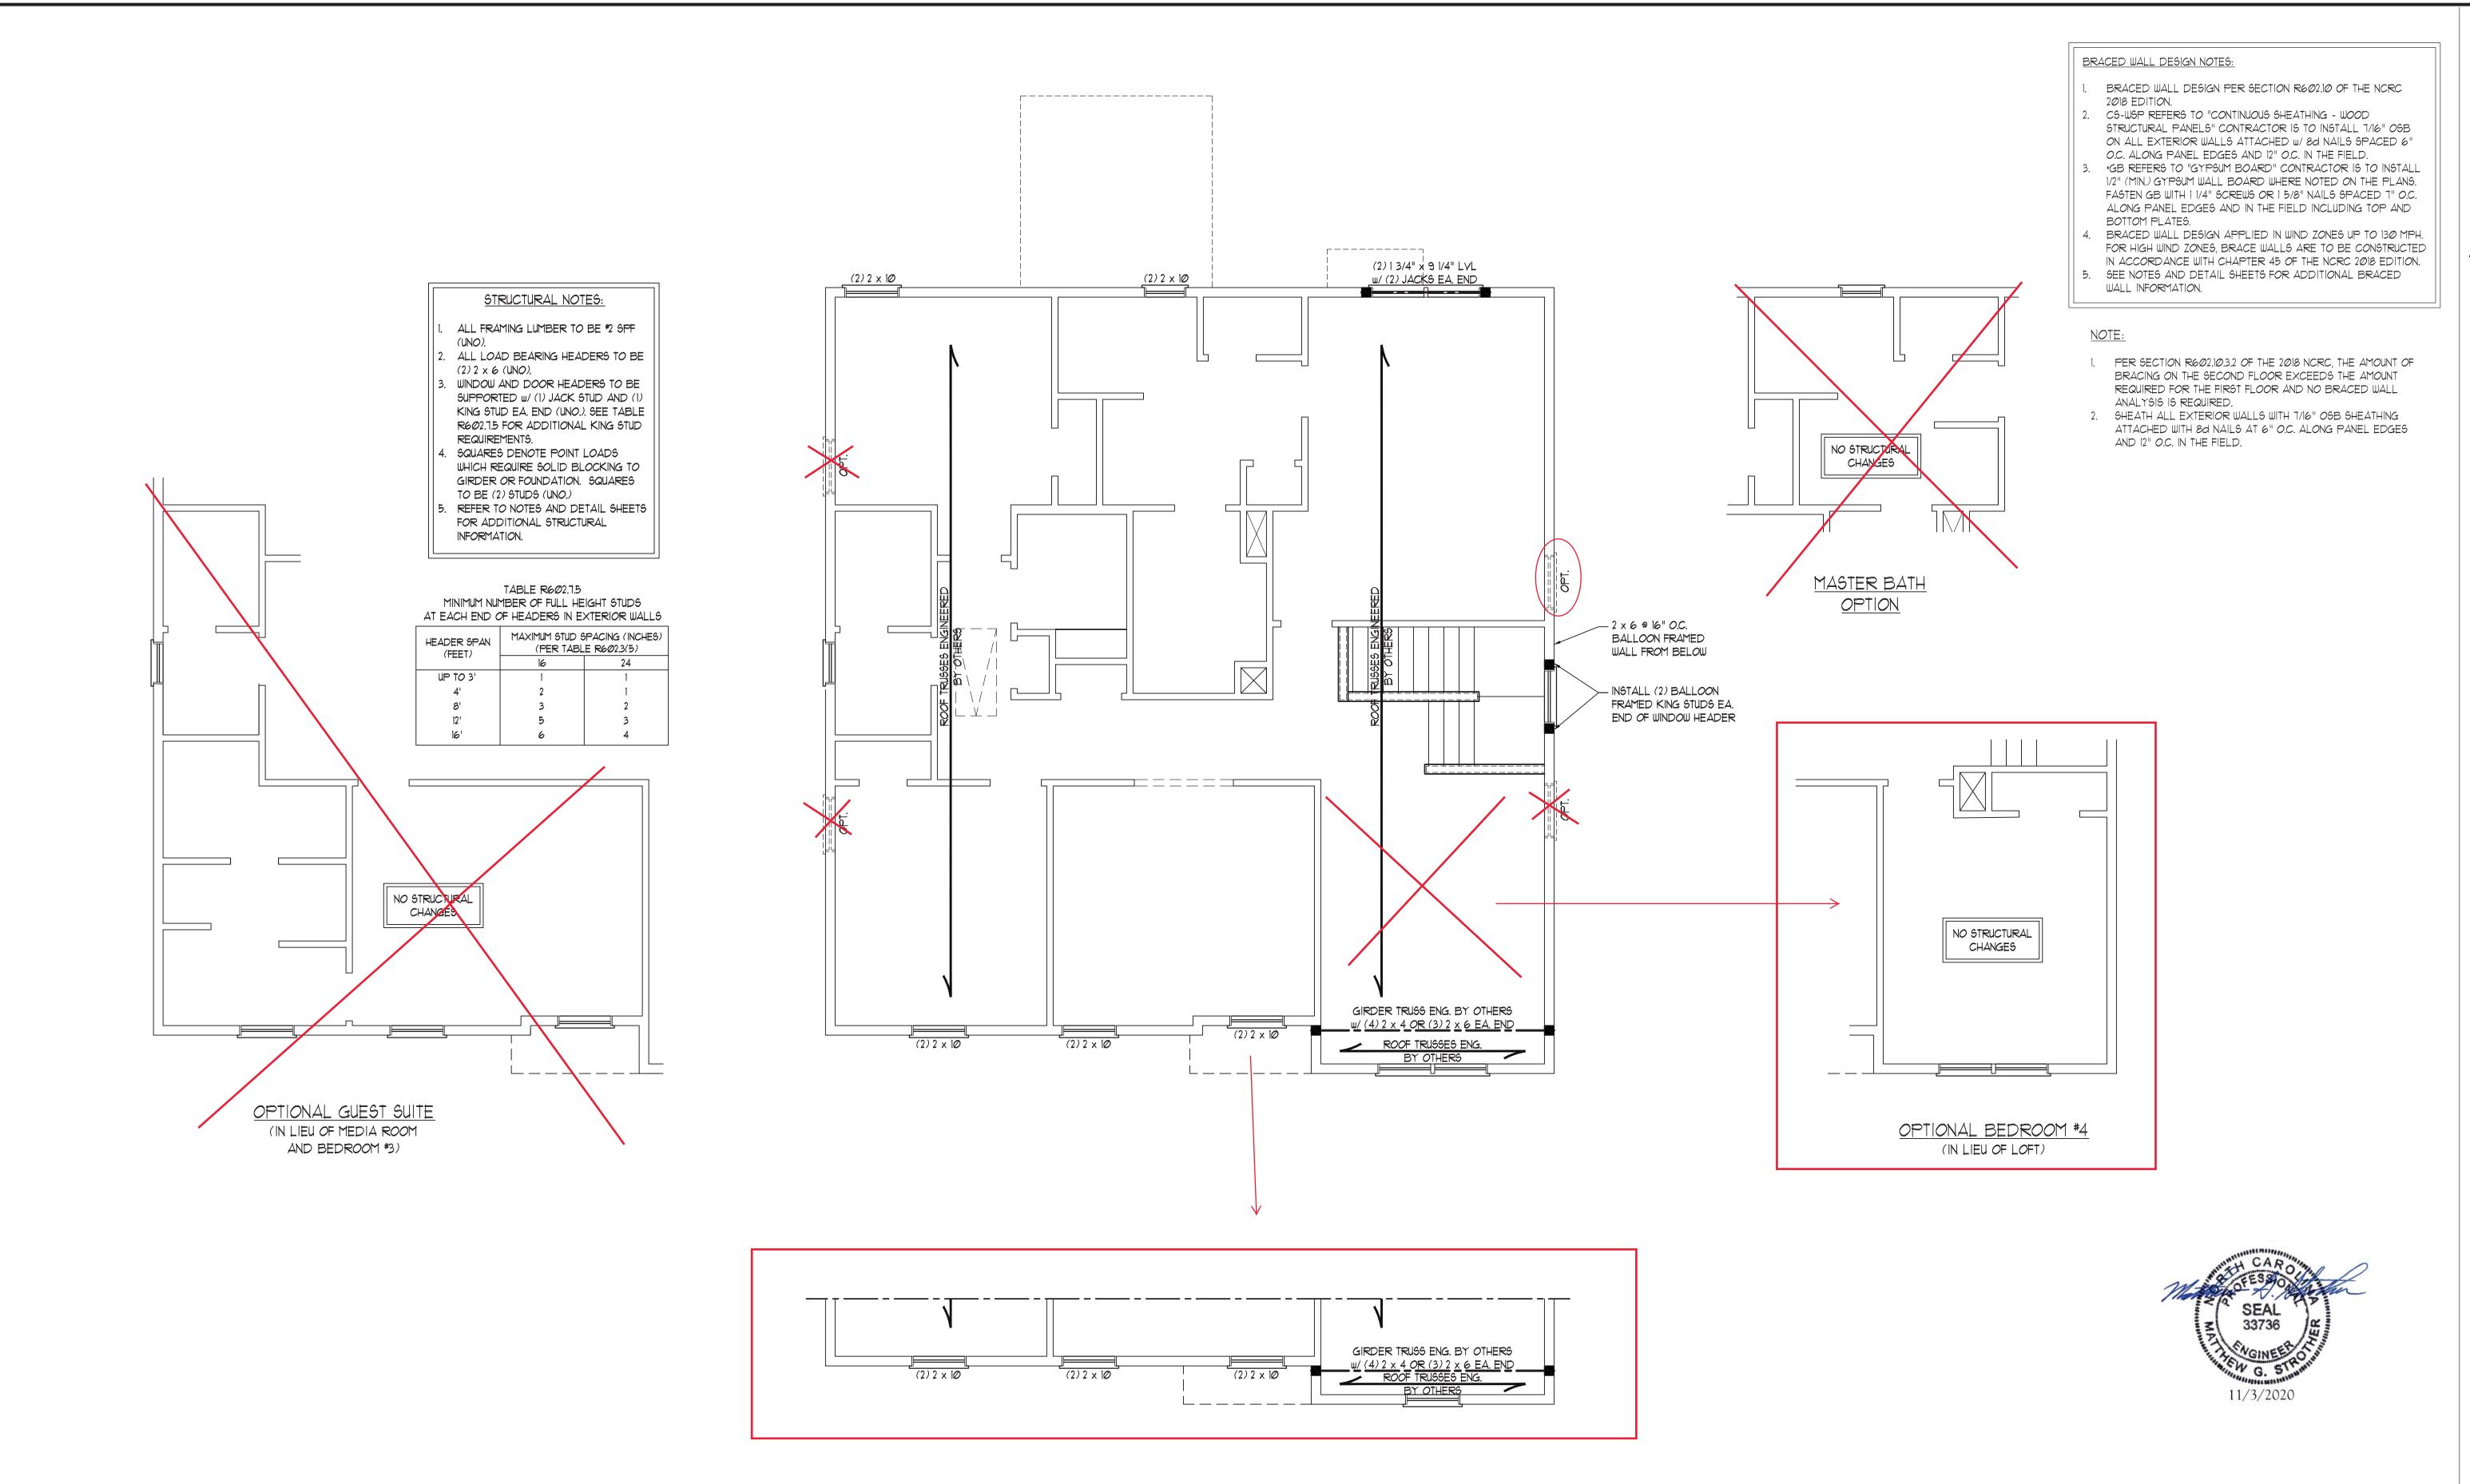

WINDOW/ WALL CONFIGURATION ELEVATION C ONLY

RENAISSANCE


RESIDENTIAL DESIGN, INC.
RALEIGH, NC (919) 649-4128
WWW.RRDCAROLINA.COM
"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE
PURPOSE OF CONVEYING AN
ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC.

HEREBY EXPRESSLY RESERVES ITS
COMMON LAW COPYRIGHT AND OTHER
PROPERTY RIGHTS IN THESE PLANS.
THESE PLANS AND DRAWINGS ARE NOT
TO BE REPRODUCED, CHANGED, OR
COPIED IN ANY FORM OR MANNER
WITHOUT FIRST OBTAINING THE EXPRESS
WRITTEN CONSENT OF RENAISSANCE
RESIDENTIAL DESIGN, INC. NOR ARE
THEY TO BE ASSIGNED TO ANY THIRD
PARTY WITHOUT FIRST OBTAINING SAID
WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



FLOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. UARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY BY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ON LOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT AN FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED ROPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION, OR DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW HOME SALES CONSULTANT FOR CURRENT DETAILS. COPYRIGHT © 2020 A&G RESIDENTIAL

A&G RESIDENTIAL GREENVILLE DRIVE LEFT

DATE: OCTOBER 15, 2020

REV.:

\*NOTE: ALL EXTERIOR WALLS AND

ATTIC WALLS ARE TO BE 2 x 6 @ 16"

O.C. (UNO). 2 x 4 @ 16" O.C. EXTERIOR

OF 2 x 6 WALLS (UNO). ALL INTERIOR

4 @ 16" O.C. (UNO) AND NON-LOAD

2 x 4 @ 24" O.C. (UNO).

WALLS MAY BE CONSTRUCTED IN LIEU

LOAD BEARING WALLS ARE TO BE 2 X

BEARING INTERIOR WALLS ARE TO BE

SCALE: 1/4"=1'-0"

DRAWN BY: WG


ENGINEERED BY: WFB

**REVIEWED BY: MGS** 

ATTIC FLOOR

FRAMING PLAN

S-3

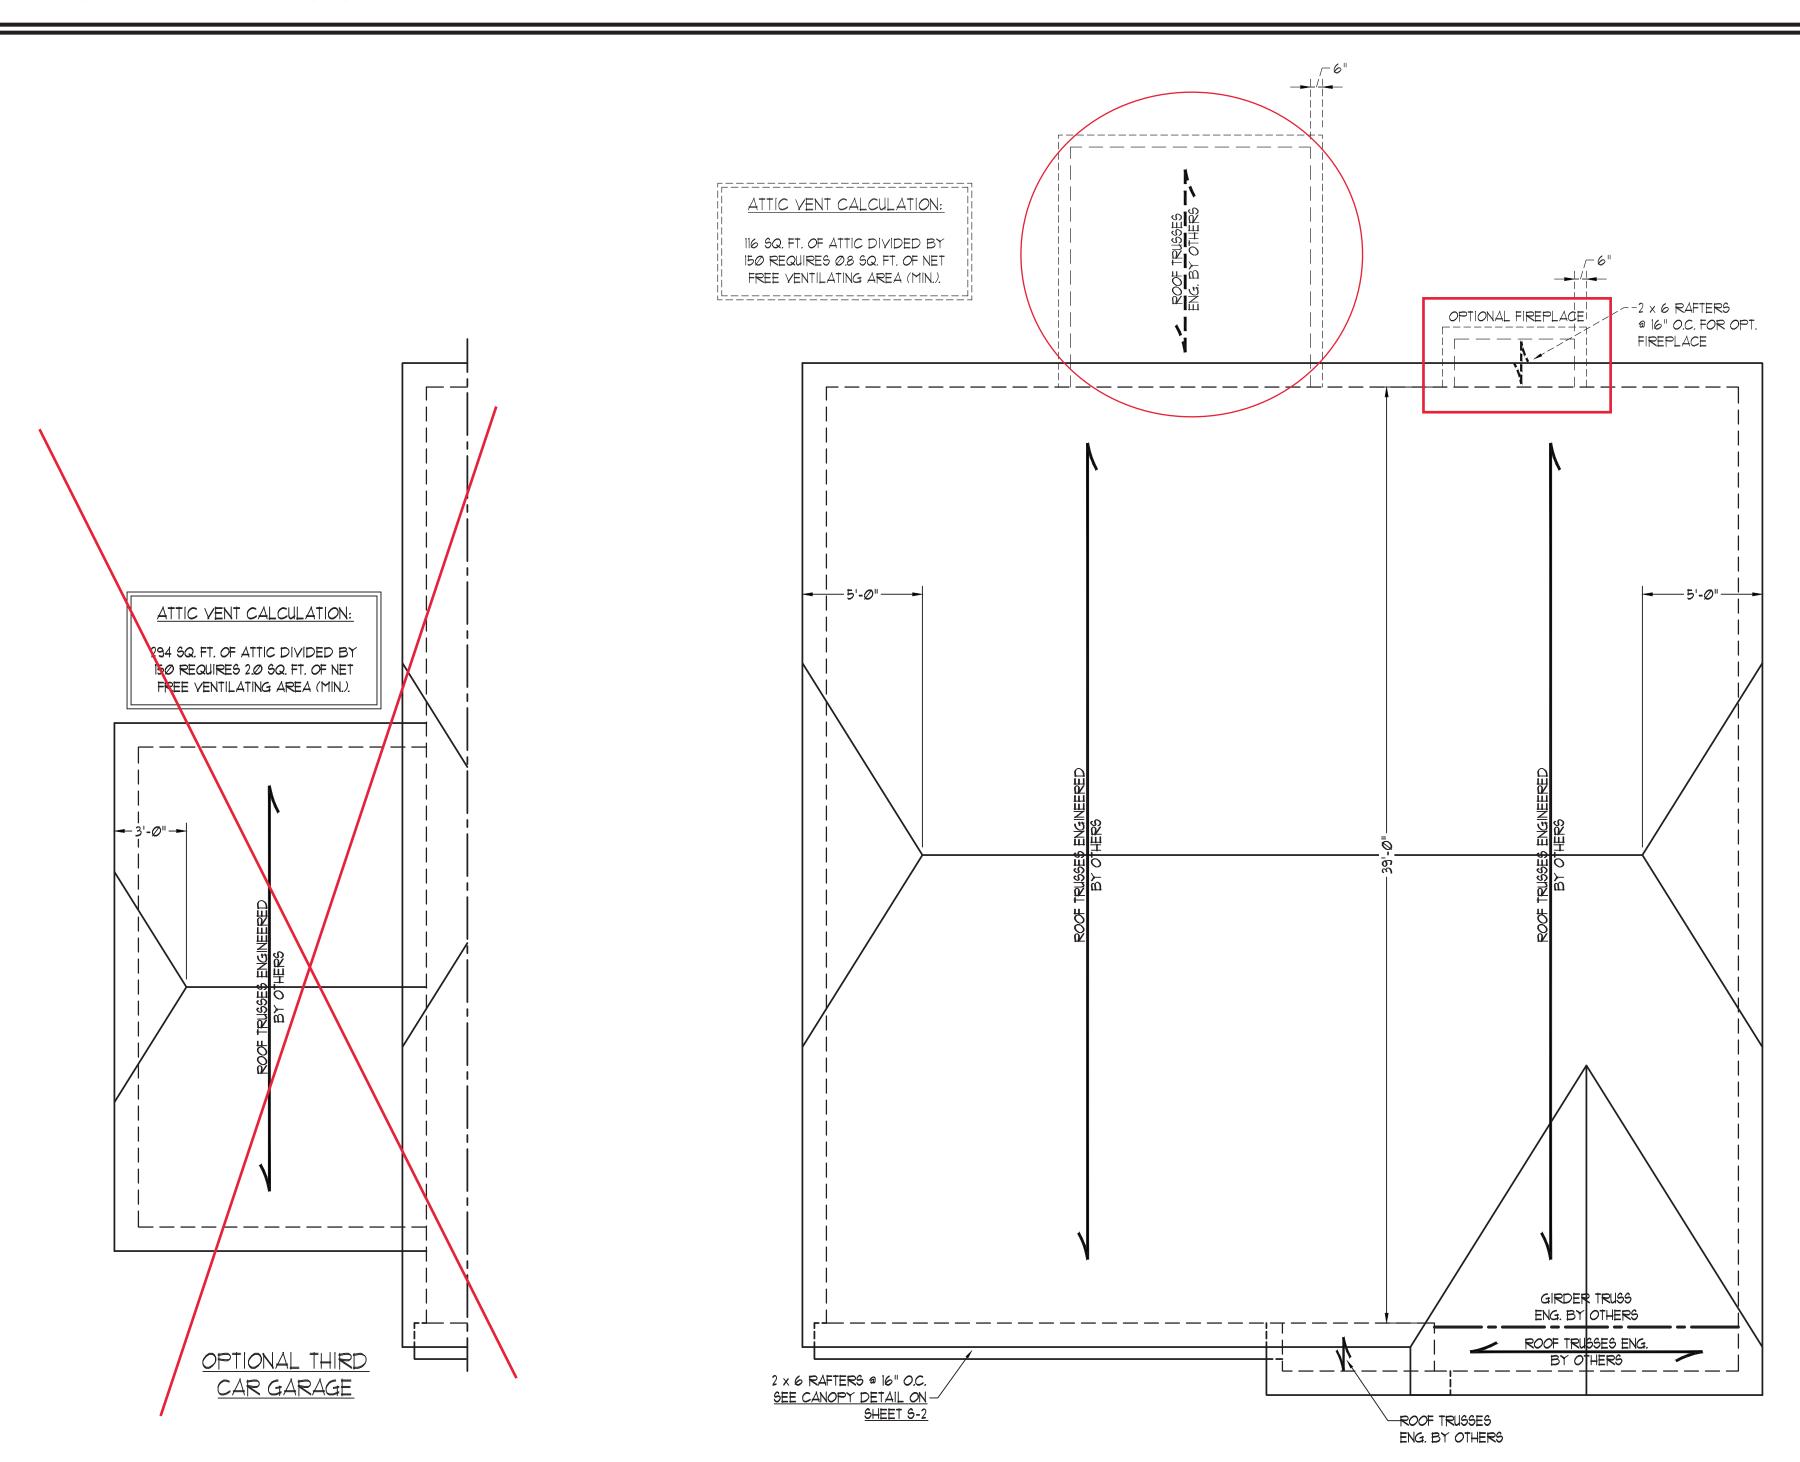

ELEVATION C

#### STRUCTURAL NOTES:

- I. ALL FRAMING LUMBER TO BE #2
- SPF (UNO).


  2. CIRCLES DENOTE (3) 2 x 4 POSTS
  FOR ROOF SUPPORT.
- 4. HIP SPLICES ARE TO BE SPACED
  A MIN. OF 8'-O". FASTEN
  MEMBERS WITH THREE ROWS OF
  12d NAILS @ 16" O.C. (TYP.)

  5. STICK FRAME OVER-FRAMED
  ROOF SECTIONS W/ 2 x 8 RIDGES,
  2 x 6 RAFTERS @ 16" O.C. AND
  FLAT 2 x 10 VALLEYS OR USE
- VALLEY TRUSSES.

  6. FASTEN FLAT VALLEYS TO
  RAFTERS OR TRUSSES WITH
  SIMPSON H2.5A HURRICANE TIES ®
  32" O.C. MAX. PASS HURRICANE
  TIES THROUGH NOTCH IN ROOF
  SHEATHING. EACH RAFTER IS TO
  BE FASTENED TO THE FLAT
  VALLEY WITH A MIN. OF (6) 12d
  TOE NAILS.
- REFER TO SECTION R802.II OF THE 2018 NCRC FOR REQUIRED UPLIFT RESISTANCE AT RAFTERS AND TRUSSES.
  REFER TO NOTES AND DETAIL
- SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

#### ATTIC VENT CALCULATION:

1705 SQ. FT. OF ATTIC DIVIDED BY 150 REQUIRES 11.4 SQ. FT. OF NET FREE VENTILATING AREA (MIN.).



## RENAISSANCE

RESIDENTIAL DESIGN, INC.
RALEIGH, NC (919) 649-4128
WWW.RRDCAROLINA.COM
"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE
PURPOSE OF CONVEYING AN


ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC.
HEREBY EXPRESSLY RESERVES ITS
COMMON LAW COPYRIGHT AND OTHER
PROPERTY RIGHTS IN THESE PLANS.
THESE PLANS AND DRAWINGS ARE NOT
TO BE REPRODUCED, CHANGED, OR
COPIED IN ANY FORM OR MANNER
WITHOUT FIRST OBTAINING THE EXPRESS
WRITTEN CONSENT OF RENAISSANCE
RESIDENTIAL DESIGN, INC. NOR ARE
THEY TO BE ASSIGNED TO ANY THIRD
PARTY WITHOUT FIRST OBTAINING SAID
WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919

FAX: (919) 789-9921

N.C. LICENSE NO.: C-1733



FLOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. SQUARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY VARY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ON LOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT PLAN. FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED PROPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION, OR DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW HOME SALES CONSULTANT FOR CURRENT DETAILS. COPYRIGHT © 2020 A&G RESIDENTIAL

A&G RESIDENTIAL GREENVILLE DRIVE LEFT

DATE: OCTOBER 15, 2020

REV.:

SCALE: 1/4"=1'-0"

SCALE: 1/4"=1'-0"

DRAWN BY: WG

ENGINEERED BY: WFB

REVIEWED BY: MGS

ROOF PLAN

ELEVATION -C
S-4

SEAL 33736

SEAL 33736

11/3/2020

FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS.

DATE: NOVEMBER 1, 2018 SCALE: NTS

DRAWN BY: JST

ENGINEERED BY: JST

FOUNDATION DETAILS

MASONRY STEMWALL SPECIFICATIONS MASONRY WALL TYPE WALL HEIGHT 4" BRICK AND 4" BRICK AND (FEET) 8" CMU 12" CMU 2 AND UNGROUTED GROUT SOLID UNGROUTED UNGROUTED BELOW UNGROUTED GROUT SOLID UNGROUTED UNGROUTED GROUT SOLID w/ #4 GROUT SOLID w/ #4 GROUT SOLID GROUT SOLID REBAR @ 48" O.C. REBAR @ 64" O.C. GROUT SOLID w/ #4 GROUT SOLID w/ #4 GROUT SOLID w/ #4 NOT APPLICABLE REBAR @ 36" O.C. REBAR @ 36" O.C. REBAR @ 64" O.C. GROUT SOLID w/ #4 GROUT SOLID w/ #4 GROUT SOLID w/ #4 NOT APPLICABLE REBAR @ 24" O.C. REBAR @ 24" O.C. REBAR @ 64" O.C. 7 AND

#### STRUCTURAL NOTES:

ENGINEERED DESIGN BASED ON SITE CONDITIONS

- 1) WALL HEIGHT MEASURED FROM TOP OF FOOTING TO TOP OF THE WALL.
- 2) TIE MULTIPLE WYTHES TOGETHER WITH LADDER WIRE AT 16" O.C. VERTICALLY.
- 3) CHART APPLICABLE FOR HOUSE FOUNDATION ONLY. CONSULT ENGINEER FOR DESIGN OF GARAGE FOUNDATION NOT COMMON TO HOUSE.
- 4) BACKFILL OF CLEAN #57 / #67 WASHED STONE IS ALLOWABLE.
- 5) BACKFILL OF WELL DRAINED OR SAND GRAVEL MIXTURE SOILS (45 PSF/FT BELOW GRADE) CLASSIFIED AS GROUP I ACCORDING TO UNIFIED SOILS CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R405.1 OF THE 2018 NORTH CAROLINA RESIDENTIAL CODE ARE ALLOWABLE.
- 6) PREP SLAB PER <u>R506.2.1</u> AND <u>R506.2.2</u> BASE AND <u>EXCEPTION</u> OF 2018 NORTH CAROLINA RESIDENTIAL CODE.
- 1) MINIMUM 24" LAP SPLICE LENGTH.

GREATER

- 8) LOCATE REBAR IN CENTER OF FOUNDATION WALL.
- 9) WHERE REQUIRED, FILL BLOCK SOLID WITH TYPE "S" MORTAR OR 3000 PSI GROUT. USE OF "LOW LIFT GROUTING" METHOD REQUIRED WHEN FILLING WALLS WITH GROUT AT HEIGHTS OF 5' AND GREATER.

ALL CELLS W/ REINFORCEMENT TO BE FILLED SOLID.  WALL REINFORCEMENT, SEE CHART FOR SPACING  16" WIDE BY 8" DEEP CONT. CONC. FTG.	FILLED SOLID.  SEE CHART FOR SPACING  -20" WIDE BY 8" DEEP  CONT. CONC. FTG.
STEM WALL FDN. DETAIL 1	STEM WALL FDN. W/ BRICK AND CURB (2)
2 × 4 STUD FRAMING (UNO) W/ TRTD. BOTTOM PLATE(9)  2 × 4 TRTD. BOTTOM PLATE(9)  2 × 4 TRTD. BOTTOM PLATE(9)  3 × 4 TRTD. BOTTOM PLATE(9)  4" BRICK VENEER  4" BRICK VENEER  4" BRICK VENEER  4" BRICK VENEER  FLASHING  A" CONCRETE SLAB W/ FIBER REINFORCING OR WELDED WIRE FABRIC  6 MIL. VAPOR BARRIER  4" WASHED STONE  UNDISTURBED EARTH, COMPACTED FILL OR WASHED STONE  TOP TWO COURSES OF STEM WALL AND ALL CELLS W/ REINFORCEMENT TO BE FILLED SOLID.  FILLED SOLID.  BRICK TIES ®  I'-4" VERTICALLY AND  2'-6" HORIZONTALLY  4" BRICK VENEER  FLASHING  LADDER WIRE EVERYMOTHER COURSE  EVERYMOTHER COURSE  EVERYMOTHER COURSE  EVERYMOTHER COURSE  FULLED SOLID.  WALL REINFORCEMENT, SEE CHART FOR SPACING  20" WIDE BY 8" DEEP CONT. CONC. FTG.	2 x 4 STUD FRAMING (UNO) W/ TRTD. BOTTOM PLATE(\$)  \$ECURED BY 1/2" DIA. BOLTS.  \$ECURED BY 1/2" DIA. BOLTS.  \$EE CHART FOR \$PACING AND EMBEDMENT REQUIREMENTS  4" CONCRETE \$LAB W/ FIBER REINFORCING OR WELDED WIRE FABRIC  6 MIL. VAPOR BARRIER  4" WASHED \$TONE  UNDISTURBED EARTH, COMPACTED FILL OR WASHED \$TONE  TOP TWO COURSES OF STEM WALL AND ALL CELLS W/ REINFORCEMENT TO BE FILLED SOLID.  FOR OPTIONAL BRICK WATERTABLE, INCREASE TO 20" WIDE BY 8" DEEP CONT. CONC. FTG.
STEM WALL FDN. W/ BRICK DETAIL (3)	STEM WALL FDN. W/ OPTIONAL BRICK WATERTABLE DETAIL  4

-SIDING AS SPEC.

-LADDER WIRE IN TOP TWO

-OPTIONAL BRICK VENEER

COURSES (W/ VENEER ONLY)

FINISHED GRADE

LADDER WIRE

EVERY OTHER

COURSE

SHEATHING

2 x 4 STUD FRAMING (UNO) W/ TRTD. BOTTOM PLATE(S)

2 x 4 TRTD. BOTTOM PLATE(S)-

SECURED BY 1/2" DIA. BOLTS.

SEE CHART FOR SPACING AND EMBEDMENT REQUIREMENTS

W FIBER REINFORCING

OR WELDED WIRE FABRIC

4" CONCRETE SLAB

6 MIL. VAPOR-BARRIER

UNDISTURBED EARTH,

COMPACTED FILL

OR WASHED STONE

TOP TWO COURSES OF STEM WALL AND-

ALL CELLS W/ REINFORCEMENT TO BE

4" WASHED STONE

BRICK TIES @

1'-4" VERTICALLY AND

LADDER WIRE

EVERY OTHER

—12" CMU BLOCK

COURSE

-WALL REINFORCEMENT,

2'-6" HORIZONTALLY

-4" BRICK VENEER

WEEP HOLES

2 x 4 STUD FRAMING (UNO) W/ TRTD. BOTTOM PLATE(S)

2 x 4 TRTD. BOTTOM PLATE(S)—

SECURED BY 1/2" DIA. BOLTS.

SEE CHART FOR SPACING AND

THICKENED SLAB

4" CONCRETE SLAB

6 MIL. VAPOR

UNDISTURBED EARTH,

COMPACTED FILL

TOP TWO COURSES OF STEM WALL AND-

OR WASHED STONE

W/ FIBER REINFORCING

OR WELDED WIRE FABRIC

4" WASHED STONE

NOT REQUIRED

EMBEDMENT REQUIREMENTS

_					
	ANCHOR SPACING AND EMBEDMENT			NOTE:	
	WIND ZONE	120 MPH	130 MPH	THREADED ROD WITH EPOXY,	
	SPACING	6'-0" O.C. INSTALL MIN. (2) ANCHORS PER PLATE SECTION AND (1) ANCHOR WITHIN 12" OF CORNERS	4'-0" O.C. INSTALL MIN. (2) ANCHORS PER PLATE SECTION AND (1) ANCHOR WITHIN 12" OF CORNERS	SIMPSON TITEN HD, OR APPROVED ANCHORS SPACED AS REQUIRED TO PROVIDE EQUIVALENT ANCHORAGE TO 1/2" DIAMETER ANCHOR BOLTS MAY BE USED IN	
	EMBEDMENT	7"	15" INTO MASONRY 7" INTO CONCRETE	LIEU OF 1/2" ANCHOR BOLTS.	

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

ES

# DATE: MAY 18, 2020

SCALE: 1/4" = 1'-0" DRAWN BY: JST

ENGINEERED BY: JST

**BRACED WALL** NOTES AND DETAILS

AND PF DETAIL

GENERAL WALL BRACING NOTES

WALL BRACING DESIGNED IN ACCORDANCE WITH CHAPTER 6 OF THE 2018 NC RESIDENTIAL BUILDING CODE (NCRC). TABLES AND FIGURES REFERENCED ARE FROM THE 2018 NCRC.

SEE THIS SHEET FOR GENERAL DETAILS. REFER TO THE 2018 NCRC FOR ADDITIONAL INFORMATION AS NEEDED BRACED EXTERIOR WALLS SUPPORTING ROOF TRUSSES AND RAFTERS, INCLUDING STORIES BELOW THE TOP FLOOR, HAVE BEEN DESIGNED PER R602.3.5 (3). WALL SHEATHING AND FASTENERS HAVE BEEN DESIGNED TO RESIST COMBINED UPLIFT AND SHEAR FORCES IN ACCORDANCE WITH ACCEPTED ENGINEERED PRACTICE.

SEE STRUCTURAL SHEETS FOR BRACED WALL LOCATIONS, DIMENSIONS, HOLD DOWN TYPE AND LOCATIONS, BRACED WALL LINE KEY WITH WALL DESIGN SUMMARY OF REQUIRED/PROVIDED TOTALS FOR EACH WALL LINE AND ANY SPECIAL NOTES OR REQUIREMENTS.


5. ALL EXTERIOR WALLS ARE TO BE SHEATHED WITH CS-WSP IN ACCORDANCE WITH SECTION R602.10.3 UNLESS NOTED


6. ALL EXTERIOR AND INTERIOR WALLS TO HAVE 1/2" GYPSUM INSTALLED. WHEN NOT USING METHOD "GB", GYPSUM TO BE FASTENED PER TABLE R102.3.5. METHOD GB TO BE FASTENED PER TABLE R602.10.1


CS-WSP REFERS TO THE "CONTINUOUS SHEATHING - WOOD STRUCTURAL PANELS" WALL BRACING METHOD. 1/16" OSB SHEATHING IS TO BE INSTALLED ON ALL EXTERIOR WALLS ATTACHED W/6d COMMON NAILS OR 8d (2 1/2" LONG x Ø.113" DIAMETER) NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD (U.N.O.,


GB REFERS TO THE "GYPSUM BOARD" WALL BRACING METHOD. 1/2" (MIN.) GYPSUM WALL BOARD IS TO BE INSTALLED ON BOTH SIDES OF THE BRACED WALL FASTENED WITH 1 1/4" SCREWS OR 1 5/8" NAILS SPACED 1" O.C. ALONG PANEL EDGES INCLUDING TOP AND BOTTOM PLATES AND INTERMEDIATE SUPPORTS (U.N.O.). VERIFY ALL FASTENER OPTIONS FOR 1/2" AND 5/8" GYPSUM PRIOR TO CONSTRUCTION. FOR INTERIOR FASTENER OPTIONS SEE TABLE R7/02.3.5. FOR EXTERIOR FASTENER OPTIONS SEE TABLE R602.3(1). EXTERIOR GB TO BE INSTALLED VERTICALLY.

REQUIRED BRACED WALL LENGTH FOR EACH SIDE OF THE CIRCUMSCRIBED RECTANGLE ARE INTERPOLATED PER TABLE R602. 10.3. METHOD CS-WSP CONTRIBUTES ITS ACTUAL LENGTH, METHOD GB CONTRIBUTES .5 ITS ACTUAL LENGTH, AND METHOD PF CONTRIBUTES 1.5 TIMES ITS ACTUAL LENGTH.

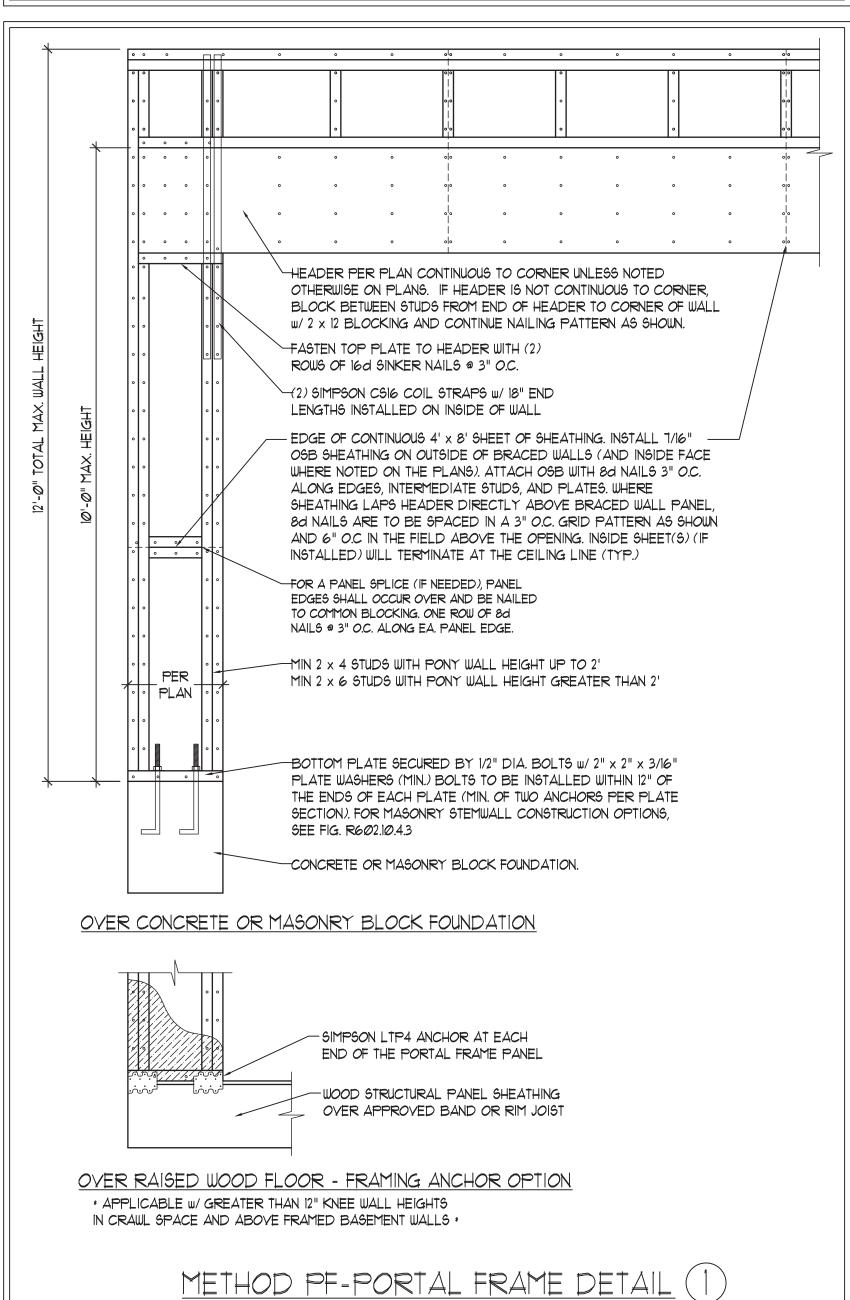


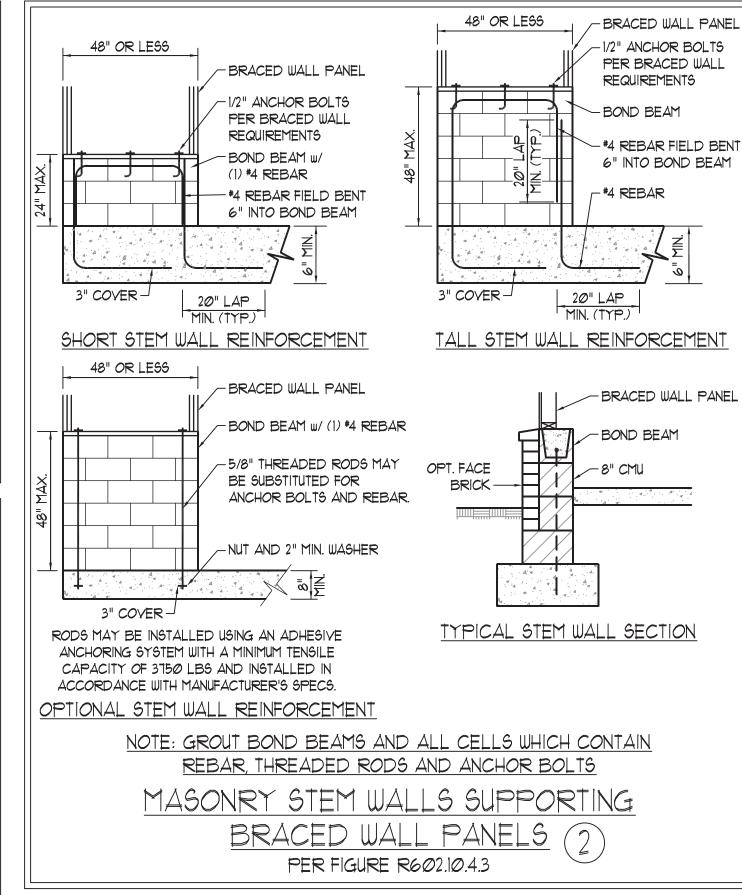


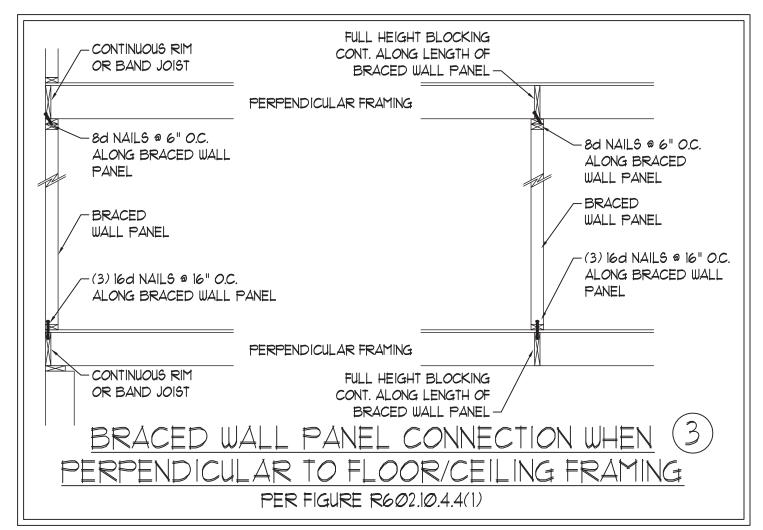

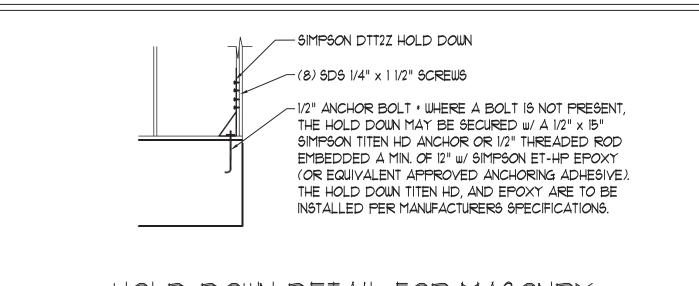

HOLD DOWN DETAIL FOR MASONRY FOUNDATION OR MONOLITHIC SLAB \* APPLICABLE ONLY WHERE SPECIFIED ON PLAN !

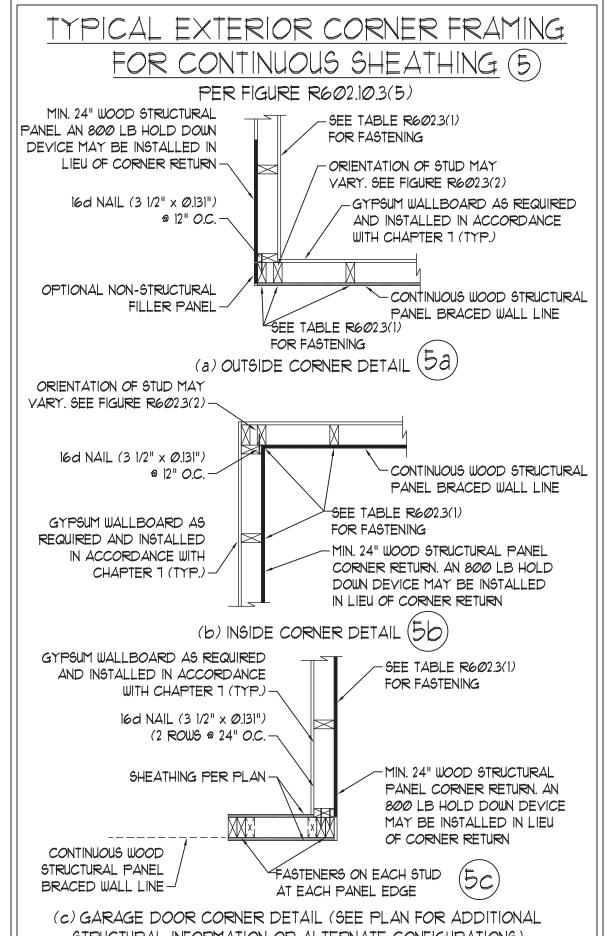

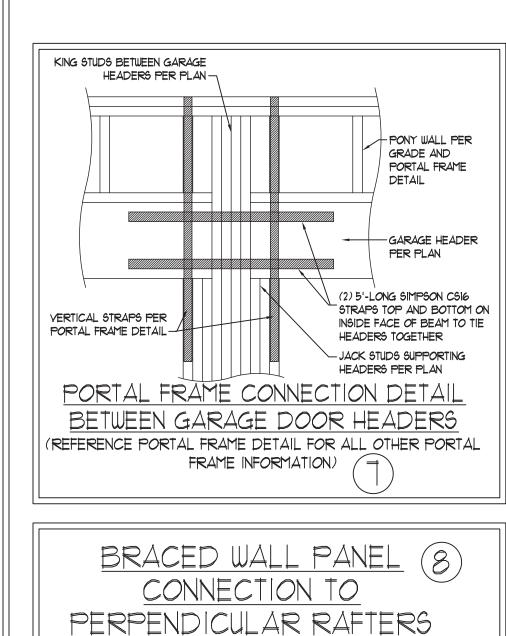

PER FIGURE R602.10.4.5(1)

FOR HEEL HEIGHTS LESS

THAN OR EQUAL TO 9.25"

NO BLOCKING REQUIRED


SOLID BLOCKING BETWEEN


ATTACHED TO TOP PLATES WITH

8d NAILS 6" O.C. ALONG LENGTH

RAFTERS OR TRUSSES


OF BRACED WALL PANEL

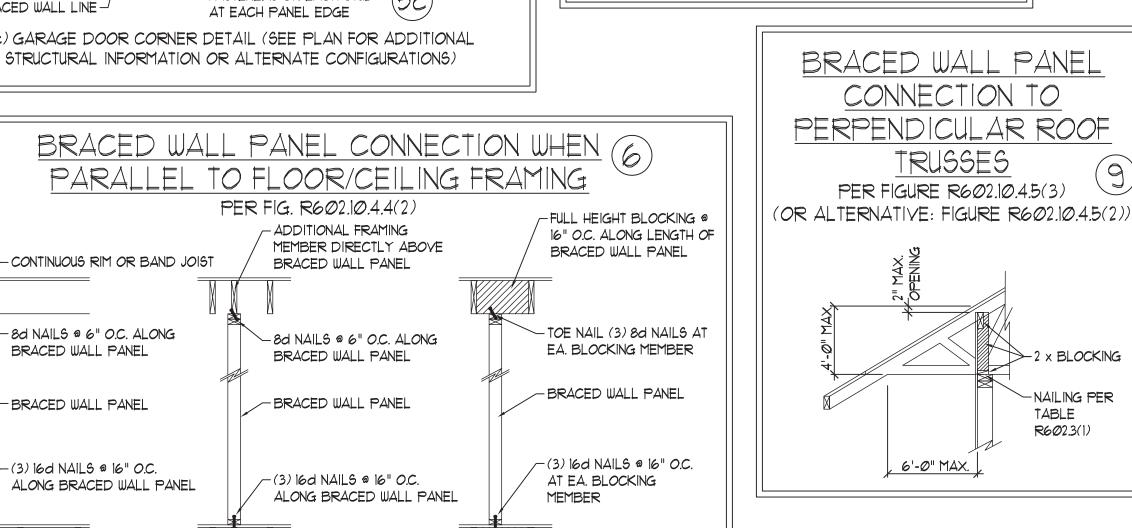

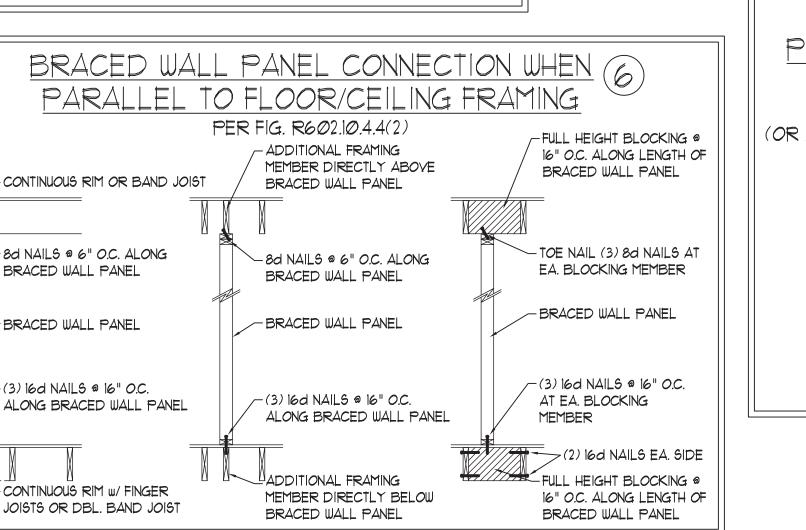

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

33736 11/3/2020

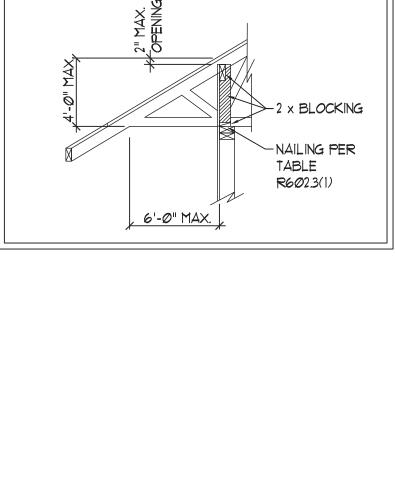

### GENERAL NOTES

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS, HEADERS, COLUMNS, CANTILEVERS, OFFSET LOAD BEARING WALLS, PIERS, GIRDER SYSTEM AND FOOTING. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OF ARCHITECTURAL LAYOUT INCLUDING ROOF. ENGINEER'S SEAL DOES NOT APPLY TO 1-JOIST OR FLOOR/ROOF TRUSS LAYOUT DESIGN AND ACCURACY.
- 2. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE (NCRC), 2018 EDITION, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTORS FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- 3. STRUCTURAL DESIGN BASED ON THE PROVISIONS OF THE NCRC, 2018 EDITION (R301.4 R301.7)

DESIGN CRITERIA:	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (IN)	
ATTIC WITH LIMITED STORAGE	2Ø	10	L/240 (L/360 w/ BRITTLE FINISHES)	
ATTIC WITHOUT STORAGE	10	10	L/360	
DECKS	40	10	L/360	
EXTERIOR BALCONIES	40	10	L/360	
FIRE ESCAPES	40	10	L/360	
HANDRAILS/GUARDRAILS	200 LB OR 50 (PLF)	10	L/360	
PASSENGER VEHICLE GARAGE	50	10	L/360	
ROOMS OTHER THAN SLEEPING ROOM	40	10	L/360	
SLEEPING ROOMS	3Ø	10	L/360	
STAIRS	40	10	L/360	
WIND LOAD	(BASED ON TABLE R3Ø1.2(4) WIND ZONE AND EXPOSURE)			
GROUND SNOW LOAD: Pg	20 (PSF)			

- I-JOIST SYSTEMS DESIGNED WITH 12 PSF DEAD LOAD AND DEFLECTION (IN) OF L/480 - FLOOR TRUSS SYSTEMS DESIGNED WITH 15 PSF DEAD LOAD
- 4. FOR 115 AND 120 MPH WIND ZONES, FOUNDATION ANCHORAGE 15 TO COMPLY WITH SECTION R403.1.6 OF THE NCRC, 2018 EDITION. FOR 130 MPH, 140 MPH, AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION 4504 OF THE NCRC, 2018 EDITION.
- 5. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NCRC, 2018 EDITION.

#### FOOTING AND FOUNDATION NOTES

- 1. FOUNDATION DESIGN BASED ON A MINIMUM ALLOWABLE BEARING CAPACITY OF 2000 PSF. CONTACT GEOTECHNICAL ENGINEER IF BEARING CAPACITY IS NOT ACHIEVED.
- 2. FOR ALL CONCRETE SLABS AND FOOTINGS, THE AREA WITHIN THE PERIMETER OF THE BUILDING ENVELOPE SHALL HAVE ALL VEGETATION, TOP SOIL AND FOREIGN MATERIAL REMOVED. FILL MATERIAL SHALL BE FREE OF VEGETATION AND FOREIGN MATERIAL. THE FILL SHALL BE COMPACTED TO ASSURE UNIFORM SUPPORT OF THE SLAB, AND EXCEPT WHERE APPROVED, THE FILL DEPTHS SHALL NOT EXCEED 24" FOR CLEAN SAND OR GRAVEL. A 4" THICK BASED COURSE CONSISTING OF CLEAN GRADED SAND OR GRAVEL SHALL BE PLACED. A BASE COURSE IS NOT REQUIRED WHERE A CONCRETE SLAB IS INSTALLED ON WELL-DRAINED OR SAND-GRAVEL MIXTURE SOILS CLASSIFIED AS GROUP I, ACCORDING TO THE UNITED SOIL CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R405.1 OF THE NCRC, 2018 EDITION.
- 3. PROPERLY DEWATER EXCAVATION PRIOR TO POURING CONCRETE WHEN BOTTOM OF CONCRETE SLAB IS AT OR BELOW WATER TABLE. IF APPLICABLE, 3/4" - 1" DEEP CONTROL JOINTS ARE TO BE SAWED WITHIN 4 TO 12 HOURS OF CONCRETE FINISHING AND WALL LOCATIONS HAVE BEEN MARKED. ADJUST WHERE NECESSARY.
- 4. CONCRETE SHALL CONFORM TO SECTION R402.2 OF THE NCRC, 2018 EDITION, CONCRETE REINFORCING STEEL TO BE ASTM A615 GRADE 60. WELDED WIRE FABRIC TO BE ASTM A185. MAINTAIN A MINIMUM CONCRETE COVER AROUND REINFORCING STEEL OF 3" IN FOOTINGS AND 1 1/2" IN SLABS. FOR POURED CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE INSIDE FACE OF THE WALL SHALL NOT BE LESS THAN 3/4". CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE OUTSIDE FACE OF THE WALL SHALL NOT BE LESS THAN 1 1/2" FOR #5 BARS OR SMALLER, AND NOT LESS THAN 2" FOR #6 BARS OR LARGER.
- 5. MASONRY UNITS TO CONFORM TO ACE 530/ASCE 5/TMS 402. MORTAR SHALL COMFORM TO ASTM C270.
- 6. THE UNSUPPORTED HEIGHT OF MASONRY PIERS SHALL NOT EXCEED FOUR TIMES THEIR LEAST DIMENSION FOR UNFILLED HOLLOW CONCRETE MASONRY UNITS AND TEN TIMES THEIR LEAST DIMENSION FOR SOLID OR SOLID FILLED PIERS. PERS MAY BE FILLED SOLID WITH CONCRETE OR TYPE M OR 5 MORTAR PIERS AND WALLS SHALL BE CAPPED WITH 8" OF SOLID MASONRY
- 1. THE CENTER OF EACH OF THE PIERS SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING. EACH GIRDER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS.
- 8. ALL CONCRETE AND MASONRY FOUNDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION R404 OF THE NCRC, 2018 EDITION OR IN ACCORDANCE WITH ACI 318, ACI 332, NCMA TR68-A OR ACE 530/ASCE 5/TMS 402. MASONRY FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R404.1.1(1), R404.1.1(2), R404.1.1(3), OR R404.1.1(4) OF THE NCRC, 2018 EDITION. CONCRETE FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R404.1.1(5) OF THE NCRC, 2018 EDITION. STEP CONCRETE FOUNDATION WALLS TO 2 x 6 FRAMED WALLS AT 16" O.C. WHERE GRADE PERMITS (UNO).

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

#### FRAMING NOTES

- 1. ALL FRAMING LUMBER SHALL BE #2 SPF MINIMUM (Fb = 875 PSI, Fv = 375 PSI, E = 1600000 PSI) UNLESS NOTED OTHERWISE (UNO). ALL TREATED LUMBER SHALL BE #2 SYP MINIMUM (Fb = 975 PSI, Fv = 175 PSI, E = 1600000 PSI) UNLESS NOTED OTHERWISE (UNO).
- LAMINATED VENEER LUMBER (LVL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fb =2600 PSI, Fv = 285 PSI, E = 1900000 PSI. LAMINATED STRAND LUMBER (LSL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fb = 2325 PSI, Fv = 310 PSI, E = 1550000 PSI. PARALLEL STRAND LUMBER (PSL) UP TO 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fc = 2500 PSI, E = 1800000 PSI. PARALLEL STRAND LUMBER (PSL) MORE THAN 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fc = 2900 PSI, E = 20000000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S SPECIFICATIONS.
- 3. STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS

W AND WT SHAPES: ASTM A992 CHANNELS AND ANGLES: ASTM A36 ASTM A36 PLATES AND BARS: HOLLOW STRUCTURAL SECTIONS: ASTM A500 GRADE B ASTM A53, GRADE B, TYPE E OR S STEEL PIPE:

4. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH (UNO). PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED AT THE BOTTOM FLANGE TO EACH SUPPORT AS FOLLOWS (UNO):

A. WOOD FRAMING (2) 1/2" DIA. x 4" LONG LAG SCREWS B. CONCRETE (2) 1/2" DIA. x 4" WEDGE ANCHORS C. MASONRY (FULLY GROUTED) (2) 1/2" DIA. x 4" LONG SIMPSON TITEN HD ANCHORS

LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOISTS ARE TOE NAILED TO THE 2x NAILER ON TOP OF THE STEEL BEAM, AND THE 2x NAILER IS SECURED TO THE TOP OF THE STEEL BEAM w/ (2) ROWS OF SELF TAPPING SCREWS @ 16" O.C. OR (2) ROWS OF 1/2" DIAMETER BOLTS @ 16" O.C. IF 1/2" BOLTS ARE USED TO FASTEN THE NAILER, THE STEEL BEAM SHALL BE FABRICATED W/ (2) ROWS OF 9/16" DIAMETER HOLES @ 16" O.C.

- 5. SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION, SHADED SQUARES DENOTE POINT LOADS FROM ABOVE WHICH REQUIRE SOLID BLOCKING TO SUPPORTING MEMBER BELOW.
- 6. ALL LOAD BEARING HEADERS TO CONFORM TO TABLE R602,7(1) AND R602,7(2) OF THE NCRC, 2018 EDITION OR BE (2) 2 x 6 WITH (1) JACK AND (1) KING STUD EACH END (UNO), WHICHEVER IS GREATER ALL HEADERS TO BE SECURED TO EACH JACK STUD WITH (4) 8d NAILS. ALL BEAMS TO BE SUPPORTED WITH (2) STUDS AT EACH BEARING POINT (UNO). INSTALL KING STUDS PER SECTION R602.7.5 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- 1. ALL BEAMS, HEADERS, OR GIRDER TRUSSES PARALLEL TO WALL ARE TO BEAR FULLY ON (1) JACK OR (2) STUDS MINIMUM OR THE NUMBER OF JACKS OR STUDS NOTED. ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY (3) STUDS OR LESS ARE TO HAVE 1 1/2" MINIMUM BEARING (UNO). ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY MORE THAN (3) STUDS OR OTHER NOTED COLUMN ARE TO BEAR FULLY ON SUPPORT COLUMN FOR ENTIRE WALL DEPTH (UNO). BEAM ENDS THAT BUTT INTO ONE ANOTHER ARE TO EACH BEAR EQUAL LENGTHS (UNO).
- 8. FLITCH BEAMS SHALL BE BOLTED TOGETHER USING 1/2" DIAMETER BOLTS (ASTM A3ØT) WITH WASHERS PLACED AT THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" CENTERS (MAXIMUM), AND STAGGERED AT TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH (2) BOLTS LOCATED AT 6" FROM EACH END (UNO).
- 9. ALL I-JOIST OR TRUSS LAYOUTS ARE TO BE IN COMPLIANCE WITH THE OVERALL DESIGN SPECIFIED ON THE PLANS. ALL DEVIATIONS ARE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO INSTALLATION.
- 10. BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO THE NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION WALL BRACING CRITERIA. THE AMOUNT, LENGTH, AND LOCATION OF BRACING SHALL COMPLY WITH ALL APPLICABLE TABLES IN SECTION R602.10.
- 11. PROVIDE DOUBLE JOIST UNDER ALL WALLS PARALLEL TO FLOOR JOISTS. PROVIDE SUPPORT UNDER ALL WALLS PARALLEL TO FLOOR TRUSSES OR I-JOISTS PER MANUFACTURER'S SPECIFICATIONS. INSTALL BLOCKING BETWEEN JOISTS OR TRUSSES FOR POINT LOAD SUPPORT FOR ALL POINT LOADS ALONG OFFSET LOAD LINES.
- 12. FOR ALL HEADERS SUPPORTING BRICK VENEER THAT ARE LESS THAN 8'-0" IN LENGTH, REST A 6" x 4" x 5/16" STEEL ANGLE WITH 6" MINIMUM EMBEDMENT AT SIDES FOR BRICK SUPPORT (UN.O.). FOR ALL HEADERS 8'-Ø" AND GREATER IN LENGTH, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO HEADER WITH 1/2" LAG. SCREWS AT 12" O.C. STAGGERED FOR BRICK SUPPORT. FOR ALL BRICK SUPPORT AT ROOF LINES, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x 10 BLOCKING INSTALLED w/ (4) 12d NAILS EA. PLY BETWEEN WALL STUDS WITH (2) ROWS OF 1/2" LAG SCREWS AT 12" O.C. STAGGERED AND IN ACCORDANCE WITH SECTION RT03.8.2.1 OF THE NCRC, 2018 EDITION.
- 13. FOR STICK FRAMED ROOFS: CIRCLES DENOTE (3) 2 x 4 POSTS FOR ROOF MEMBER SUPPORT. HIP SPLICES ARE TO BE SPACED A MINIMUM OF 8'-0". FASTEN MEMBERS WITH THREE ROWS OF 12d NAILS AT 16" O.C. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS AS SHOWN (UNO).
- 14. FOR TRUSSED ROOFS: FRAME DORMER WALLS ON TOP OF 2 x 4 LADDER FRAMING AT 24" O.C. BETWEEN ADJACENT ROOF TRUSSES. STICK FRAME OVER-FRAMED ROOF SECTIONS WITH 2 x 8 RIDGES, 2 x 6 RAFTERS AT 16" O.C. AND FLAT 2 x 10 YALLEYS (UNO).
- 15. ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY UPLIFT CONNECTORS TOP AND BOTTOM (UNO.) POSTS MAY BE SECURED USING ONE SIMPSON HE OR LTS12 UPLIFT CONNECTOR FASTENED TO THE BAND AT THE BOTTOM AND THE BEAM AT THE TOP OF EACH POST. ONE 16" SECTION OF SIMPSON CS16 COIL STRAPPING WITH (8) 8d HDG NAILS AT EACH END MAY BE USED IN LIEU OF EACH TWIST STRAP IF DESIRED. FOR MASONRY OR CONCRETE FOUNDATION USE SIMPSON POST BASE.



DATE: OCTOBER 29, 2018

SCALE: 1/4" = 1'-0"

ENGINEERED BY: JST

DRAWN BY: JES

STRUCTURAL NOTES

33736 11/3/2020