

Harnett County Department of Public Health

PERMIT # SFD2103-0057

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 300 GRACE JOHNSON RD. (521434)

Name: (owner) BAZECOST BLDG CO SUBDIVISION _____ LOT # _____

System Installer: KIMBY JOHNSON


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 50+ feet

System Type: 25% REDUCTION SYSTEM IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

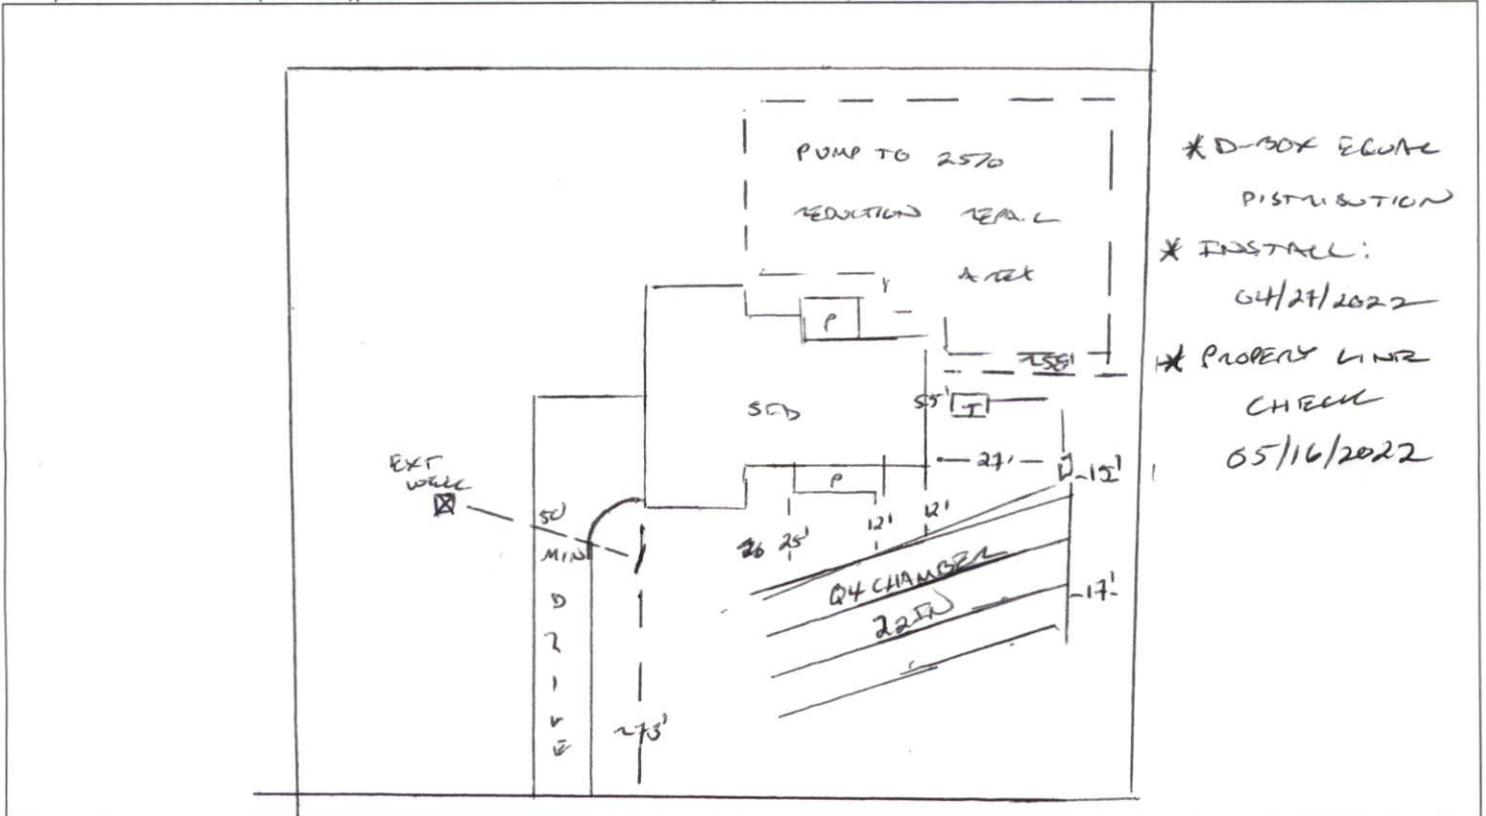

* D-BOX EQUAL DISTRIBUTION
 * INSTALL: 04/27/2022
 * PROPERTY LINE CHECK 05/16/2022

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: *As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Q4 CHAMBER IIIg Septic Tank: 1250 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length 74, 74, width of depth of
 Drainage Field ditches 4 of each ditch 74, 74 feet ditches 3 feet ditches 22 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 05/16/2022