

Client:

Project: Address: Ben Stout Real Estate


2/23/2021

Input by: David Landry Job Name: Lot 5 Spartan Ridge Project #: J0221-0897

Page 1 of 2

Kerto-S LVL 2-Ply - PASSED 1.750" X 14.000" **GDH**

Level: Level

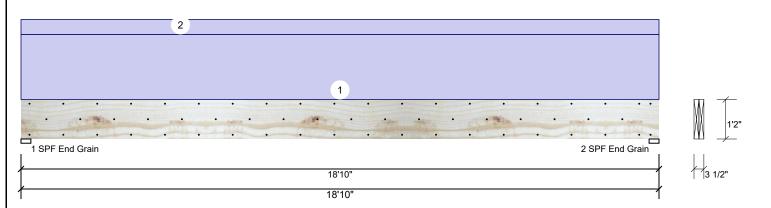

Member Information						Reactions UNPATTERNED Ib (Uplift)							
Туре:	Girder		Application	on:	Floor		Brg	Live	Dead	d Snow		Wind	Const
Plies:	2		Design M	/lethod:	ASD		1	0	2363	3 0		0	0
Moisture Condition	ı: Dry		Building	Code:	IBC/IRC 2015		2	0	2363	3 0		0	0
Deflection LL:	480		Load Sha	aring:	No								
Deflection TL:	360		Deck:	I	Not Checked								
Importance:	Normal												
Temperature:	Temp <= 10	0°F											
							Bearing	S					
							Bearing	Length	Сар.	React D/L lb	Total	Ld. Case	Ld. Com
							1 - SPF End	3.500"	22%	2363 / 0	2363	Uniform	D
Analysis Resul	ts						Grain						
Analysis Ad	tual	Location	Allowed	Capacity	Comb.	Case	2 - SPF	3.500"	22%	2363 / 0	2363	Uniform	D
Moment 10	589 ft-lb	9'5"	24299 ft-lb	0.436 (449	%) D	Uniform	End Grain						
Unbraced 10	589 ft-lb	9'5"	10593 ft-lb	1.000 (100%)	D	Uniform							

Uniform

Uniform

Design Notes

Shear

1 Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".

1'4 3/4" 9408 lb

0.214 (21%) D

0 999.000 (L/0) 0.000 (0%)

9'5 1/16" 0.612 (L/360) 0.700 (70%) D

- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be laterally braced at a maximum of 10'1 1/2" o.c.
- 6 Bottom braced at bearings.

2012 lb

LL Defl inch 0.000 (L/999)

TL Defl inch 0.427 (L/516)

7 Lateral slenderness ratio based on single ply width

/ Lateral Sierius	erriess ratio based oir sirigle	piy widiii.									
ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6	Const. 1.25	Comments	
1	Uniform			Тор	195 PLF	0 PLF	0 PLF	0 PLF	0 PLF	B1GE	
2	Uniform			Тор	45 PLF	0 PLF	0 PLF	0 PLF	0 PLF	Wall Above	
	Self Weight				11 PLF						

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

- Dry service conditions, unless noted otherwise
 LVL not to be treated with fire retardant or corrosive
- Handling & Installation
- LVL beams must not be cut or drilled
 Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals

 2 Damaged Beams must not be used
- Danaged Beams must not be used
 Design assumes top edge is laterally restrained
 Provide lateral support at bearing points to avoid
 lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Metsä Wood 301 Merritt 7 Building, 2nd Floor Norwalk, CT 06851 (800) 622-5850 www.metsawood.com/us ICC-ES: ESR-3633

Manufacturer Info

Comtech, Inc. 1001 S. Reilly Road, Suite #639 Fayetteville, NC USA 28314 910-864-TRUS



This design is valid until 2/26/2023 CSD DESIGN isDesign

Client: Ben Stout Real Estate


Project: Address: Date: 2/23/2021

Input by: David Landry Job Name: Lot 5 Spartan Ridge Project #: J0221-0897

Page 2 of 2

Kerto-S LVL 1.750" X 14.000" 2-Ply - PASSED **GDH**

Level: Level

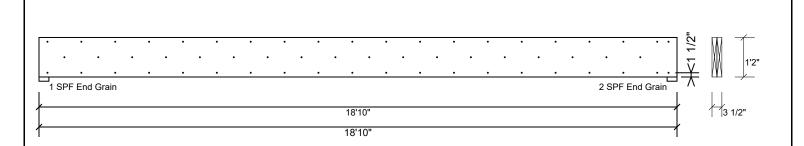

Multi-Ply Analysis

Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6"

, ,		`	,
Capacity	0.0 %		
Load	0.0 PLF		
Yield Limit per Foot	245.6 PLF		
Yield Limit per Fastener	81.9 lb.		
Yield Mode	IV		
Edge Distance	1 1/2"		
Min. End Distance	3"		
Load Combination			
Duration Factor	1.00		

Notes

NOtes
Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

- Dry service conditions, unless noted otherwise
 LVL not to be treated with fire retardant or corrosive

Handling & Installation

- Handling & Installation

 1. UVI beams must not be cut or drilled

 2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals

 3. Damaged Beams must not be used

 4. Design assumes top edge is laterally restrained

 5. Provide lateral support at bearing points to avoid lateral displacement and rotation

For flat roofs provide proper drainage to prevent ponding

Metsä Wood 301 Merritt 7 Building, 2nd Floor Norwalk, CT 06851 (800) 622-5850 www.metsawood.com/us ICC-ES: ESR-3633

Manufacturer Info

Comtech, Inc. 1001 S. Reilly Road, Suite #639 Fayetteville, NC USA 28314 910-864-TRUS



This design is valid until 2/26/2023