

RE: J0321-1587
Lot 14 Forest Ridge

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Customer: Project Name: J0321-1587
Lot/Block: Model:
Address: Subdivision:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.3
Wind Code: N/A Wind Speed: N/A mph
Roof Load: N/A psf Floor Load: 55.0 psf

This package includes 11 individual, dated Truss Design Drawings and 0 Additional Drawings.

| No. | Seal# | Truss Name | Date |
|-----|-----------|------------|-----------|
| 1 | E15484788 | ET-1 | 3/11/2021 |
| 2 | E15484789 | ET-2 | 3/11/2021 |
| 3 | E15484790 | F1 | 3/11/2021 |
| 4 | E15484791 | F2 | 3/11/2021 |
| 5 | E15484792 | F3 | 3/11/2021 |
| 6 | E15484793 | F4 | 3/11/2021 |
| 7 | E15484794 | F5 | 3/11/2021 |
| 8 | E15484795 | F6 | 3/11/2021 |
| 9 | E15484796 | F7 | 3/11/2021 |
| 10 | E15484797 | F8 | 3/11/2021 |
| 11 | E15484798 | F9 | 3/11/2021 |

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2021.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



March 11, 2021

| | | | | | | |
|------------|-------|-----------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484788 |
| J0321-1587 | ET-1 | Floor Supported Gable | 1 | 1 | Job Reference (optional) | |


Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:51 2021 Page 1
 ID:UseLIZXJndaeTVmvuhGhGzcPnY-ftg_5Qq1jdFmhjSMep_V7w?1hyllMzGDAVpffHEzcJzs

0-1-8

0-1-8

Scale = 1:62.9

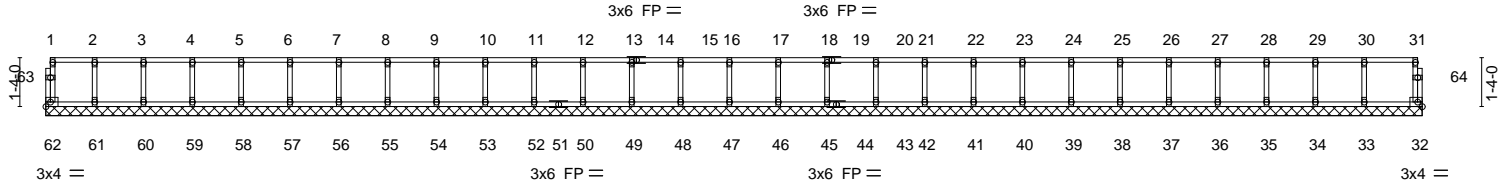

37-7-0
37-7-0

| | | | | | | | | | | |
|----------------------|----------------------|-------|-------------|--------------|------|-------|--------|-----|----------------|-----------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 40.0 | Plate Grip DOL | 1.00 | TC 0.09 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.00 | BC 0.01 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.03 | Horz(CT) | 0.00 | 32 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | | Matrix-R | | | | | | Weight: 161 lb | FT = 20%F, 11%E |

LUMBER-
 TOP CHORD 2x4 SP No.1 (flat)
 BOT CHORD 2x4 SP No.1 (flat)
 WEBS 2x4 SP No.3 (flat)
 OTHERS 2x4 SP No.3 (flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 37-7-0.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 62, 32, 61, 60, 59, 58, 57, 56, 55, 54, 53, 52, 50, 49, 48, 47, 46, 45, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 33

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|-----------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484789 |
| J0321-1587 | ET-2 | Floor Supported Gable | 1 | 1 | Job Reference (optional) | |


Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:52 2021 Page 1
ID:UseLIZXJndaeTVmvuhGhGzcPnY-7sRMJmrfUxNdJt1ZCWVkg7XDrMH_4QXMP9ZDpgzCzr

0₁8

0₁8

Scale = 1:23.4

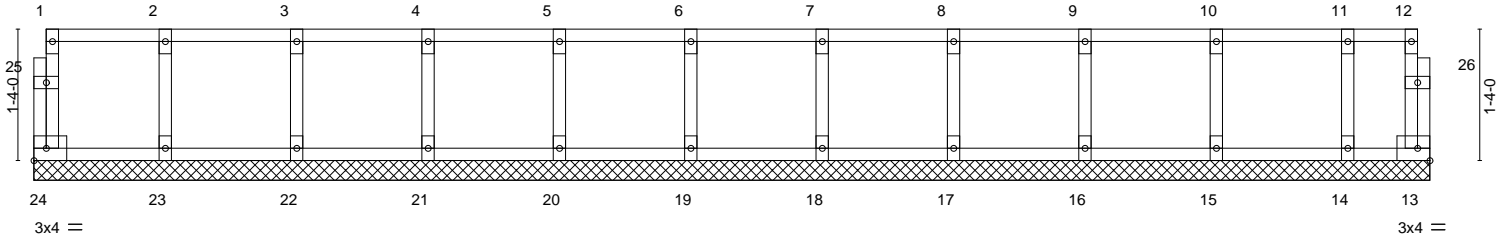


| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|-----------------|
| TCLL 40.0 | Plate Grip DOL | 1.00 | TC 0.06 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.00 | BC 0.01 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.03 | Horz(CT) | 0.00 | 13 | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | | Matrix-R | | | | | Weight: 64 lb | FT = 20%F, 11%E |

| LUMBER- | BRACING- |
|------------------------------|---|
| TOP CHORD 2x4 SP No.1 (flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1 (flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.3 (flat) | |
| OTHERS 2x4 SP No.3 (flat) | |

REACTIONS. All bearings 14-2-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 24, 13, 23, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

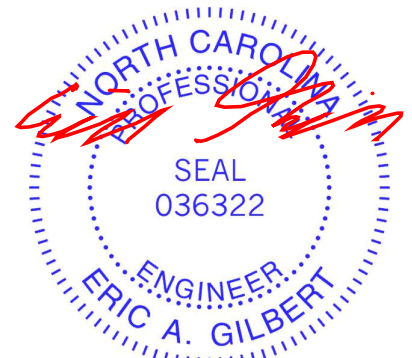

March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484790 |
| J0321-1587 | F1 | Floor | 7 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:53 2021 Page 1
ID:UseLIZXJndaeTVmvuhGIhGzcPnY-b2?kW6sHFEVUw0blmE0zCL4E2mTKphcWdpImM6zcJzq

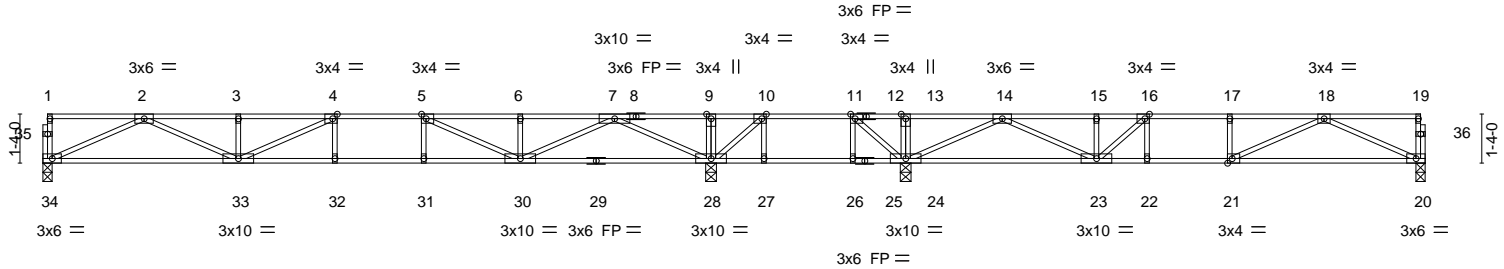

| | |
|-----------------------|--|
| Plate Offsets (X,Y)-- | [4:0-1-8,Edge], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [16:0-1-8,Edge], [21:0-1-8,Edge] |
|-----------------------|--|

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|----------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.67 | Vert(LL) -0.28 | 32-33 | >771 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.64 | Vert(CT) -0.37 | 32-33 | >585 | 360 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.75 | Horz(CT) 0.05 | 20 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | | |
| | | | | | | | Weight: 186 lb | FT = 20%F, 11%E |

| LUMBER- | BRACING- |
|--|---|
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) *Except* 29-34: 2x4 SP 2400F 2.0E(flat) | BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. |
| WEBS 2x4 SP No.3(flat) | |

REACTIONS. All bearings 0-3-0 except (it=length) 28=0-3-8, 24=0-3-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) except 34=904(LC 3), 28=1427(LC 16), 20=685(LC 4), 24=1163(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2751/0, 3-4=-2751/0, 4-5=-3061/0, 5-6=-2197/0, 6-7=-2197/0, 7-9=0/1549, 9-10=0/1544, 10-11=0/1362, 11-13=0/1453, 13-14=0/1458, 14-15=-1536/10, 15-16=-1536/10, 16-17=-1775/0, 17-18=-1775/0
BOT CHORD 33-34=0/1698, 32-33=0/3061, 31-32=0/3061, 30-31=0/3061, 28-30=-182/833, 27-28=-1362/0, 26-27=-1362/0, 24-26=-1362/0, 23-24=-383/656, 22-23=0/1775, 21-22=0/1775, 20-21=0/1222
WEBS 2-34=-1863/0, 2-33=0/1165, 3-33=-317/0, 4-33=-526/91, 7-28=-2232/0, 7-30=0/1568, 6-30=-268/27, 5-30=-1161/0, 10-28=-479/0, 11-24=-369/68, 18-20=-1340/0, 18-21=0/611, 14-24=-1751/0, 14-23=0/1076, 16-23=-669/0

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 1 degree rotation about its center.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484791 |
| J0321-1587 | F2 | Floor | 5 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:54 2021 Page 1
ID:UseLIZXJndaeTVmvuhGIhGzcPnY-3EY6kStv0YdLYAAxJxXCiYdRbAmzYAnfsT2KuZzcJzp

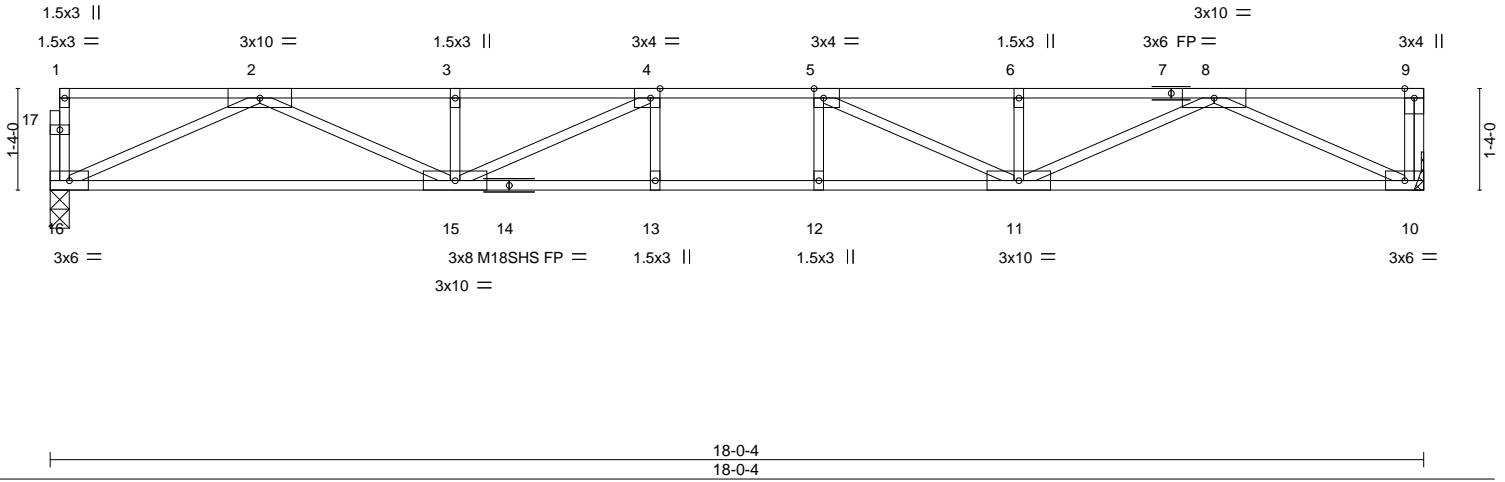



Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.55 | Vert(LL) -0.26 | 11-12 | >806 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.87 | Vert(CT) -0.35 | 11-12 | >611 | 360 | M18SHS | 244/190 |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.62 | Horz(CT) 0.06 | 10 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 90 lb | FT = 20%F, 11%E |

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 16=0-3-0, 10=Mechanical
Max Grav 16=971(LC 1), 10=977(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3024/0, 3-4=-3024/0, 4-5=-3566/0, 5-6=-3023/0, 6-8=-3023/0
BOT CHORD 15-16=0/1840, 13-15=0/3566, 12-13=0/3566, 11-12=0/3566, 10-11=0/1842
WEBS 2-16=-2020/0, 2-15=0/1309, 3-15=-303/6, 4-15=-871/0, 8-10=-2028/0, 8-11=0/1306,
6-11=-302/6, 5-11=-871/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484792 |
| J0321-1587 | F3 | Floor | 10 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:55 2021 Page 1
ID:UseLIZXJndaeTVmvuhGIhGzcPnY-XR6VxotXnsiCAKI8f2RHm9d9a86Hg9o57ntQ?zcJzo

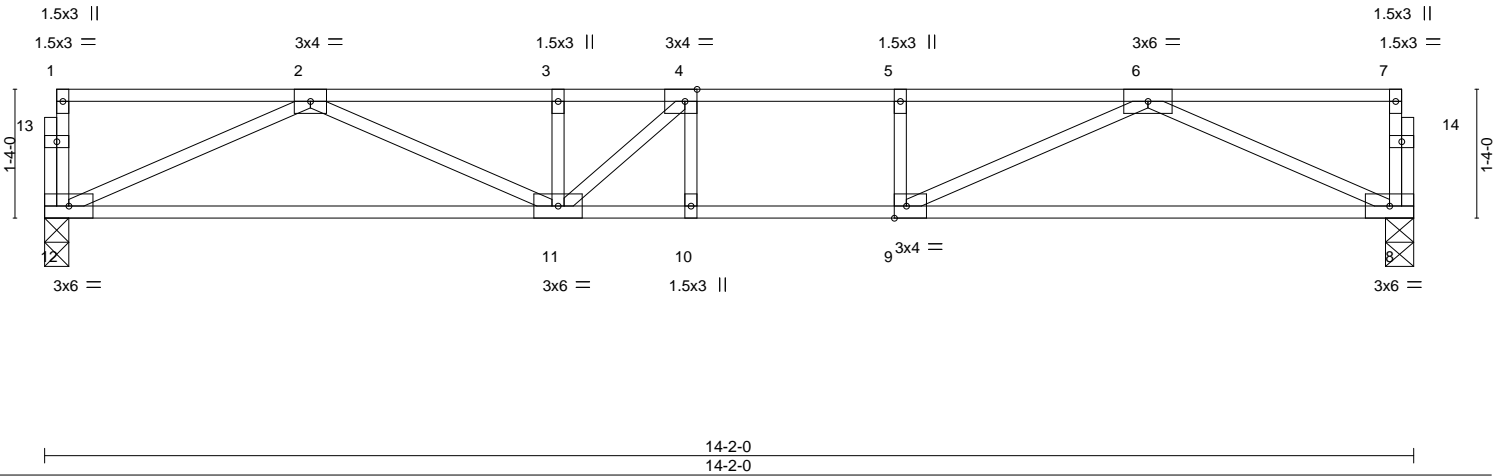



Plate Offsets (X,Y)-- [4:0-1-8,Edge], [9:0-1-8,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------|----------|--------|------|---------------|-----------------|
| TCLL 40.0 | 2-0-0 | TC 0.50 | Vert(LL) | -0.16 | 10-11 | >999 | MT20 | 244/190 |
| TCDL 10.0 | 1.00 | BC 0.75 | Vert(CT) | -0.20 | 10-11 | >819 | | |
| BCLL 0.0 | 1.00 | WB 0.42 | Horz(CT) | 0.03 | 8 | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 71 lb | FT = 20%F, 11%E |

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 12=0-3-0, 8=0-3-8
 Max Grav 12=759(LC 1), 8=759(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2108/0, 3-4=-2108/0, 4-5=-2148/0, 5-6=-2148/0
 BOT CHORD 11-12=0/1387, 10-11=0/2148, 9-10=0/2148, 8-9=0/1385
 WEBS 2-12=-1521/0, 2-11=0/797, 3-11=-270/29, 6-8=-1519/0, 6-9=0/890, 5-9=-279/0, 4-11=-387/199

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|---------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484793 |
| J0321-1587 | F4 | Floor | 1 | 1 | | |


Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:56 2021 Page 1
 ID:UseLIZXJndaeTVmvuhGhGzcPnY-0dgt97u9Y9t3nUKKRMagqzinDzTv06yyKnXQyRzcJzn



0-1-8

Scale = 1:32.4

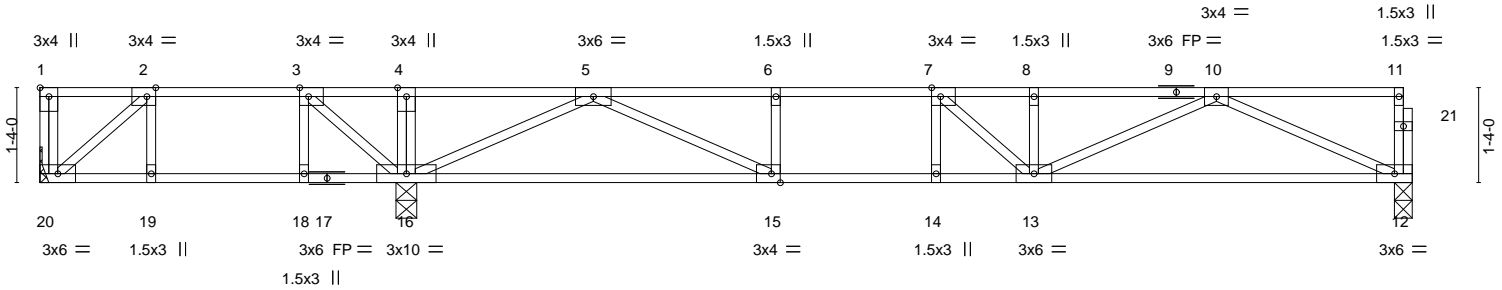

| | |
|-----------------------|---|
| Plate Offsets (X,Y)-- | [1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [7:0-1-8,Edge], [15:0-1-8,Edge] |
|-----------------------|---|


| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.55 | Vert(LL) -0.17 | 13-14 | >984 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.78 | Vert(CT) -0.22 | 13-14 | >777 | 360 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.45 | Horz(CT) 0.03 | 12 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 98 lb | FT = 20%F, 11%E |

| LUMBER- | BRACING- |
|-----------------------------|---|
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. |
| WEBS 2x4 SP No.3(flat) | |

REACTIONS. (size) 20=Mechanical, 16=0-3-8, 12=0-3-0
 Max Grav 20=267(LC 10), 16=1126(LC 8), 12=747(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=0/260, 4-5=0/265, 5-6=-2061/0, 6-7=-2061/0, 7-8=-2058/0, 8-10=-2058/0
 BOT CHORD 15-16=0/1233, 14-15=0/2061, 13-14=0/2061, 12-13=0/1360
 WEBS 2-20=-317/54, 3-16=-478/0, 10-12=-1492/0, 10-13=0/771, 8-13=-274/9, 5-16=-1530/0,
 5-15=0/951, 6-15=-315/0, 7-13=-302/211

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
 Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.

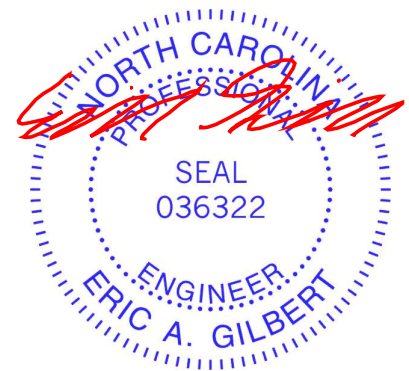

March 10, 2021

| | | | | | | |
|------------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484794 |
| J0321-1587 | F5 | Floor | 2 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:57 2021 Page 1
 ID:UseLIZXJndaeTVmvuhGhGzcPnY-UpEFMTvoJT?wPevW_35vNBFzNNSlIZ15YRG_VuzcJzm



Scale = 1:31.2


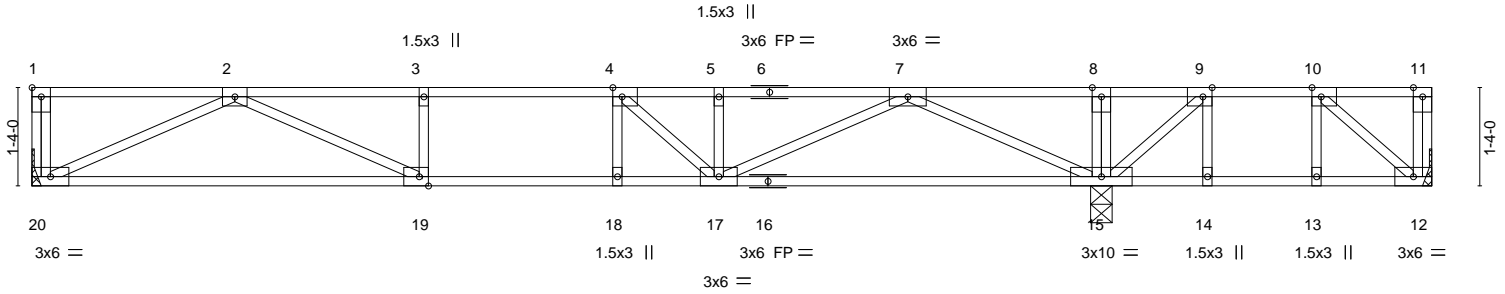


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge], [19:0-1-8,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.46 | Vert(LL) -0.15 | 17-18 | >999 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.58 | Vert(CT) -0.21 | 19-20 | >814 | 360 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.46 | Horz(CT) 0.03 | 15 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 98 lb | FT = 20%F, 11%E |

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 12=Mechanical, 20=Mechanical, 15=0-3-8
 Max Uplift 12=-97(LC 3)
 Max Grav 12=204(LC 7), 20=743(LC 10), 15=1246(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2031/0, 3-4=-2031/0, 4-5=-1839/0, 5-7=-1839/0, 7-8=0/700, 8-9=0/696
 BOT CHORD 19-20=0/1335, 18-19=0/2031, 17-18=0/2031, 15-17=0/975
 WEBS 2-20=-1469/0, 2-19=0/774, 3-19=-269/0, 7-15=-1652/0, 7-17=0/973, 4-17=-494/0,
 10-12=-186/312, 9-15=-697/0

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 1 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 97 lb uplift at joint 12.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|--------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484795 |
| J0321-1587 | F6 | Floor Girder | 1 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:35:59 2021 Page 1
ID:UseLIZXJndaeTVmvuhGhGzcPnY-QCM?n9w2r4Feex3v6U7NscKP7BfUDZeO0l4ZmzcJzk



Scale = 1:31.2

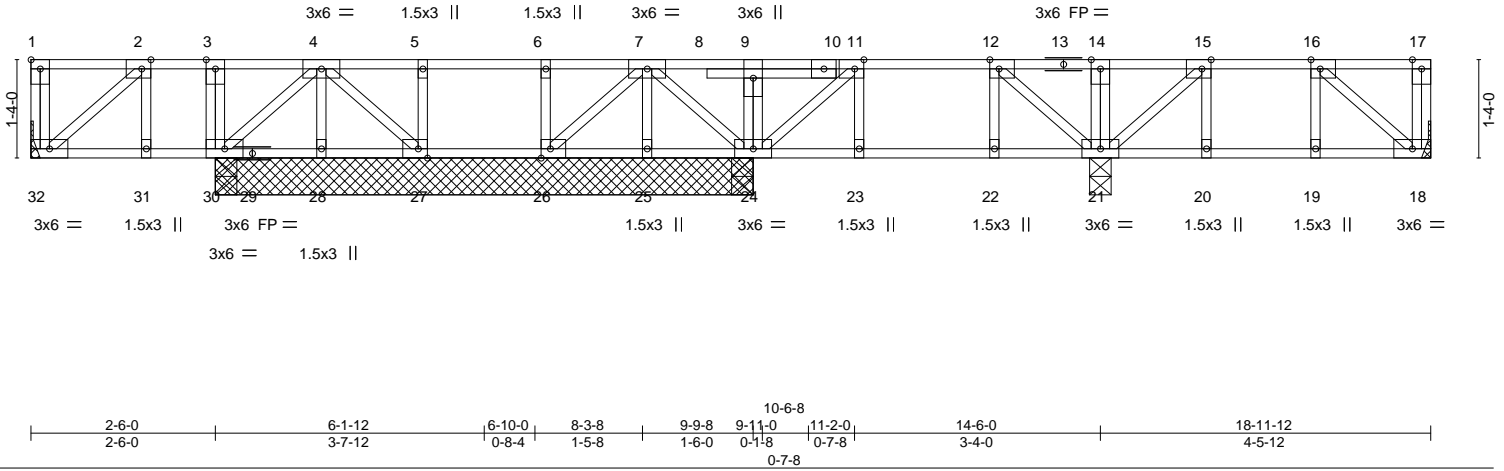


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-1-8,Edge], [11:0-1-8,Edge], [12:0-1-8,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge], [26:0-1-8,Edge], [27:0-1-8,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|----------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.12 | Vert(LL) -0.00 | 19 | >999 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.08 | Vert(CT) -0.01 | 19 | >999 | 360 | | |
| BCLL 0.0 | Rep Stress Incr NO | WB 0.07 | Horz(CT) 0.00 | 18 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | | |
| | | | | | | | Weight: 111 lb | FT = 20%F, 11%E |

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 26-27,25-26,24-25.

REACTIONS. All bearings 7-3-8 except (jt=length) 32=Mechanical, 21=0-3-8, 18=Mechanical.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 30, 30, 28, 27, 25, 26, 18 except 24=582(LC 15), 24=555(LC 1), 21=510(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 9-24=-320/0, 12-21=-289/0, 11-24=-300/0, 15-21=-282/0, 16-18=-258/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 216 lb down at 9-11-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 18-32=-10, 1-17=-100
Concentrated Loads (lb)
Vert: 9=-170(B)

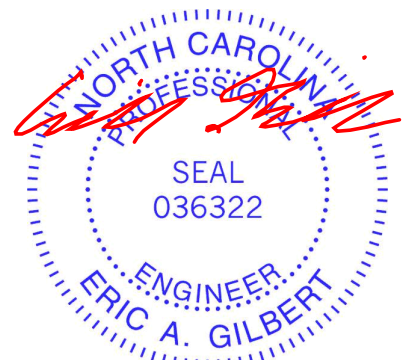

March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



| | | | | | | |
|------------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484796 |
| J0321-1587 | F7 | Floor | 11 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:36:01 2021 Page 1
ID:UseLIZXJndaeTVmvuhGihGzcPnY-MbUmCryINiVMuFDHDv9rX1Pgn_FChJYhT3EBefzcJzi

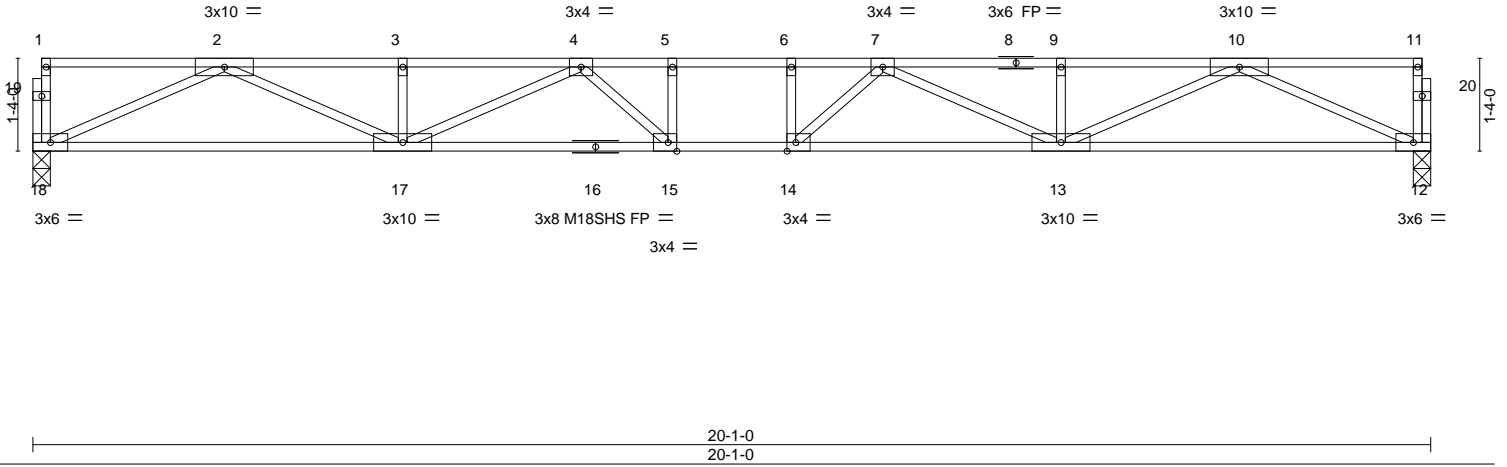



Plate Offsets (X,Y)-- [14:0-1-8,Edge], [15:0-1-8,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|----------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.37 | Vert(LL) -0.30 | 14-15 | >794 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.45 | Vert(CT) -0.41 | 14-15 | >578 | 360 | M18SHS | 244/190 |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.75 | Horz(CT) 0.07 | 12 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | | |
| | | | | | | | Weight: 101 lb | FT = 20%F, 11%E |

LUMBER-

TOP CHORD 2x4 SP 2400F 2.0E(flat)
BOT CHORD 2x4 SP 2400F 2.0E(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 18=0-3-0, 12=0-3-0
Max Grav 18=1085(LC 1), 12=1085(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3509/0, 3-4=-3509/0, 4-5=-4443/0, 5-6=-4443/0, 6-7=-4443/0, 7-9=-3509/0, 9-10=-3509/0
BOT CHORD 17-18=0/2086, 15-17=0/4274, 14-15=0/4443, 13-14=0/4274, 12-13=0/2086
WEBS 2-18=-2290/0, 2-17=0/1573, 3-17=-256/0, 4-17=-846/0, 10-12=-2290/0, 10-13=0/1573, 9-13=-256/0, 7-13=-846/0, 7-14=-162/582, 6-14=-304/64, 4-15=-162/582, 5-15=-304/64

NOTES-

- Unbalanced floor live loads have been considered for this design.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 1.5x3 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 1 degree rotation about its center.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Lot 14 Forest Ridge | E15484797 |
| J0321-1587 | F8 | Floor | 1 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:36:02 2021 Page 1
ID:UseLIZXJndaeTVmvuhGihGzcPnY-qn18PBzw8?dVVPoUndg43EyyuOhOQwRqij_IA5zcJzh



Scale = 1:16.4

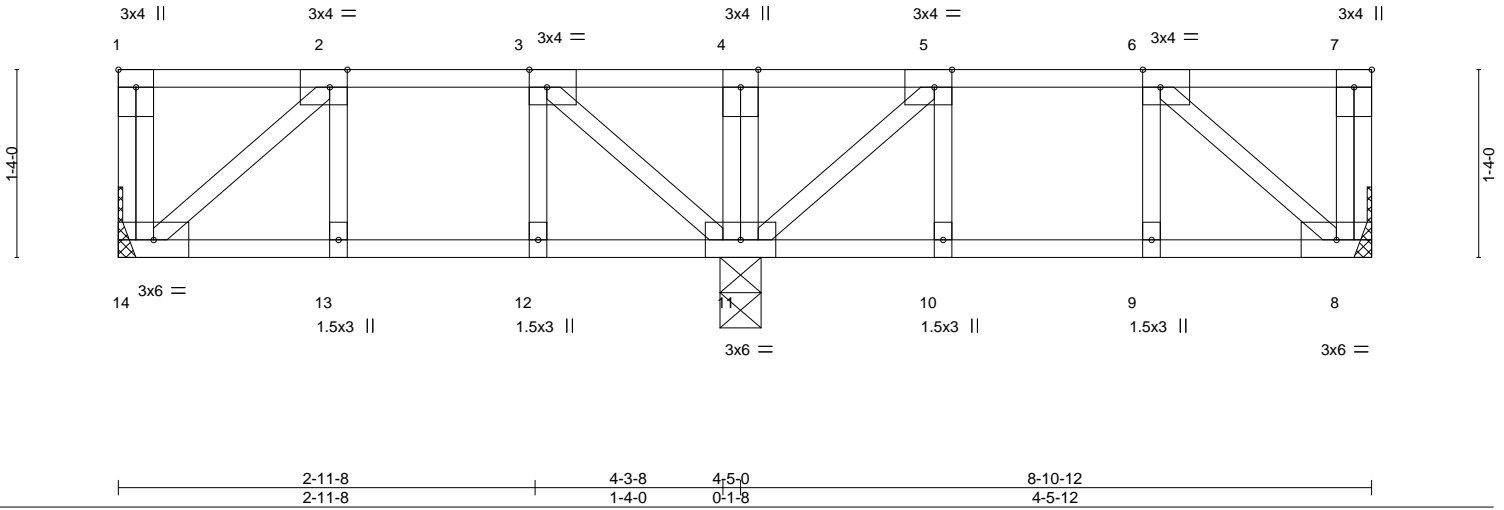


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [5:0-1-8,Edge], [6:0-1-8,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.09 | Vert(LL) -0.00 | 9 | >999 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.07 | Vert(CT) -0.01 | 9 | >999 | 360 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.07 | Horz(CT) 0.00 | 8 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 52 lb | FT = 20%F, 11%E |

LUMBER-
 TOP CHORD 2x4 SP No.1 (flat)
 BOT CHORD 2x4 SP No.1 (flat)
 WEBS 2x4 SP No.3 (flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 14=Mechanical, 8=Mechanical, 11=0-3-8
 Max Grav 14=245(LC 10), 8=247(LC 7), 11=485(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-14=-284/0, 3-11=-273/0, 6-8=-289/0, 5-11=-277/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|-------------------|-------------|----------------------------|----------|----------|---|-----------|
| Job J0321-1587 | Truss F9 | Truss Type Floor Girder | Qty 1 | Ply 1 | Lot 14 Forest Ridge Job Reference (optional) | E15484798 |
|-------------------|-------------|----------------------------|----------|----------|---|-----------|

Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Oct 7 2020 MiTek Industries, Inc. Wed Mar 10 12:36:03 2021 Page 1
ID:UseLIZXJndaeTVmvuhGhGzcPnY-lzbWdX_YuJl37ZMgLKcJcSV4?o0f9Nh_xNjliXzcJzg

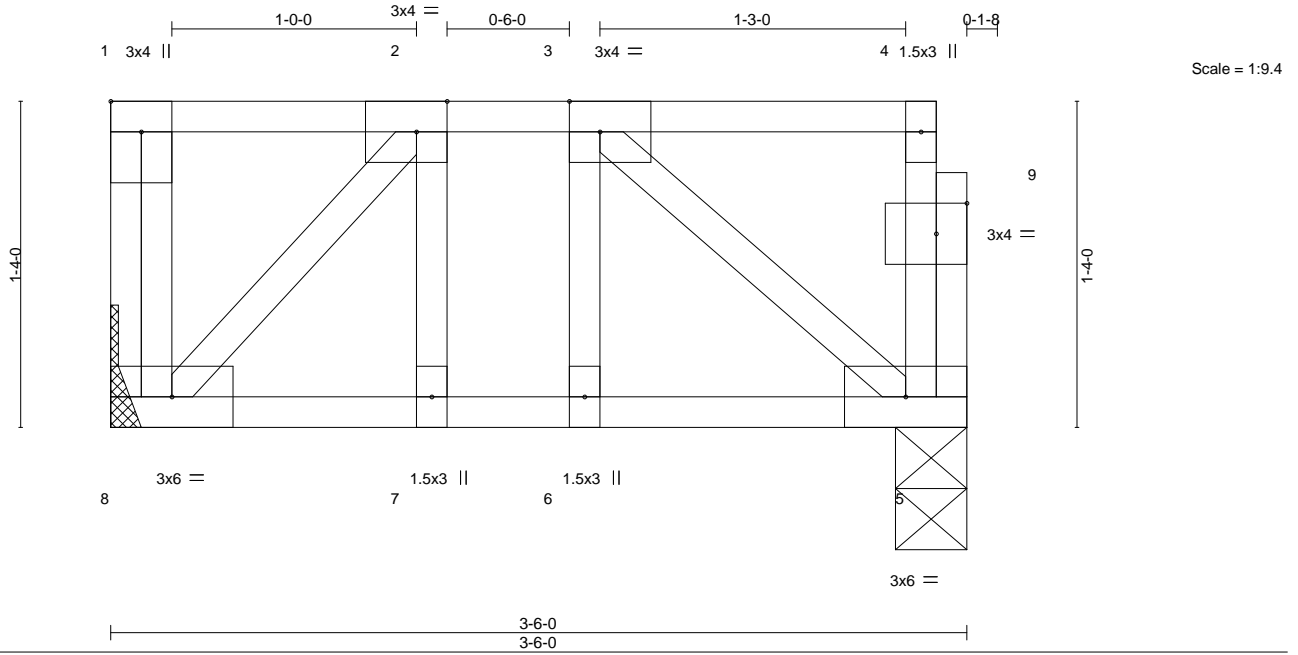


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [9:0-1-8,0-1-8]

| LOADING (psf) | SPACING- | CSL | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|-----------------|
| TCLL 40.0 | Plate Grip DOL 1.00 | TC 0.13 | Vert(LL) -0.00 | 5-6 | >999 | 480 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.00 | BC 0.13 | Vert(CT) -0.01 | 5-6 | >999 | 360 | | |
| BCLL 0.0 | Rep Stress Incr NO | WB 0.07 | Horz(CT) 0.00 | 5 | n/a | n/a | | |
| BCDL 5.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 24 lb | FT = 20%F, 11%E |

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS. (size) 8=Mechanical, 5=0-3-8
Max Grav 8=243(LC 1), 5=253(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-5=-263/0, 2-8=-292/0

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - Plates checked for a plus or minus 1 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 181 lb down at 1-10-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-8=-10, 1-4=-100
Concentrated Loads (lb)
Vert: 3=-145(F)

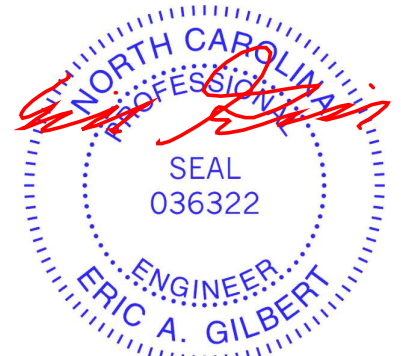

March 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate
BCSI: Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)



JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.