


QUOTE:  
1600124

**THIS LAYOUT IS INTENDED FOR THE PURPOSE OF TRUSS LOCATION AND PLACEMENT ONLY.  
REFER TO THE BUILDING PLANS FOR ACTUAL BUILDING CONSTRUCTION.**

**GENERAL NOTES:**

DO NOT CUT OR MODIFY TRUSSES.  
TRUSSES ARE SPACED 24" ON CENTER UNLESS NOTED OTHERWISE.  
REFER TO THE INDIVIDUAL TRUSS DESIGN DRAWINGS FOR THE LOCATION OF LATERAL BRACING AND MULTI-PLY CONNECTION REQUIREMENTS.  
PER ANSI TPI 1-2002 THE TRUSS ENGINEER IS RESPONSIBLE FOR TRUSS TO TRUSS CONNECTIONS AND TRUSS PLY TO PLY CONNECTIONS.  
THIS TRUSS PLACEMENT PLAN RECOMMENDS TRUSS TO BEARING CONNECTIONS AND TRUSS TO BEAM CONNECTIONS WHICH SHALL BE REVIEWED BY THE BUILDING DESIGNER. IT IS THE RESPONSIBILITY OF THE BUILDING DESIGNER TO RESOLVE ALL ROOF FORCES ADEQUATELY TO THE FOUNDATION.

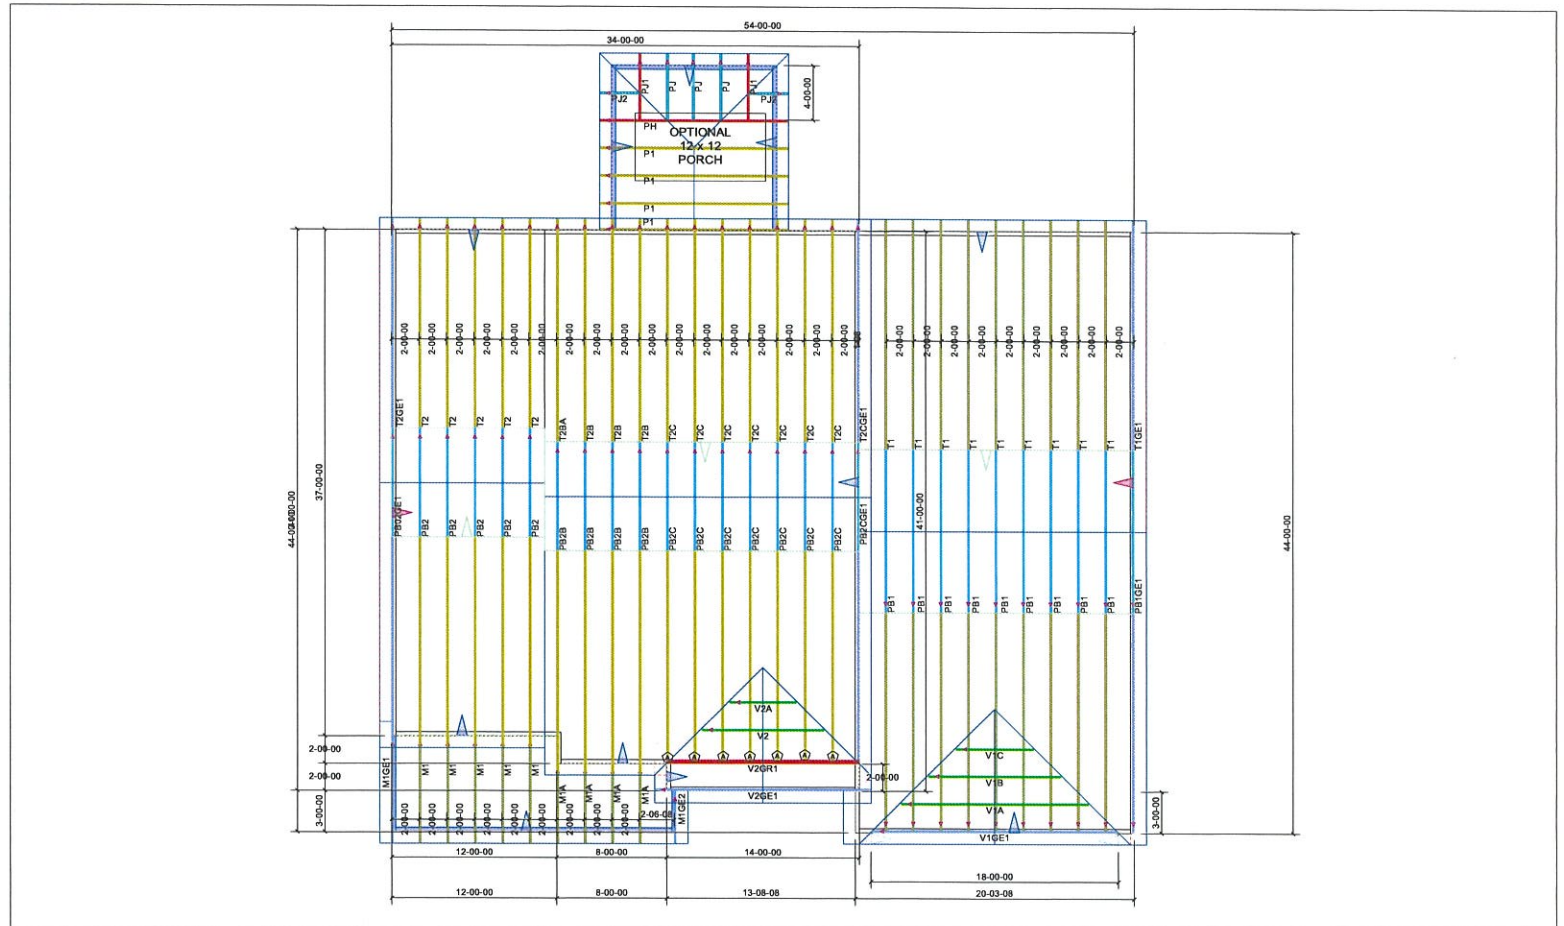

Hardware List:		
A	7	HUS26
B	-	HUS28-2
C	-	#####
D	-	#####
-	-	H2.5A
-	-	TBE4
-	-	SUPER ANCHOR



ROOF LOADING:	
TOP LIVE:	20 PSF
TOP DEAD:	10 PSF
BOTTOM DEAD:	10 PSF
WIND SPEED:	115 MPH



**84 LUMBER**  
COMPONENTS

DEDICATED TO QUALITY AND EXCELLENCE  
200 EMMETT ROAD  
DUNN, NORTH CAROLINA 28334  
PHONE: 910-892-8400

PROJECT:			
CUSTOMER:		<b>CL2977 A W/CP</b>	
MODEL:		<b>CL 2977 A W/CP GOR</b>	
SCALE:	NOT TO SCALE	P.O. NUMBER:	XXXXX
QUOTE:	1600124	REV:	04/07/16
DRAWN BY:	---	PRINT DATE:	//
SHIP DATE:	04/30/16	REV:	10:09:34

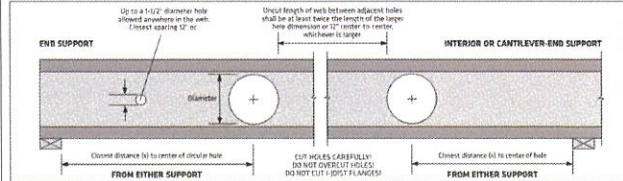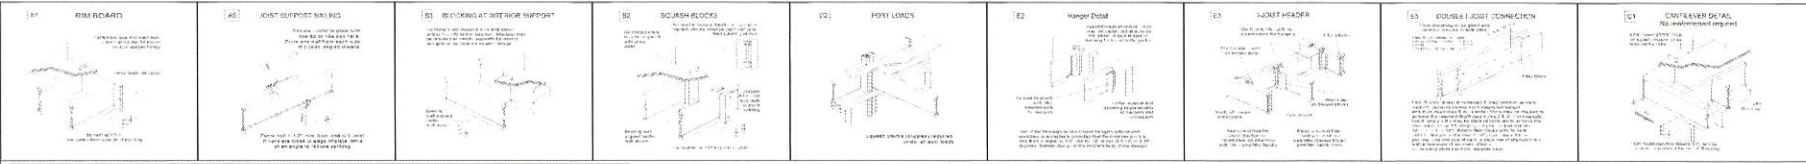

**TO USE:**

- Select the required tables and design.
- Determine the support condition for the required loading and support or interior support (including cantilever and supports).
- Select the row corresponding to the required Clear Span. For spans between those listed, use the next larger value.
- Select the column corresponding to the required hole diameter. For diameters between those listed, use the next larger value.
- The intersection of the Clear Span row and Hole Diameter column gives the maximum distance from the inside face of opening to the center of a circular hole.
- Double check the distance to the other support, using the appropriate support condition.


Depth	Clear Span (ft)	Distance from End Support					Distance from Interior or Cantilever-End Support						
		Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter	Hole Diameter		
14"	14'	1'-0"	1'-0"	1'-0"	1'-0"	2'-2"	-	1'-0"	1'-0"	1'-5"	2'-7"	3'-9"	-
	18'	1'-0"	1'-0"	1'-0"	1'-0"	4'-6"	-	1'-8"	2'-10"	3'-11"	5'-1"	6'-3"	-
	22'	1'-5"	2'-9"	4'-1"	5'-6"	7'-0"	-	4'-2"	5'-4"	6'-5"	7'-7"	8'-9"	-
	26'	3'-8"	5'-0"	6'-5"	8'-0"	9'-8"	-	6'-8"	7'-10"	8'-11"	10'-1"	11'-4"	-
	18'	1'-0"	1'-0"	1'-4"	2'-5"	3'-7"	4'-11"	1'-6"	2'-6"	3'-6"	4'-6"	5'-6"	6'-6"
16"	22'	1'-4"	2'-5"	3'-6"	4'-8"	6'-1"	7'-5"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"
	26'	3'-6"	4'-8"	5'-11"	7'-2"	8'-7"	10'-1"	6'-6"	7'-6"	8'-6"	9'-6"	10'-6"	11'-9"
	30'	5'-9"	7'-0"	8'-4"	9'-9"	11'-3"	12'-10"	9'-0"	10'-0"	11'-0"	12'-0"	13'-2"	14'-8"

**DESIGN ASSUMPTIONS:**

- The hole locations listed above are valid for floor joists supporting only uniform loads. The total uniform load shall not exceed 150 psf (e.g., 40 psf Live Load and 25 psf Dead Load spaced 74" oc).
- Hole location is measured from the inside face of opening to the center of a circular hole, from the closest support.
- Clear Span has not been verified for these joists and is shown for informational purposes only.
- Verify that the joist selected will work for the span and loading conditions needed before checking hole location.
- The maximum hole depth for circular holes in the joist depth less 4" except the maximum hole depth is 6" for 8-1/2" joists, and 8" for 11-7/8" joists.
- Holes cannot be located in the span where designated "no" without further analysis by a design professional.

**NOTES:**

- Holes may be placed anywhere within the depth of the joist. A maximum 1/4" gap distance is required between the hole and the joist.
- Round holes up to 1/2" diameter may be placed anywhere in the web.
- Perforated "squares" may be neglected when blocking web holes.
- Holes larger than 1/2" are not permitted in cantilevers without special engineering.
- Multiple holes shall have a clear separation along the length of the joist of at least twice the length of the larger diameter hole, or an equivalent of 12" center-to-center whichever is greater.
- Multiple holes may be spaced closer provided they fit within the boundary of an acceptable single hole. Example: two 1" round holes spaced to the side lengths may be spaced 2" apart (clear distance) provided that a 3" high by 8" wide rectangle or an 8" diameter round hole are acceptable for the clear depth at that location and completely encircle the holes.
- For joists that are cut in the field, use LP's design software or contact your local LP's distributor or contact your local distributor for more information.

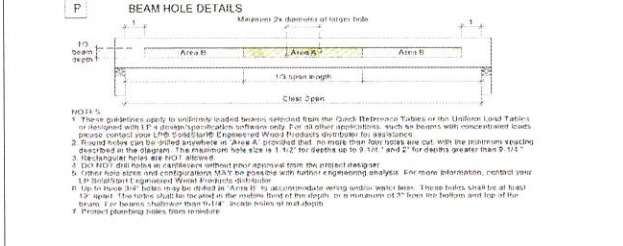

**Important Notes:** WARNINGS: Failure to follow proper procedures for handling, storage and installation could result in compromised performance, unsafe structures and possible collapse.

These instructions are intended as a guide to good practice in the handling, storage and installation of LP's products. LP's products are not intended for use in areas where there are general requirements such as in areas where there are specific requirements for fire resistance or sound insulation or where there are specific requirements for fire resistance or sound insulation or where there are specific requirements for fire resistance or sound insulation.

This is not intended as a manual for selecting products and assumes that competent and qualified have been specified correctly.

Consult the LP's product literature for more information on the products and their use.

These instructions are not intended to be used in conjunction with other design loads or design conditions.

These instructions are not intended to be used in conjunction with other design loads or design conditions.

**2nd Floor Joist (Flush)**

Label	Description	Width	Depth	Qty	Plies	Pcs	Length
J101	1.1/2" x 14"	14	14	1	1	1	12'-0"
J102	1.1/2" x 18"	14	14	1	1	1	12'-0"
J103	1.1/2" x 22"	14	14	1	1	1	12'-0"
J104	1.1/2" x 26"	14	14	1	1	1	12'-0"
J105	1.1/2" x 30"	14	14	1	1	1	12'-0"

**Beam By Others (Dropped)**

Label	Description	Width	Depth	Qty	Plies	Pcs	Length
B101	1.1/2" x 14"	14	14	1	1	1	12'-0"
B102	1.1/2" x 18"	14	14	1	1	1	12'-0"
B103	1.1/2" x 22"	14	14	1	1	1	12'-0"
B104	1.1/2" x 26"	14	14	1	1	1	12'-0"
B105	1.1/2" x 30"	14	14	1	1	1	12'-0"

**Rim Board**

Label	Description	Width	Depth	Qty	Plies	Pcs	Length
R1	LP APA Rated OSB 1.125 X 14	14	14	16	1	16	12'-0"

**Blocking**

Label	Description	Width	Depth	Qty	Plies	Pcs	Length
B1	1.1/2" 20 Plus	2.5	14	16	1	16	12'-0"

**Hanger**

Label	Pcs	Description	Skew	Slope	Beam/Joist	Supported Member
H1	3	US2.56-1/4 (Min)			12 10dx1 1/2	Joist

**2ND FLOOR FRAMING**

SCALE: 1/4" = 1'

Legend:

- Load from Above
- 2x4 Est Wall
- 2x4 Brg Wall
- 2x4 Non-Brg Wall
- 2x6 Non-Brg Wall
- Wall Opening
- LP APA Rated OSB 1.125 X 14
- 1.1/2" 20 Plus 14
- 1.1/2" 20 Plus 14 (Dropped)
- 1.1/2" 20 Plus 14 (Dropped)
- 1.1/2" 20 Plus 14 (Dropped)
- 1.5 X 9.25 (Dropped)
- 1.5 X 9.25 (Dropped)

**Roof Trusses by Others:** 10" max dia. field cut web holes, 1.1/2" 20 Plus 14, 1.1/2" 26 Plus 14, 1.1/2" 30 Plus 14.



**Dealer:** 84 Lumber-Fayetteville #2307  
**Dealer Address:** 620 Belt Road, Fayetteville, NC 28301 (910) 867-9185  
**Project:** CL2977 GR CP  
**Created:** March 24, 2016  
**Layout Name:** CL2977 GR CP  
**Description:** Caviness Land CL2977 GR CP  
**Designer:** Kyle Miltner  
**Revised:** February 18, 2020

**2nd Floor**

Design Method	ASD (USA)
Building Code	IRC 2012

**Floor Loads**

Live	Dead
40	10

**Deflection Joist**

LL Span L/160	LL Span L/240	LL Span L/360	LL Span L/480
360	360	360	360

**Deflection Girder**

LL Span L/160	LL Span L/240	LL Span L/360
360	360	360

**Decking:** 23/32 APA Rated Stud-1/4" Floor OSB  
 Nailed & Glued

**Fastener**

Fastener	Fastener
Nailed & Glued	Nailed & Glued

