

# Harnett County Department of Public Health

PERMIT # SFD2104-0055

## Operation Permit

81412

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 599 WINDY FARM LN. (CHRISTIAN CT RD)

Name: (owner) KB HOMER CAROLINAS   SUBDIVISION HIGHLAND GLEN   LOT # 21

System Installer: THANTONS PLUMBING

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community    Public    Well   Distance from well NA feet

System Type: 85% SO<sub>2</sub> REDUCTION PPBPS   Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

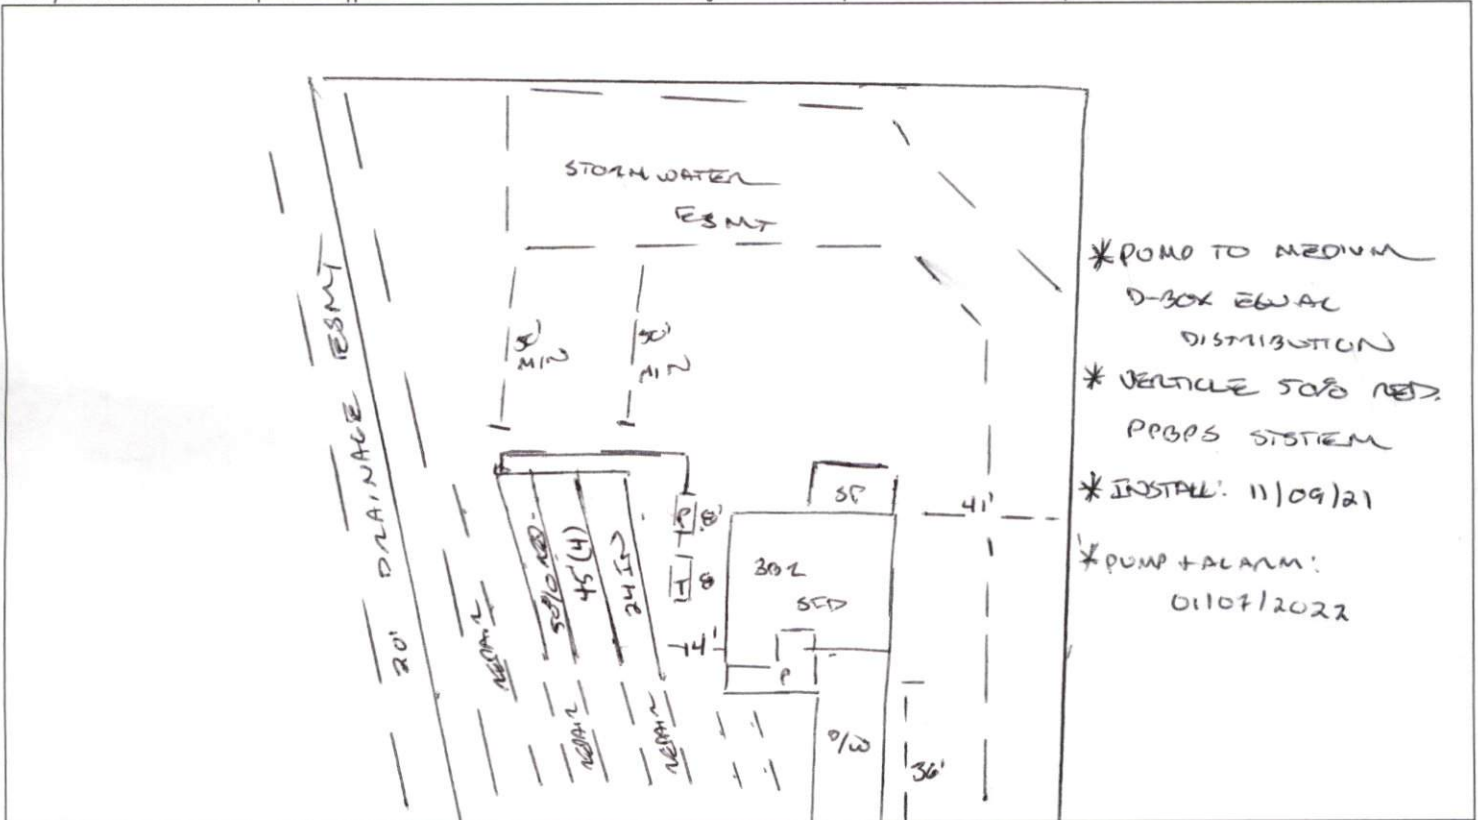

\* PUMP TO MEDIUM  
D-BOX EQUAL  
DISTRIBUTION  
\* VERTICLE SO<sub>2</sub> RED.  
PPBPS SYSTEM  
\* INSTALL: 11/09/21  
\* PUMP + ALARM:  
01/07/2022

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 50% SO<sub>2</sub> RED. PPBPS SYS.   Septic Tank: 1000 gallons   Pump Tank: 1000 gallons  
Subsurface   No. of   exact length   width of   depth of  
Drainage Field   ditches 4   of each ditch 45 feet   ditches 8 FT feet   ditches 24 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]   Date 01/07/2022