## Harnett County Department of Public Health


## Improvement Permit

A building permit cannot be issued with only an Improvement Permit PROPERTY LOCATION: 1093 Turlington Road (SR 1723) ISSUED TO: KMB Building LLC SUBDIVISION EXPANSION REPAIR Site Improvements required prior to Construction Authorization Issuance: Type of Structure: 45x35 sfd, 3 beds 2 baths Proposed Wastewater System Type: 25% Reduction System Projected Daily Flow: 360 Number of Occupants: 6 Number of bedrooms: 3 Basement Yes ☐ No Pump Required: XYes May be required based on final location and elevations of facilities Type of Water Supply: Community Public Well Distance from well NA Permit valid for: X Five years ■ No expiration Permit conditions: 125/2021 Authorized State Agent:: The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit. Construction Authorization (Required for Building Permit) The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout. ISSUED TO: KMB Building LLC PROPERTY LOCATION: 1093 Turlington Road (SR 1723) Facility Type: 45x35 sfd, 3 beds 2 baths Expansion Basement? Yes X No Basement Fixtures? Yes Pump to 25% Reduction System Type of Wastewater System\*\* (Initial) Wastewater Flow: 360 (See note below, if applicable ) Pump to 25% Reduction Sys, Number of trenches 3 Installation Requirements/Conditions Exact length of each trench 90 Trench Spacing: 9 Septic Tank Size 1000 Feet on Center gallons Pump Tank Size 1000 Soil Cover: 14->6 Trenches shall be installed on contour at a inches gallons Maximum Trench Depth of: 26->18 inches (Maximum soil cover shall not exceed (Trench bottoms shall be level to +/-1/4" 36" above the trench bottom) in all directions) NA Pump Requirements: ft. TDH vs. inches below pipe Aggregate Depth: NA inches above pipe Conditions: Pump to Medium D-Box Equal Distribution inches total WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA. NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA. \*\*If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit. Date: Owner/Legal Representative Signature: This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This SEE ATTACHED SITE SKETCH Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.

Construction Authorization Expiration Date: \_ 65/25/2026

Authorized State Agent:

## Harnett County Department of Public Health Site Sketch

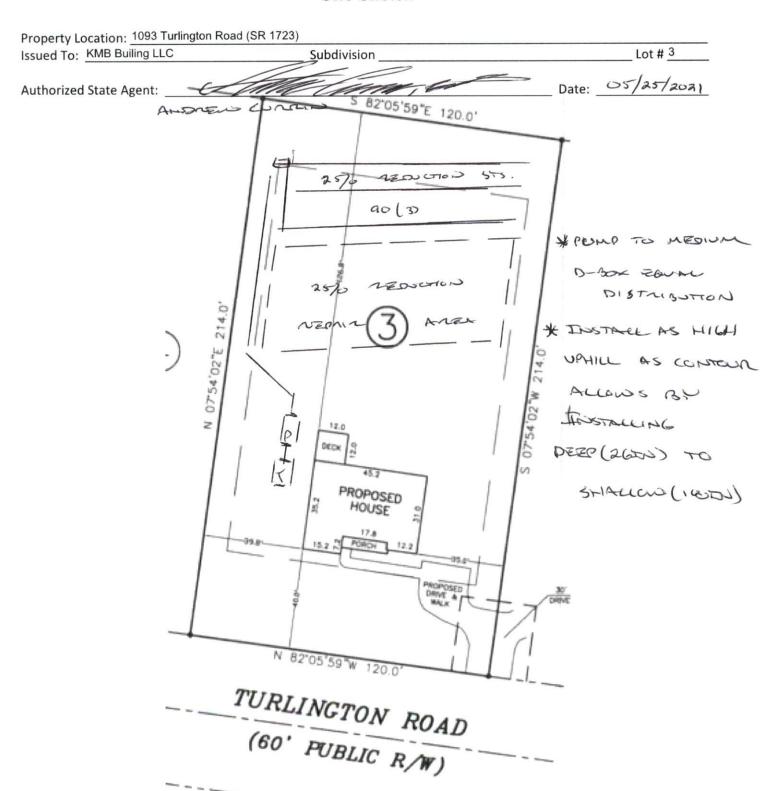

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.