

Harnett County Department of Public Health

PERMIT # SFT 2125-0084

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 286 Prance Ln US 4215

Name: (owner) H Paul Mayron Jr SUBDIVISION _____ LOT # _____

System Installer: Genes Kocher

Basement with plumbing: Garage Number of Bedrooms 5

Type of Water Supply: Community Public Well Distance from well 50' feet


System Type: 2590 Red System Type #B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

BZCAG

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

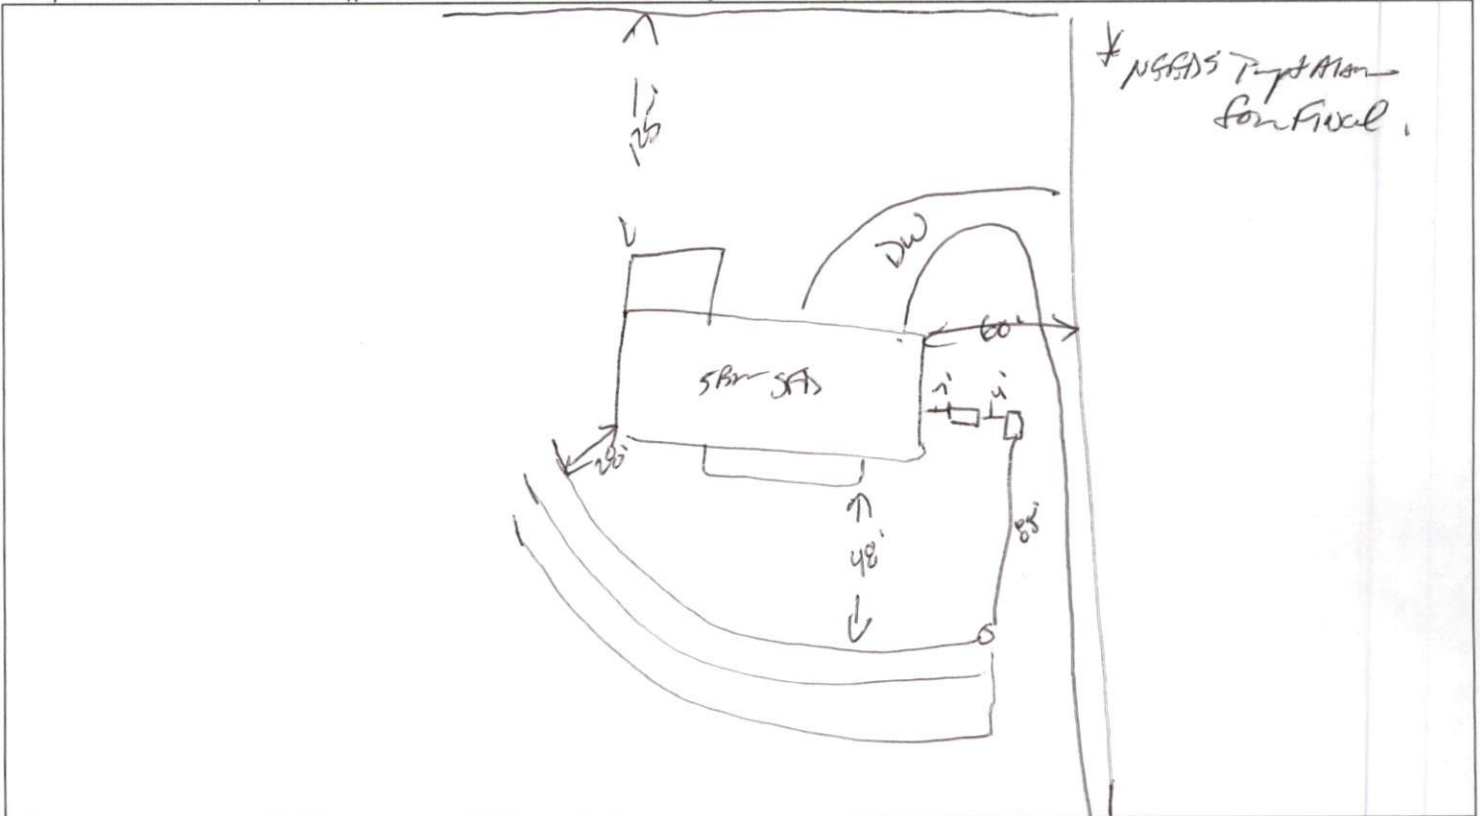

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 2590 REDUCED Septic Tank: 1250 gallons Pump Tank: 1250 gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 145 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent Jane E. Markham ^{#2685} Date 12-20-22