



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. The individual design sheets for each truss design identified on the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 1500#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 1500#.

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 1500#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 1500#.

Signature: _____
Sales Area

Truss List	Truss	Qty	Span	Ply	Overhang	Height
A1-GE	1	39' 11"	1	1' 3"	11' 5 3/4"	
A2	7	39' 11"	1	1' 3"	11' 5 3/4"	
A3	3	37' 11"	1		11' 5 3/4"	
A4	1	37' 11"	1		11' 5 3/4"	
A5	6	37' 11"	1	L: 1' 3" R: 1' 3"	11' 5 3/4"	
A6	4	30' 3 3/4"	1		11' 5 3/4"	
A7	2	20' 1 1/2"	1	L: 1' 3" R:	11' 5 3/4"	
A7A	4	20' 1 1/2"	2	L: 1' 3" R:	11' 5 3/4"	
A8	3	32' 4"	1	L: 1' 3" R:	11' 5 3/4"	
A9-GE	1	32' 4"	1	L: 1' 3" R:	11' 5 3/4"	
B1-GE	1	17' 7"	1	1' 3"	5' 8 7/16"	
B2	2	17' 7"	1	1' 3"	5' 8 7/16"	
C1-GE	1	28' 2 1/2"	1	1' 3"	8' 4 5/16"	
C2	1	28' 2 1/2"	1	1' 3"	8' 4 5/16"	
C3	1	28' 2 1/2"	1	L: 1' 3" R:	8' 4 5/16"	
D1-GE	1	24' 11"	1	1' 3"	11' 5 3/4"	
D2	1	24' 11"	1	1' 3"	11' 5 3/4"	
D3	7	24' 11"	1	L: 1' 3" R:	11' 5 3/4"	
D4	2	24' 11"	1		11' 5 3/4"	
D5	1	24' 11"	1		11' 5 3/4"	
E1-GE	1	7' 7"	1	1' 3"	5' 9 7/16"	
E2	1	7' 7"	1		5' 9 7/16"	
G1-GE	1	21' 11"	1	1' 3"	9' 4 1/4"	
G2	5	21' 11"	1	1' 3"	9' 4 1/4"	
PB1	2	10' 0"	1		3' 6 1/2"	
PB2	24	10' 0"	1		3' 6 1/2"	
PB3	4	6' 2"	1		3' 6 1/2"	
PB4	12	5' 11 5/16"	1		2' 11 11/16"	
VA-1	1	23' 3 9/16"	1		11' 7 3/4"	
VA-2	1	20' 5 9/16"	1		10' 2 3/4"	
VA-3	1	17' 7 9/16"	1		8' 9 3/4"	
VA-4	1	14' 9 9/16"	1		7' 4 3/4"	
VA-5	1	11' 11 9/16"	1		5' 11 3/4"	
VA-6	1	9' 1 9/16"	1		4' 6 3/4"	
VA-7	1	6' 3 9/16"	1		3' 1 3/4"	
VA-8	1	3' 5 9/16"	1		1' 8 3/4"	
VC-1	1	26' 10 5/8"	1		6' 8 5/8"	
VC-2	1	21' 2 5/8"	1		5' 3 5/8"	
VC-3	1	15' 6 5/8"	1		3' 10 5/8"	
VC-4	1	9' 10 5/8"	1		2' 5 5/8"	
VC-5	1	4' 2 5/8"	1		1' 0 5/8"	

Connector Information				Nail Information		
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
JUS26	USP	4	Varies	10d3"	10d3"	10d3"


Beam Schedule					
PlotID	Length	Product	Piles	Net Qty	Fab Type
DBL-28	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH-1	25' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
GDH-2	12' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
BM1	11' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
BM2	11' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF

▲ = Indicates Left End of Truss (Reference Engineered Truss Drawing) Do Not Erect Trusses Backwards

Roof Area = 4581.87 sq.ft.
Ridge Line = 161.78 ft.
Hip Line = 0 ft.
HORIZ. OH = 122.65 ft.
RAKED OH = 278.43 ft.
Decking = 158 sheets

All Walls Shown Are Considered Load Bearing

WALL SCHEDULE	
	9' Plate Height
	10' Plate Height
	Non-Bearing Walls

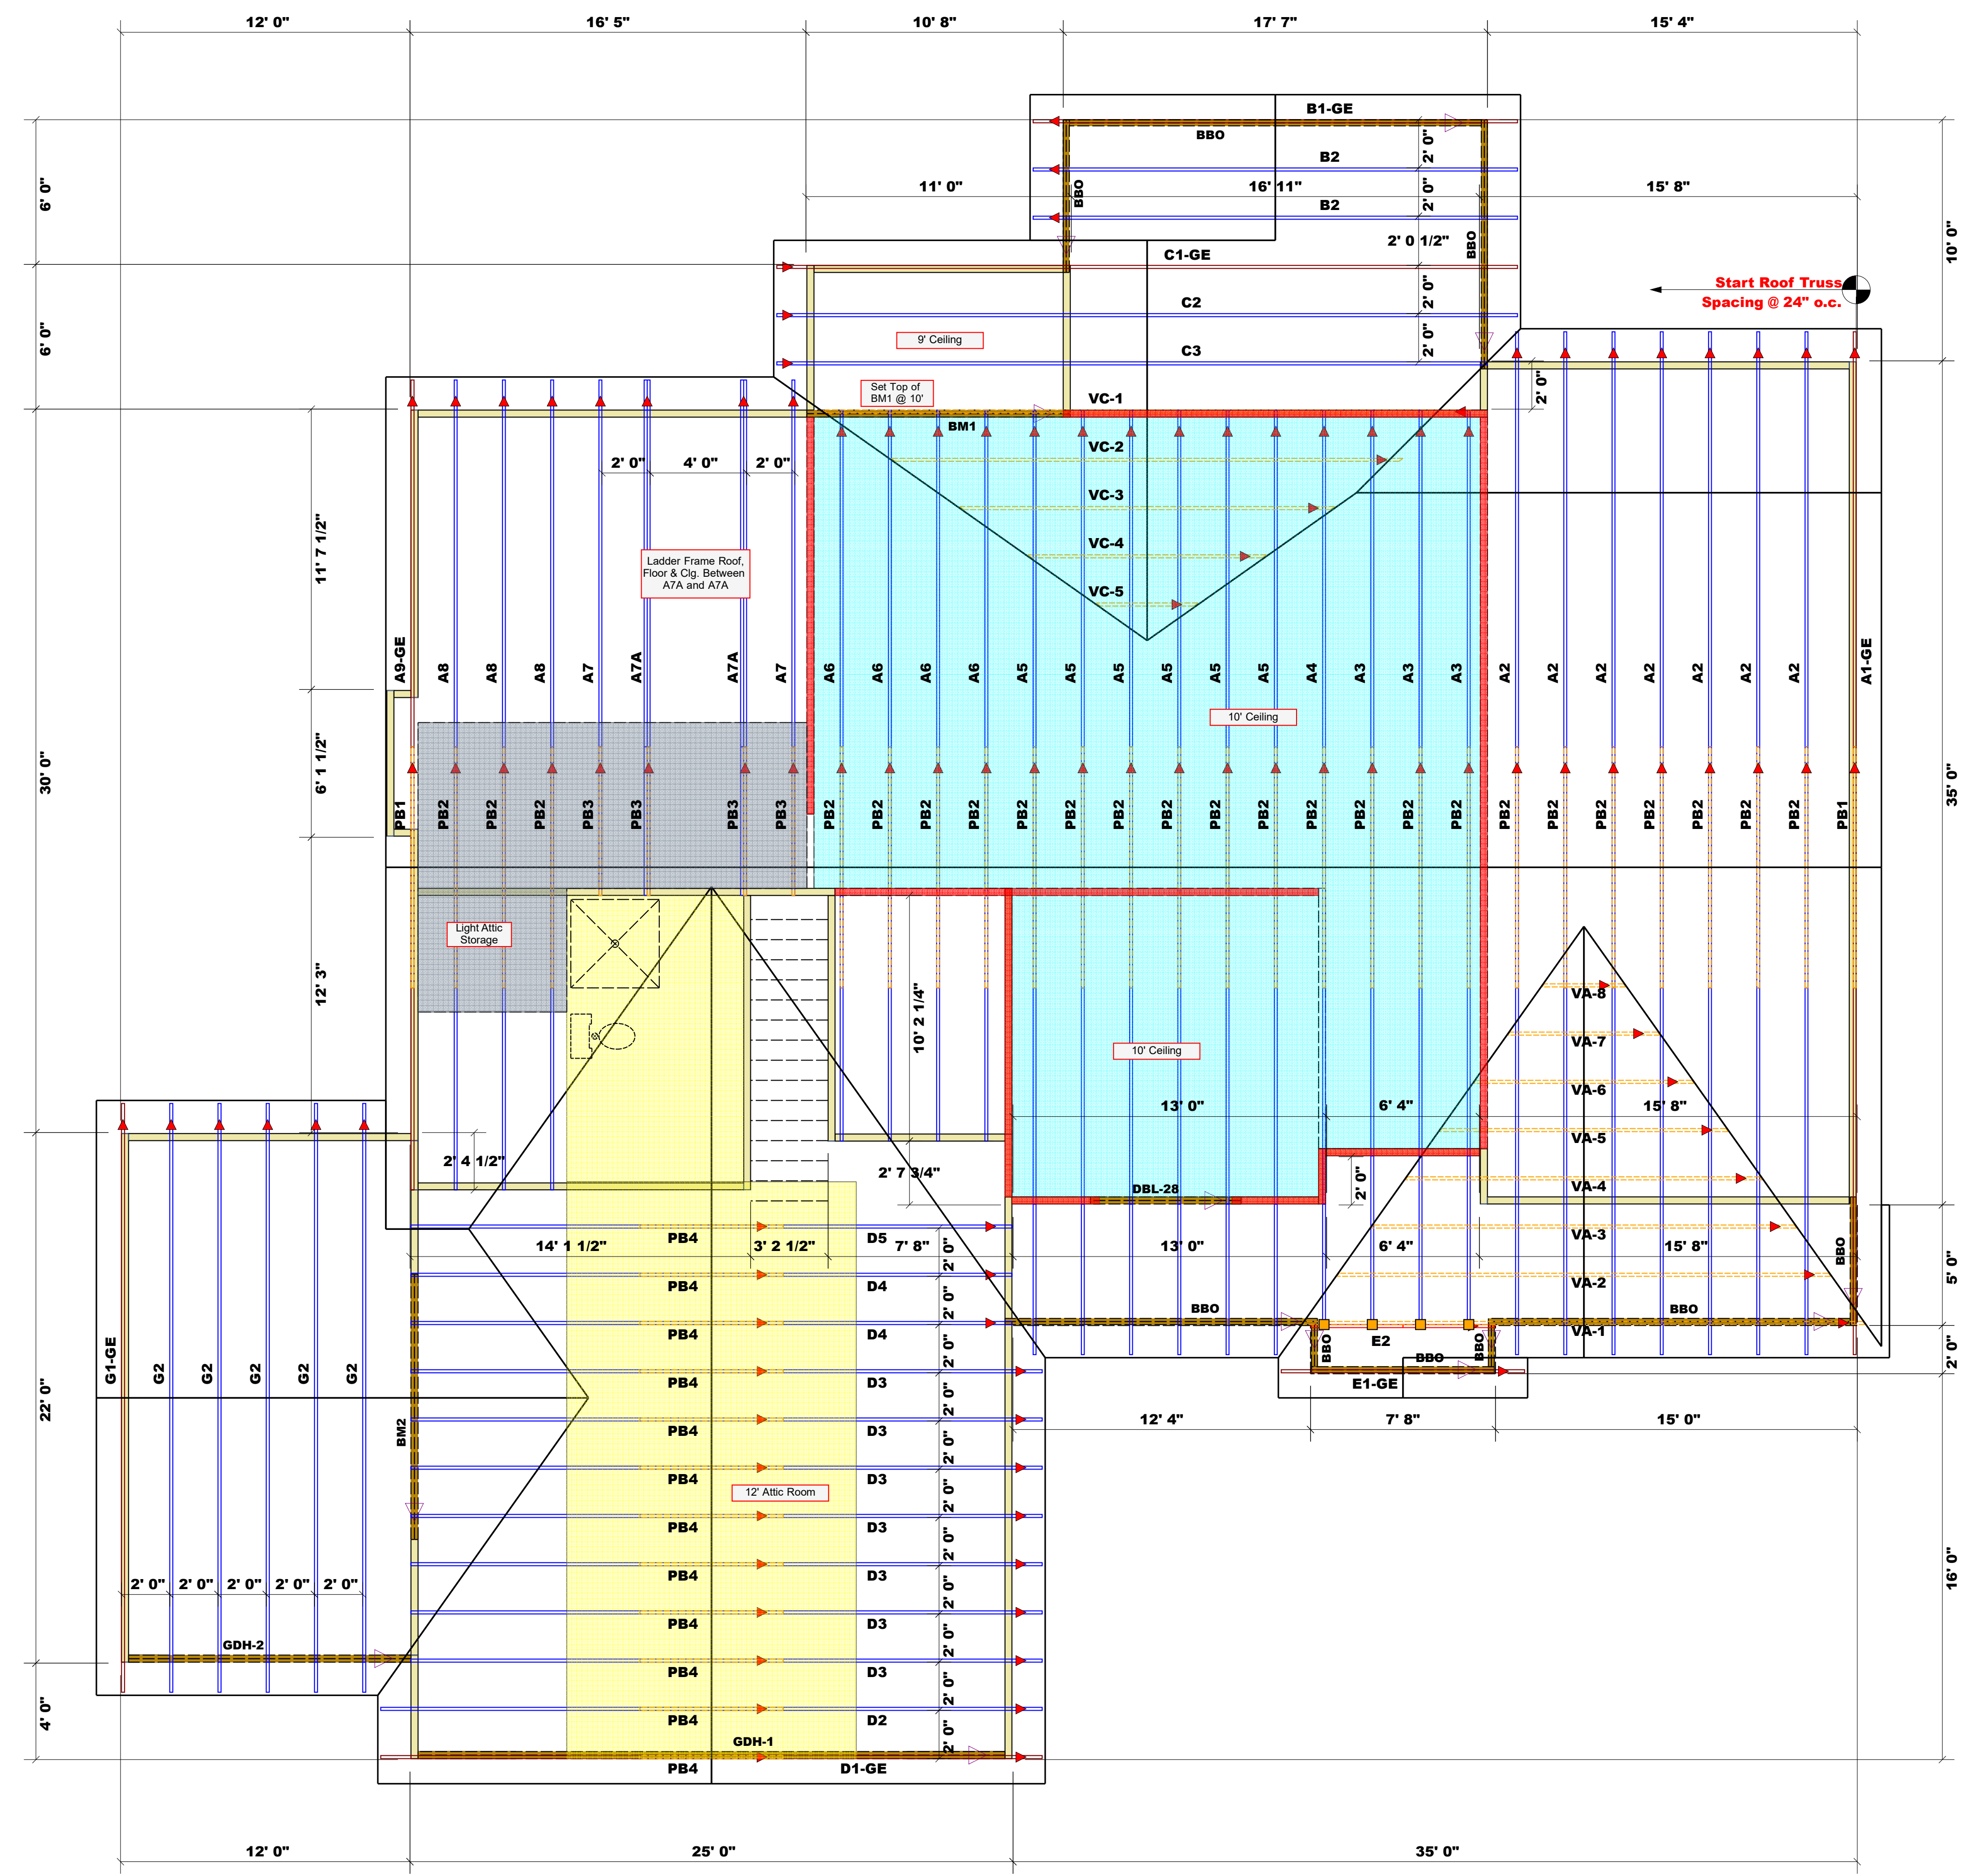

Truss Placement Plan
SCALE: 1/4" = 1'-0"

COUNTY	ADDRESS	MODEL	DATE REV.	DRAWN BY	SALESMAN
Hammett County	Lot 119 Ballard Woods	Roof	7/6/21	Anthony Williams	Anthony Williams

BUILDER	JOB NAME	PLAN	SEAL DATE	QUOTE #	JOB #
Watermark Homes	Lot 119 Ballard Woods	Oleander II Plan	12/18/19	NA	J0721-4155

LOAD CHART FOR JACK STUDS		BASED ON TABLES 502.2.1 & 5.1	
REQ. REACTION (LBS)	REQ. STUDS PER JOINT	REQ. REACTION (LBS)	REQ. STUDS PER JOINT
1700	1	2550	1
3400	2	5100	2
5100	3	7650	3
6800	4	10200	4
8500	5	12750	5
10200	6	15300	6
11900	7		
13600	8		
15300	9		