

Harnett County Department of Public Health

SFD 2106-6010

PERMIT # SFD 2106-6011

Operation Permit

SN 1418

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: POUGHARTAIN ST. (RIVER ROAD)

Name: (owner) THOMAS L BRADLEY SUBDIVISION THOMAS L BRADLEY JR. LOT # 121

System Installer: ADCOCK ESCALTING

Basement with plumbing: Garage Number of Bedrooms 5 (EXT + FUTURE)


Type of Water Supply: Community Public Well Distance from well 50+ feet

System Type: 25% REDUCTION SYSTEM III Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

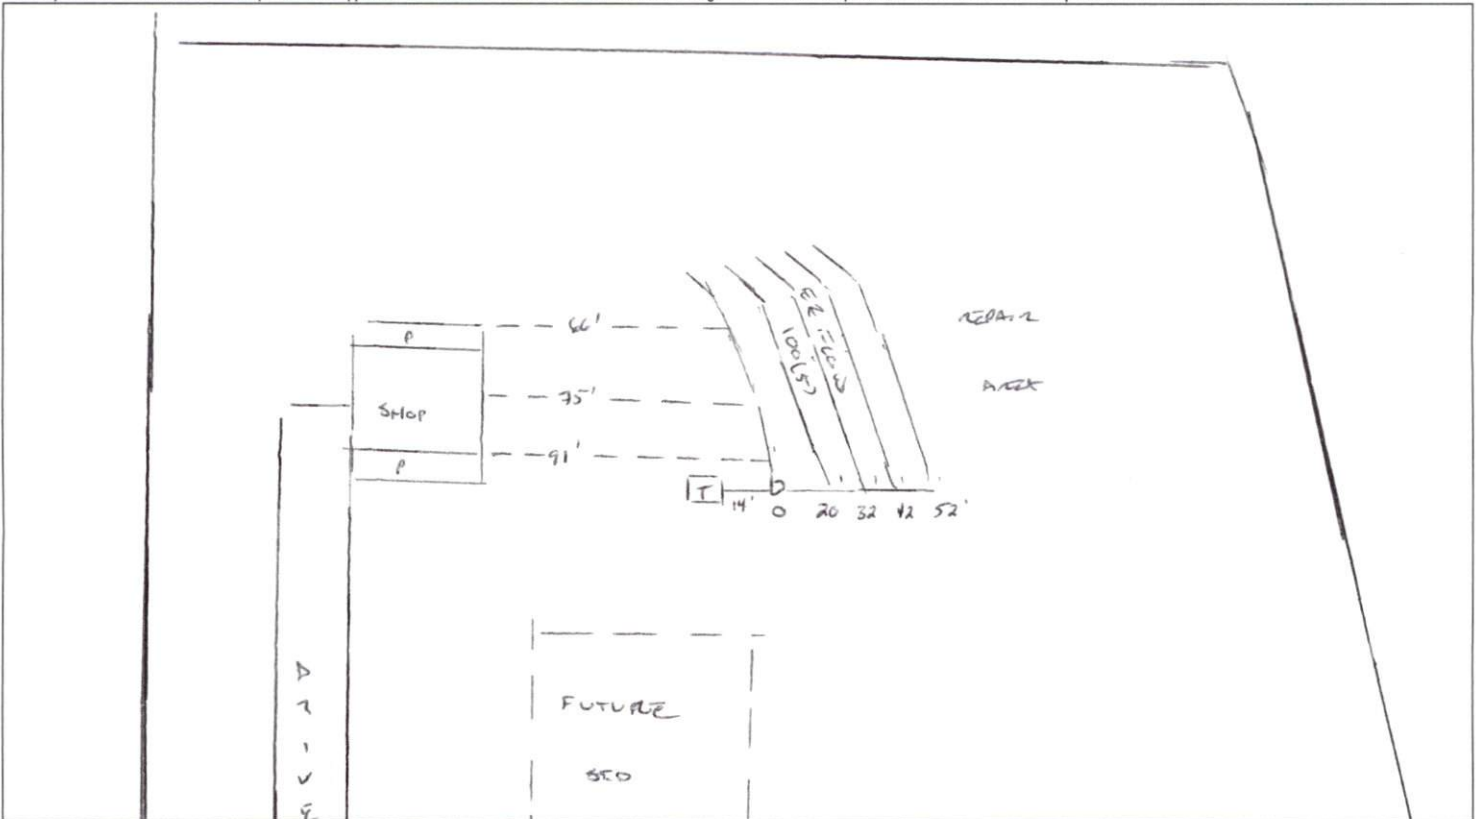

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961. NEW
- III. Maintenance: As required by Rule .1961. Other: WELL
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other ER FLOW III Septic Tank: 1256 gallons Pump Tank: _____ gallons
Subsurface No. of _____ exact length _____ width of _____ depth of _____
Drainage Field ditches 5 of each ditch 100 feet ditches 3 feet ditches 18 inches
French Drain Required: _____ Linear feet

Authorized State Agent: [Signature] Date 02/17/2022