

THIS LAYOUT IS TO BE USED AS A TRUSS PLACEMENT GUIDE ONLY.
PLEASE REFER TO BUILDING PLANS FOR BUILDING CONSTRUCTION AND DETAILS,
SUCH AS PLUMBING OR DUCT DROPS.

CONSTRUCTION COPY-
FOR FIELD USE

Job #

P-9558

Larson / Cool Meadow
140 Thornton Crk
Lillington NC

Unit/Lot:

- Notes:
- Exterior dimensions shown are assumed to be:
 - Out-to-out of stud
 - Out-to-out of sheathing
 - Adjust truss locations as needed for plumbing and mechanical clearance. Unless otherwise noted, trusses may be shifted as long as O.C. spacing shown is not exceeded.
 - Do not cut, drill, or otherwise damage any part of any truss without prior approval from Peak Truss. Do not install trusses that are damaged, are not properly fabricated, or do not have adequate bearing.
 - Do not approve drawings if any information herein is unclear. Once ordered trusses will be fabricated as approved.
 - Please contact Peak Truss Builders with any questions. We are available to help any way we can. We can be reached at 919-545-5555 or sales@peaktruss.com

Floor Truss Loading per 2018 NC Residential Code

Top Chord Live Load 40# PSF
Top Chord Dead Load 10# PSF
Bottom Chord Live Load 0# PSF
Bottom Chord Dead Load 5# PSF

Live load deflection limit L/360
Spans over 20' limit L/480

△ - This symbol denotes left end of truss as shown on truss drawings

● - Approximate location of toilet drop. Builder please confirm.

Truss connections by others:

- N - Nailed
- L - Ledger

Layout Creation Date:


4/25/2023

Designer:
Aron Meeks

Wendell Builder's Supply
2505 Wendell Blvd
Wendell, NC
27591

Peak Truss
Builders, LLC

PO Box 340, New Hill, NC 27562

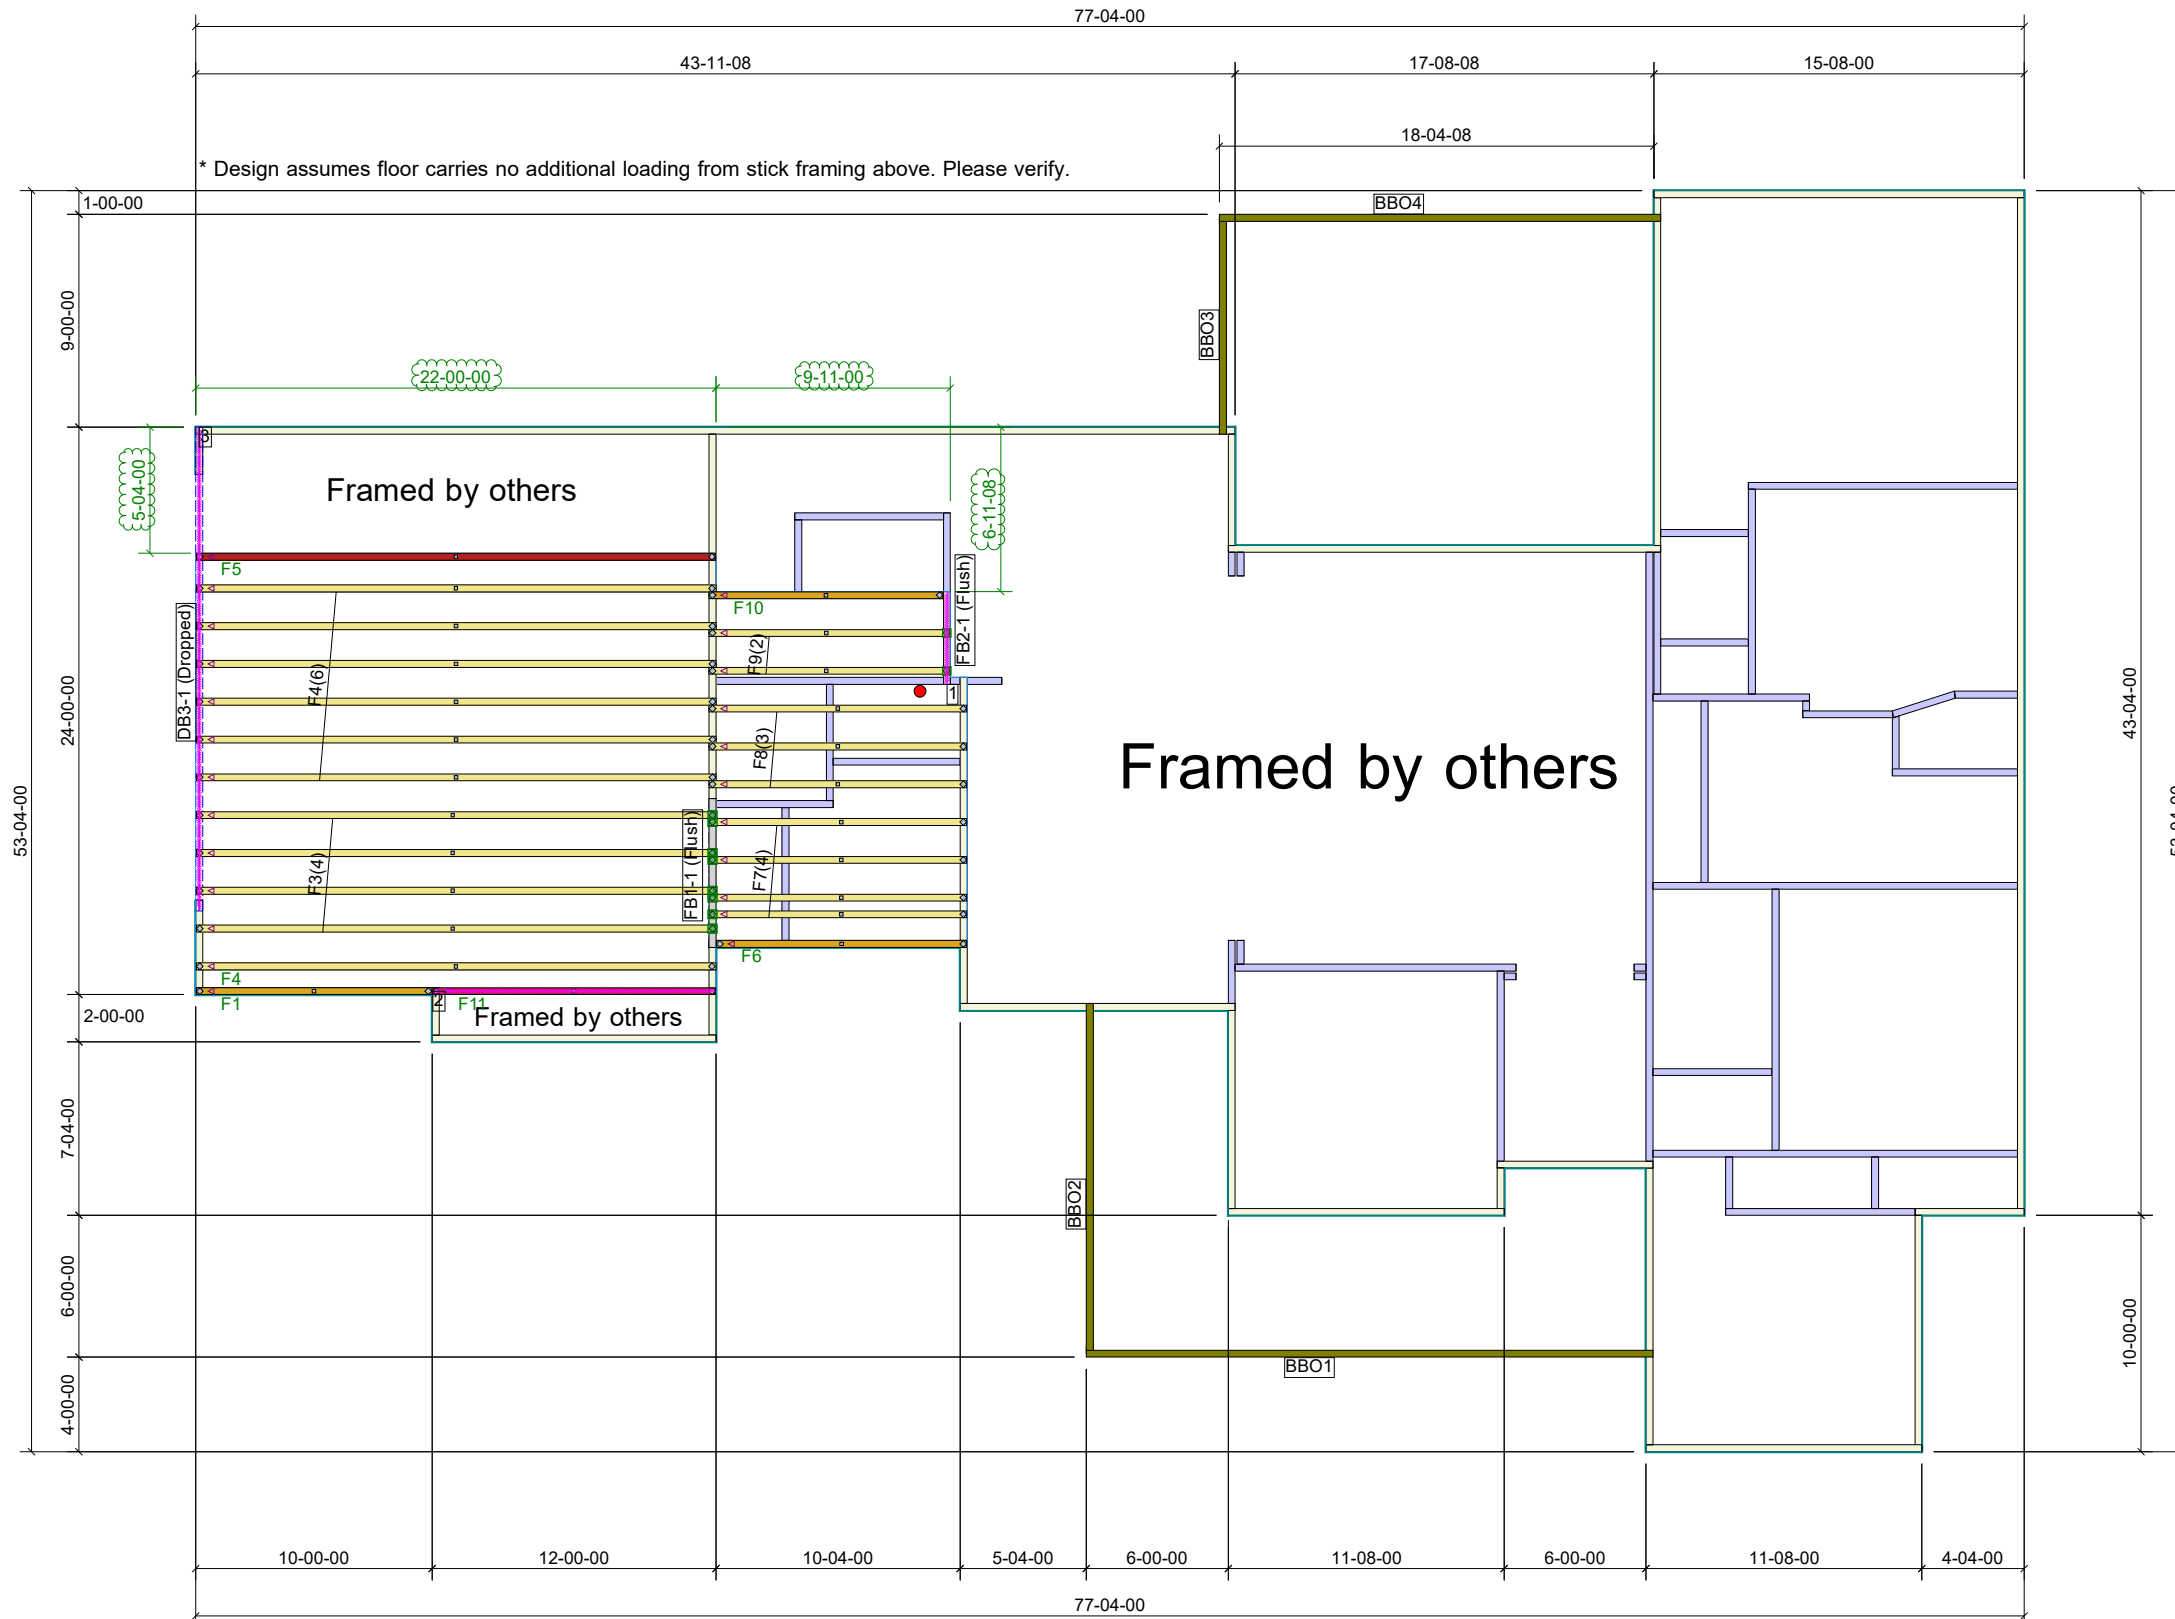

Cool Meadow
16" Depth
19.2" OC

Products						
PlotID	Length	Product	Plies	Net Qty	Fab Type	
FB1-1 (Flush)	8-00-00	1-3/4X11-7/8 LP-LVL 2900Fb-2.0E	2	2	MFD	
FB2-1 (Flush)	4-00-00	1-3/4X11-7/8 LP-LVL 2900Fb-2.0E	2	2	MFD	
DB3-1 (Dropped)	22-00-00	1-3/4X18 LP-LVL 2900Fb-2.0E	2	2	MFD	

Wall Types	
	Load Bearing
	Non Load Bearing