

# Harnett County Department of Public Health

PERMIT # SFD 2106-0074

## Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 51006 OLD STAGE RD

Name: (owner) Allison Marshall SUBDIVISION Allison Marshall LOT # 1

System Installer: A+R Enterprises


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: 50% Nitrification System PPOs Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

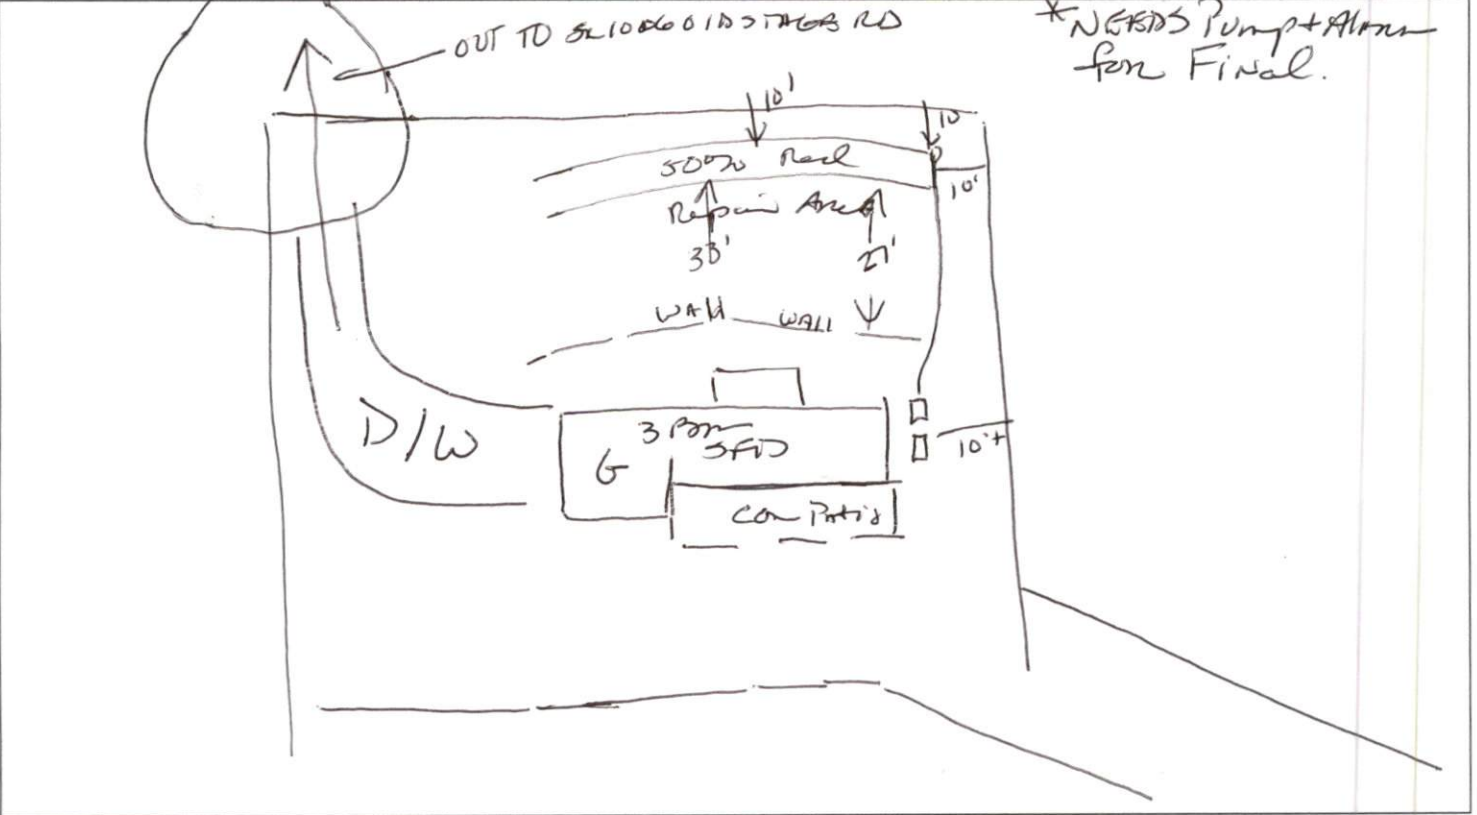

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box     Pump     Alarm     H2O Line     PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Pumps + 50% Nitrification Septic Tank: 1000 gallons Pump Tank: 1000 gallons  
 Subsurface No. of ditches 2 exact length of each ditch 50 feet width of ditches 3 feet depth of ditches 18 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent REHS Date 10/31/23