Academy at Anderson Creek 1114 - 199 Scholar Drive, Spring Lake, 28390 Harnett County Created: 9/2/2021 - changed from Paxton III to Mixon III


House Plan: Mixon III Elevation: C Stone/Brick Option: Option #1 see MSS Foundation: Crawl Foundation Finish: 3 Sides Parged Garage Hand: Right Garage: 2 Car Front Garage Door: (1)16x8 Front Porch: Concrete Roof: Truss Siding: Fiber Cement Ceiling Height 1st Floor: 9' Ceiling Height 2nd Floor: 9' Door Frame Height 1st Floor: 83" Door Frame Height 2nd Floor: 83" Windows 1st Floor: 6/0 Front only, 5/0 side&rear Windows 2nd Floor: 5/0


## **OPTIONS**

Single Garage Door 16x8 Screen Porch **Optional Bedroom #4** Rec Room Trey Ceiling in Master Bedroom

Total Heated SQ FT: 2989 Total Unheated SQ FT: 640 Total SQ FT: 3629


Bedrooms:5 + Rec Room Full Bathrooms: 3 Half Bathrooms: 0

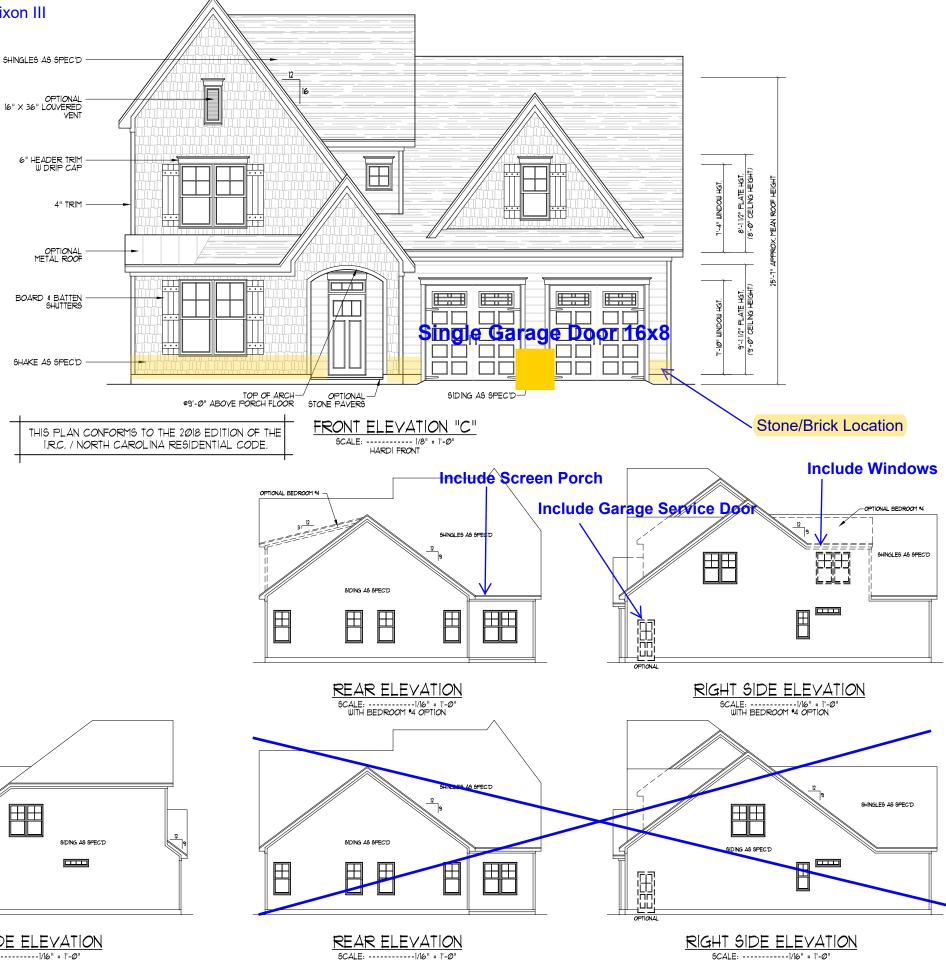


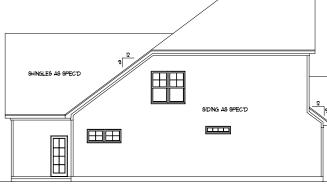







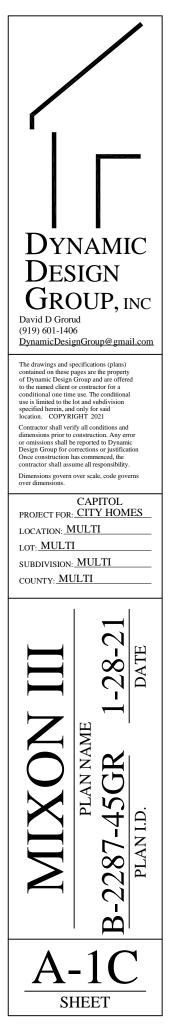

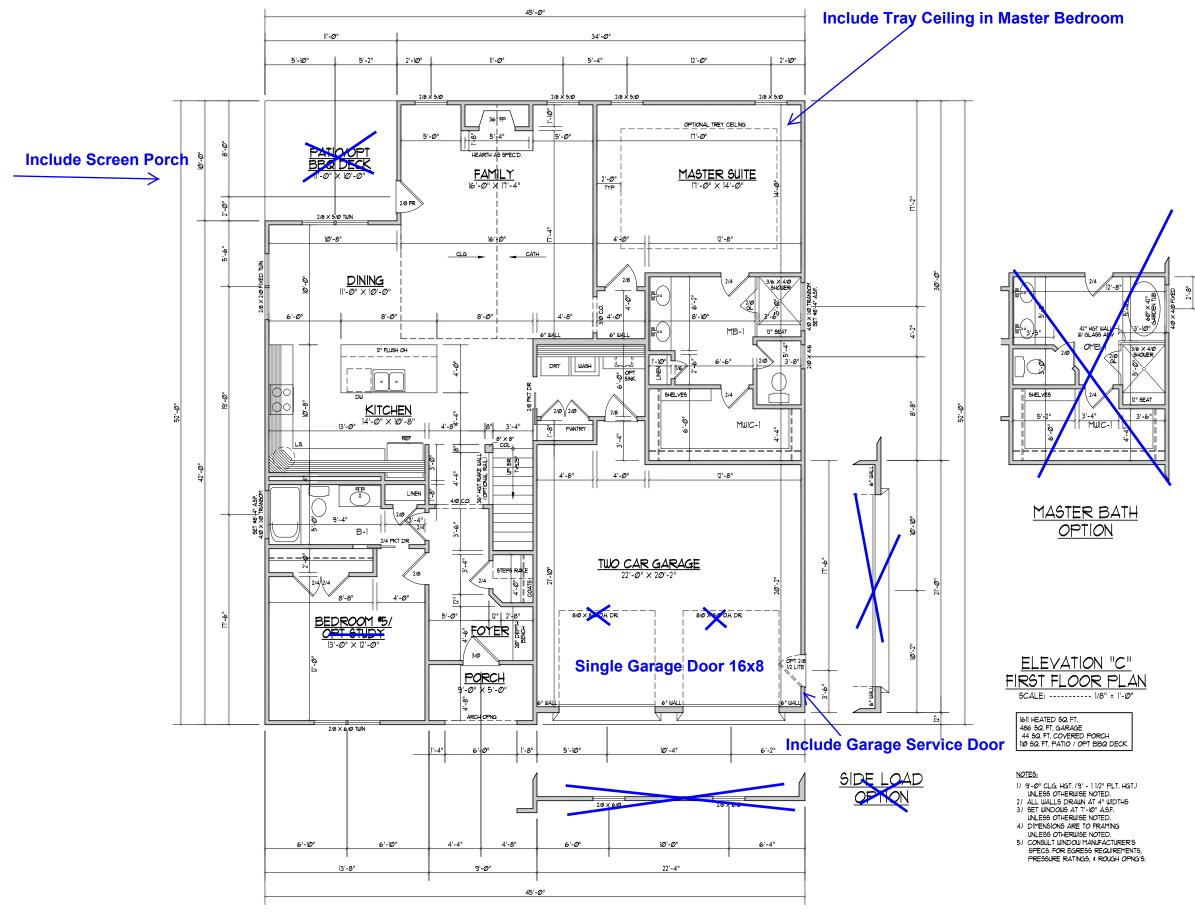





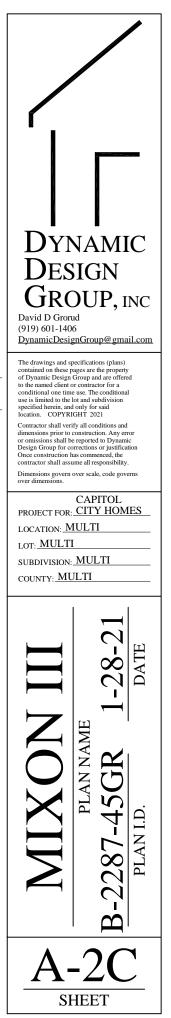

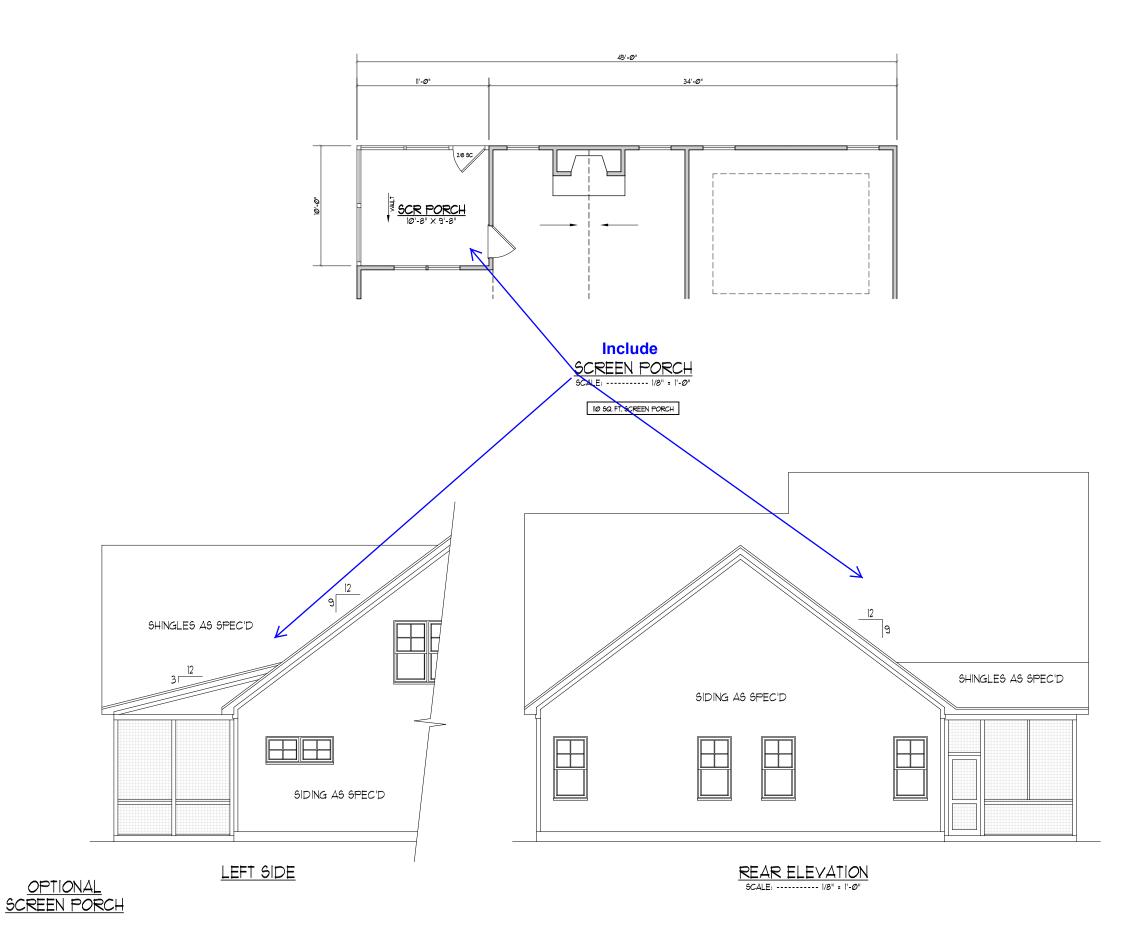



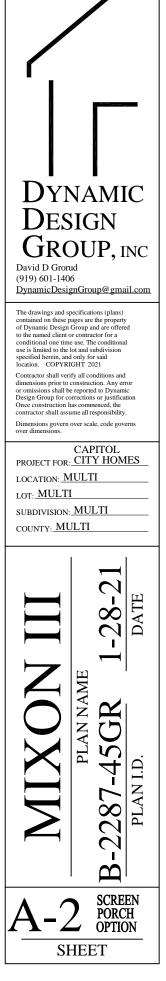

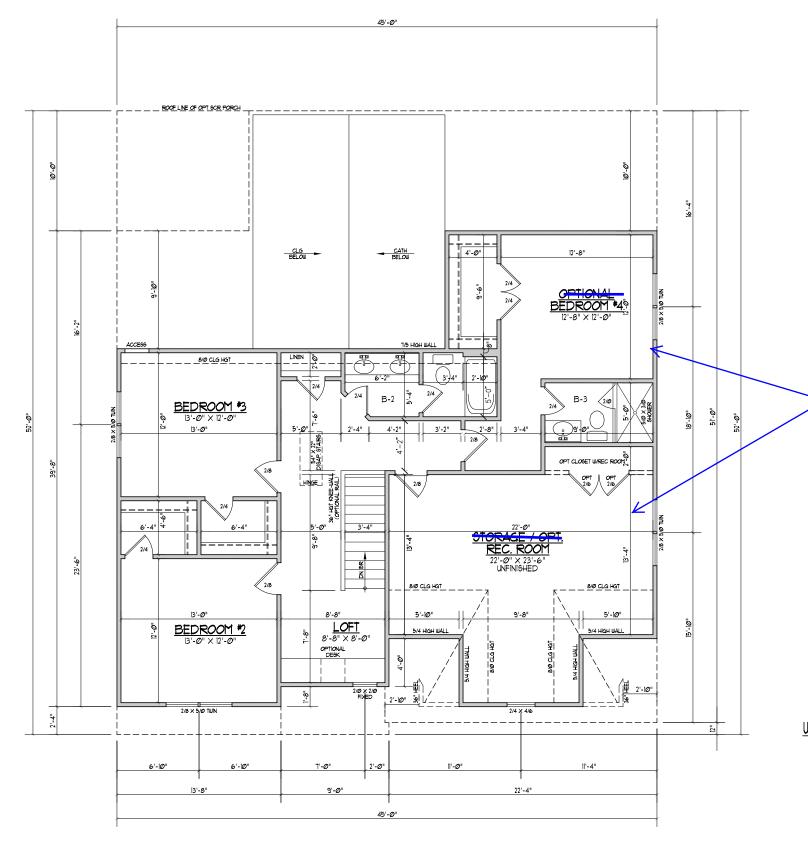












## NOTES:

- NOTES: 1) 81-8" CLG, HGT, (8' 11/2" PLT, HGT.) UNLESS OTHERWISE NOTED. 2) ALL WALLS DRAWN AT 4" WIDTHS UNLESS OTHERWISE NOTED. 3) SET WINDOWS AT 1"-4" A.S.F. UNLESS OTHERWISE NOTED. 4) DIMENSIONS ARE TO FRAMMAS UNLESS OTHERWISE NOTED. 5) CONSULT WINDOW MANUFACTURER'S SFECS. FOR EGRESS REQUIREMENTS, PRESSURE RATINGS, 4 ROUGH OPING'S.

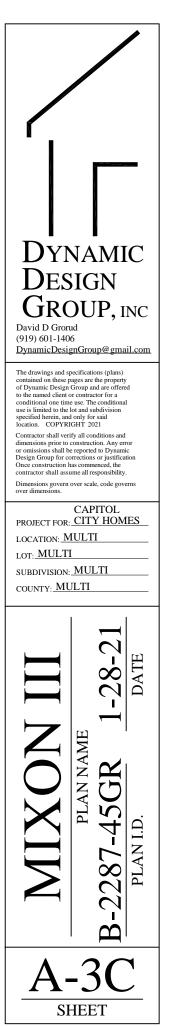

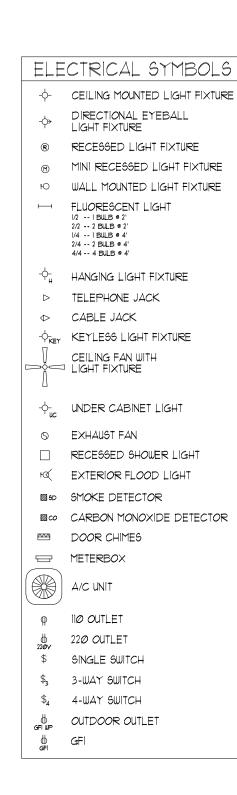

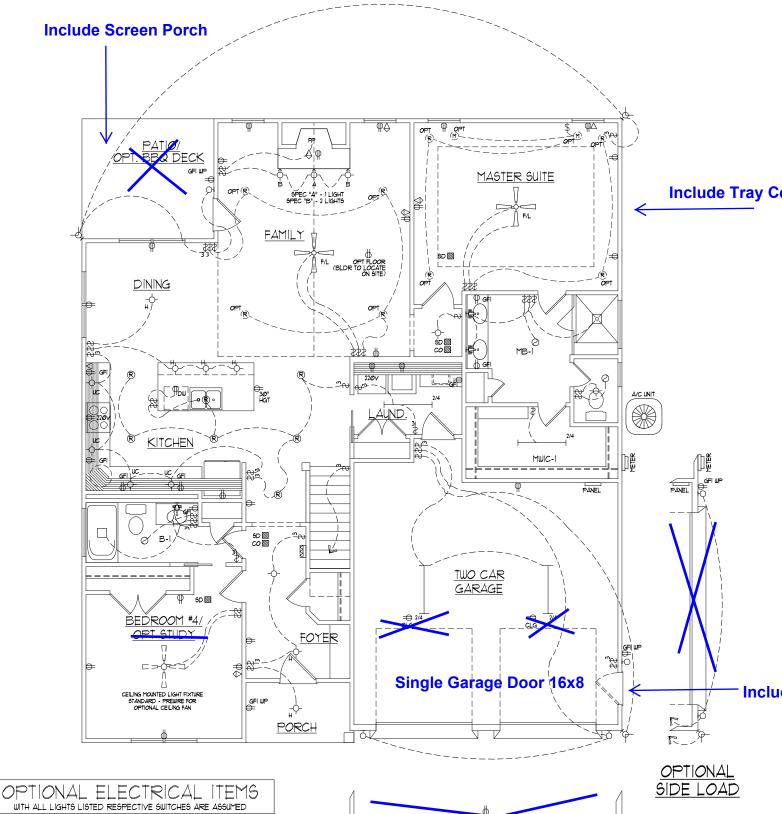


RECESSED	LIGHTS
	LOUT NUMBER 2

FLUORESCENT LIGHT IN LIEU OF RECESSED CANS & KITCHEN ONLY CEILING FANS IN LIEU OF FLUSH MOUNT FLOODLIGHTS HANGING LIGHTS & KITCHEN UNDER CABINET LIGHTS EXTERIOR LIGHTS AT GARAGE DOOR




# Include Tray Ceiling in Master Bedroom





# Include Garage Service Door



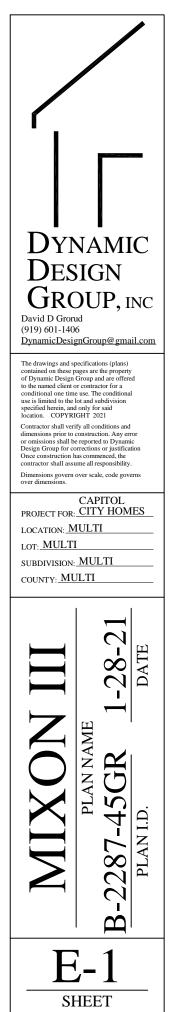


### ELECTRICAL SYMBOLS CEILING MOUNTED LIGHT FIXTURE -ф-DIRECTIONAL EYEBALL -¢> LIGHT FIXTURE RECESSED LIGHT FIXTURE R MINI RECESSED LIGHT FIXTURE $\bigcirc$ Ю WALL MOUNTED LIGHT FIXTURE FLUORESCENT LIGHT $\vdash$ 1/2 -- 1 BULB @ 2' 2/2 -- 2 BULB @ 2' 1/4 -- 1 BULB @ 4' 2/4 -- 2 BULB @ 4' 4/4 -- 4 BULB @ 4' -¢\_ HANGING LIGHT FIXTURE TELEPHONE JACK $\triangleright$ CABLE JACK $\diamondsuit$ -\$\_ Key KEYLESS LIGHT FIXTURE Π CEILING FAN WITH □ LIGHT FIXTURE 11 -\$-w UNDER CABINET LIGHT EXHAUST FAN 0 RECESSED SHOWER LIGHT EXTERIOR FLOOD LIGHT ю SMOKE DETECTOR 🖾 5D CARBON MONOXIDE DETECTOR 🖾 co DOOR CHIMES METERBOX A/C UNIT 110 OUTLET φ ₿ 22ØV 22Ø OUTLET \$ SINGLE SWITCH \$3 3-WAY SWITCH \$4 4-WAY SWITCH d GfiwP OUTDOOR OUTLET ∯ ∉⊓ GFI


SCREEN PORCH


**Include Screen Porch** 



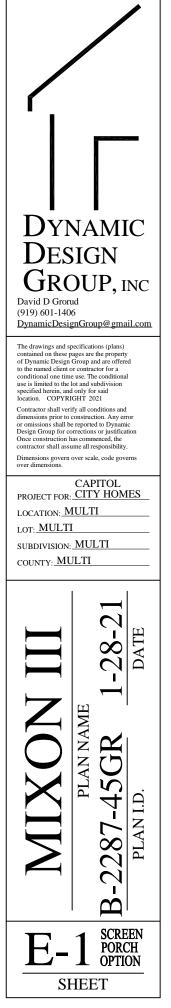



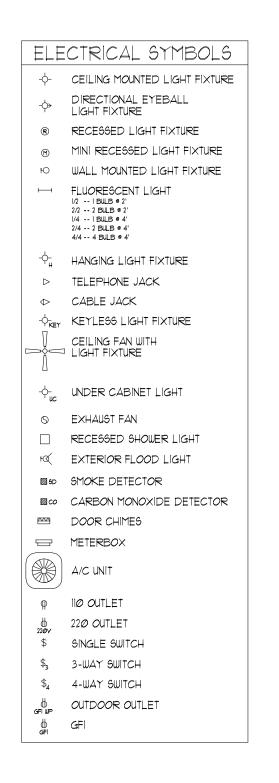

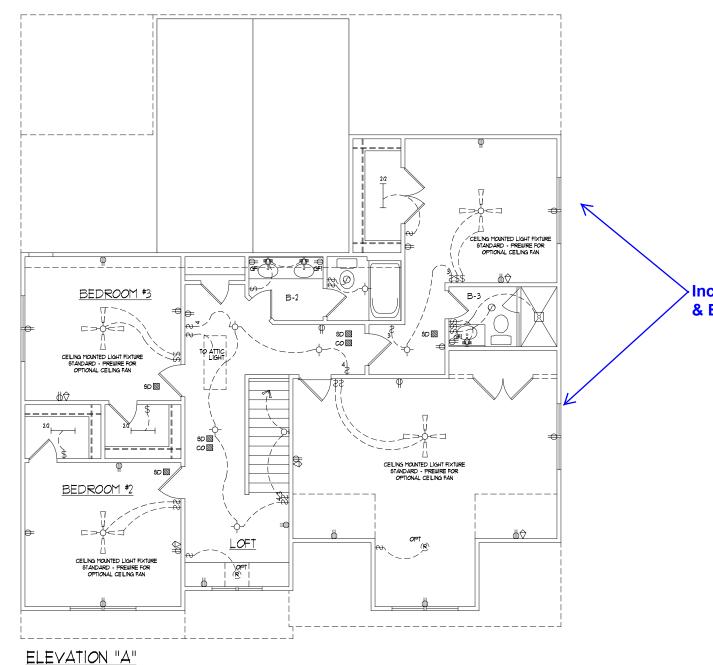






## Include Rec Room & Bedroom #4





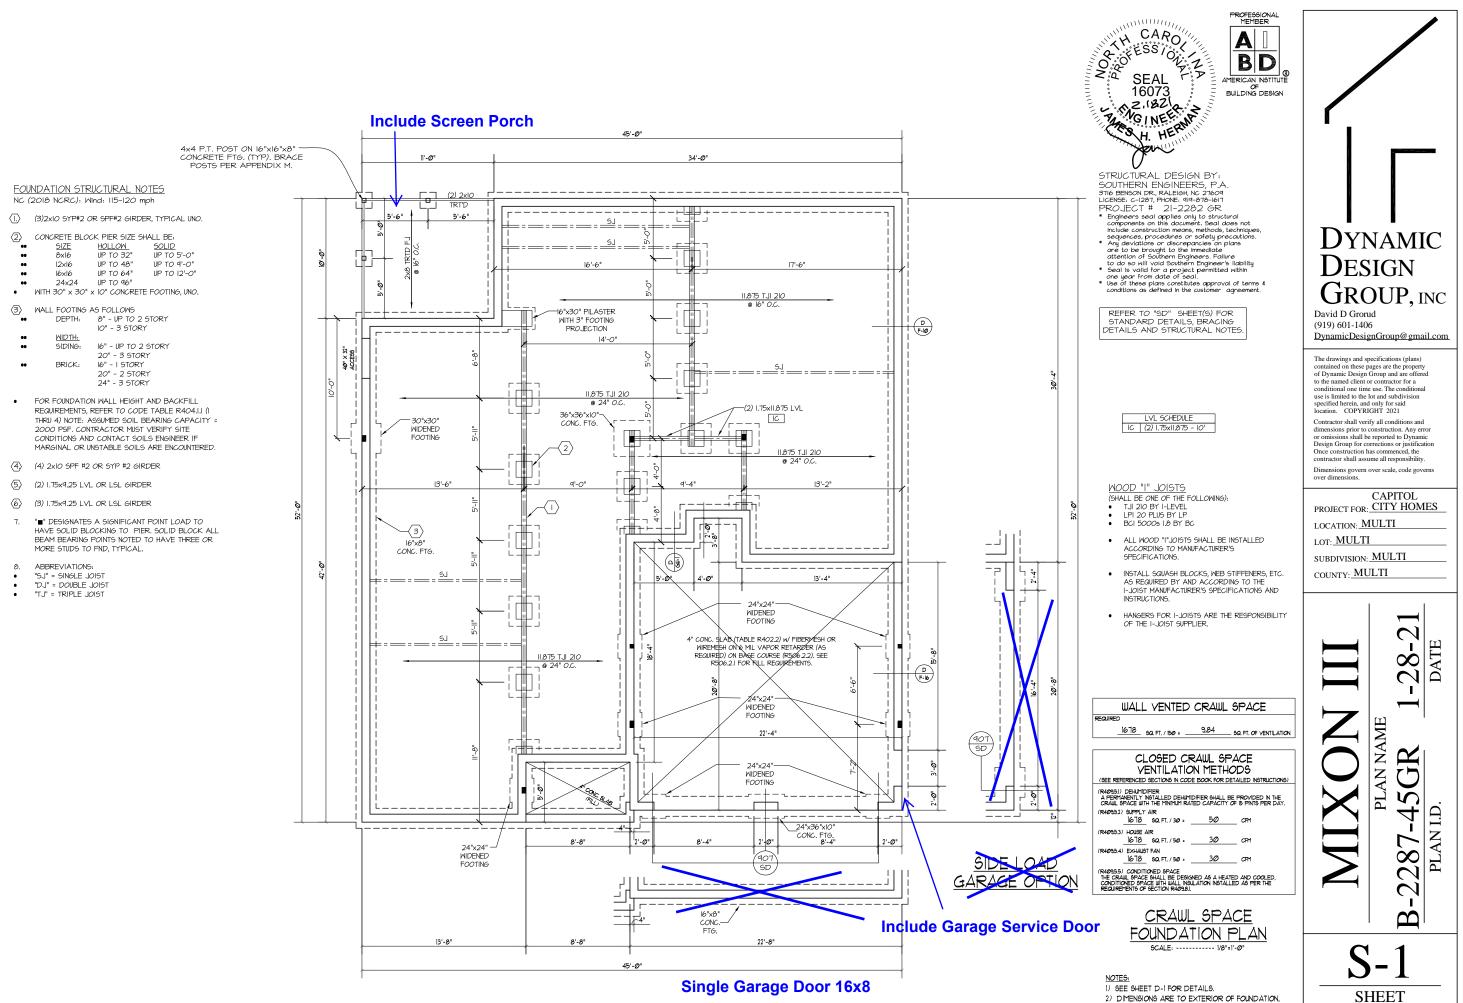

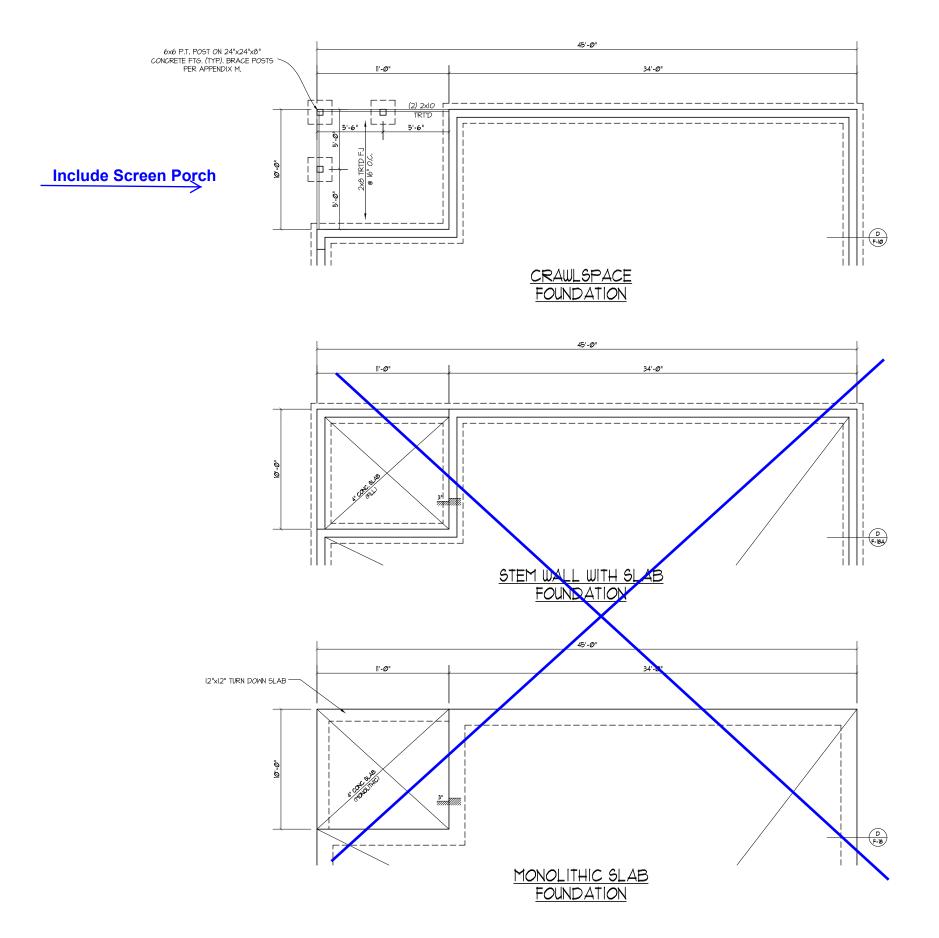

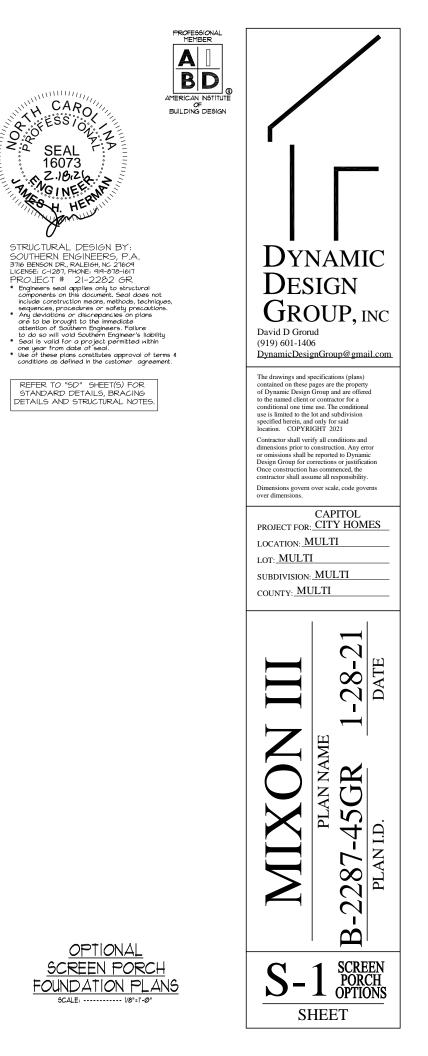


## FRAMING NOTES

NC (2018 NCRC): Wind: 115-120 mph


- BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED WSP; CS-WSP, NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING.
- 2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING MALLS ON ALL STORIES MITH WOOD STRUCTURAL PANEL SHEATHING (MSP) (EXPOSURE B: 17/16", EXPOSURE C: 15/32"), SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. WSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE WEP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD
- 4. <u>"HD" = HOLDOWN:</u> HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY
- \*\*GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR EQUIV) \*\*UPPER FLOORS: ATTACH BASE OF KING STUD WITH A SIMPSON CS22
- STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH 1/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTERMEDIATE
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBW-WSP" ON PLANS), ATTACH ONE SIDE WITH 16" WSP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS) INSTALL BLOCKING AT ALL PANEL EDGES ATTACH GB OVER WSP AS REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2 GB WITH A MIN, OF 5d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.



- TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS
- TRUSS SCHEMATICS (PROFILES) SHALL BE 2. PREPARED AND SEALED BY TRUSS MANUFACTURER.
- З. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO 4. UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

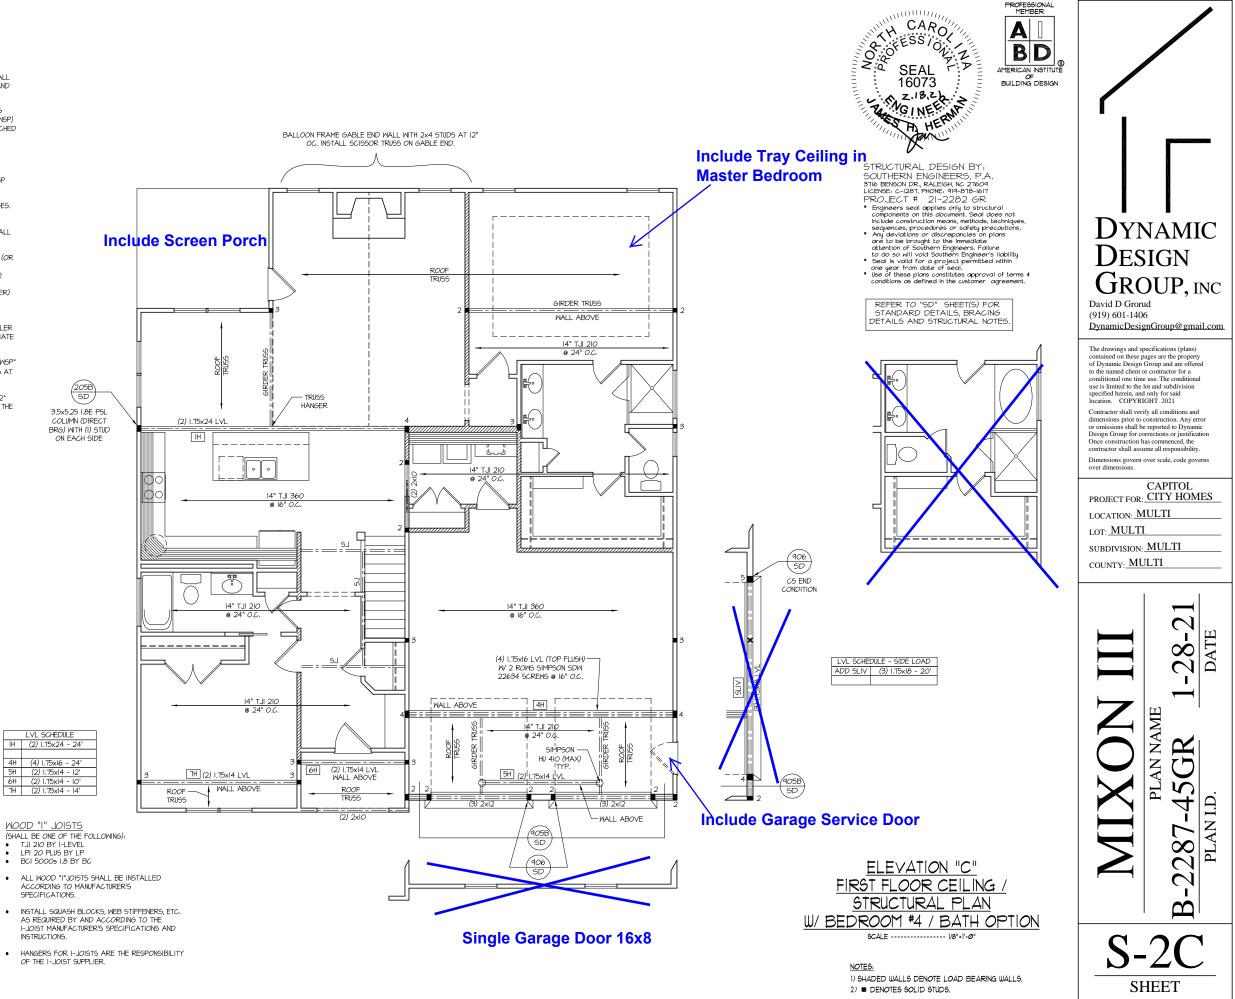



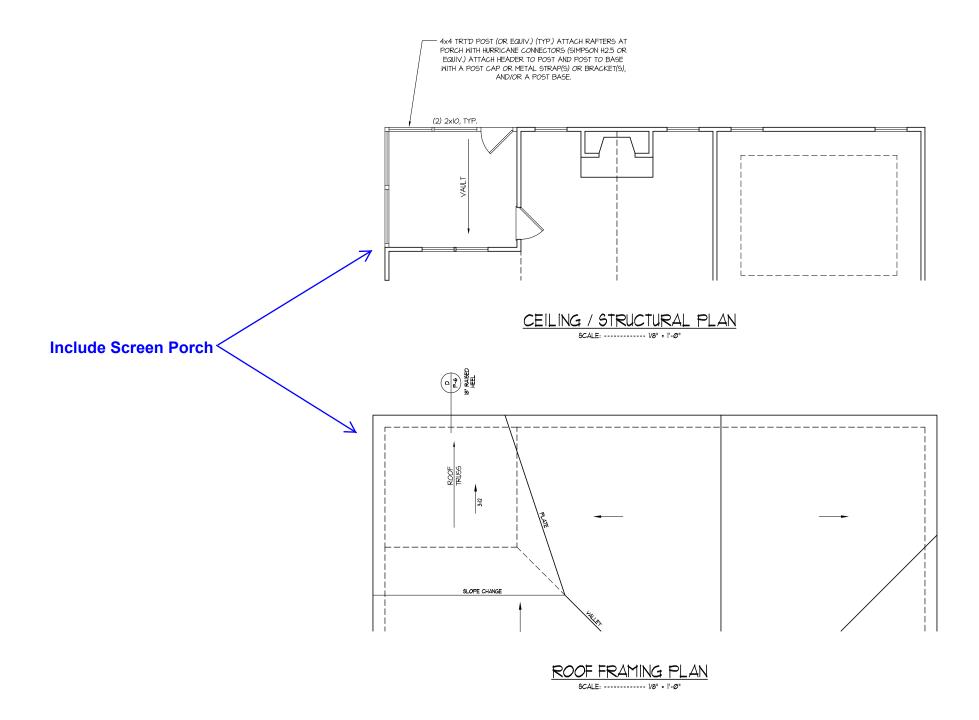





STRUCTURAL DESIGN BY:

- STRUCTURAL DESIGN BY: SOUTHERN ENGINEERS, P.A. 316 Belson DR, RALEIGH, NC 21604 LICENSE: C-1287, PHONE: 914-918-1617 PROJECT # 21-2282 GR \* Engineers seal applies only to structural components on this document. Seal does not include construction means, methods, techniques, sequences, procedures or aafety precautions. Any deviations or discrepancies on plans or to be brought to the Immediate attention of Southern Engineers. Failure to do so vill void Southern Engineer's liability Seal is valid for a project permitted within one year from date of seal. Use of these plans constitutes approval of terms 4 conditions as defined in the customer agreement.


REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.

ROOF FRAMING NOTES:


NC (2018 NCRC): Wind: 115-120 mph

- (I.) 2x8 @ 16" O.C. WITH 2x10 RIDGE, UNO.
- 2) (2) 2x10 OR 1.75x11.875 LVL HIP. (2) 2x10 HIPS MAY BE SPLICED WITH A MIN. 6'-O" OVERLAP AT CENTER
- (2) 2×10 OR 1.75×9.25 LVL VALLEY. DO NOT SPLICE 3, VALLEYS
- 4) 1.75x11.875 LVL OR (2)1.75x9.25 LVL VALLEY
- (5.) FALSE FRAME VALLEY ON 2x10 FLAT PLATE
- 6. 2x6 RAFTERS @ 16" O.C. W/ 2x8 RIDGE, UNO.
- 1 2xIO RAFTERS @ 16" O.C. W 2xI2 RIDGE, UNO.
- 8 EXTEND RIDGE 12" BEYOND INTERSECTION
- "SR" = SINGLE RAFTER
- "DR" = DOUBLE RAFTER
- "TR" = TRIPLE RAFTER "RS" = ROOF SUPPORT
- .
- "■" = (3) STUD OR 4x4 POST FOR ROOF SUPPORT (USE 2X6 OR 6X6 FOR SUPPORT POSTS OVER IO'-O" IN . HEIGHT)
- ATTACH VAULTED RAFTERS WITH HURRICANE CLIPS: .
- SIMPSON "H-2.5A" OR EQUIVALENT INSTALL RAFTER TIES AND COLLAR TIES PER SECTION .
- R802.3.1 OF THE 2018 NC RESIDENTIAL CODE.



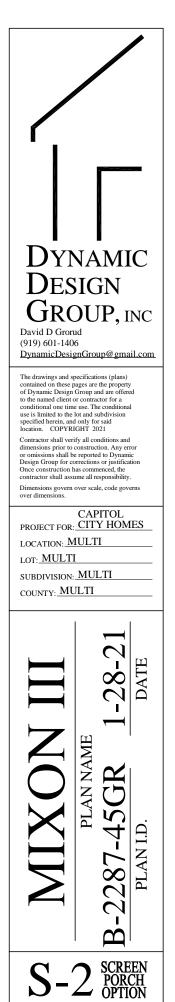

SHEET

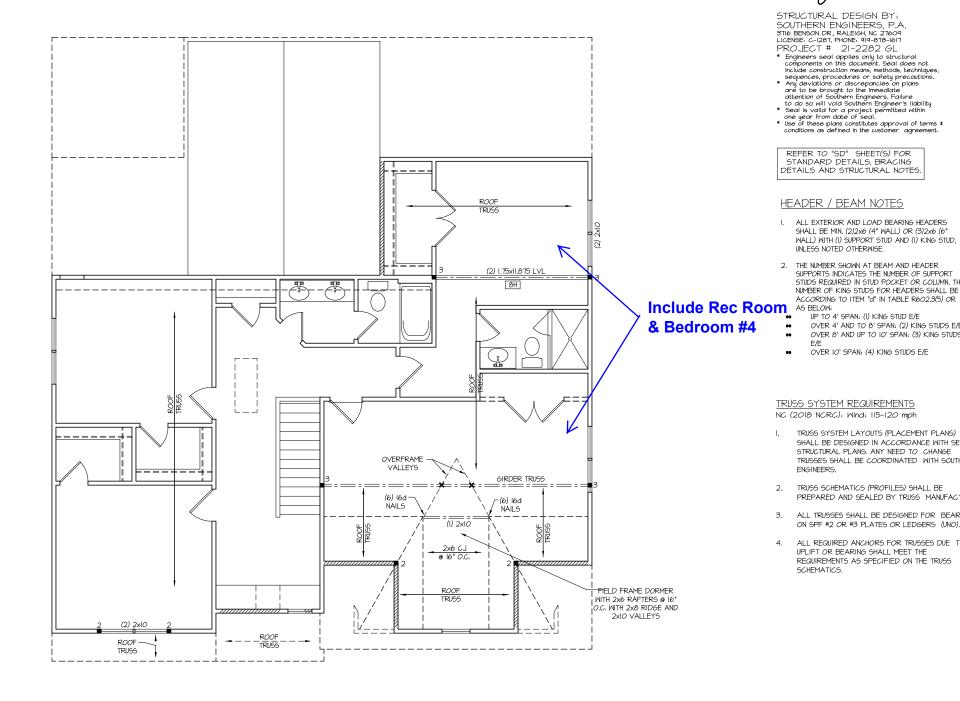

 LVL SCHEDULE

 8H
 (2) 1.75x11.875 - 14'-0"





STRUCTURAL DESIGN BY:

- STRUCTURAL DESIGN BY: SOUTHERN ENGINEERS, P.A. 316 Belson DR, RALEIGH, NC 21604 LICENSE: C-1287, PHONE: 914-978-1617 PROJECT # 21-2282 GL \* Engineers seal applies only to structural components on this document. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions. Any deviations or discrepancies on plans are to be brought to the Immediate attention of Southern Engineers. Failure to do so vill void Southern Engineer's liability Seal is valid for a project permitted within one year from date of seal. Use of these plans constitutes approval of terms 4 conditions as defined in the customer agreement.

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.

HEADER / BEAM NOTES

- I. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2)2x6 (4" WALL) OR (3)2x6 (6" WALL) WITH (I) SUPPORT STUD AND (I) KING STUD, UNLESS NOTED OTHERWISE.
- 2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUPBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS FOR HEADERS SHALL BE
- ...
- UP TO 4' SPAN: (I) KING STUD E/E OVER 4' AND TO 8' SPAN: (2) KING STUDS E/E
- OVER &' AND UP TO IO' SPAN: (3) KING STUDS E/E
- .. OVER IO' SPAN: (4) KING STUDS E/E

TRUSS SYSTEM REQUIREMENTS NC (2018 NCRC): Wind: 115-120 mph


- I. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- 2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
- З. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO 4. UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.




NOTES: SHADED WALLS DENOTE LOAD BEARING WALLS.
 DENOTES SOLID STUDS.

DYNAMIC DESIGN **GROUP**, INC David D Grorud (919) 601-1406 DynamicDesignGroup@gmail.com The drawings and specifications (plans) contained on these pages are the property of Dynamic Design Group and are offered to the named client or contractor for a conditional one time use. The conditional use is limited to the lot and subdivision specified herein, and only for said location. COPYRIGHT 2021 Contractor shall verify all conditions and dimensions prior to construction. Any error or omissions shall be reported to Dynamic Design Group for corrections or justification Once construction has commenced, the contractor shall assume all responsibility. Dimensions govern over scale, code govern over dimensions CAPITOL PROJECT FOR: CITY HOMES LOCATION: MULTI LOT: MULTI SUBDIVISION: MULTI COUNTY: MULTI 28-2 DATE PLAN NAME -45GR PLAN I.D. ì 287 Ņ В **S-3C** 

SHEET

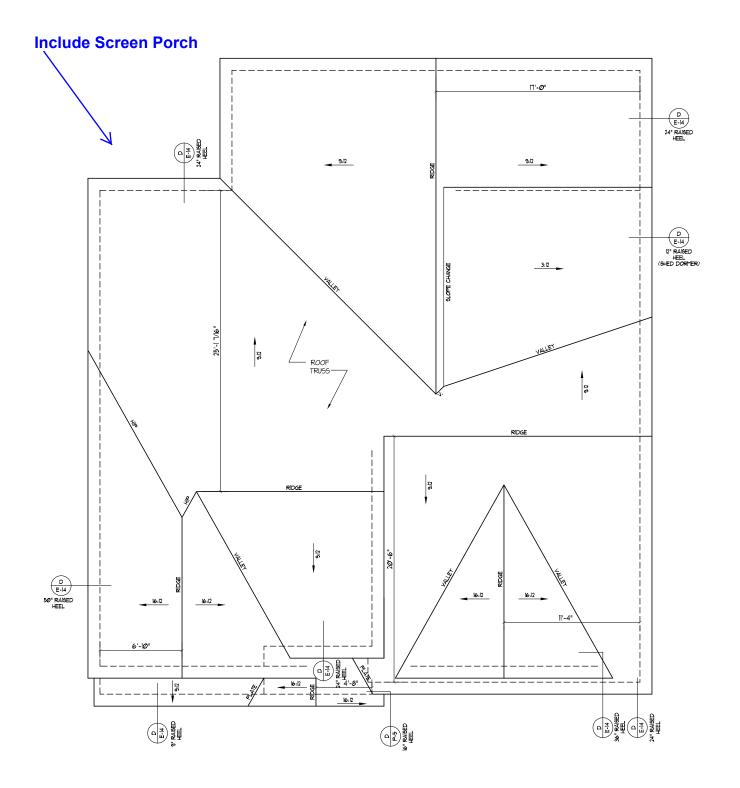




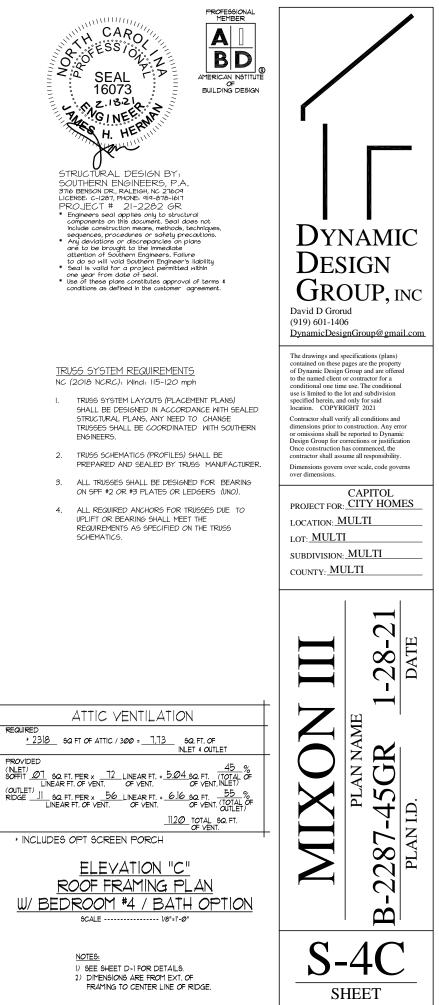

### STRUCTURAL NOTES NC (2018 NCRC): Wind: 115-120 mph

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS AND HEADERS, COLUMNS, CANTILEVERS, OFFSET LOAD BEARING WALLS, PIER & GIRDER SYSTEM, FOOTING, AND PILING SYSTEM. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM. ALL REQUIREMENTS FOR PROFESSIONAL CERTIFICATION SHALL BE PROVIDED BY THE APPROPRIATE PROFESSIONAL. SOUTHERN ENGINEERS, P.A. CERTIFIES ONLY THE STRUCTURAL COMPONENTS AS SPECIFICALLY STATED
- 2. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF RESIDENTIAL CODE, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF CONSTRUCTION MEANS METHODS TECHNIQUES SEQUENCES OR PROCEDURES WILL THE ENGINEER BRESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. "CONSTRUCTION REVIEW" SERVICES ARE NOT PART OF OUR CONTRACT. ALL MEMBERS SHALL BE FRAMED ANCHORED, TIED AND BRACED IN ACCORDANCE WITH GOOD CONSTRUCTION PRACTICE AND THE BUILDING CODE.
- DESIGN LOADS (LISTED AS: LIVE LOAD, DEAD LOAD, DEFLECTION) 3
- ROOMS OTHER THAN SLEEPING ROOMS: (40 PSF, 10 PSF, L/360) SLEEPING ROOMS: (30 PSF, 10 PSF, L/360)
- ATTIC WITH PERMANENT STAIR: (40 PSF, 10 PSF, L/360)
- ATTIC WITHOUT PERMANENT STAIR: (20 PSE 10 PSE 1/360)
- ATTIC WITHOUT STORAGE: (IO PSF, IO PSF, L/240)
- STAIRS: (40 PSE IO PSE I /360)
- EXTERIOR BALCONIES: (60 PSF, 10 PSF, L/360)
- DECKS: (40 PSF, 10 PSF, L/360) GUARDRAILS AND HANDRAILS: (200 LBS)
- PASSSENGER VEHICLE GARAGES: (50 PSF, 10 PSF, L/360)
- FIRE ESCAPES: (40 PSF, 10 PSF, L/360)
- SNOW: (20 PSF)
- WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANELS. SEE FRAMING NOTES FOR THICKNESS AND NAILING REQUIREMENTS.
- 5. SEE APPENDIX M (DCA6) FOR EXTERIOR DECK REQUIREMENTS INCLUDING ATTACHMENTS FOR LATERAL LOADS
- 6. CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 5 INCHES UNLESS NOTED OTHERWISE (INO). AIR ENTRAINED PER TABLE 402.2. ALL CONCRETE SHALL BE PROPORTIONED, MIXED, HANDLED, SAMPLED, TESTED, AND PLACED IN ACCORDANCE WITH ACI STANDARDS ALL SAMPLES FOR PUMPING SHALL BE TAKEN FROM THE EXIT FND OF THE PUMP CONTROL JOINTS IN SLABS SHALL BE SPACED ON A GRID OF +-30 TIMES THE DEPTH (D). CONTROL JOINTS SHALL BE SAWCUT TO A DEPTH OF I/D. (I.E. 4" CONCRETE SLABS SHALL HAVE /4" DEEP CONTROL JOINTS SAWCUT IN SLAB ON A +-10'-0" X +-10'-0" GRID).
- 7. ALLOWABLE SOIL BEARING PRESSURE ASSUMED TO BE 2000 PSF. THE CONTRACTOR MUST CONTACT A GEOTECHNICAL ENGINEER AND THE STRUCTUAL ENGINEER IF UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED, THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE PROVIDED WITH ADEQUATE DRAINAGE, AND SHALL BE GRADED SO AS TO DRAINSURFACE WATER AWAY FROM FOUNDATION WALLS.
- 8. ALL FRAMING LUMBER SHALL BE SPF #2 (Fb = 875 PSI) UNLESS NOTED OTHERWISE (UNO), ALL TREATED LUMBER SHALL BE SYP # 2. PLATE MATERIAL MAY BE SPF # 3 OR SYP #3 (Fc(perp) = 425 PSI - MIN).
- L.V.L. SHALL BE LAMINATED VENEER LUMBER: Fb=2600 PSI, Fv=285 PSI, E=1.9x10 PSI.
   P.S.L. SHALL BE PARALLEL STRAND LUMBER: Fb=2900 PSI, Fv=290 PSI, E=2.0x10 PSI.
   P.S.L. SHALL BE LAMINATED STRAND LUMBER: Fb=2250 PSI, Fv=400 PSI, E=1.55x10 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURERS INSTRUCTIONS
- IO. ALL ROOF TRUSS AND I-JOIST LAYOUTS SHALL BE PREPARED IN ACCORDANCE WITH THE SEALED STRUCTURAL DRAWINGS. TRUSSES AND I-JOISTS SHALL BE INSTALLED ACCORDING TO THE MANUFACTURE'S SPECIFICATIONS. ANY CHANGE IN TRUSS OR I-JOIST LAYOUT SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- II. ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" INCHES AND FULL FLANGE WIDTH, PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS (1/2" DIAMETER x 4" LONG). LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOIST ARE TOE NAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE @ 48" O.C. ALL STEEL TUBING SHALL BE ASTM A500. LAP ALL REBAR SPLICES 30 BAR
- 12. REBAR SHALL BE DEFORMED STEEL, ASTM615, GRADE 60.
- 13. FLITCH BEAMS SHALL BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM A325) WITH WASHERS PLACED UNDER THE THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" O.C. (MAX), AND STAGGERED AT THE TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH 2 BOLTS LOCATED AT 6" FROM EACH END.
- 14. BRICK LINTELS (WHEN REQUIRED) SHALL BE 3 1/2"x3 1/2"x1/4" STEEL ANGLE FOR UP TO 6'-0" SPAN AND 6"x4"x5/16" STEEL ANGLE WITH 6" LEG VERTICAL FOR SPANS UP TO 9'-0". SEE PLANS FOR SPANS OVER 9'-O". SEE ALSO SECTION RT03.7.3 LINTELS.

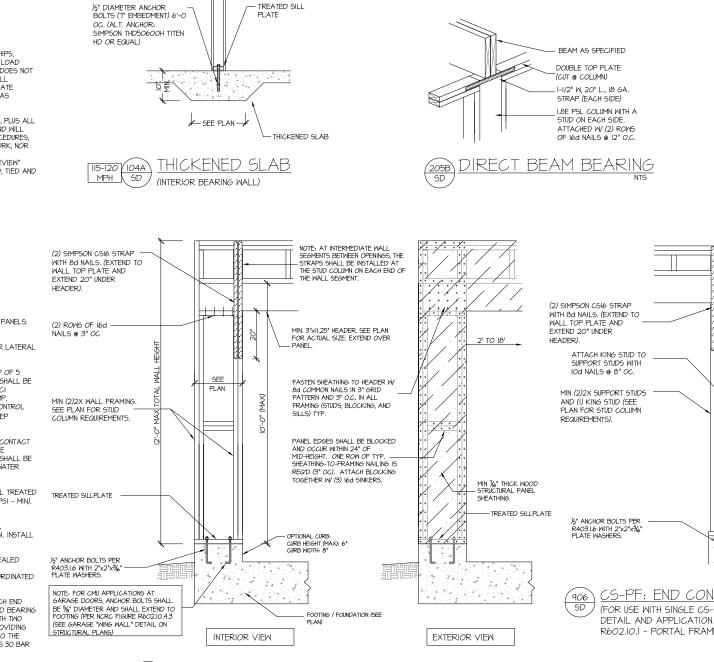

CS-PF: CONTINUOUS PORTAL FRAME CONSTRUCTION 905B DETAIL AND APPLICATION BASED ON NCRC FIGURE R602.0.1 - PORTAL FRAME CONSTRUCTION

