

Harnett County Department of Public Health

PERMIT # SFD2107-0012

Operation Permit

821436

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 106 WALKER GROVE LN. (MATTHEWS RD)

Name: (owner) TRUE HOMES LLC SUBDIVISION WALKER GROVE LOT # 14

System Installer: DAVID BRANTLEY + SONS

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well 222 feet

System Type: 25% REDUCTION SYSTEM IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

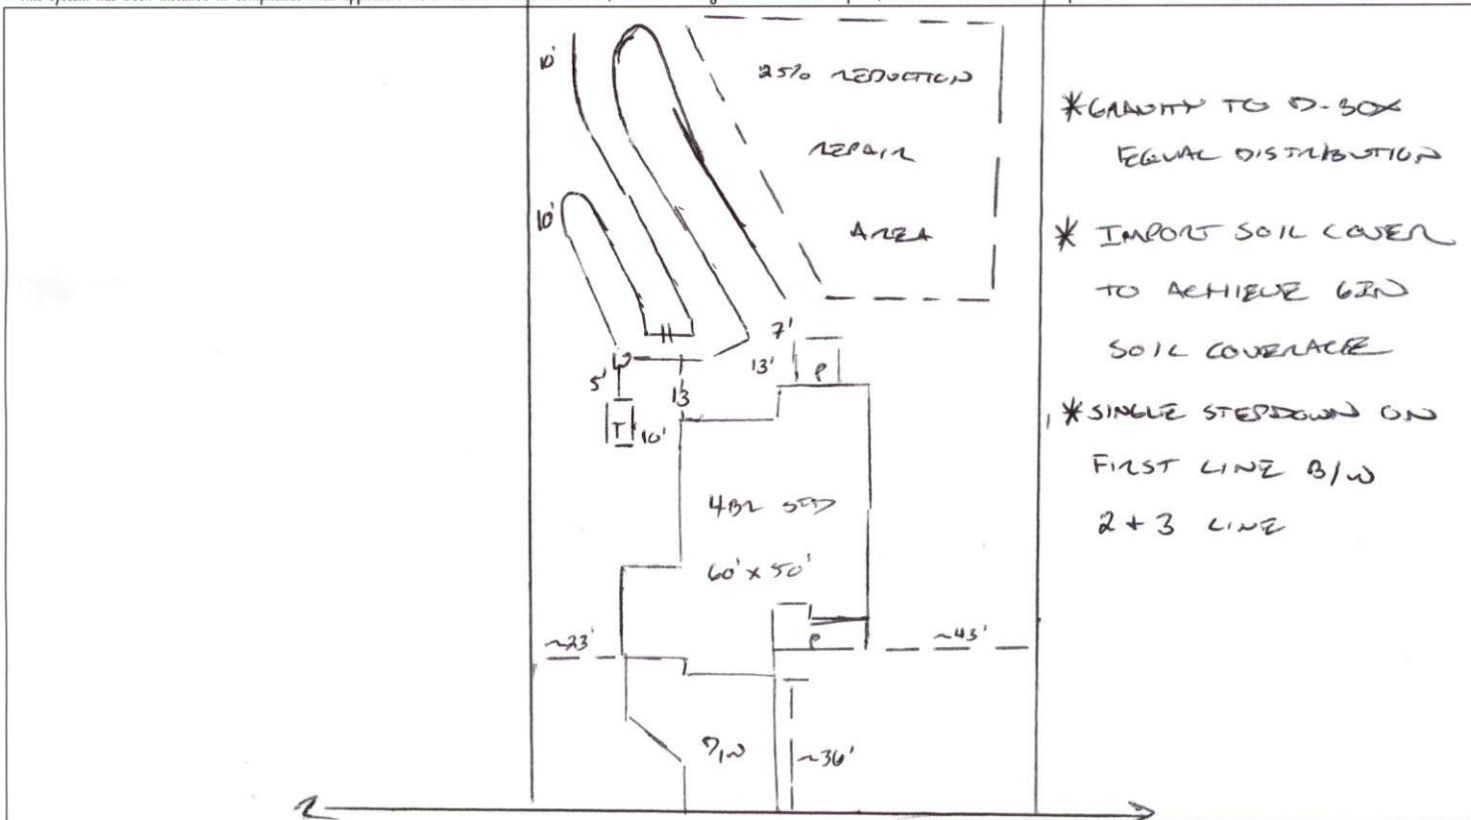

- * CAPACITY TO D-BOX EQUAL DISTRIBUTION
- * IMPORT SOIL COVER TO ACHIEVE 6IN SOIL COVERAGE
- * SINGLE STEPDOWN ON FIRST LINE B/W 2+3 LINE

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW IIIg Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of

Drainage Field ditches 2 of each ditch 180 feet ditches 3 feet ditches 16 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 09/08/2021