

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

) -

-- Denotes Reaction Greater than 3,000 lbs.

Reaction / # of Studs

▲= Denotes Left End of Truss (Reference Engineered Truss Drawing)

J0720-3440

LOAD CHART FOR JACK STUDS
(BASED ON MALES 850/53) A 60)
MARKE OF JACK STUDO ACO 1980/6 (A COD OF FEADER/6000E)

2550 1 5100 2

7650 3

10200 4 12750 5

15300 6

3400

6600 2

10200 3

13600 4

17000 5

JOB #

1700 1 3400 2

Truss Placement Plan SCALE: NTS

Lenny Norris

	BUILDER	Weaver Development	CITY / CO.	Dunn / Harnett	THIS IS A TRUSS PLAC These trusses are designed the building design at the sp sheets for each truss design is responsible for temporary the overall structure. The de walls, and columns is the re- regarding bracing, consult B	
	JOB NAME	Lot 16 West Park	ADDRESS	Lot 16 West Park		
	PLAN	Magnolia Elev. C	MODEL	Roof	or online @ sbcindustry.com  Bearing reactions less that prescriptive Code requires	
	SEAL DATE	Seal Date	DATE REV.	/ /	( derived from the prescriptoundation size and numb than 3000# but not greate be retained to design the specified in the attached retained to design the suppression of the suppression	
	QUOTE #	Quote #	DRAWN BY	Christine Shivy		

SALES REP.

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.

These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Christine Shivy

Christine Shivy



Fax: (910) 864-4444

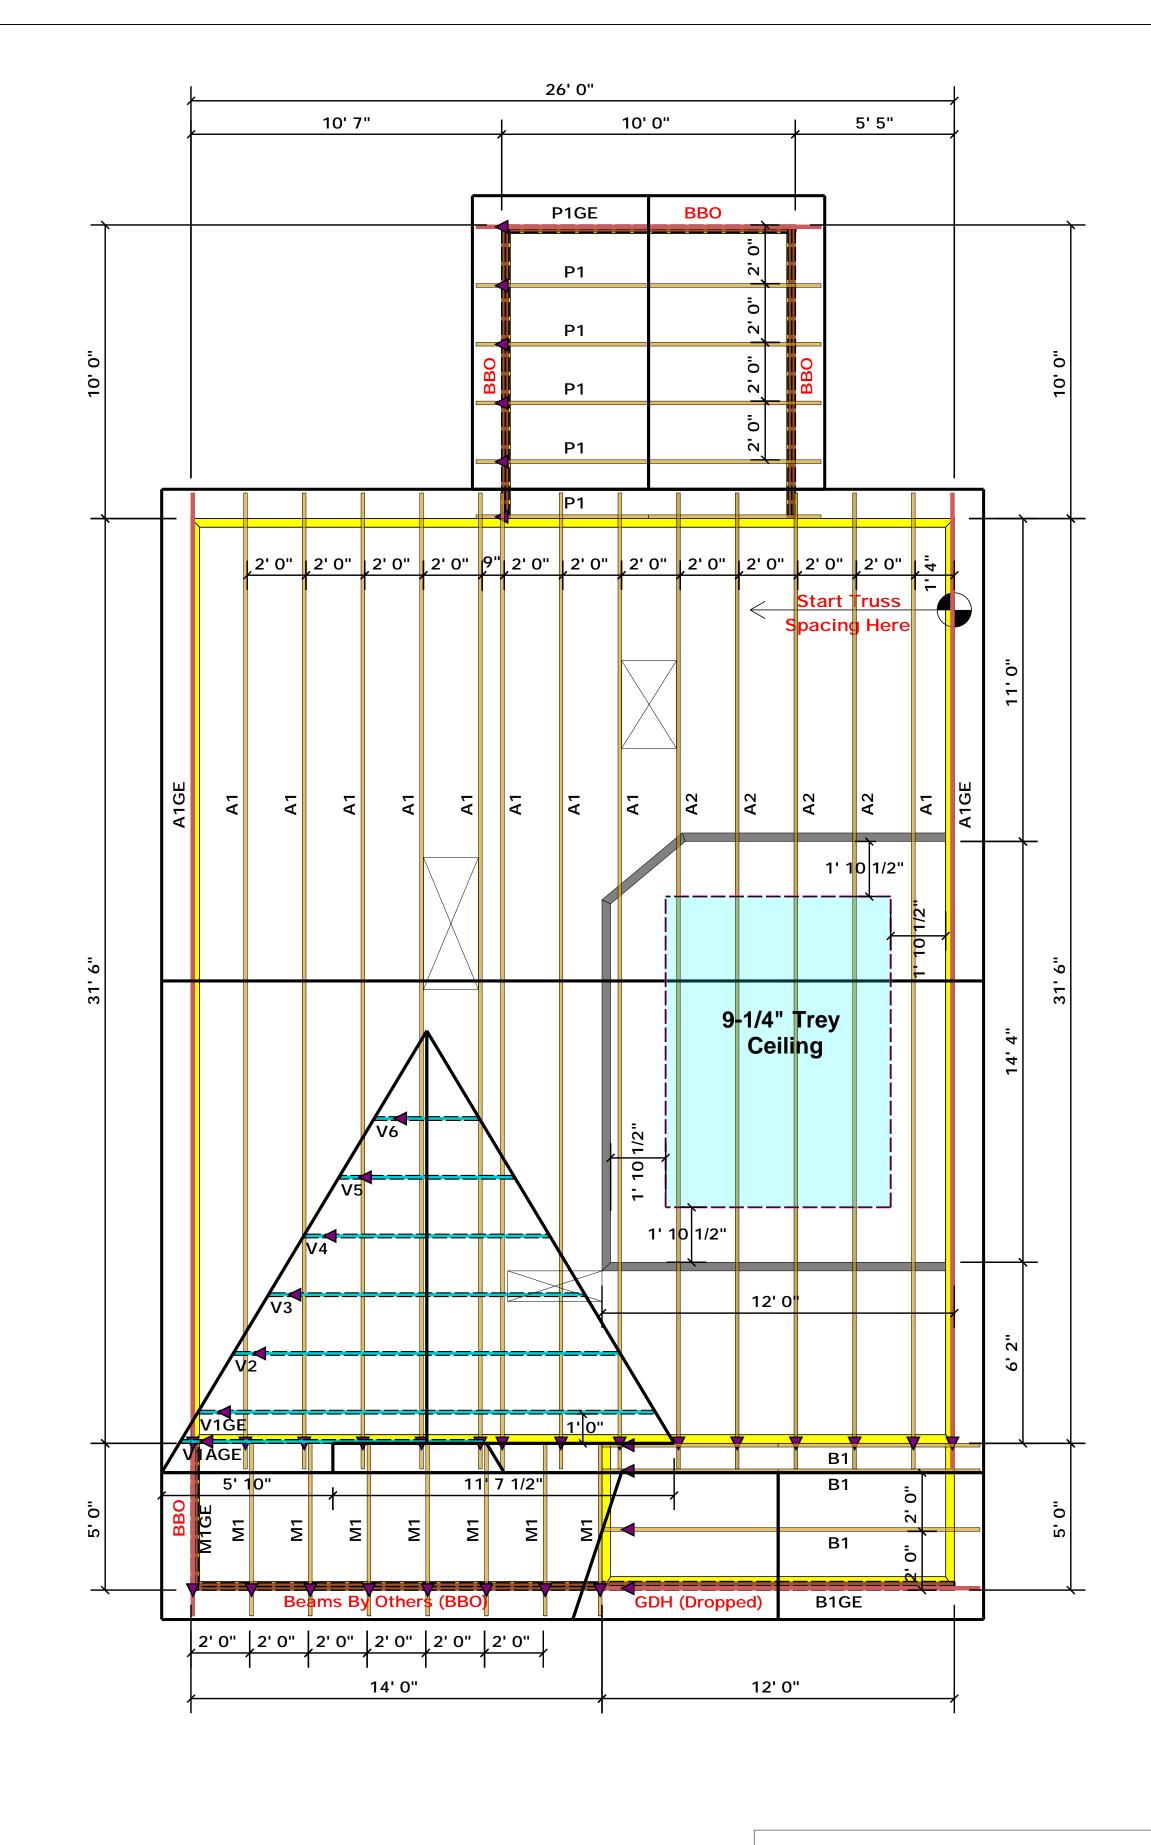

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

) -

-- Denotes Reaction Greater than 3,000 lbs.
Reaction / # of Studs

▲= Denotes Left End of Truss (Reference Engineered Truss Drawing)

J0720-3440

LOAD CHART FOR JACK STUDS

(BASED ON LABBES (50) 53) A 60)

STANGE OF JACK STUDO ALS INSIDE ( A CND OF FEADER/SERGES)

2550 1 5100 2

7650 3

10200 4 12750 5

15300 6

3400

6600 2

10200 3

13600 4

17000 5

JOB#

1700 1 3400 2

5100 3

Truss Placement Plan SCALE: NTS

SALES REP. Lenny Norris

					_	
	BUILDER	Weaver Development	CITY / CO.	Dunn / Harnett	THIS IS These tru the building	
240E	JOB NAME	Lot 16 West Park	ADDRESS	Lot 16 West Park	is respon- the overal walls, and regarding	
(1) PA	PLAN	Magnolia Elev. C	MODEL	Roof	or online  Bearing I prescript	
_	SEAL DATE	Seal Date	DATE REV.	/ /	( derived foundation than 3000 be retain specified retained	
	QUOTE #	Quote #	DRAWN BY	Christine Shivy		
					Signa	

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.

These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Christine Shivy

Christine Shivy



Phone: (910) 864-8787 Fax: (910) 864-4444