

Truss Placement Plan
SCALE: 1/4" = 1'-0"

■	HUS26	USP	5	NA	16d/3-1/2"	16d/3-1/2"
●	MSH422	USP	2	Varies	10d/3"	10d/3"

Estimation

Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	2049.22
Roof Decking	1st Floor	Roof Decking	70 sheets

BEAM LEGEND

PlotID	Length	Product	Plies	Net Qty
2852 TWIN	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	4
GDH (dropped)	12' 0"	2x12 SP No.2	2	2

▲ = Denotes Left End of Truss
 (Reference Engineered Truss Drawing)

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs.
 Reaction / # of Studs

LOAD CHART FOR JACK STUDS

BASED ON TABLES 10.10.1 AND 10.10.2
 NUMBER OF JACK STUDS REQUIRED PER SHEET OF ROOF DECKING

Roof Decking (PSF)	Span (ft)	Jack Stud Spacing (ft)	Number of Jack Studs
1700	1	2550	1
3400	2	5100	2
5100	3	7650	3
6800	4	10200	4
8500	5	12750	5
10200	6	15300	6
11900	7		
13600	8		
15300	9		

BUILDER	Weaver Development Co. Inc.
JOB NAME	Lot 15 West Park
PLAN	Leyland Elev. " C "
SEAL DATE	Seal Date
QUOTE #	Quote #
JOB #	J0820-3790


CITY / CO.	Dunn / Harnett
ADDRESS	Lot 15 West Park
MODEL	ROOF
DATE REV.	//
DRAWN BY	Lenny Norris
SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris
 Lenny Norris

comTECH
ROOF & FLOOR TRUSSES & BEAMS
 Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

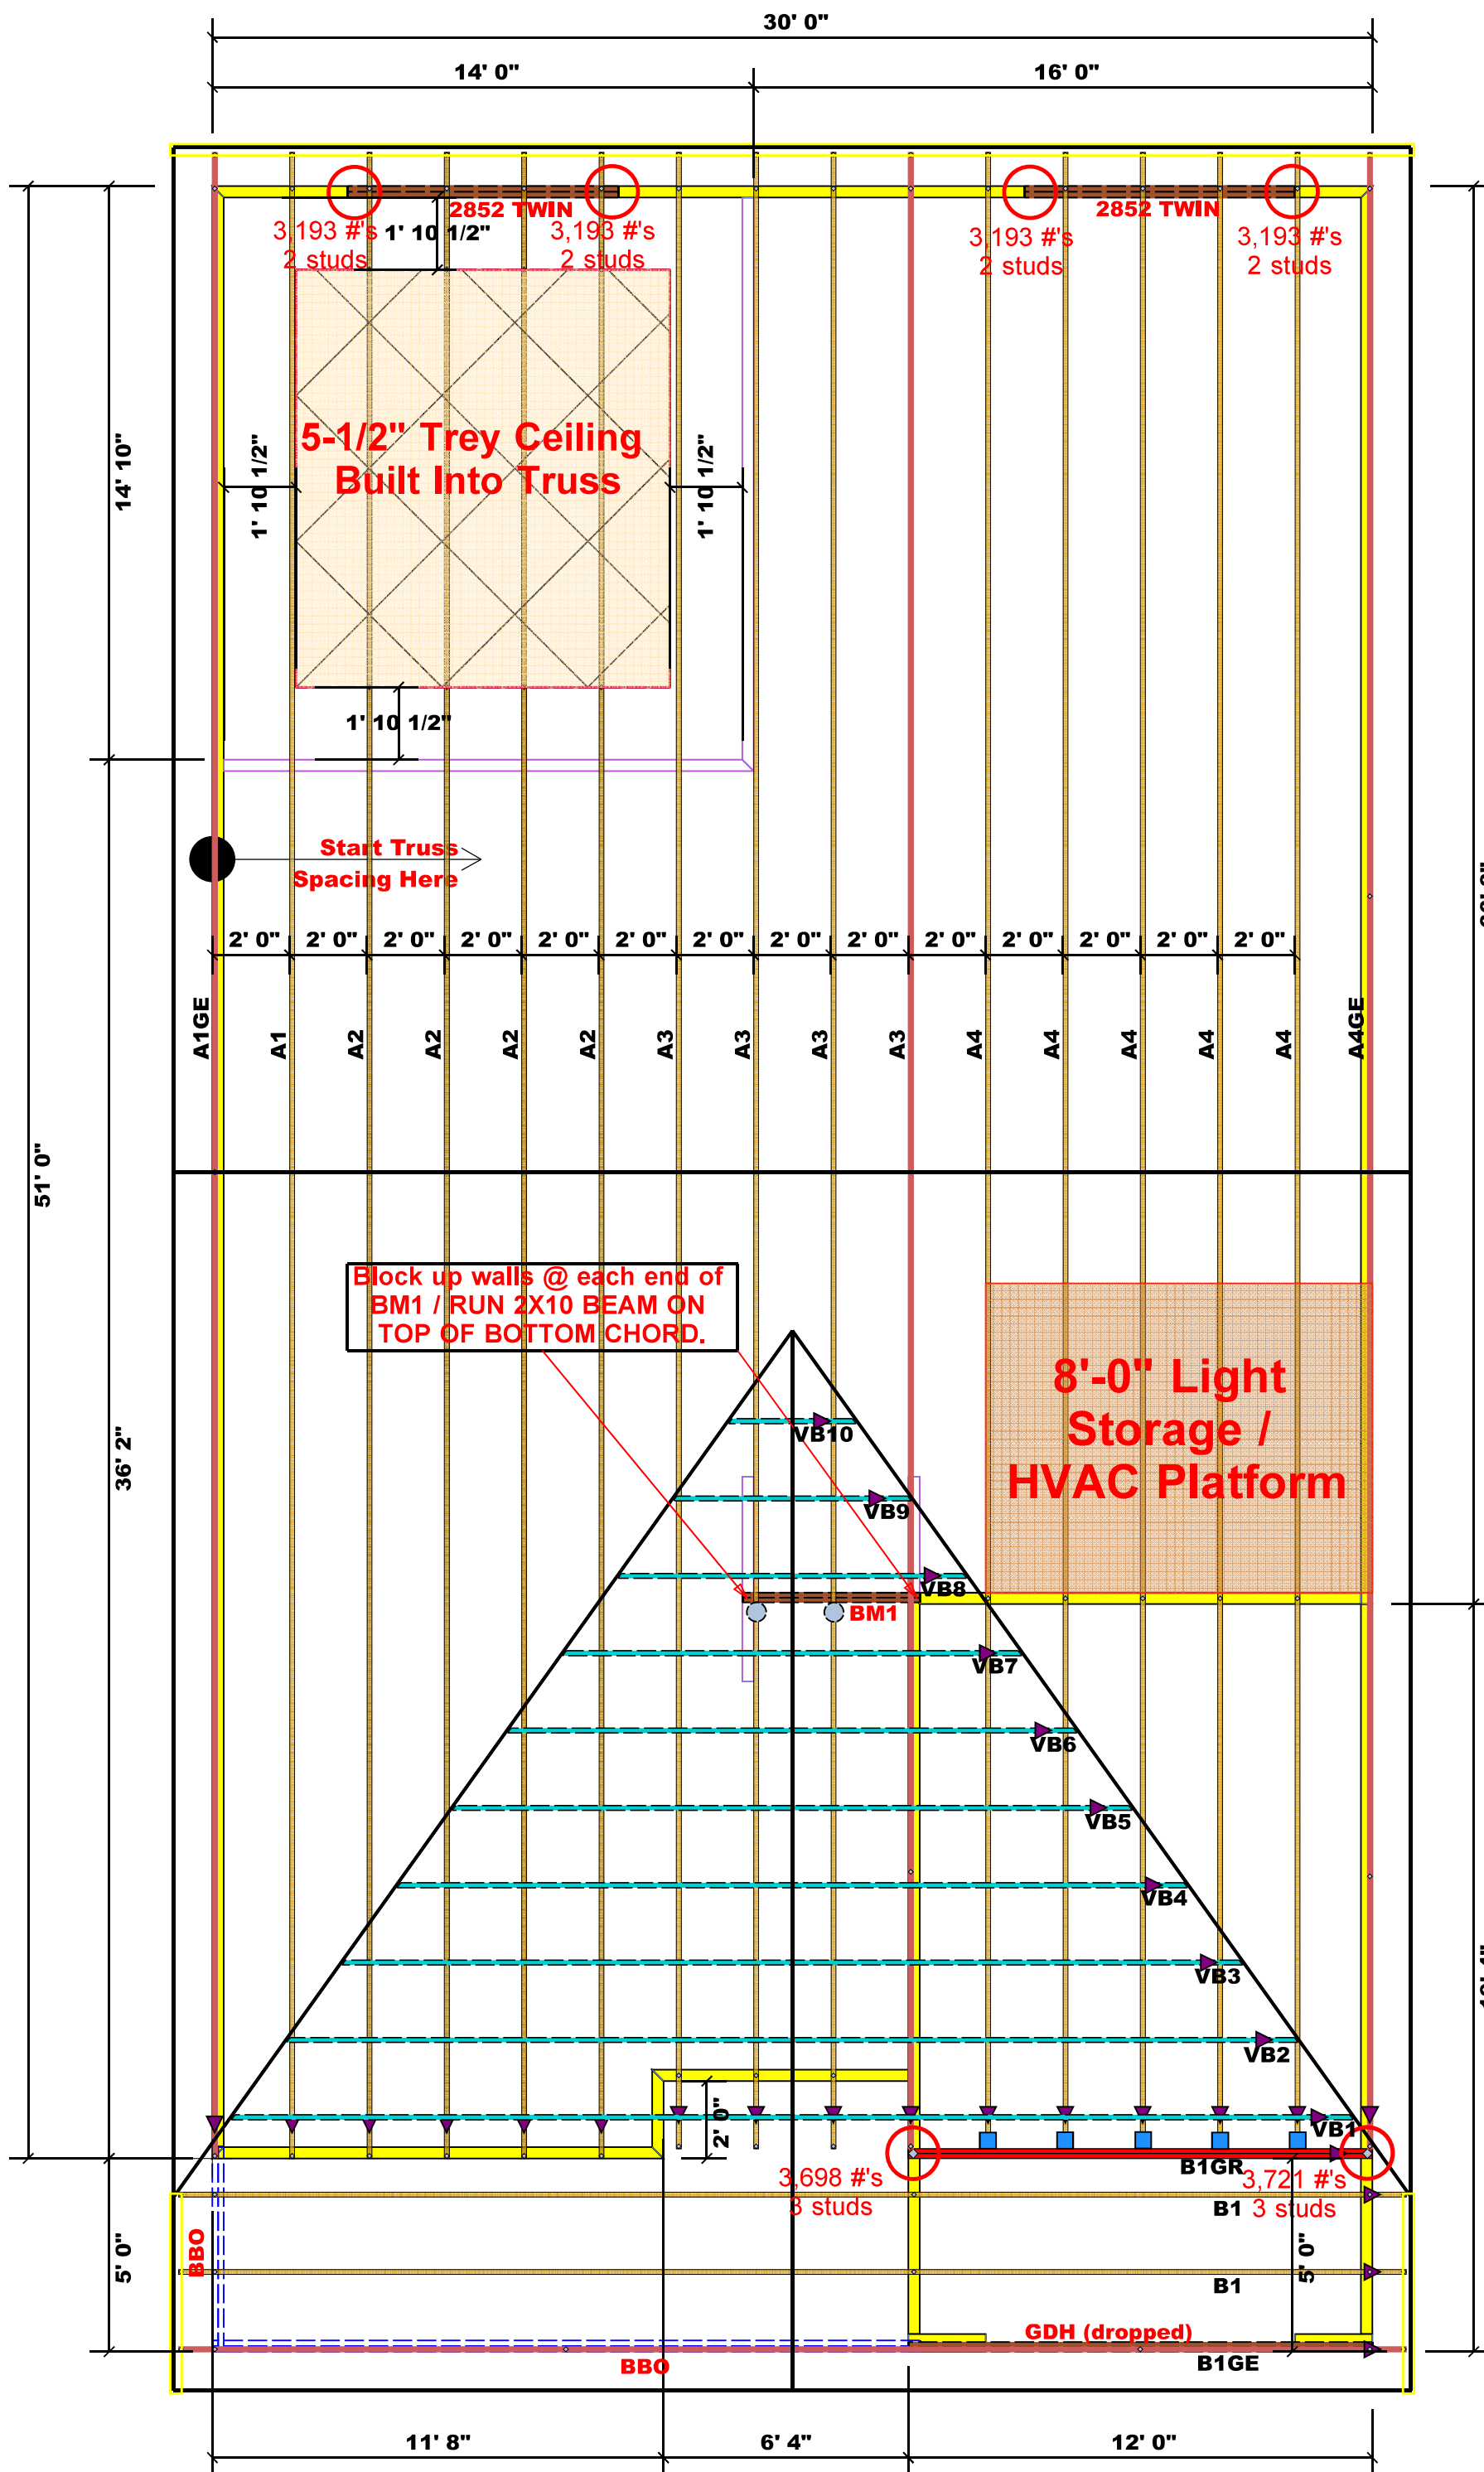

Truss Placement Plan
SCALE: 1/4" = 1'-0"

■	HUS26	USP	5	NA	16d/3-1/2"	16d/3-1/2"
●	MSH422	USP	2	Varies	10d/3"	10d/3"

Estimation

Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	2049.22
Roof Decking	1st Floor	Roof Decking	70 sheets

BEAM LEGEND

PlotID	Length	Product	Plies	Net Qty
2852 TWIN	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	4
GDH (dropped)	12' 0"	2x12 SP No.2	2	2

▲ = Denotes Left End of Truss
(Reference Engineered Truss Drawing)

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs.
Reaction / # of Studs

LOAD CHART FOR JACK STUDS

BASED ON TABLES SHEETS 201
NUMBER OF JACK STUDS REQUIRED: SEE TABLE OF HEADINGS

Beam Size (inches)	Beam Spacing (ft)	Jack Stud Spacing (ft)	Number of Jack Studs
1700	1	2550	1
1700	2	3400	1
3400	2	5100	2
5100	3	6800	2
6800	4	7650	3
8500	4	10200	3
10200	5	13500	4
11900	5	12750	4
13600	6	15000	5
15300	6	17000	5

BUILDER	Weaver Development Co. Inc.
JOB NAME	Lot 15 West Park
PLAN	Leyland Elev. " C "
SEAL DATE	Seal Date
QUOTE #	Quote #
JOB #	J0820-3790

CITY / CO.	Dunn / Harnett
ADDRESS	Lot 15 West Park
MODEL	ROOF
DATE REV.	//
DRAWN BY	Lenny Norris
SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCS1-B1 and BCS1-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris
Lenny Norris

comTECH

ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444