

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0820-3590
Weaver / 1 West Park / Harnett Co.

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: E14734902 thru E14734908

My license renewal date for the state of North Carolina is December 31, 2020.

North Carolina COA: C-0844



August 12, 2020

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Weaver / 1 West Park / Harnett Co.	E14734902
J0820-3590	A1	FINK	16	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:28 2020 Page 1
 ID:CP1eRYXLwLzYgapavR3SHyqHLI-?vVwBLK0rYdJdlvUcoxLzMwp?kS78Nark7q4b2yoYir

0-10-8 7-3-0 14-6-0 21-9-0 29-0-0 29-10-8
 0-10-8 7-3-0 7-3-0 7-3-0 7-3-0 0-10-8

Scale = 1:55.2

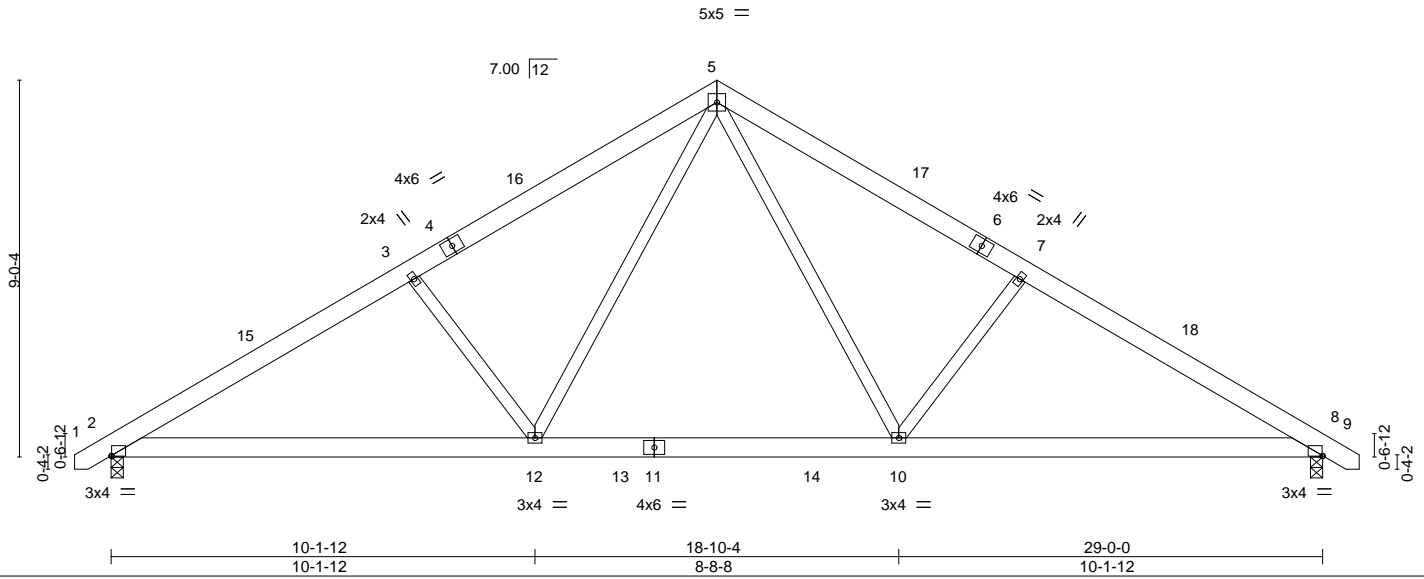


Plate Offsets (X,Y)-- [2:0-0-2,0-0-2], [8:0-0-2,0-0-2]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.23	Vert(LL)	-0.11 10-12	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(CT)	-0.16 2-12	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.21	Horz(CT)	0.03 8	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.03 2-12	>999	240	Weight: 193 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-7 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 8=0-3-8
 Max Horz 2=-213(LC 10)
 Max Uplift 2=-77(LC 12), 8=-77(LC 13)
 Max Grav 2=1226(LC 19), 8=1226(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1861/386, 3-5=-1660/408, 5-7=-1661/408, 7-8=-1861/386
 BOT CHORD 2-12=-214/1683, 10-12=-15/1087, 8-10=-222/1523
 WEBS 3-12=-472/266, 5-12=-114/754, 5-10=-114/754, 7-10=-472/266

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 14-6-0, Exterior(2) 14-6-0 to 18-10-13, Interior(1) 18-10-13 to 29-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.

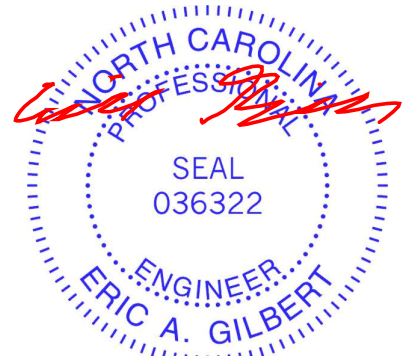

August 12, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job J0820-3590	Truss A1A	Truss Type FINK	Qty 2	Ply 1	Weaver / 1 West Park / Harnett Co.	E14734903
-------------------	--------------	--------------------	----------	----------	------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:28 2020 Page 1
ID:CP1eRYXLwLzYgapavR3SHyqHLI?vVwBLK0rYdJdlvUcoxLzMwpjkT58LjrK7q4b2yoYir

0-10-8 7-3-0 14-6-0 21-9-0 29-0-0 29-10-8
0-10-8 7-3-0 7-3-0 7-3-0 7-3-0 0-10-8

Scale = 1:55.7

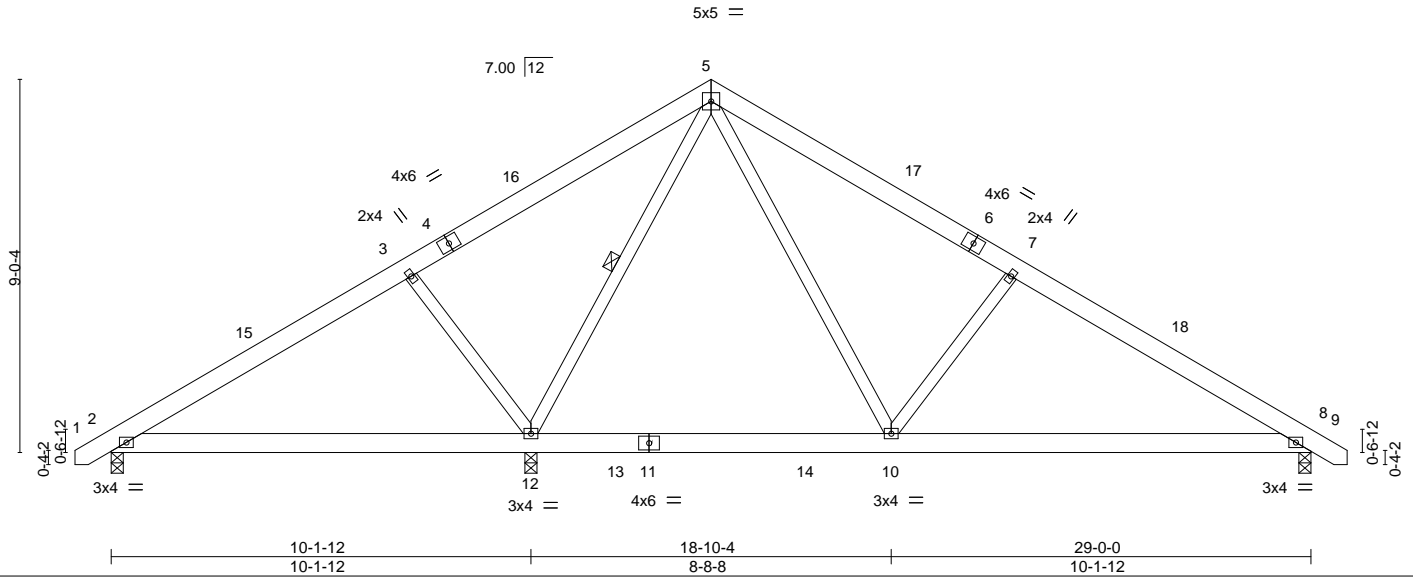


Plate Offsets (X,Y)-- [6:0-0-0,0-0-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.25	Vert(LL) -0.10	10-12	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.30	Vert(CT) -0.14	8-10	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.33	Horz(CT) 0.01	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.13	2-12	>934	240		
							Weight: 193 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-12

REACTIONS.


(size) 2=0-3-8, 12=0-3-8, 8=0-3-8
Max Horz 2=-213(LC 10)
Max Uplift 2=-54(LC 9), 12=-89(LC 12), 8=-72(LC 13)
Max Grav 2=394(LC 23), 12=1293(LC 2), 8=790(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-257/85, 3-5=-43/252, 5-7=-823/199, 7-8=-1025/178
BOT CHORD 10-12=0/283, 8-10=-45/809
WEBS 3-12=-504/308, 5-12=-806/126, 5-10=-73/783, 7-10=-491/275

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 14-6-0, Exterior(2) 14-6-0 to 18-10-13, Interior(1) 18-10-13 to 29-8-9 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 8.

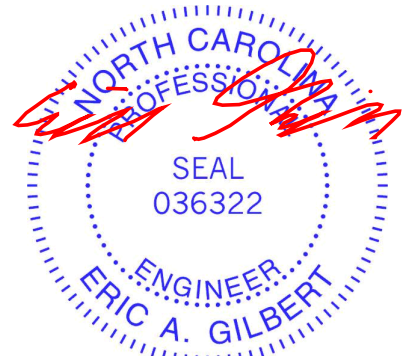

August 12, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Weaver / 1 West Park / Harnett Co.	E14734904
J0820-3590	A1GE	GABLE	1	1		

Comtech, Inc., Fayetteville, NC - 28314, 8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:30 2020 Page 1
 ID:CP1eRYXLwLzYgapavR3SHyqHLI-xlcgc1LGNAt1s33tkDzp2n?CWYctcJO8oRJAgywoYip

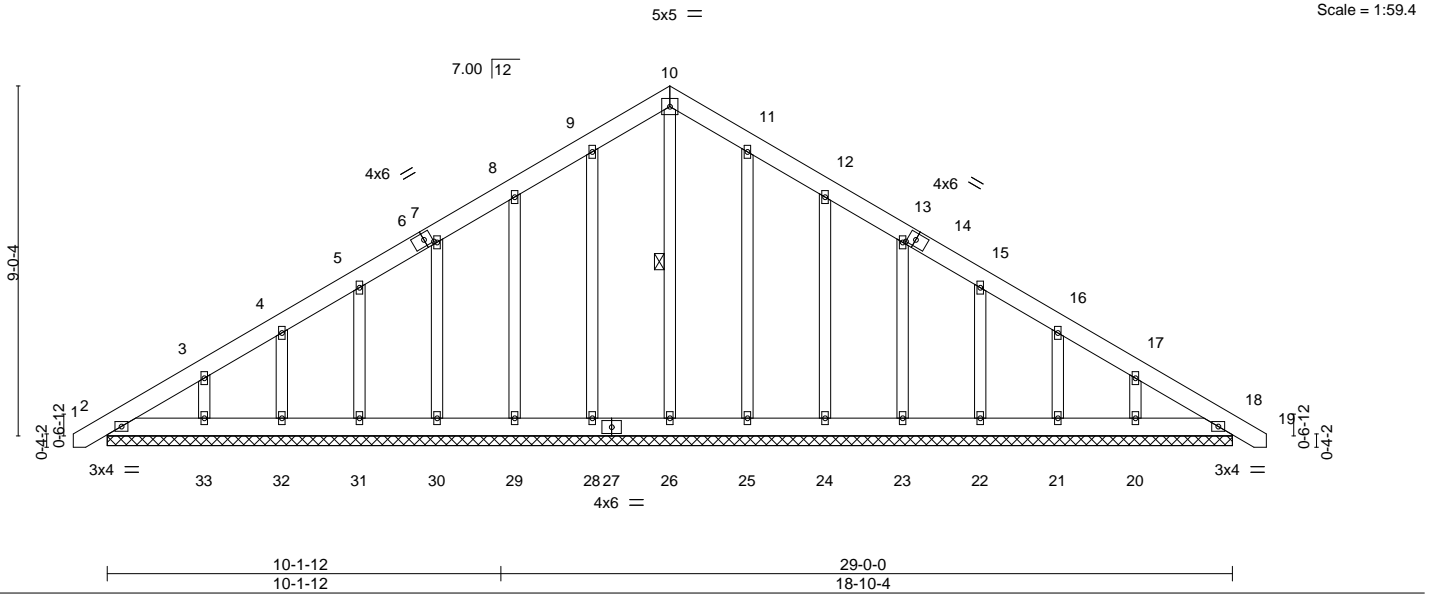


Plate Offsets (X,Y)-- [6:0-2-7,0-2-0], [14:0-2-7,0-2-0]

LOADING (psf)	SPACING-	CS.I.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.04	Vert(LL) 0.00	18	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.02	Vert(CT) 0.00	18	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.13	Horz(CT) 0.01	18	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 236 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 10-26

REACTIONS. All bearings 29-0-0.
 (lb) - Max Horz 2=-266(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 28, 29, 30, 31, 32, 25, 24, 23, 22, 21 except 33=-102(LC 12), 20=-100(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 2, 18, 26, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-9 to 3-8-4, Exterior(2) 3-8-4 to 14-6-0, Corner(3) 14-6-0 to 18-10-13, Exterior(2) 18-10-13 to 29-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 28, 29, 30, 31, 32, 25, 24, 23, 22, 21 except (jt=lb) 33=102, 20=100.

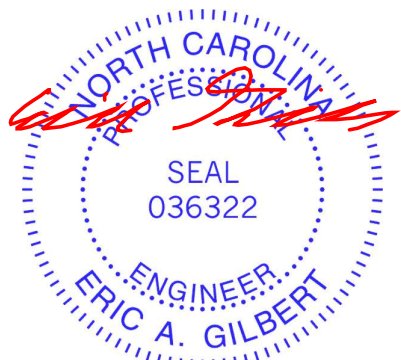

August 12, 2020

Job	Truss	Truss Type	Qty	Ply	Weaver / 1 West Park / Harnett Co.	E14734905
J0820-3590	A1SE	GABLE	1	1		

Comtech, Inc., Fayetteville, NC - 28314, 8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:31 2020 Page 1
 ID:CP1eRYXLwLzYgapavR3SHyqHLI-PUA2pNMu8T?uUDe3HwU2b?YJFxTWLjnH052kCMyoYio
 0-10-8 7-3-0 14-6-0 21-9-0 29-0-0 29-10-8
 0-10-8 7-3-0 7-3-0 7-3-0 7-3-0 0-10-8

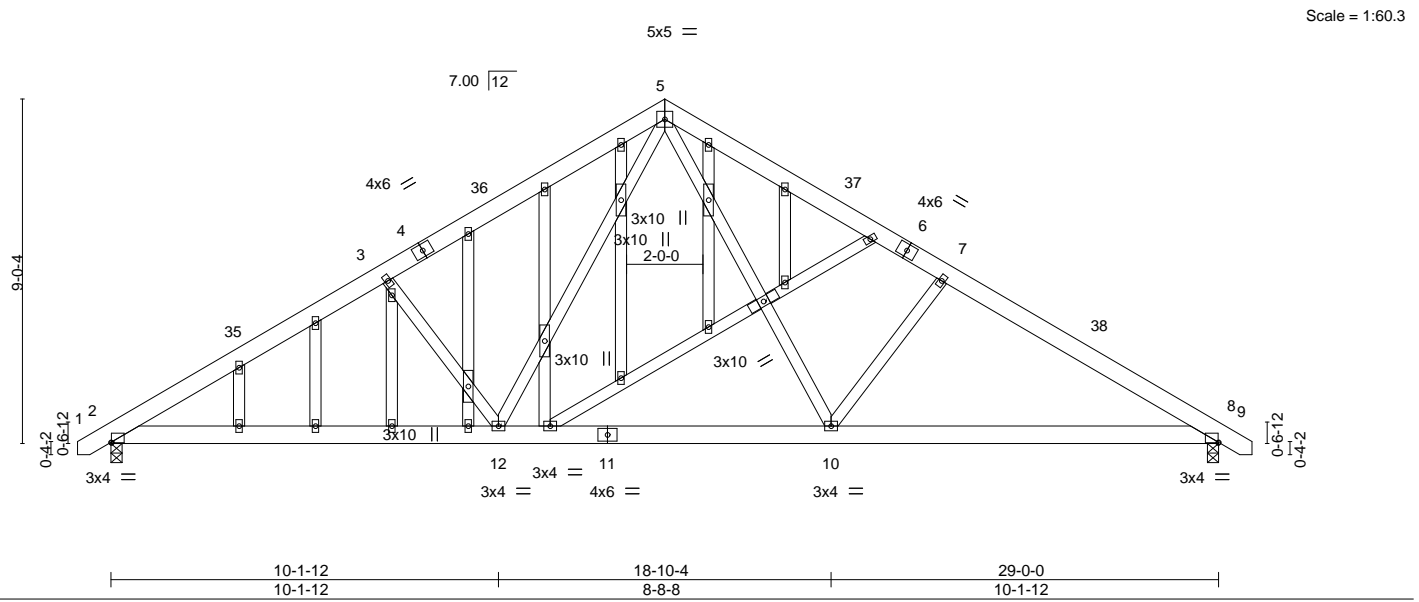

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.23	Vert(LL) -0.07	8-10	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.35	Vert(CT) -0.16	8-10	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.31	Horz(CT) 0.03	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.05	2-12	>999	240	Weight: 256 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-7-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 8=0-3-8
 Max Horz 2=266(LC 10)
 Max Uplift 2=254(LC 12), 8=254(LC 13)
 Max Grav 2=1200(LC 1), 8=1200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1796/386, 3-5=-1580/408, 5-7=-1580/408, 7-8=-1796/386
 BOT CHORD 2-12=-384/1531, 10-12=-89/978, 8-10=-222/1481
 WEBS 3-12=-472/353, 5-12=-196/661, 5-10=-197/661, 7-10=-472/353

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 14-6-0, Exterior(2) 14-6-0 to 18-10-13, Interior(1) 18-10-13 to 29-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=254, 8=254.




August 12, 2020

Job	Truss	Truss Type	Qty	Ply	Weaver / 1 West Park / Harnett Co.	E14734906
J0820-3590	A2	DBL. FINK	5	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:31 2020 Page 1

ID:CP1eRYXLwLzYgapavR3SHyqHLI-PUA2pNMu8T?uUDe3HwU2b?YGfxPELKH052kCMYoYio



Scale = 1:56.1

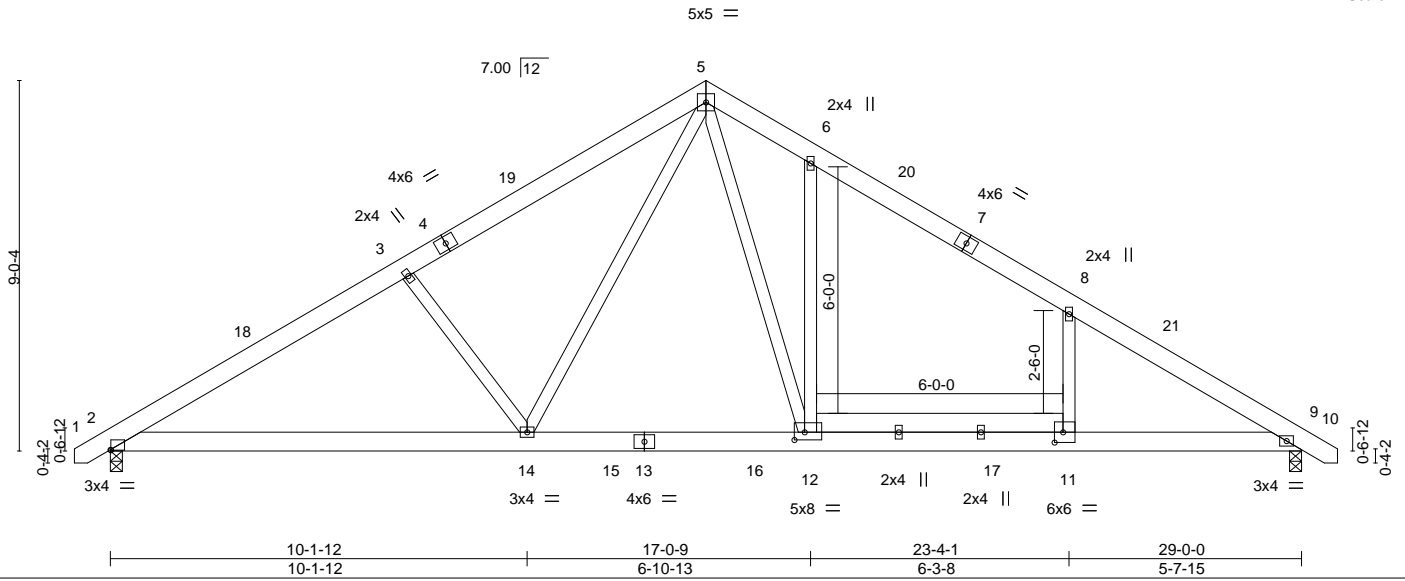


Plate Offsets (X,Y)-- [2:0-0-2,0-0-2], [11:0-2-8,0-3-0], [12:0-3-0,0-2-4]

LOADING (psf)	SPACING-	CS.I.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.40	Vert(LL) -0.17	11	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.59	Vert(CT) -0.34	11	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.53	Horz(CT) 0.03	9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.18	11	>999	240		
							Weight: 213 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 11-12: 2x6 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-5-1 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 9=0-3-8
 Max Horz 2=213(LC 10)
 Max Uplift 2=77(LC 12), 9=77(LC 13)
 Max Grav 2=1205(LC 19), 9=1200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1800/384, 3-5=-1599/405, 5-6=-1721/521, 6-8=-1489/369, 8-9=-1582/244
 BOT CHORD 2-14=-213/1633, 12-14=-18/1077, 11-12=-108/1295, 9-11=-108/1295
 WEBS 3-14=-486/271, 5-14=-93/654, 6-12=-649/299, 5-12=-314/1088

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 14-6-0, Exterior(2) 14-6-0 to 18-10-13, Interior(1) 18-10-13 to 29-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 9.



August 12, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job	Truss	Truss Type	Qty	Ply	Weaver / 1 West Park / Harnett Co.	E14734907
J0820-3590	A3	ROOF SPECIAL	4	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:32 2020 Page 1

ID:CP1eRYXLwLzYgapavR3SHyqHLI-ugkQ1iNWvn715MDGrd0H7C4TSLpY4A8QFIoHkpyoYin



5x5 =

Scale = 1:65.7

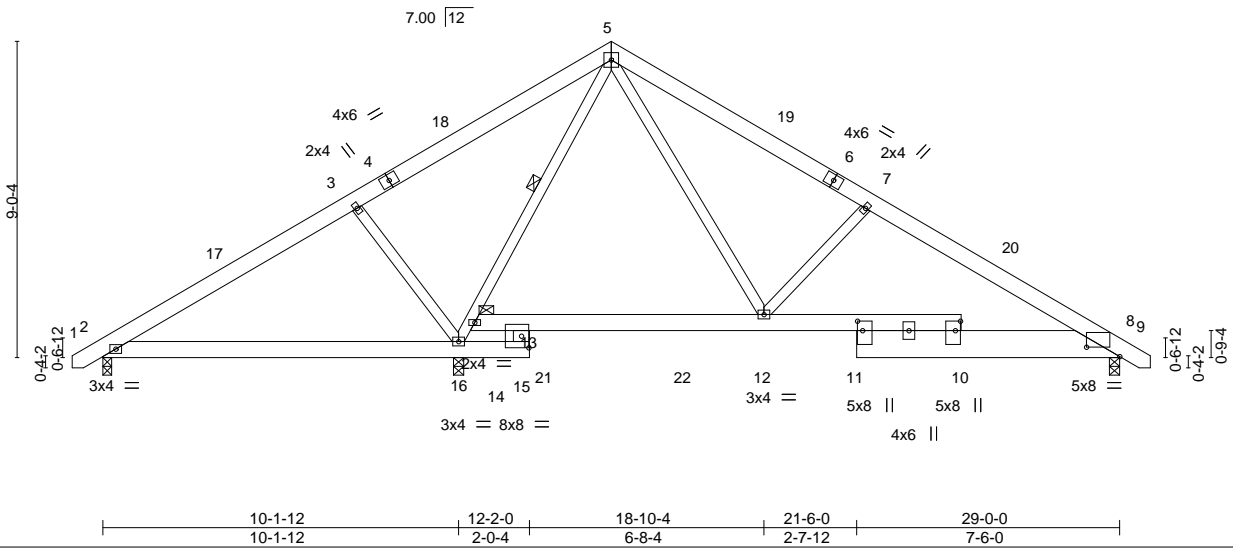


Plate Offsets (X,Y)-- [8:0-11-6,0-3-4], [10:0-3-4,0-1-12], [11:0-3-4,0-1-12], [13:0-2-12,0-0-0], [15:0-2-12,0-0-0], [15:0-2-8,0-4-0]


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.26	Vert(LL) -0.08	12-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.33	Vert(CT) -0.11	2-16	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.24	Horz(CT) 0.02	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.12	2-16	>984	240		
							Weight: 215 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.2 *Except*	6-0-0 oc bracing: 2-16.
13-15: 2x6 SP No.1	WEBS 1 Row at midpt 5-14

REACTIONS. (size) 2=0-3-0, 8=0-3-8, 16=0-3-8
 Max Horz 2=-214(LC 10)
 Max Uplift 2=-146(LC 8), 8=-125(LC 13), 16=-8(LC 12)
 Max Grav 2=346(LC 23), 8=742(LC 20), 16=1485(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-177/367, 3-5=-67/536, 5-7=-815/353, 7-8=-1061/360
 BOT CHORD 8-12=-194/837
 WEBS 14-16=-971/0, 5-14=-1005/0, 5-12=-77/819, 7-12=-482/271, 3-16=-502/300

- NOTES-**
- Unbalanced roof live loads HAVING been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 14-6-0, Exterior(2) 14-6-0 to 18-10-13, Interior(1) 18-10-13 to 29-8-9 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16 except (jt=lb) 2=146, 8=125.

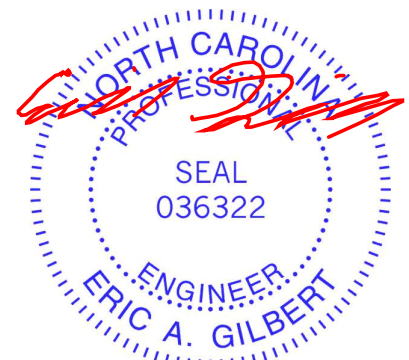


August 12, 2020

Job	Truss	Truss Type	Qty	Ply	Weaver / 1 West Park / Harnett Co.	E14734908
J0820-3590	B1GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Jul 22 2020 MiTek Industries, Inc. Wed Aug 12 15:21:33 2020 Page 1

ID:CP1eRYXLwLzYgapavR3SHyqHLI-MtlpE2O8g5FcjWoSPLXWgQdixlEepgPaUPXrHFYoYim

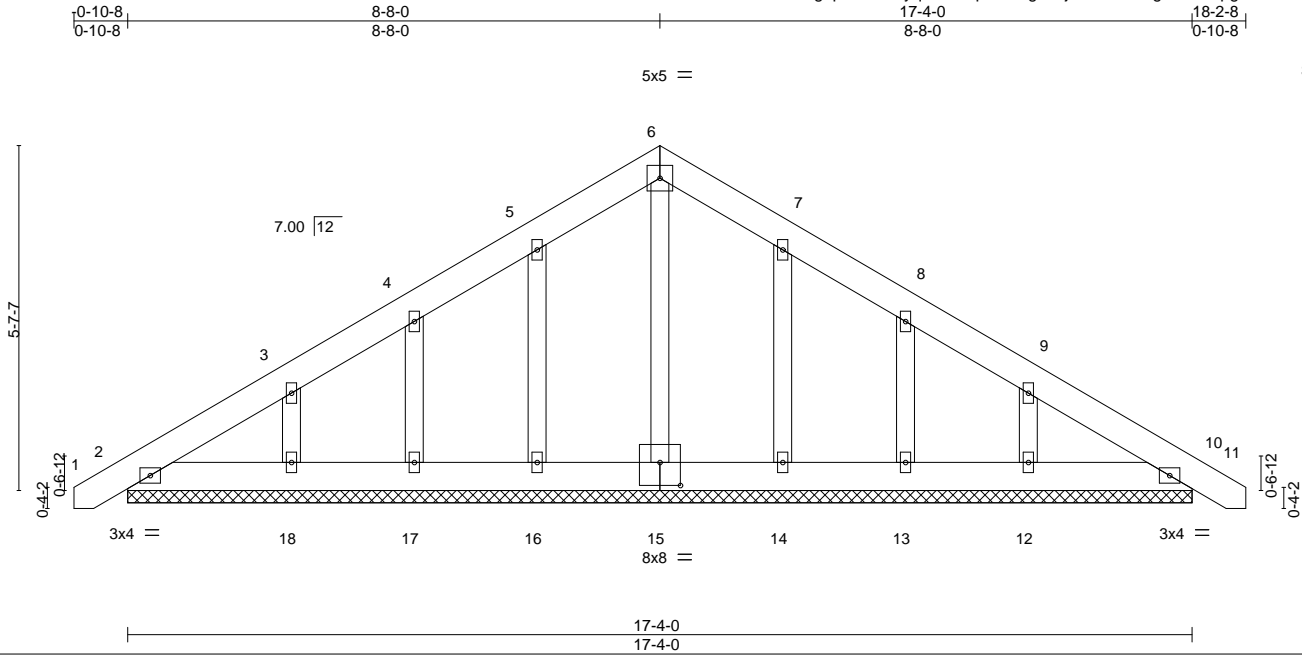

Scale = 1:37.5

Plate Offsets (X,Y)-- [15:0-4-0,0-4-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.03	Vert(LL)	0.00	10	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	0.00	10	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	10	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S						
								Weight: 121 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS. All bearings 17-4-0.
 (lb) - Max Horz 2--164(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 16, 17, 14, 13, 10 except 18--104(LC 12), 12--103(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 2, 15, 16, 17, 18, 14, 13, 12, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-9 to 3-8-4, Exterior(2) 3-8-4 to 8-8-0, Corner(3) 8-8-0 to 13-0-13, Exterior(2) 13-0-13 to 18-0-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2'-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 16, 17, 14, 13, 10 except (jt=lb) 18=104, 12=103.




August 12, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

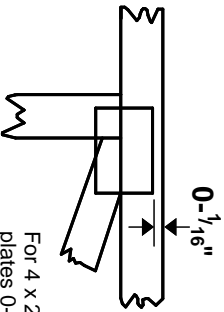

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

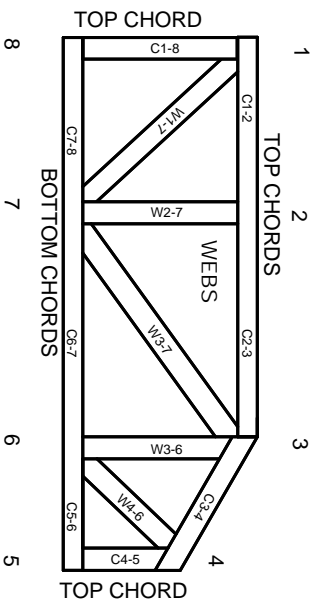

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.