

# Harnett County Department of Public Health

PERMIT # SFD 2108-0041

## Operation Permit

SQ 1563

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 18 ROCK RIDGE PL. (BILL AVERY RD.)

Name: (owner) ON TOP DUG CO LLC   SUBDIVISION JAMES E JOHNSON III   LOT # 6

System Installer: GENES BACKHOE

Basement with plumbing:    Garage    Number of Bedrooms 3


Type of Water Supply:  Community    Public    Well   Distance from well NA feet

System Type: 25% REDUCTION SYSTEM III S   Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

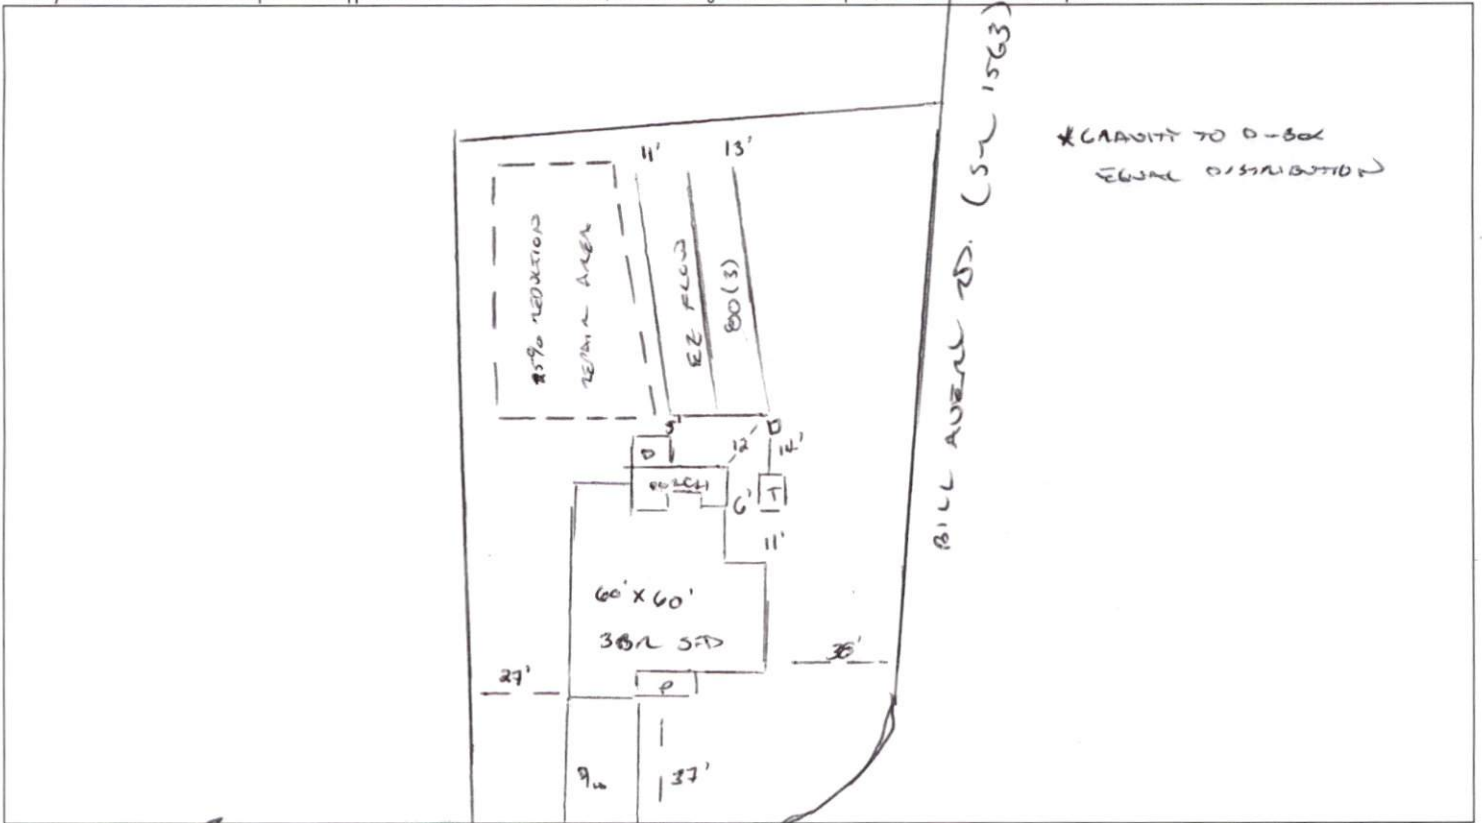

PERMIT CONDITIONS: rock ridge pl.

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.  
 Type of system:  Conventional    Other EZ FLOW III S   Septic Tank: 1000 gallons   Pump Tank: \_\_\_\_\_ gallons  
 Subsurface   No. of   exact length   width of   depth of  
 Drainage Field   ditches 3   of each ditch 80 feet   ditches 3 feet   ditches 24 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]   Date 01/04/2021