



# Plans Designed to the 2018 NORTH CAROLINA STATE RESIDENTIAL BUILDING CODE

CLIMATE ZONE	ZONE 3	ZONE 4	ZONE 5
FENESTRATION U-FACTOR	0.35	0.35	0.35
SKYLIGHT U-FACTOR	0.55	0.55	0.55
GLAZED FENESTRATION SHGC	0.30	0.30	NR
CEILING R-VALUE	38	38	38
WALL R-VALUE	15	15	19
FLOOR R-VALUE	19	19	30
*BASEMENT WALL R-VALUE	5/13	10/15	10/15
**SLAB R-VALUE	0	10	10
* CRAWLSPACE WALL R-VALUE	5/13	10/15	10/19

\* "10/15" Means R-10 Sheathing Insulation or R-15 Cavity Insulation  
 \*\* Insulation Depth with Monolithic Slab 18" or From Inspection Gap to bottom of Footing; Insulation Depth with Stem Wall Slab 24" or to bottom of Foundation Wall

DESIGNED FOR WIND SPEED OF 120 MPH

DESIGN PRESSURES FOR DOORS AND WINDOWS POSITIVE AND NEGATIVE IN PSF			
		MEAN ROOF HEIGHT (FT)	
VELOCITY (MPH)	15	25	35
115	15	17	19
120	20	23	25

ASSUMED MEAN ROOF HEIGHT 11'8"

## Roof Truss Requirements

### TRUSS DESIGN.

Trusses, if used, to be designed and engineered in accordance with these drawings. Any variation with these drawings must be brought to Frazier Designs attention before construction begins.

### KNEE WALL AND CEILING HEIGHTS.

All Finished knee wall heights and ceiling heights are shown furred down 10" from roof decking for insulation. If for any reason the truss manufacturer fails to meet or exceed designated heel heights, finished knee wall heights, or finished ceiling heights shown on these drawings the finished square footage may vary. Any discrepancy must be brought to Frazier Designs Attention, so that a suitable solution can be reached before construction begins. Any variation due to these conditions not being met is the responsibility of the truss manufacturer.

### ANCHORAGE.

All required anchors for trusses due to uplift or bearing shall meet the requirements as specified on the truss schematics. Anchorage in the 120 and 130 MPH Wind Zones shall be Continuous from the Roof to the footing.

### Bearing.

All trusses shall be designed for bearing on SPF # 2 Plates or Ledgers unless noted otherwise.

### Plate Heights and Floor Systems.

See Elevation page(s) for plate heights and floor system thicknesses.

## ROOF VENTILATION

### Section R806

#### R806.1 Ventilation required.

Enclosed Attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of the roof rafters shall have a cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow. Ventilation openings shall have a least dimension of 1/16 inch (1.6mm) minimum and 1/4 inch (6.4 mm) maximum. Ventilation openings having a least dimension larger than 1/4" inch (6.4mm) shall be provided with corrosion-resistant wire cloth screening, hardware cloth, or similar material with openings having a least dimension of 1/16 insh(1.6mm) minimum and 1/4 inch (6.4mm) maximum. Openings in roof framing members shall conform to the requirements of Section R802.7.

#### R806.2 Minimum Area.

The Total net free ventilating area shall not be less than 1/150 of the area of the space ventilated except that reduction of the total area to 1/300 is permitted provided that at least 50 percent and not more than 80 percent of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated at least 3 feet (914mm) above the eave or cornice vents with the balance of the required ventilation provided by eave or cornice vents. As an alternative, the net free cross-ventilation area may be reduced to 1/300 when a Class I or II vapor retarder is installed on the warm-in-winter side of the ceiling.

#### Exceptions:

1. Enclosed attic/rafter spaces requiring less than 1 square foot (0.0929 m2) of ventilation may be vented with continuous soffit ventilation only.
2. Enclosed attic/rafter spaces over unconditioned space may be vented with continuous soffit vent only.

*Square footage of roof to be vented = 4846 Sq. Ft.*

*Net-Free Cross Ventilation Needed:*

*Without 50% to 80% of Venting 3'0" above Eave= 32.30 Sq.Ft.*

*With 50% to 80% of Venting 3'0" above eave; or with Class I or II Vapor Retarder on Warm-In-Winter Side of Ceiling: 16.15 Sq.Ft.*

## STRUCTURAL NOTES

All construction shall conform to the latest requirements of the 2018 North Carolina Residential Building Code, plus all local codes and regulations. This document in no way shall be construed to supercede the code.

### Job Site Practices And Safety:

Frazier Designs assumes no liability for contractor practices and procedures or safety program. Frazier Designs takes no responsibility for the contractor's failure to carry out the construction work in accordance with the contract documents. All members shall be framed, anchored, and braced in accordance with good construction practice and the building code.

Design Loads	Live Load	Dead Load	Deflection
USE	(PSF)	(PSF)	(LL)
Attics without storage	10	10	L/240
Attics with Limited storage	20	10	L/360
Attics with fixed stairs	40	10	L/360
Balconies and Decks	40	10	L/360
Fire Escapes	40	10	L/360
Guardrails and Handrails	200	--	--
Guardrail in-fill components	50	--	--
Passenger vehicle garages	50	10	L/360
Rooms other than sleeping	40	10	L/360
Sleeping rooms	30	10	L/360
Stairs	40	--	L/360
Snow	20	--	--

### Framing Lumber:

All non treated framing lumber shall be SPF # 2 (Fb=875 PSI) or SYP # 2 (Fb= 750 PSI) and all treated lumber shall be SYP # 2 ( Fb= 750 PSI) unless noted otherwise.

### Engineered Wood Beams:

Laminated veneer lumber (LVL) = Fb= 2600 PSI, Fv=285 PSI, E=1.9x106 PSI  
 Parallel strand lumber (PSL) = Fb= 2900 PSI, Fv= 290 PSI, E= 2.0x106 PSI  
 Laminated Strand Lumber (LSL) = Fb= 2250 PSI, Fv= 400 PSI, E = 1.55 x 106 PSI  
 Install All connections per Manufacturers Instructions

### Truss And I -Joist Members:

All Roof Truss and I-Joist Layouts shall be prepared in accordance with this document. Trusses and I-Joists shall be Installed according to the Manufacturers specifications. Any Change in Truss or I-Joist Layout shall be coordinated with Frazier Designs.

### Lintels:

Brick Lintels Shall be 3 1/2" x 3 1/2" x 1/4" Steel angle for up to 6'0" Span and 6" x 4" x 5/16" Steel angle with 6" leg vertical for spans up to 9'0" unless noted otherwise.

### Concrete and Soils:

See Foundation Notes.

## Foundation Structural Notes

120 MPH wind zone (1 1/2 to 2 1/2 story)

### Continuous Footing:

24" wide and 8" thick minimum. 28" wide minimum at brick veneer. Must extended 2" Min. to either side of supported wall.


### Girders:

(2) 2x8 girder unless noted otherwise.

### Piers:

8" x 16" piers with 8" solid masonry cap on 16" x 24" x 8" concrete footing with maximum pier height of 64" with hollow masonry and 160" with solid masonry unless otherwise noted.

### Point Loads:

 designates significant point load and should have solid blocking to pier, girder or foundation wall.

### Anchor Bolts:

1/2" diameter anchor bolts embedded minimum 7" maximum 4'0" on center, within 12" of plate ends, and minimum two anchor bolts per plate.

### Concrete:

Concrete shall have a minimum 28 day strength of 3000 psi and maximum 5" slump. Air entrained in Table 402.2. All concrete shall be in accordance with ACI standards. All samples for pumping shall be taken from the exit end of the pump.

### Lug Footings:

Lug Footings shall be 2'0" wide x 1'0" depth and shall run continuously underneath any wall that is deemed to be load bearing. See Detail for specs.

### Soils:

Allowable soil bearing pressure assumed to be 2000 PSF. The Contractor must contact a geotechnical engineer and a structural engineer if unsatisfactory subsurface conditions are encountered. The surface area adjacent to be foundation wall shall be provided with adequate drainage, and shall be graded so as to drain surface water away from foundation walls.

## AIR LEAKAGE

### Section N1102.4

#### N1102.4.1 Building Thermal Envelope.


The Building Thermal Envelope shall be durably sealed with an Air Barrier System to limit infiltration. The sealing methods between dissimilar materials shall allow for differential expansion and contraction. For all homes, where present, the following shall be caulked, gasketed, weatherstripped or otherwise sealed with an air barrier material or solid material consistent with Appendix E-2.4 of this code:

1. Blocking and sealing floor/ceiling systems and under knee walls open to unconditioned or exterior space.
2. Capping and sealing shafts or chases, including flue shafts.
3. Capping and sealing soffit or dropped ceiling areas.

"I DO HEREBY CERTIFY THAT THIS DRAWING OR PLAN AND RELATED SPECIFICATIONS MEET ALL LOCAL REQUIREMENTS AND ARE IN SUBSTANTIAL CONFORMITY WITH BOTH SAH AND VA MINIMUM PROPERTY REQUIREMENTS INCLUDING THE INTERNATIONAL BUILDING CODE COUNCIL (2018 NC RESIDENTIAL BUILDING CODE), ENERGY CONSERVATION STANDARDS OF THE 2018 COUNCIL OF AMERICAN BUILDING OFFICIALS, MODEL ENERGY CODE AND THE REQUIREMENT FOR LEAD-FREE PIPING.

The Information on These Construction Documents is for the Exclusive Use of the Client in Construction of the Building. It is not to be used for any other purpose. The Designer assumes no liability for any errors or omissions in these documents or for any damage or loss resulting from their use. The Client shall be responsible for obtaining all necessary permits and for compliance with all applicable laws and regulations. The Client shall be responsible for the accuracy of the information provided to the Designer. The Designer shall not be responsible for the accuracy of the information provided to the Designer. The Designer shall not be responsible for the accuracy of the information provided to the Designer.

APPROVED BY	DATE



MEMBER  
**A I**  
**B D**  
 AMERICAN INSTITUTE OF BUILDING DESIGN

Frazier Designs  
 A Residential Design Company  
 (910) 818-2413  
 www.frazierplans.com

Project:   
 MODEL:   
 FD- 2281   
 BUILDER:


DATE PRINTED:   
 Nov2021   
 DRAWN BY:   
 ATF

## Notes

SHEET  
 2

The Information in These Construction Documents is for the Exclusive Use of the Client in Construction of the Building and is not to be used for any other purpose. The Designer shall not be responsible for any errors or omissions in these documents or for any consequences that may result from their use. The Client shall be responsible for obtaining all necessary permits and for ensuring that the work is done in accordance with all applicable codes and regulations. The Designer shall not be responsible for any damage to property or persons resulting from the use of these documents.

APPROVED BY	DATE



MEMBER  
**A I B D**  
AMERICAN INSTITUTE OF BUILDING DESIGN


Frazier Designs  
A Residential Design Company  
(910) 818-2413  
www.frazierplans.com

Project:  
MODEL:  
FD-2281  
BUILDER:

DATE PRINTED:  
Nov2021  
DRAWN BY:  
ATF


Construction Details

SHEET  
3

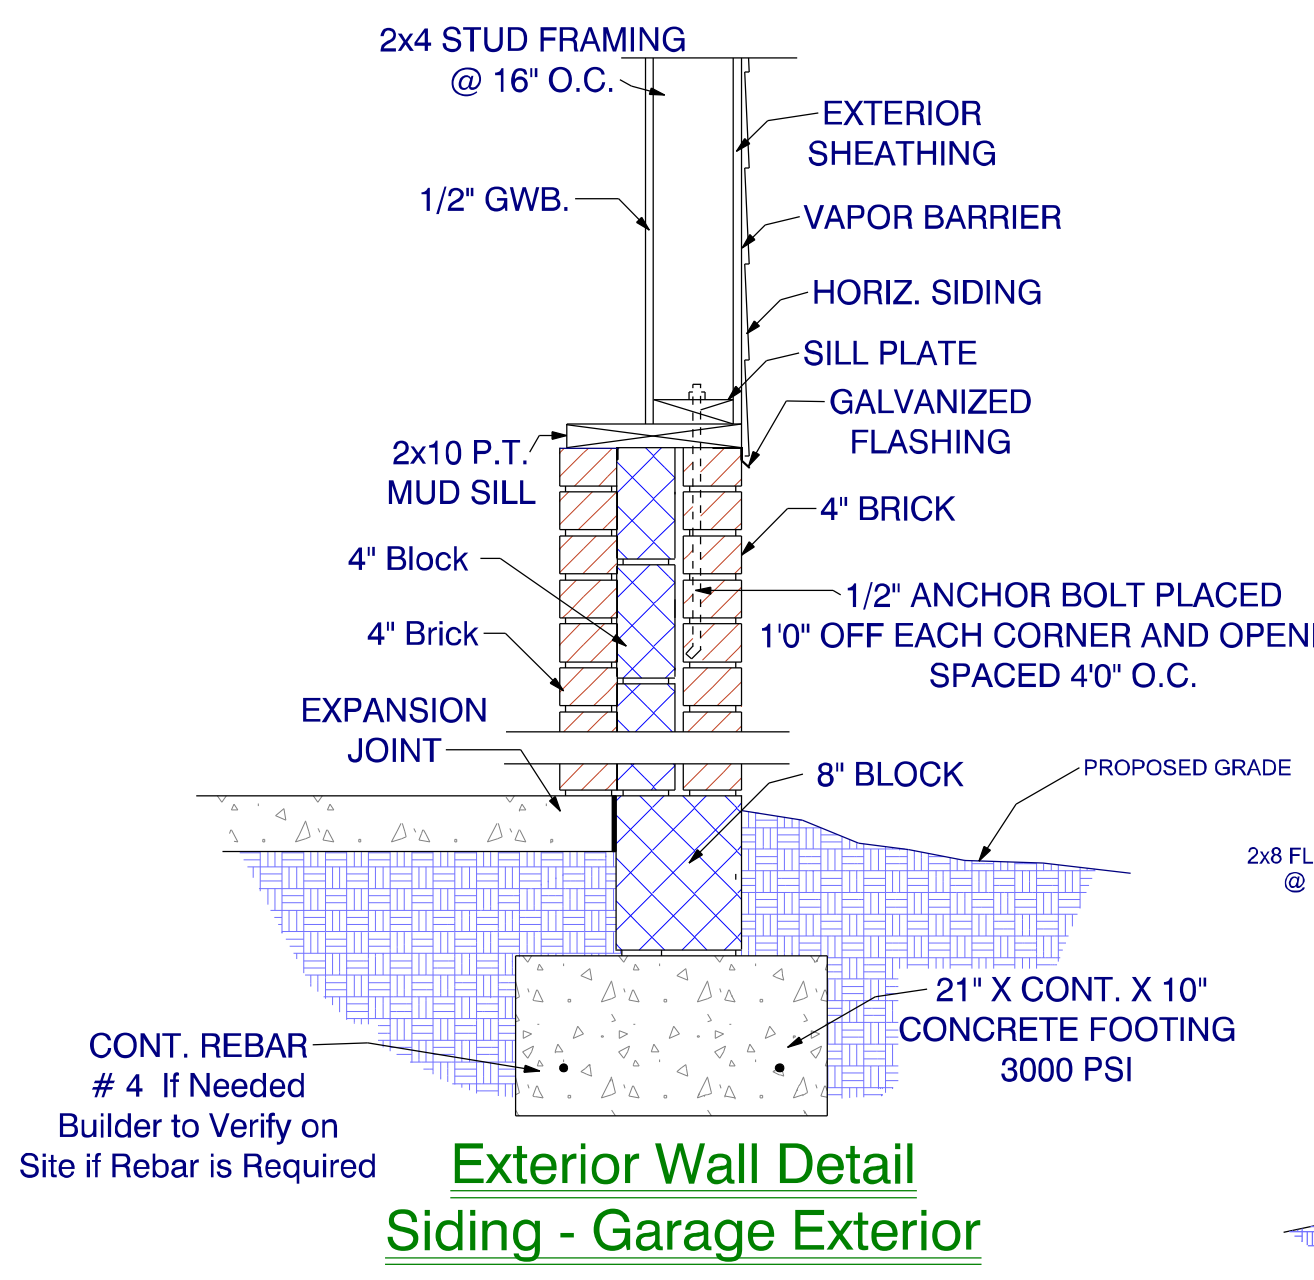


**Exterior Wall Detail Siding - Garage Exterior**

SCALE: 1" = 1'0"  
Reinforced Concrete Slab Minimum 3 1/2" Thick Over 4" Base of Clean Approved Material Passing a Through 2" Sieve. Reinforcement maybe Fiber Additive or Welded Wire Mesh. Wire Reinforcement Must be Supported to Remain in the Upper Third of the Reinforced Slab.

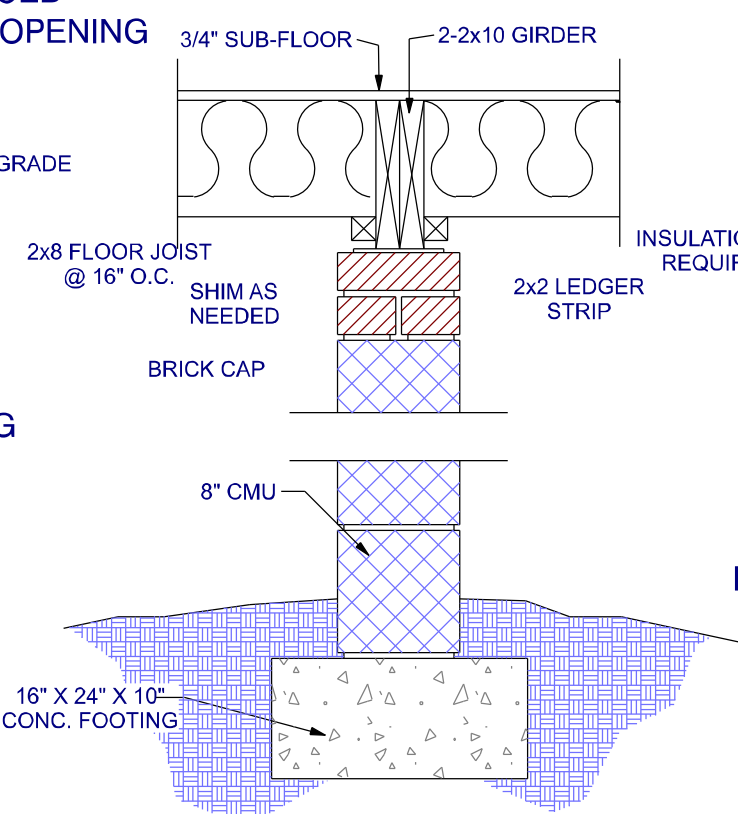


**2-2X10 Girder 8X16 Pier**

SCALE: 1" = 1'0"

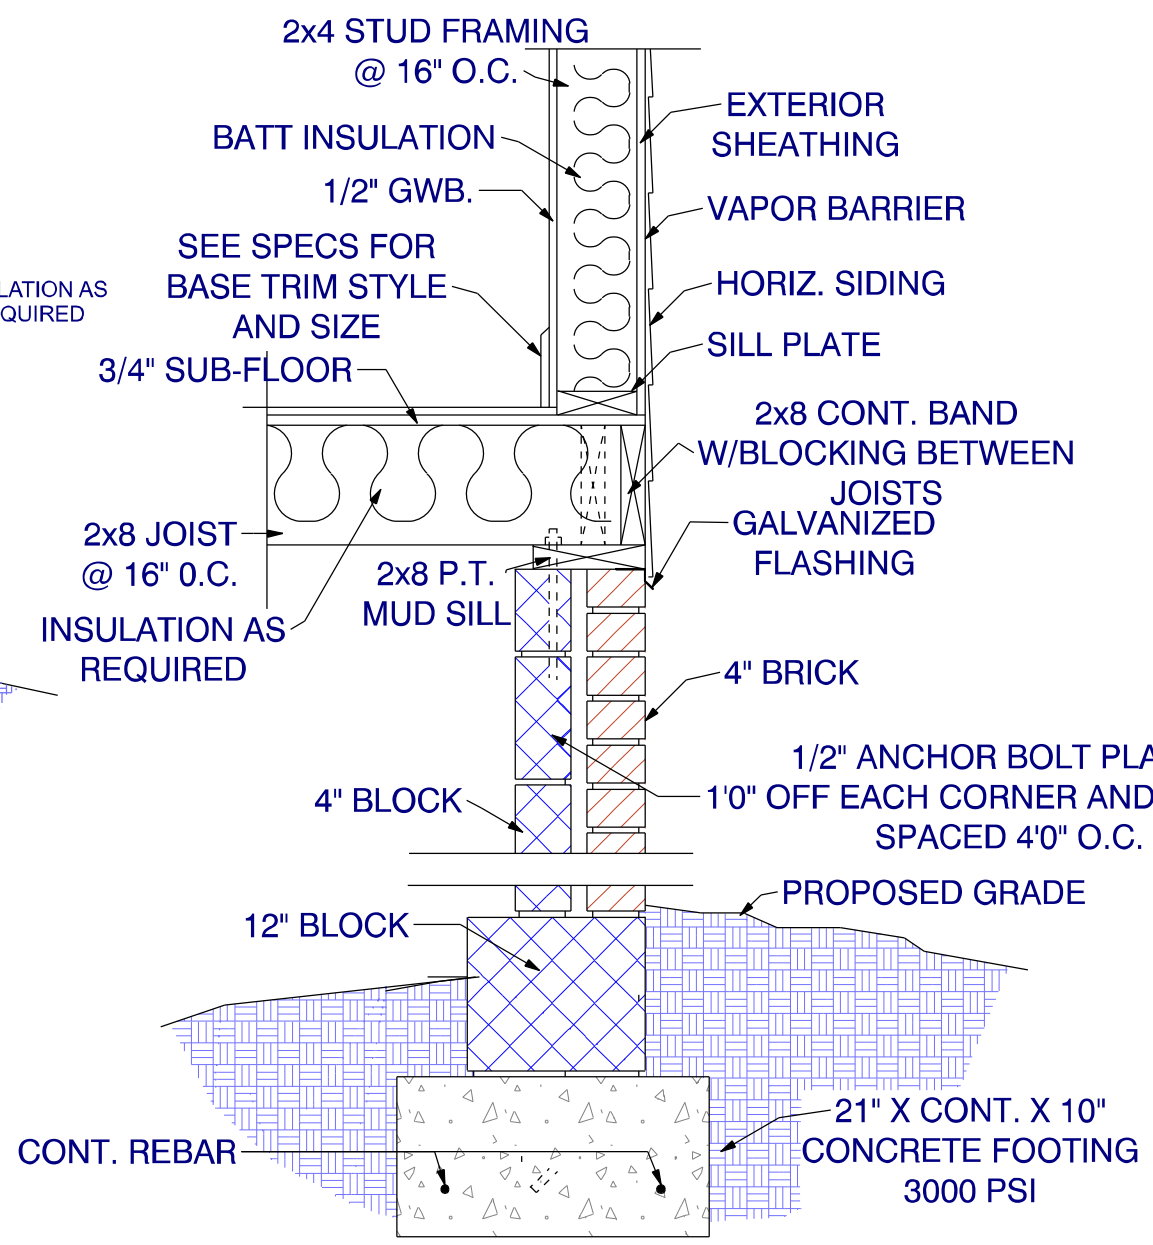


**Exterior Wall Detail Siding - 4" Brick/4" Block**

SCALE: 1" = 1'0"

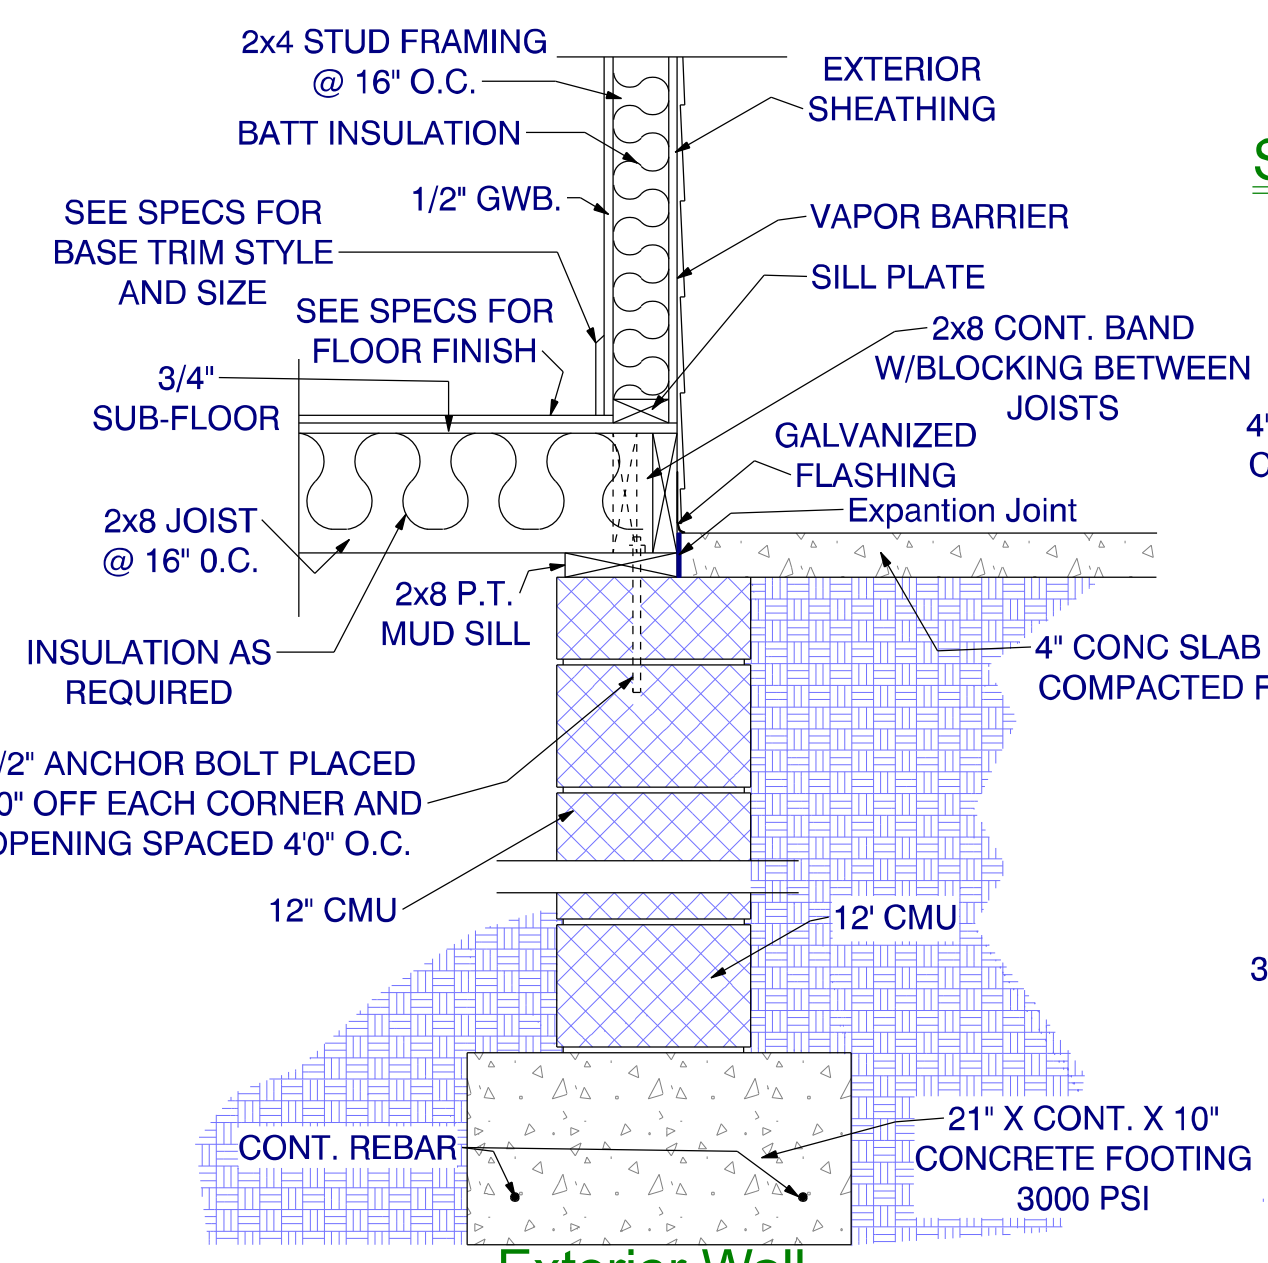


**Exterior Wall Detail - Porch**

SCALE: 1" = 1'0"

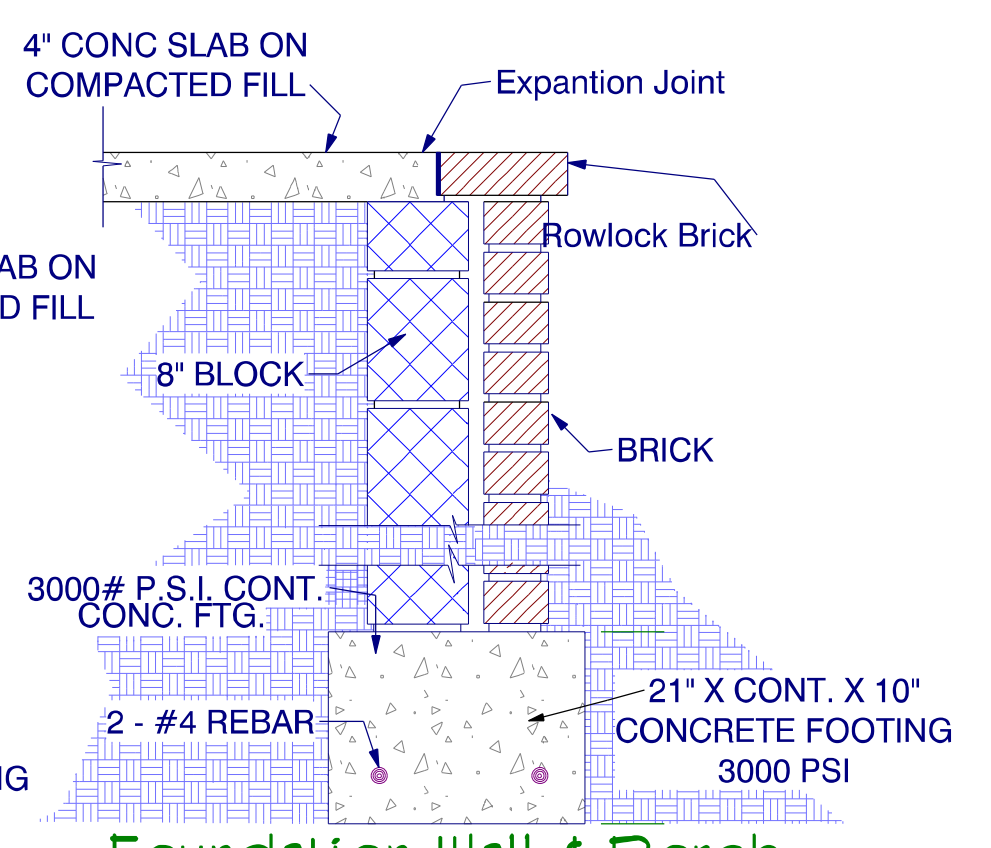

**Foundation Wall & Porch**


SCALE: 1" = 1'0"

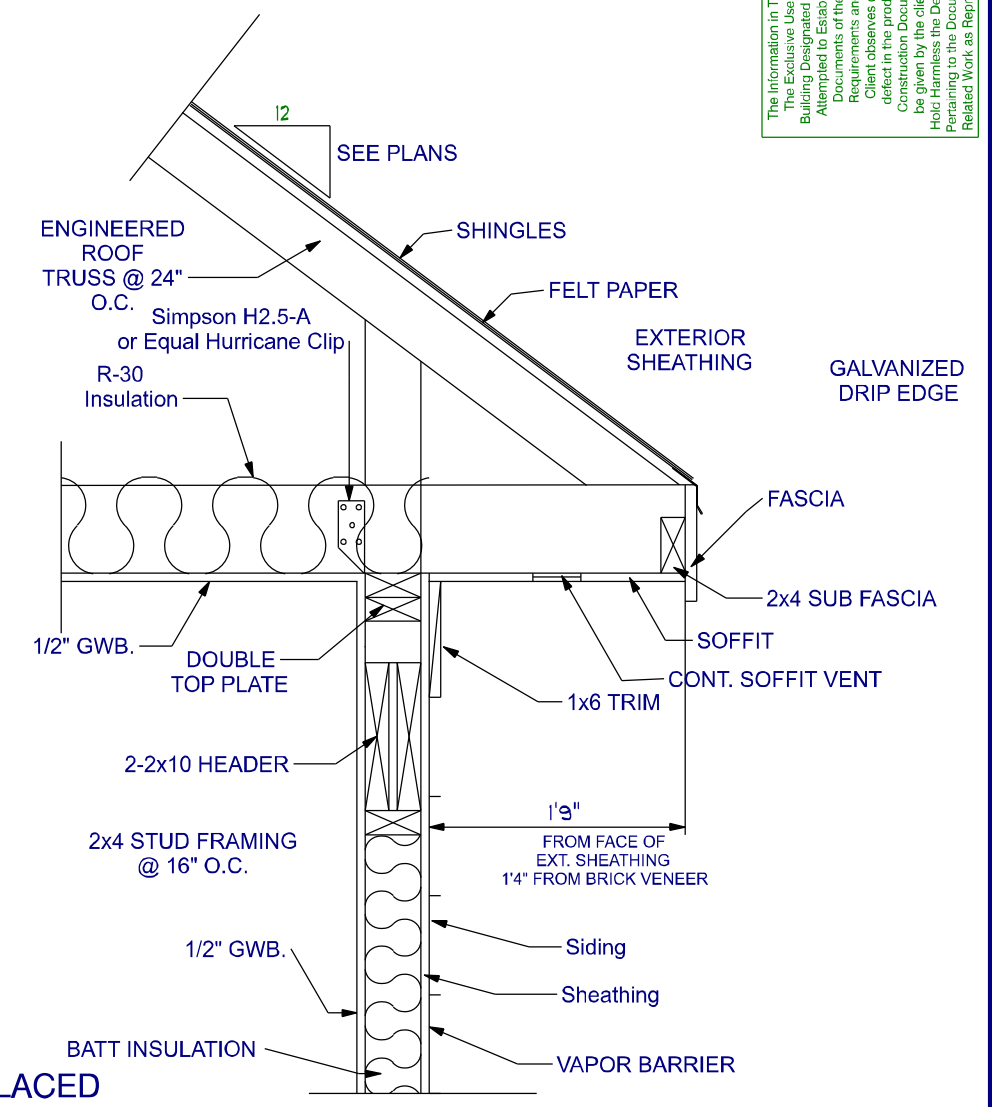


**Overhang Detail - Siding**

SCALE: 1" = 1'0"  
Cantilevered Truss System


NOTE THAT "DORMER" STYLE THROUGH-ROOF EXHAUST VENTS MAY BE PROVIDED IN ADDITION TO OR IN LIEU OF RIDGE VENTS INDICATED.  
MIN. 26 SQ. FT. (3800/150 + 25.33) VENTILATION AREA REQ'D

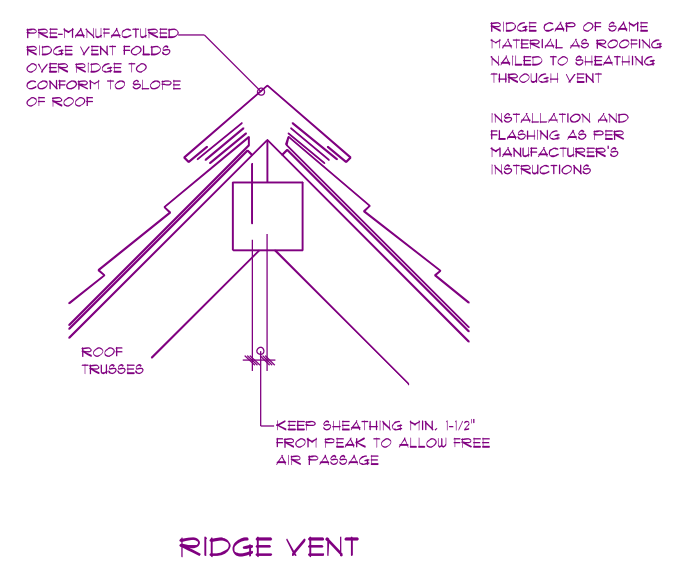

**RIDGE VENT**

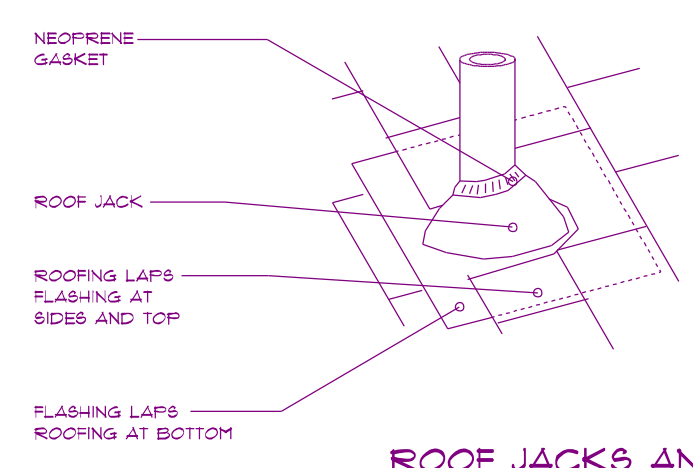


**ROOF JACKS AND VENTS**

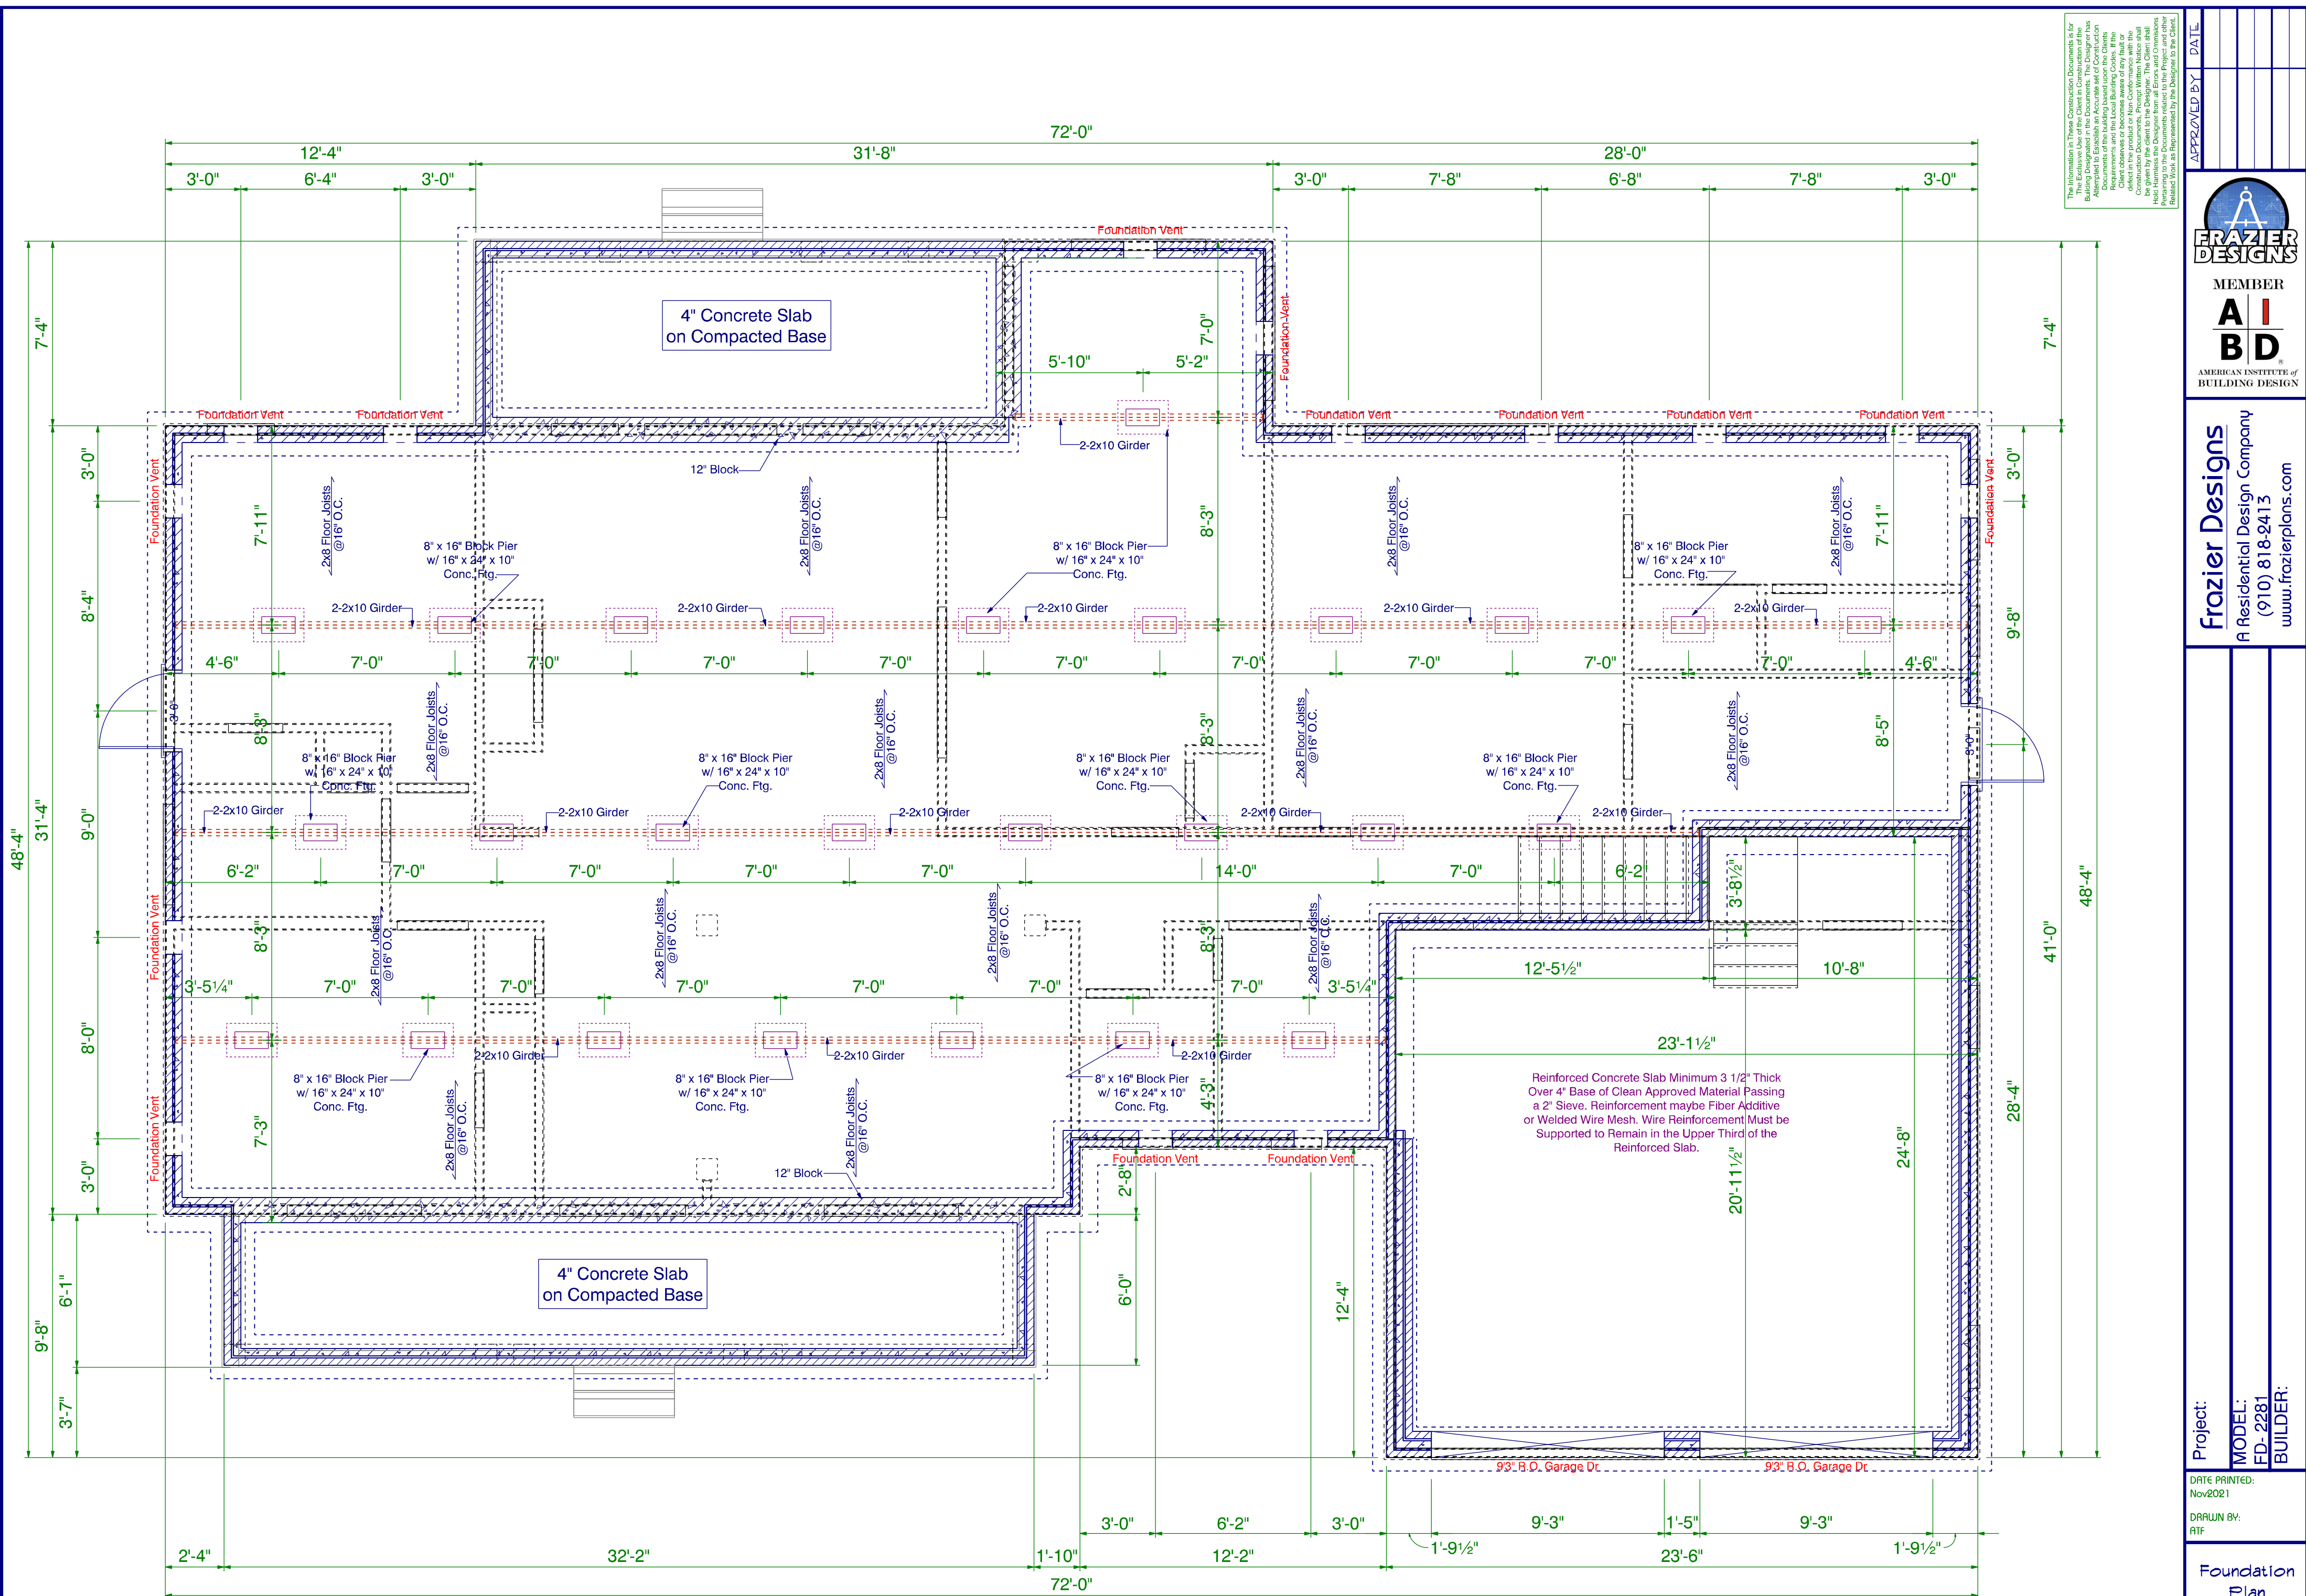

The location of these Construction Documents is for the Exclusive Use of the Client in Construction of the Building. Any other use, including reproduction, distribution, or alteration, is strictly prohibited. The Client shall be responsible for the accuracy of the information provided in these documents. The Designer shall not be held responsible for any errors or omissions in these documents. The Client shall be responsible for the accuracy of the information provided in these documents. The Designer shall not be held responsible for any errors or omissions in these documents.

APPROVED BY	DATE

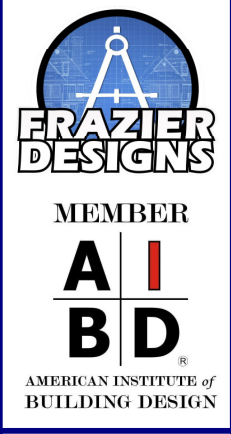


**Frazier Designs**  
 A Residential Design Company  
 (910) 818-2413  
 www.frazierplans.com

Project:   
 MODEL: FD-2281  
 BUILDER:   
 DATE PRINTED: Nov2021  
 DRAWN BY: ATF

Foundation Plan

SHEET 4

**Foundation Plan**  
 Scale: 1/4" = 10"

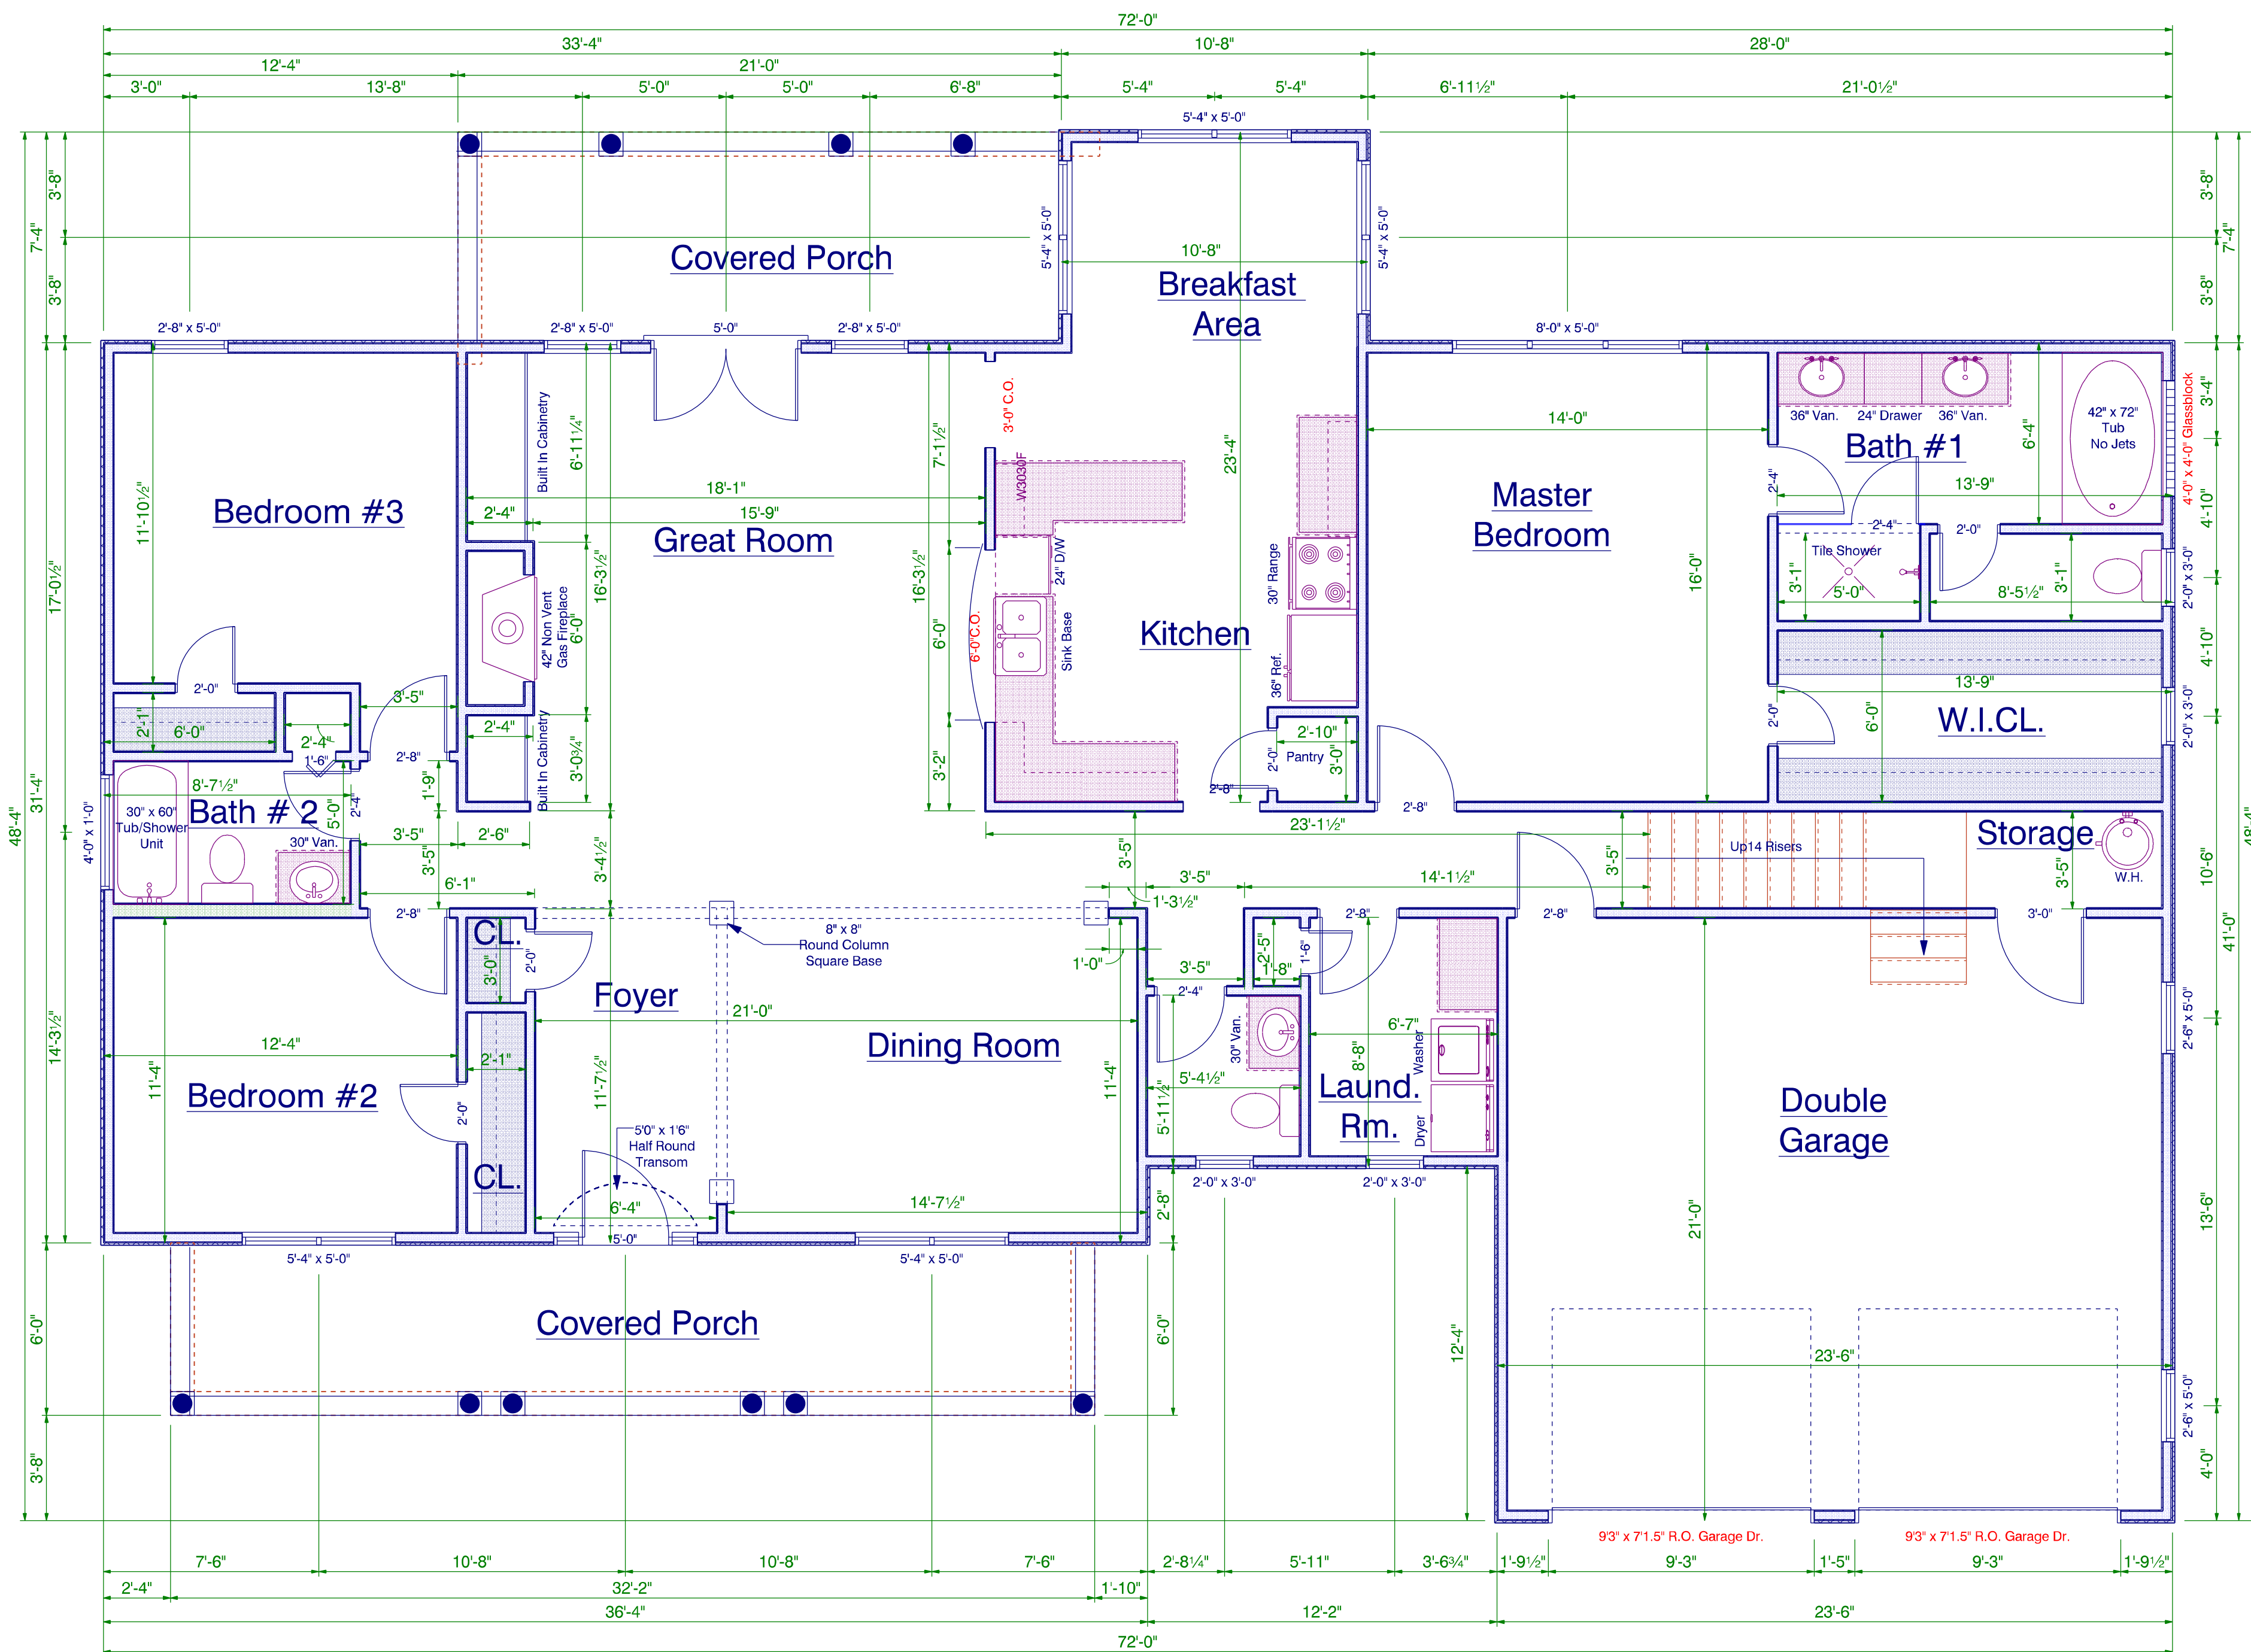

# Main Floorplan

Scale: 1/4" = 1'0"

Electrical and HVAC Layout and Specs are to be Provided by Builder.


9'0" Fin. Ceiling Ht.  
(Unless otherwise Noted)

1991 S.F. Main Floor Heated  
290 S.F. Bonus Room (Finished)  
2281 S.F. Total Heated

526 S.F. Double Garage  
205 S.F. Covered Porch(Front)  
165 S.F. Covered Porch(Rear)

The Information in These Construction Documents is for the Exclusive Use of the Client in Construction of the Building and is not to be used for any other purpose. The Designer shall not be responsible for any errors or omissions in these documents or for any consequences that may result from their use. The Client shall be responsible for obtaining all necessary permits and for the accuracy of all information provided to the Designer. The Client shall be responsible for the design of any work not shown in these documents and for the safety of the work. The Designer shall not be responsible for any work not shown in these documents.

APPROVED BY	DATE

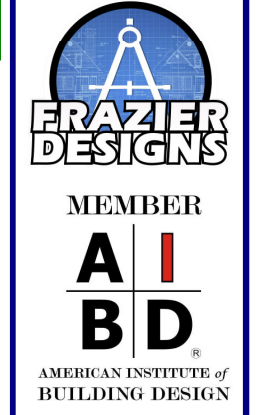

**Frazier Designs**  
A Residential Design Company  
(910) 818-2413  
www.frazierplans.com

Project:	
MODEL:	FD-2281
BUILDER:	


DATE PRINTED:  
Nov2021  
DRAWN BY:  
ATF

Main Floor Layout

SHEET  
5

The Information in These Construction Documents is for the Exclusive Use of the Client in Connection with the Building Project and is not to be used for any other purpose. The Client shall be responsible for obtaining all necessary permits and approvals. The Designer shall not be responsible for any delays or problems caused by the Client's failure to obtain all necessary permits and approvals. The Client shall be responsible for any delays or problems caused by the Client's failure to provide all necessary information. The Client shall be responsible for any delays or problems caused by the Client's failure to pay for the Designer's services. The Client shall be responsible for any delays or problems caused by the Client's failure to provide all necessary information. The Client shall be responsible for any delays or problems caused by the Client's failure to pay for the Designer's services. The Client shall be responsible for any delays or problems caused by the Client's failure to provide all necessary information. The Client shall be responsible for any delays or problems caused by the Client's failure to pay for the Designer's services.

APPROVED BY	DATE



MEMBER  
**A I**  
**B D**  
AMERICAN INSTITUTE of  
BUILDING DESIGN


**Frazier Designs**  
A Residential Design Company  
(910) 818-2413  
www.frazierplans.com

Project:	
MODEL:	FD-2281
BUILDER:	

DATE PRINTED:  
Nov2021  
DRAWN BY:  
ATF

Bonus Room  
Layout

SHEET  
6

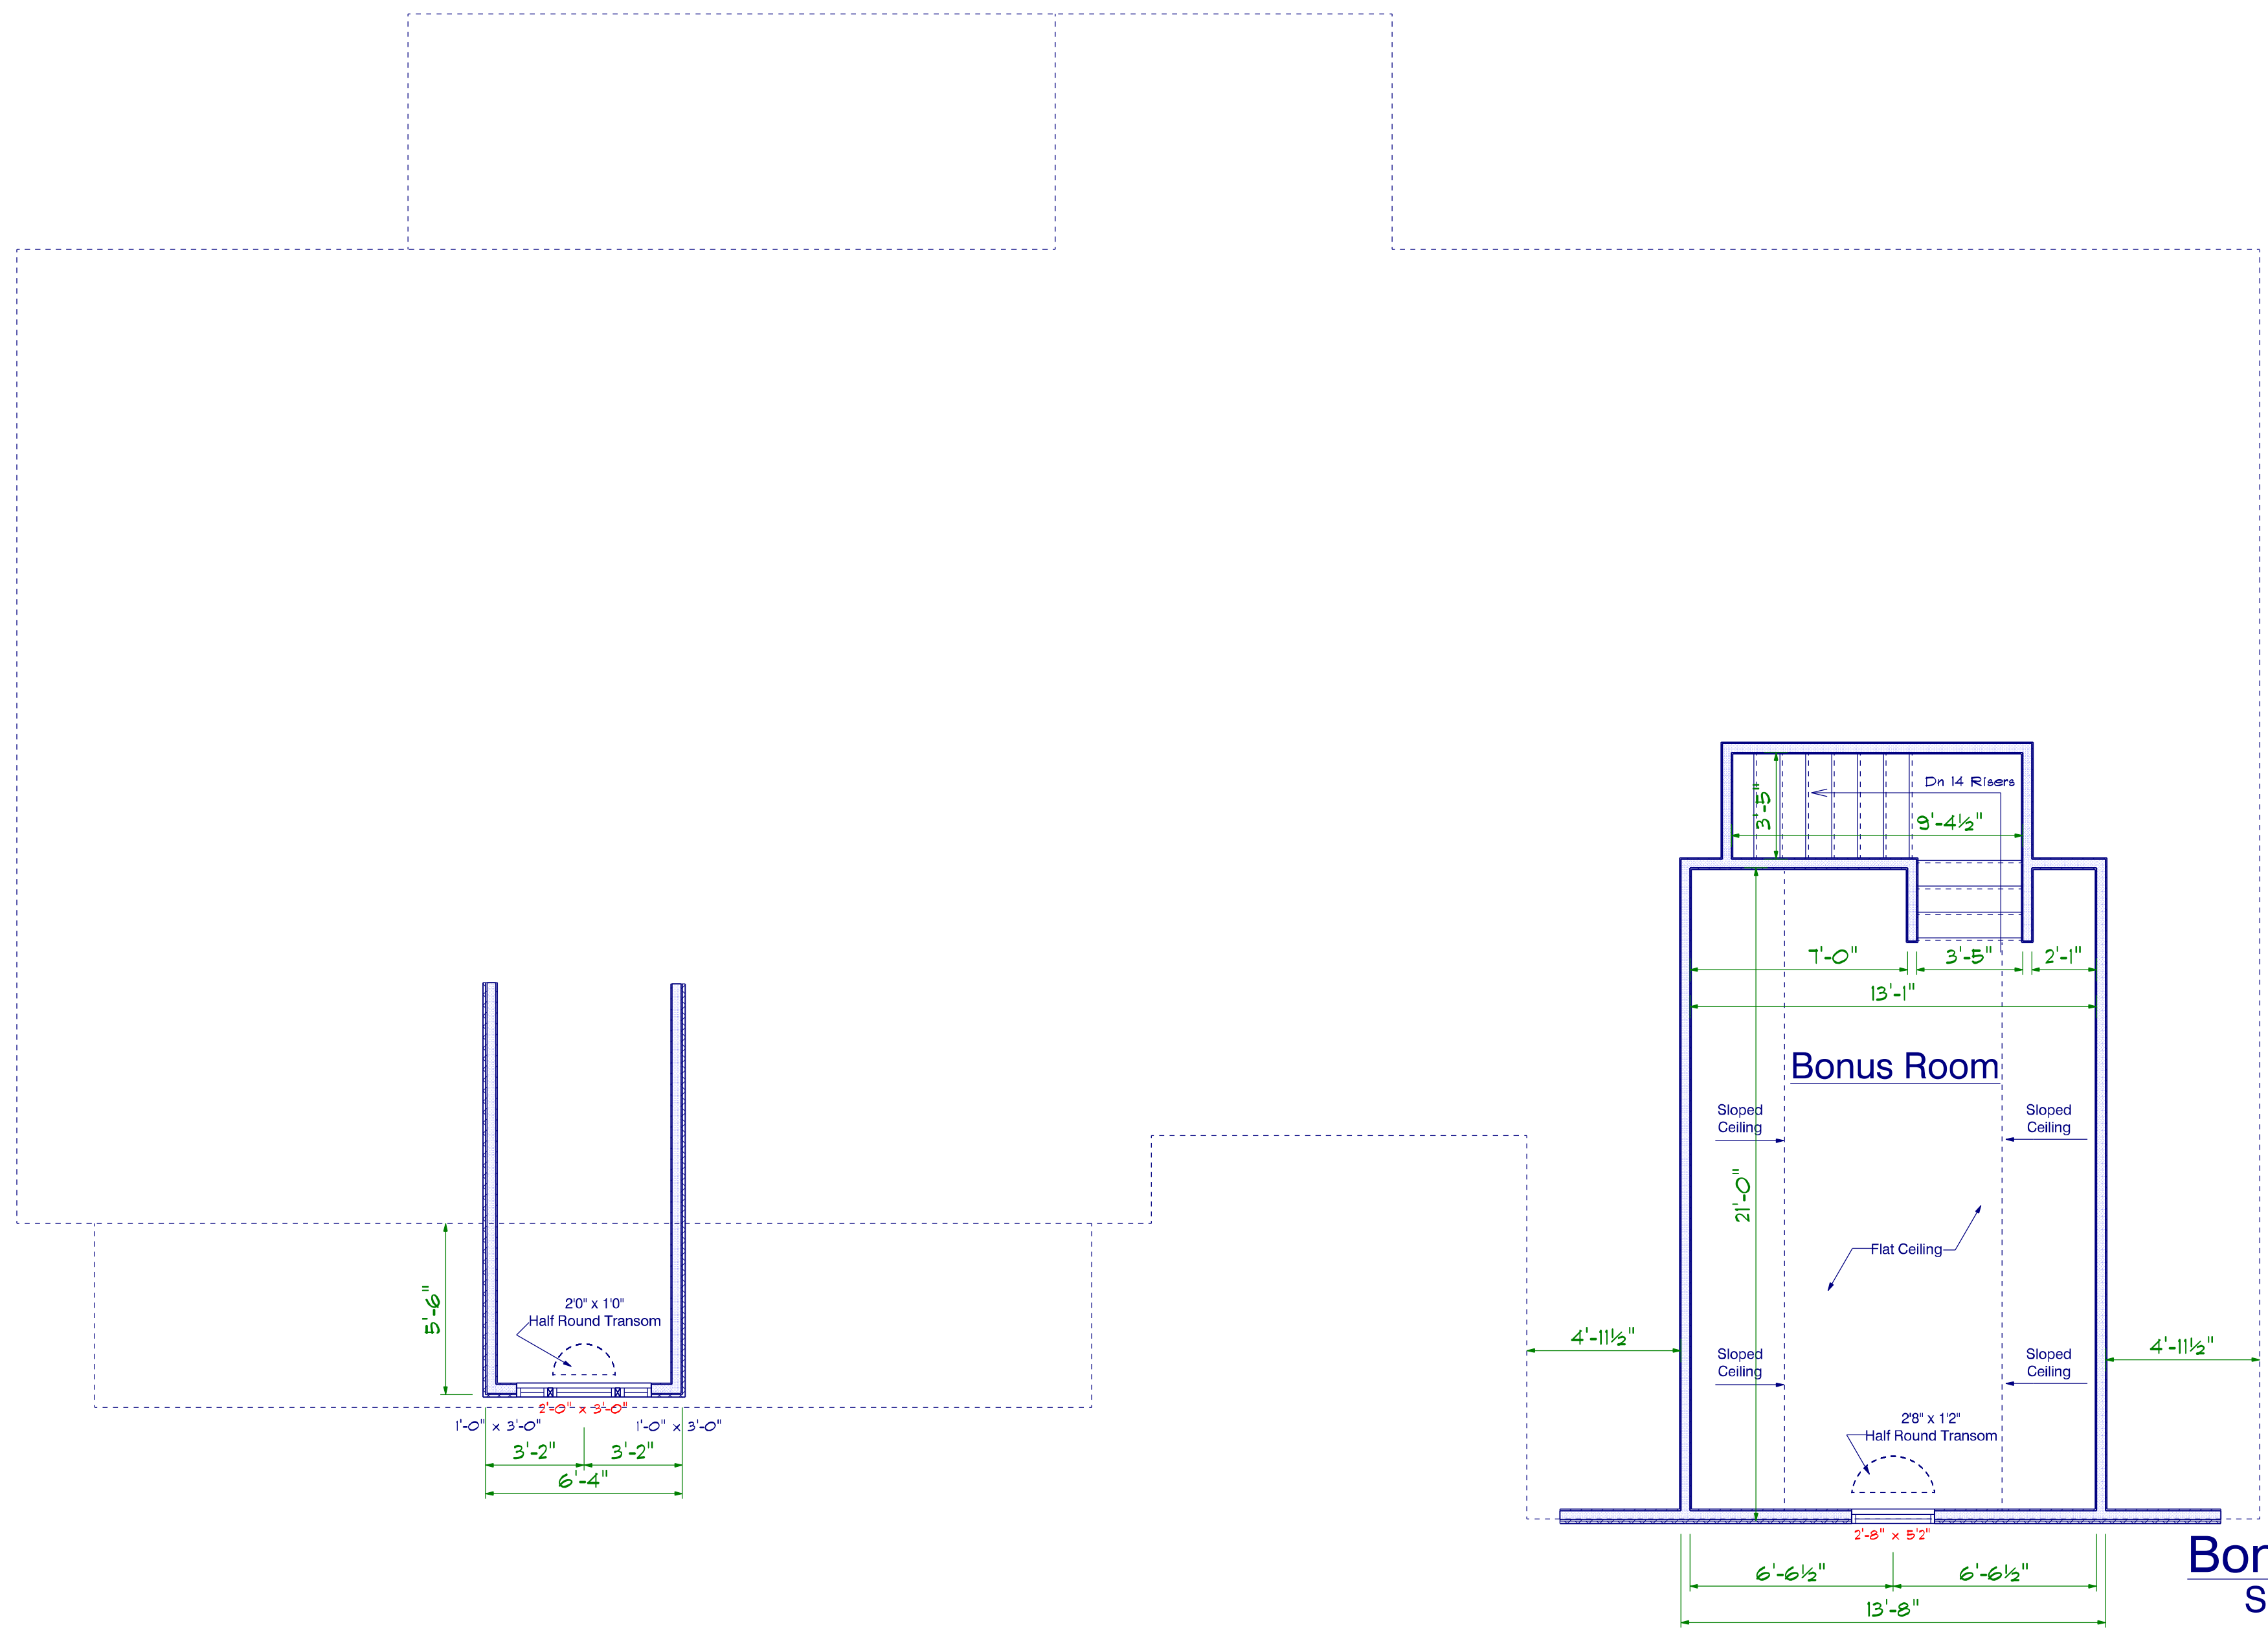


**Bonus Room Plan**  
Scale: 1/4" = 1'0"  
290 S.F. Bonus Room  
(Finished)  
Electrical and HVAC Layout  
Provided by Builder

Roof Area: sqft 3874.88

Calculation may not included area under valleys.

Notes:

Spacing as noted on plan.  
Field Frame all shaded areas.

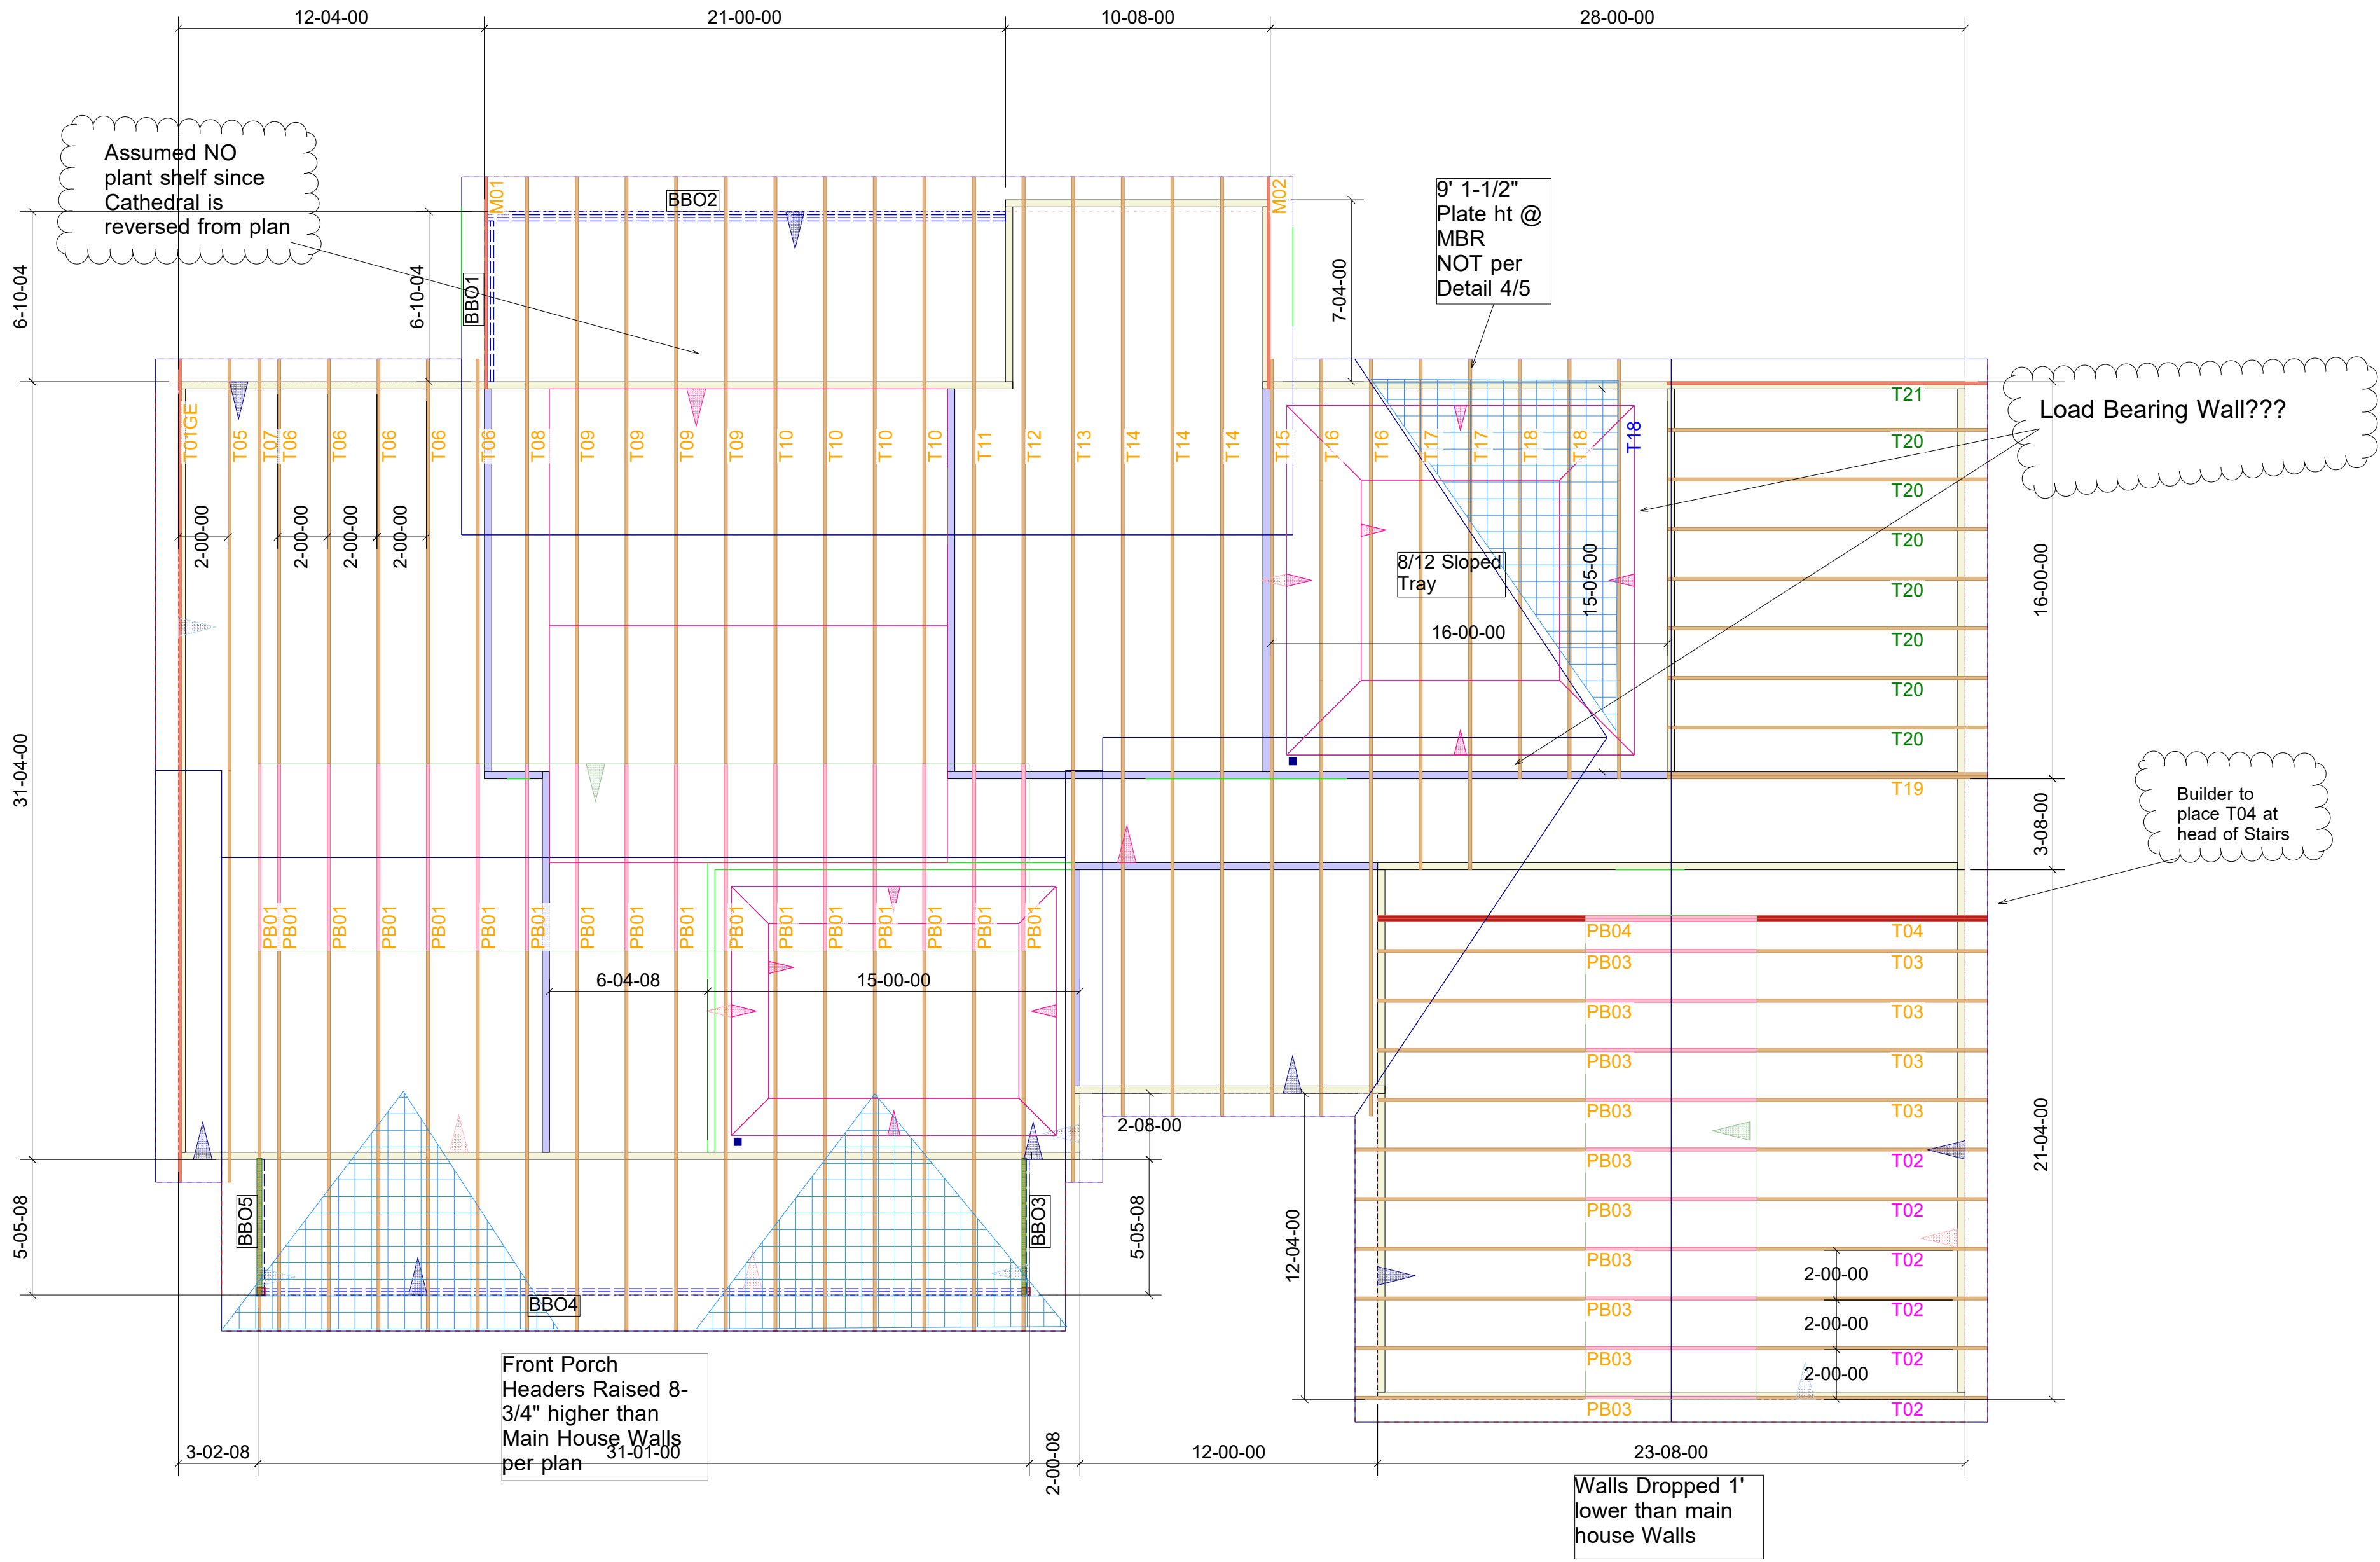

### ROOF TRUSS LAYOUT

NTS

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**

These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding loading, consult Chapter 16 of the International Building Code, 2018 Edition, 1603.1.1.1.

**SHOP DRAWING APPROVAL**

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

REVIEWED BY: \_\_\_\_\_ APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_




**Client:** Parks Buiding Supply

**Project:** PAMI/Elliott Bridge Rd.

**Model:** \_\_\_\_\_ Date: 9/30/2021

**Lot #:** \_\_\_\_\_ Sales Rep: **Jimmy Eudy**

**Order #:** **B-80605** Designer: **Roger Lentz**

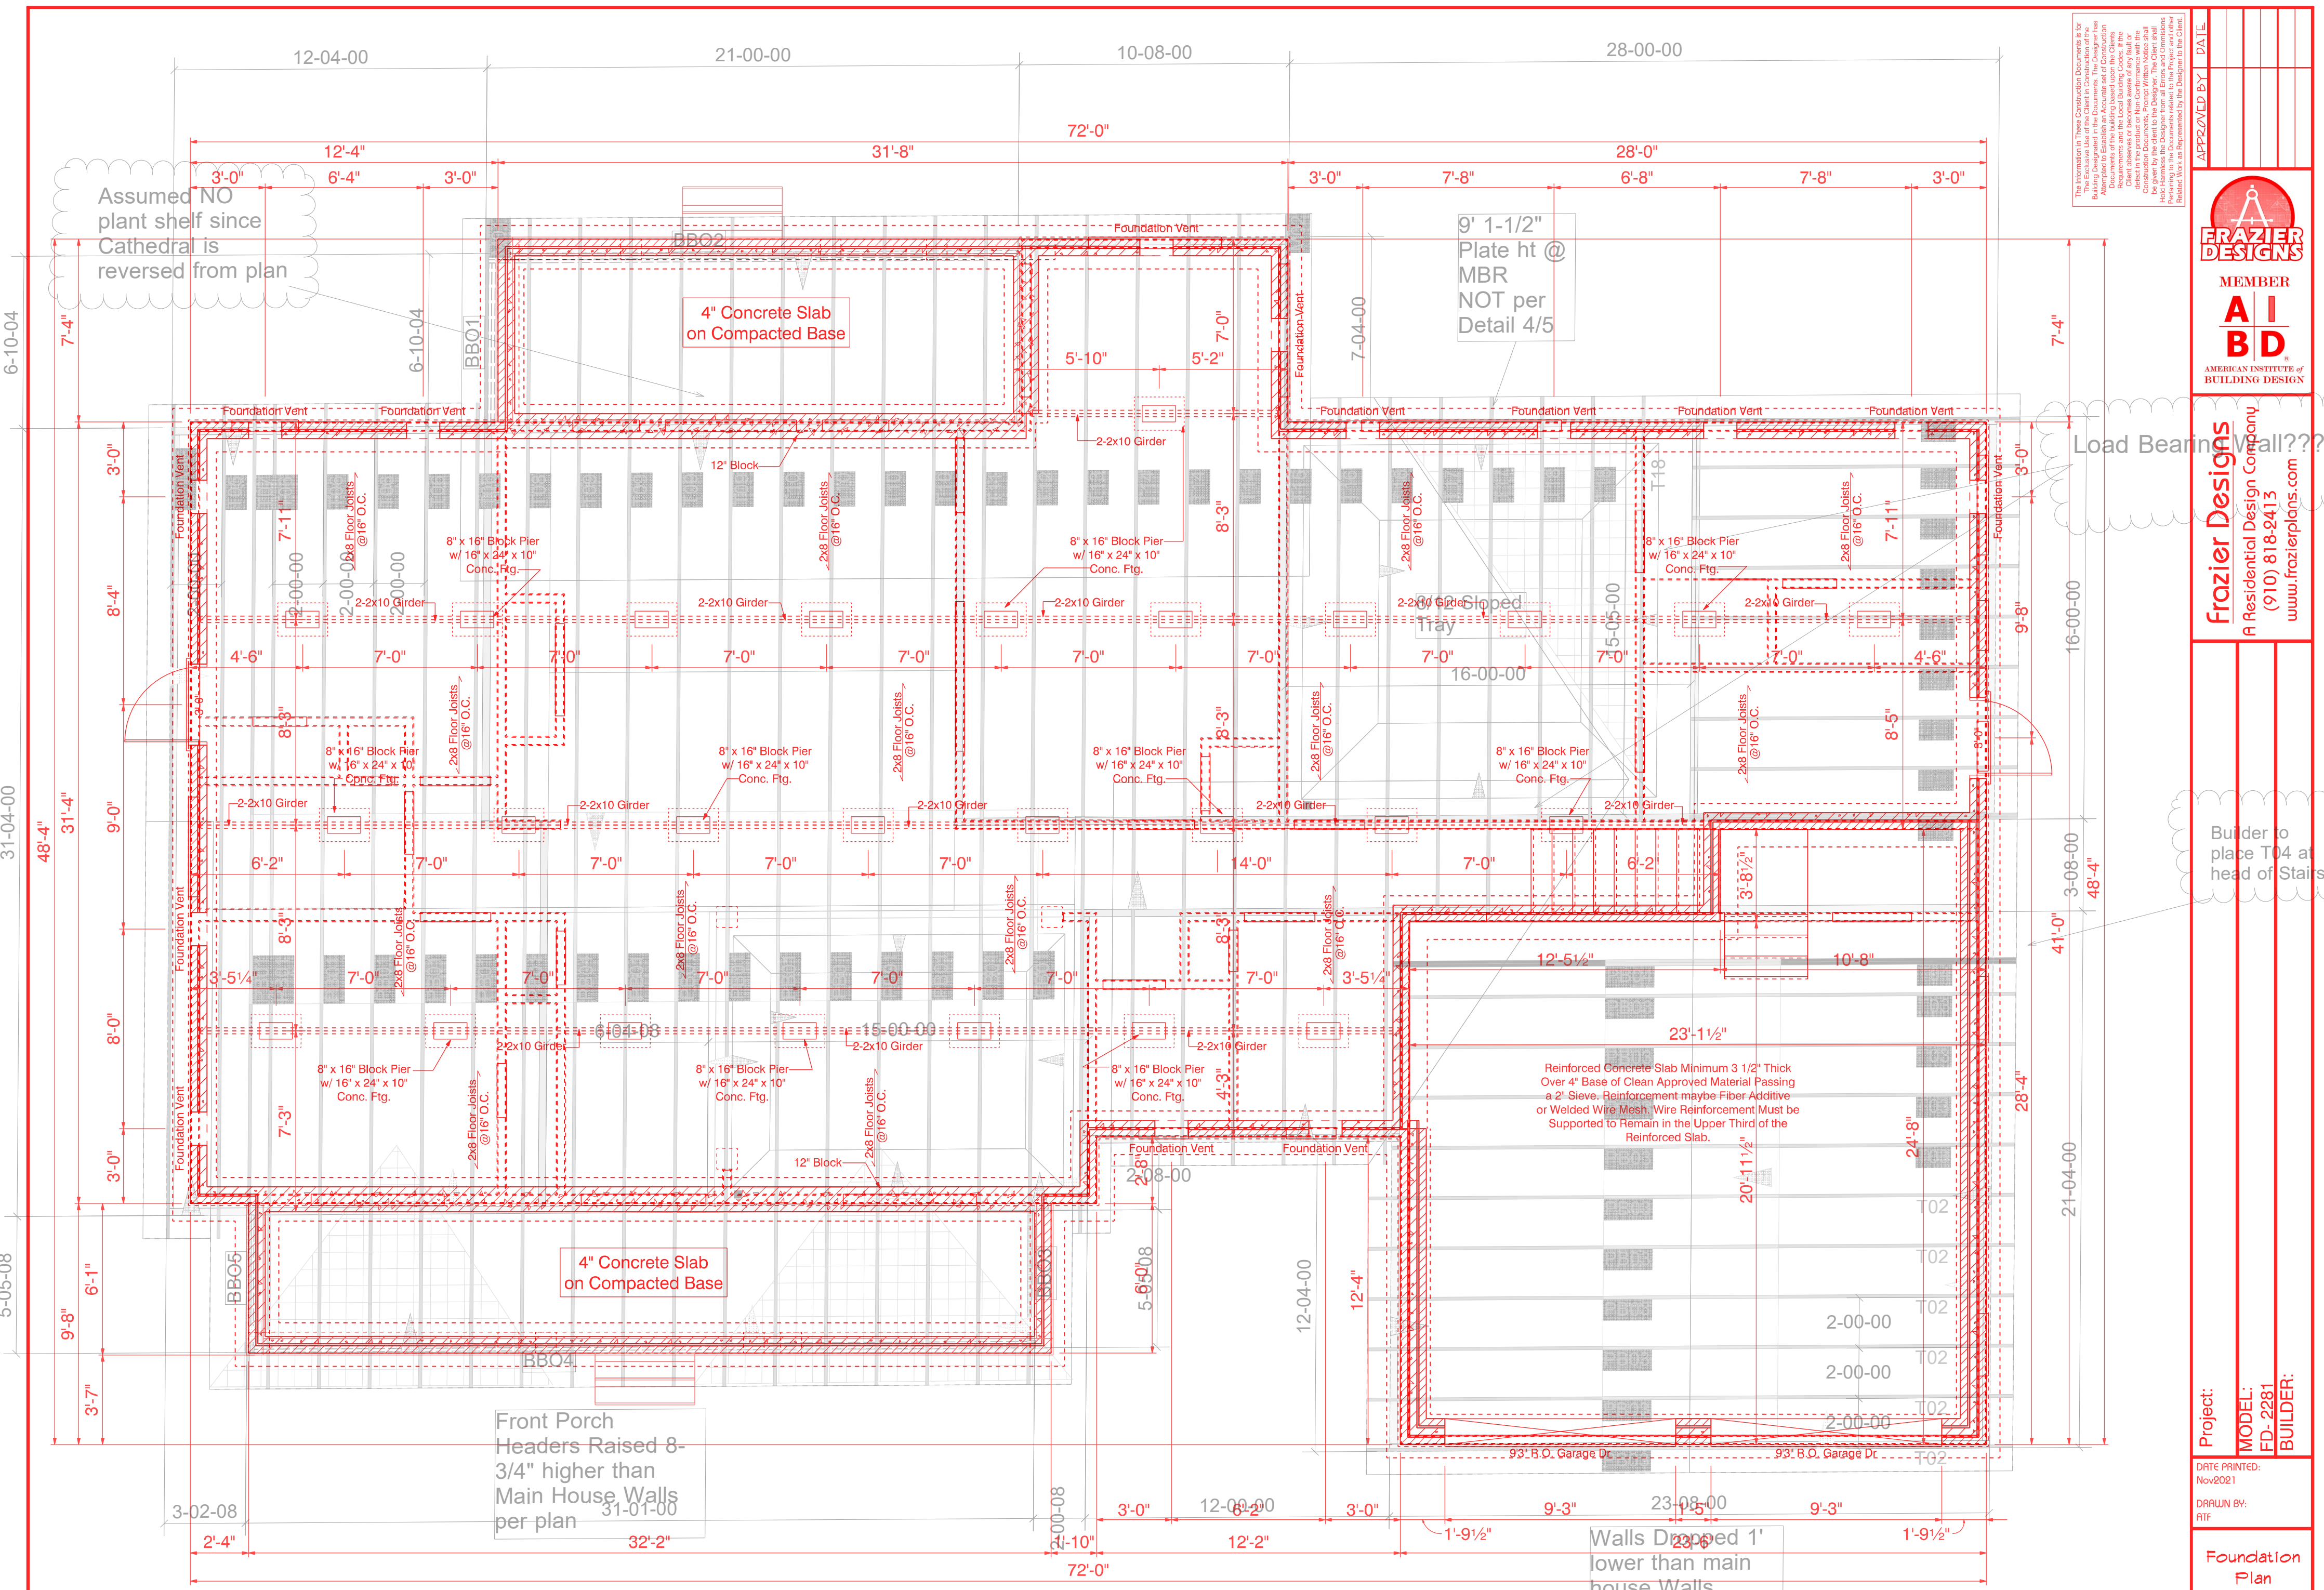

**Foundation Plan**  
 Scale: 1/4" = 10"  
**ROOF TRUSS LAYOUT**

NTS

The User assumes all responsibility for the use of these documents. The user shall be responsible for the accuracy of the information provided. The user shall be responsible for the accuracy of the information provided. The user shall be responsible for the accuracy of the information provided.

APPROVED BY	DATE



**Frazier Designs**  
 A Residential Design Company  
 (910) 818-2413  
 www.frazierplans.com

Project: \_\_\_\_\_  
 MODEL: FD- 2281  
 BUILDER: \_\_\_\_\_

DATE PRINTED: Nov2021  
 DRAWN BY: ATF

Foundation Plan

SHEET  
**4**