

# Harnett County Department of Public Health

PERMIT # SFD 2108-0045

## Operation Permit

SL 1563

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 41 ROCK RIDGE PL. (SUL AGENCY ROAD)

Name: (owner) ON TOP BLDG CO LLC      SUBDIVISION JAMES E JOHNSON III      LOT # 2

System Installer: LORENZO BACKHOE


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public       Well      Distance from well NA feet

System Type: 2 1/2 REDUCTION SYSTEM IIIg      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

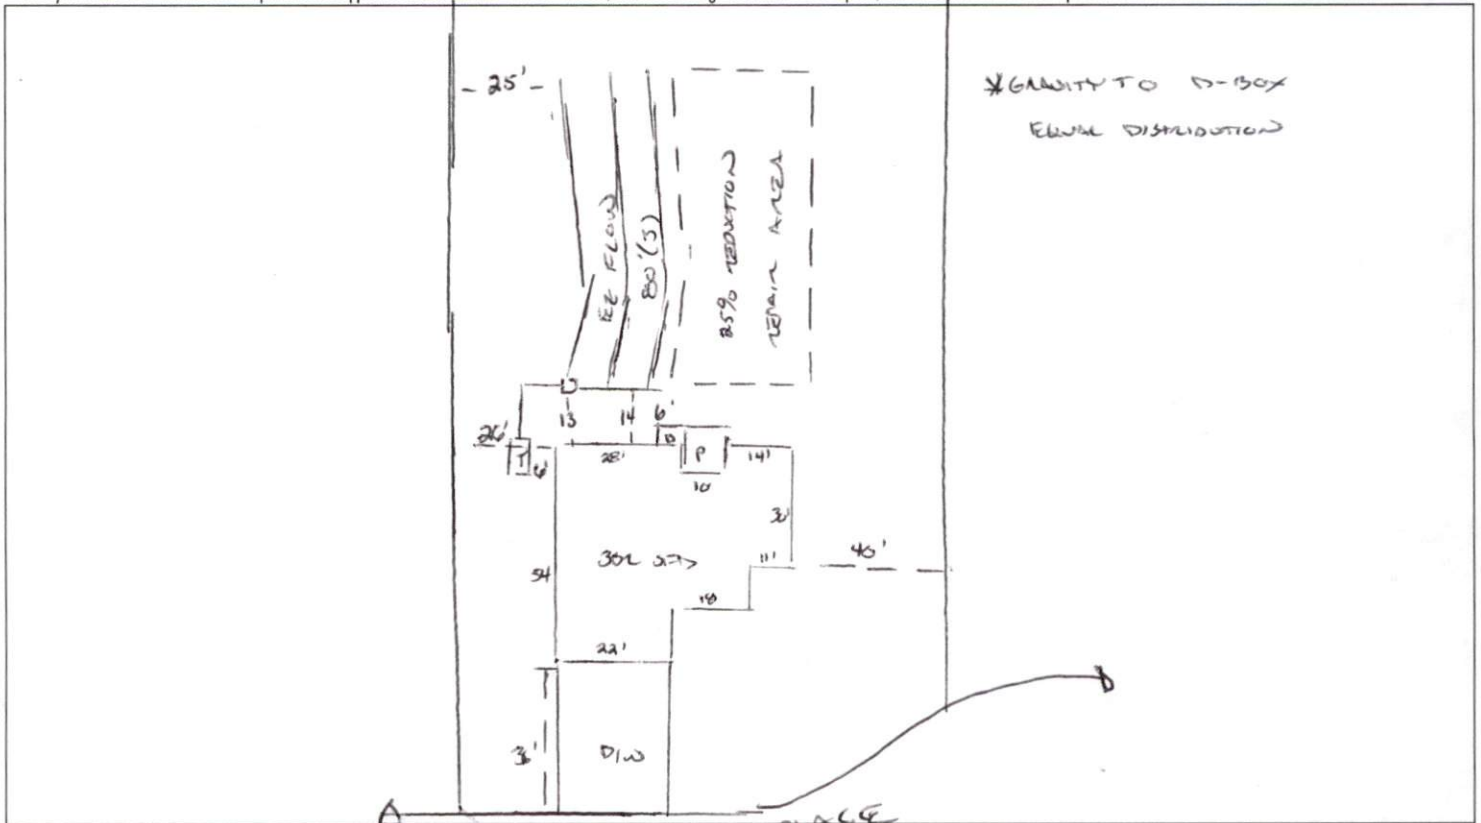

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box     Pump     Alarm     H2O Line     PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other EE FLOW IIIg    Septic Tank: 1000 gallons    Pump Tank: \_\_\_\_\_ gallons  
Subsurface      No. of      exact length      width of      depth of  
Drainage Field      ditches 3      of each ditch 80 feet      ditches 3 feet      ditches 24 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 01/25/2022