

Harnett County Department of Public Health

180 Cameron RD

PERMIT # SFD 2108-0049

Operation Permit

- New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: SR 1232 Cameron RD

Name: (owner) Weaver Homes

SUBDIVISION _____

LOT # _____

System Installer: Yellow Dog

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: 75% Reduction System Type IIC Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Charlotte 2/28/24

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

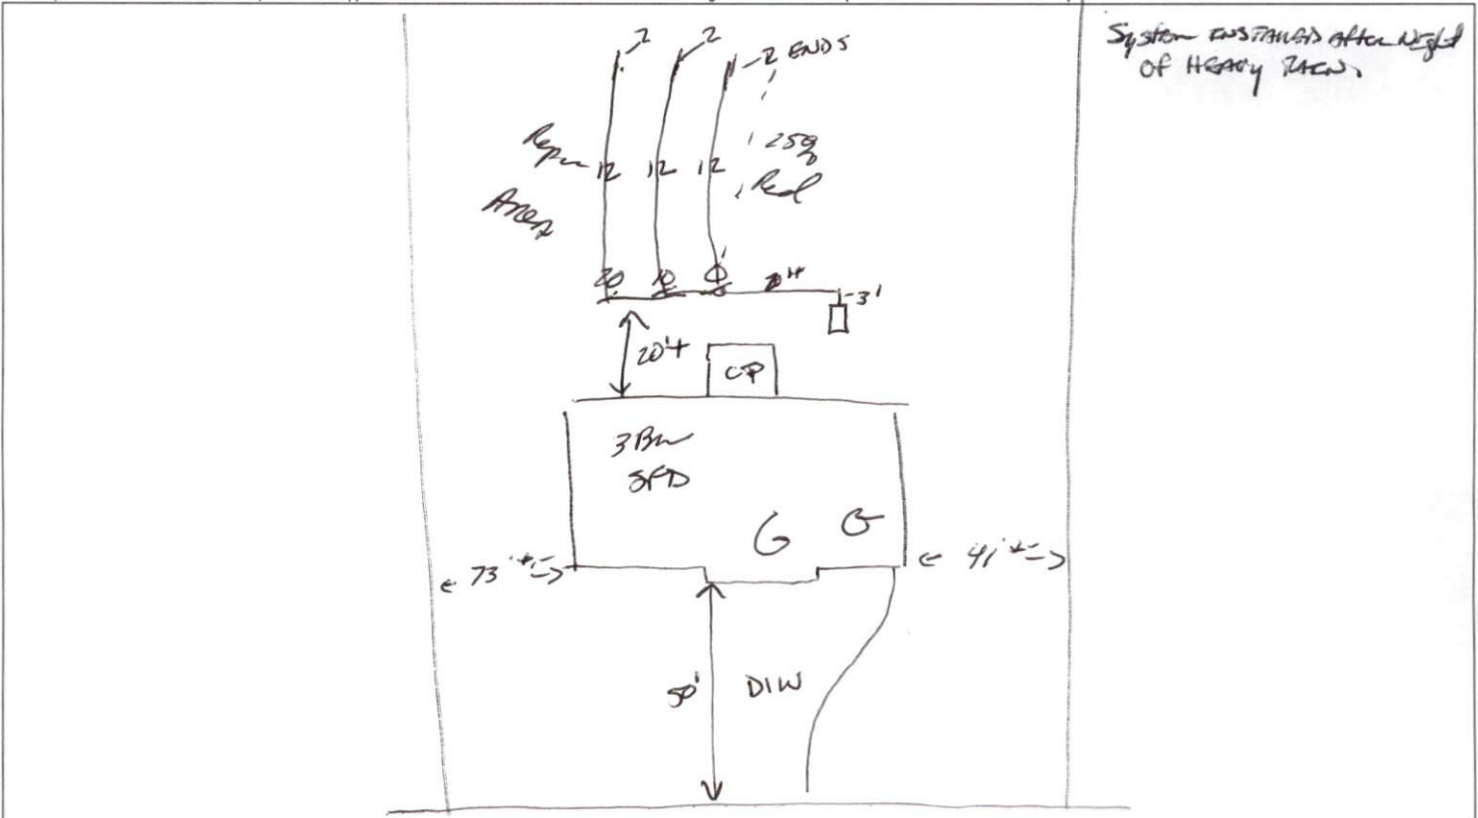

System installed after night of heavy rain.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

SR 1232 Cameron RD

- _____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 75% Reduction System Septic Tank: 1000 gallons Pump Tank: _____ gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 50 feet ditches 3 feet ditches 24-18 inches
French Drain Required: _____ Linear feet

Authorized State Agent James E. Markon Date 4-6-22