

# Harnett County Department of Public Health

PERMIT # SFD 2108-0073

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 521437 Bellwood RD

Name: (owner) Watermark Homes Inc    SUBDIVISION Bellwood Woods    LOT # 157

System Installer: Tomas Archa

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community    Public    Well   Distance from well \_\_\_\_\_ feet

System Type: Up to 50% REDUCTION PPBS    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

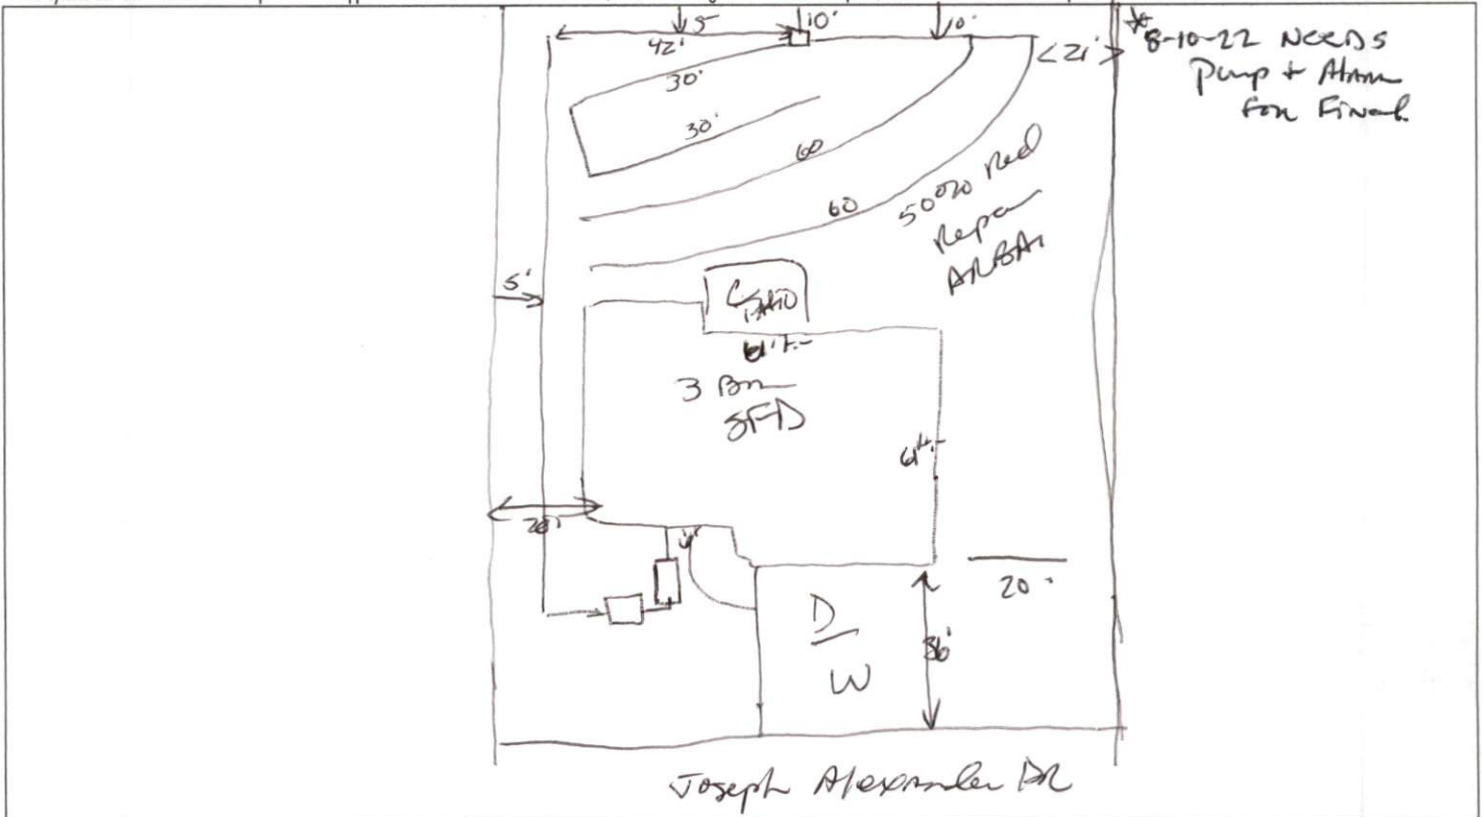

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box  
  \_\_\_\_\_ Pump  
  \_\_\_\_\_ Alarm  
  \_\_\_\_\_ H2O Line  
  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 75% REDUCTION    Septic Tank: 1000 gallons    Pump Tank: 1000 gallons

Subsurface                      No. of                      exact length                      width of                      depth of

Drainage Field                      ditches 3                      of each ditch 60 feet                      ditches 3 feet                      ditches 18" inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. MANDALAY III 12345    Date 11-1-22