isDesign

Client: WESTAN


Project: Address: Date: Input by: 9/13/2021 Lenny Norris


Project #:

**2852 TWIN Kerto-S LVL** 1.750" X 9.250" 2-Ply - PASSED

Level: Level

Job Name: LEYLAND A

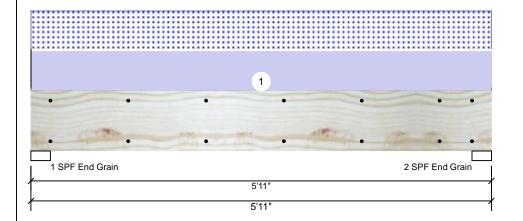



Page 1 of 1

Member Information								
Type:	Girder							
Plies:	2							
Moisture Condition:	Dry							
Deflection LL:	480							
Deflection TL:	360							
Importance:	Normal							
Temperature:	Temp <= 100°F							

Application: Floor Design Method: ASD **Building Code: IBC/IRC 2015** Load Sharing: No Deck: Not Checked

Reactions UNPATTERNED Ib (Uplift) Brg Wind Const Live Dead Snow 0 1616 1595 0 0 1 0 0 2 1616 1595 0

# Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	4166 ft-lb	2'11 1/2"	14423 ft-lb	0.289 (29%)	D+S	L
Unbraced	4166 ft-lb	2'11 1/2"	11027 ft-lb	0.378 (38%)	D+S	L
Shear	2170 lb	4'11 1/2"	7943 lb	0.273 (27%)	D+S	L
LL Defl inch	0.032 (L/2069)	2'11 1/2"	0.139 (L/480)	0.230 (23%)	S	L
TL Defl inch	0.065 (L/1028)	2'11 1/2"	0.185 (L/360)	0.350 (35%)	D+S	L

#### Bearings Bearing Length Cap. React D/L lb Total Ld. Case Ld. Comb. 1616 / 1595 3210 L D+S 1 - SPF 3.000" End Grain 2 - SPF 3.000" 1616 / 1595 3210 L D+S End Grain

### **Design Notes**

- 1 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top loads must be supported equally by all plies.
- 5 Top braced at bearings.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.

ID Trib Width Side Dead 0.9 Load Type Location Live 1 Snow 1.15 Wind 1.6 Const. 1.25 Comments 1 Uniform Top 539 PLF 0 PLF 539 PLF 0 PLF 0 PLF TRUSSES A2,A4 Self Weight 7 PLF

#### Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

- Dry service conditions, unless noted otherwise
   LVL not to be treated with fire retardant or corrosive
- Handling & Installation
- LVL beams must not be cut or drilled
  Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
- Damaged Beams must not be used
- Design assumes top edge is laterally restrained
  Provide lateral support at bearing points to avoid
  lateral displacement and rotation
- 6. For flat roofs provide proper drainage to prevent ponding

Metsä Wood 301 Merritt 7 Building, 2nd Floor Norwalk, CT 06851 (800) 622-5850 www.metsawood.com/us ICC-ES: ESR-3633

Comtech, Inc. 1001 S. Reilly Road, Suite #639 Fayetteville, NC USA 28314 910-864-TRUS



This design is valid until 2/26/2023 CSD I

Manufacturer Info



Client: WESTAN

Project: Address:


9/13/2021 Date: Input by:


Lenny Norris Job Name: LEYLAND A

Project #:

2.000" X 12.000" 2-Ply - PASSED S-P-F #2

Level: Level

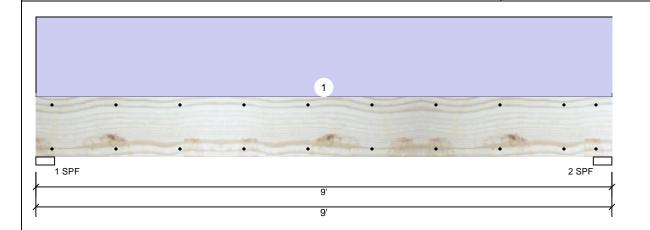



Page 1 of 1

Member Infor	Reactio	Reactions UNPATTERNED lb (Uplift)								
Type:	Girder	Application:	Floor	Brg	Live	Dead	Snow	Wi	ind	Const
Plies:	2	Design Method:	ASD	1	0	1350	0		0	0
Moisture Condition	on: Dry	Building Code:	IBC/IRC 2015	2	0	1350	0		0	0
Deflection LL:	480	Load Sharing:	No							
Deflection TL:	360	Deck:	Not Checked							
Importance:	Normal									
Temperature:	Temp <= 100°F									
				Bearing	gs					
				Bearing	g Length	Cap. Re	act D/L lb	Total L	.d. Case	Ld. Comb.
				1 - SPF	3.500"	30%	1350 / 0	1350 U	Iniform	D
				2 - SPF	3.500"	30%	1350 / 0	1350 U	Iniform	D

#### Analysis Results

	Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
	Moment	2736 ft-lb	4'6"	4153 ft-lb	0.659 (66%)	D	Uniform
	Unbraced	2736 ft-lb	4'6"	3515 ft-lb	0.778 (78%)	D	Uniform
	Shear	1000 lb	1'2"	2734 lb	0.366 (37%)	D	Uniform
	LL Defl inch	0.000 (L/999)	0	999.000 (L/0)	0.000 (0%)		
	TL Defl inch	0.072 (L/1422)	4'6"	0.285 (L/360)	0.250 (25%)	D	Uniform
_				•			

## **Design Notes**

- 1 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top loads must be supported equally by all plies.
- 5 Top braced at bearings.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.

ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6 (	Const. 1.25	Comments	
1	Uniform			Top	300 PLF	0 PLF	0 PLF	0 PLF	0 PLF	GABLE WEIGHT	

Comtech, Inc. 1001 S. Reilly Road, Suite #639 Fayetteville, NC USA 28314 910-864-TRUS Manufacturer Info соттесн

CSD BOOK