

Graphical Illustration - Not To Scale
Member Cut Length - 14-06-06
MemberPitch - 0/12

Design Information:

| | | | | | | | |
|---------------------|---------|----------------------|-------------------------|-----------------|-------------------------|-------------------|-------------------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft ² | Roof Dead Load: | 10.0 lb/ft ² | Ground Snow Load: | 20.0 lb/ft ² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft ² | Roof Live Load: | 20.0 lb/ft ² | | |
| | | Unbraced Length Top: | 0-00 | Bottom: | 14-04-00 | | |

Design Results:

| | Location | Design | Control | Result | LDF | Load Combination |
|-----------------------|----------|---------------|--|----------------|------|------------------|
| Critical Moment (Pos) | 7-02-08 | 2597.15 lb ft | 4530.03 lb ft | Passed - 57% | 1.00 | D + L |
| Critical Shear | 0-01 | 720.19 lb | 1730.00 lb | Passed - 42% | 1.00 | D + L |
| Live Load Deflection | 7-02-08 | 0-02 | 0-12 (L/480) | Passed - L/999 | - | L |
| Total Load Deflection | 7-02-08 | 0-03 | 1-00 (L/240) | Passed - L/981 | - | D + L |
| Max. Reaction | 0-00 | 735.30 lb | Supported Mtl 1325.00 lb Supporting Mtl 0.00 lb | Passed - 55% | 1.00 | D + L |
| | 14-05-00 | 741.79 lb | 1387.50 lb 5195.25 lb | Passed - 53% | 1.00 | D + L |

Design Notes:

- * The required bearing length for this member is the same for both with and without web stiffeners (112)
- *

Loading:

| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|---------|-------|----------|-------------------|-------------------------|------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Uniform | 0-00 | 14-06-06 | FC2 Floor Decking | 20 lb/ft | 80 lb/ft | - | - |

Support Information:


| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|----------|----------|--------------|----------------------------|------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 0-00 | 1BM3-2(i648) | 147.00 lb | 588.00 lb | - | - |
| 2 | 14-04-00 | 14-06-06 | W18(i17) | 148.00 lb | 593.00 lb | - | - |

Connector Information:

| Support | Manufacturer | Model | Nailing Requirements | | | Nail Seal Length | Other Information |
|---------|--------------|------------|----------------------|------|--------|------------------|---|
| | | | Top | Face | Member | | |
| 1 | | ITS2.56/14 | - | - | - | N/A | Connector manually specified by the user. |

Errors, Warnings & Notes:

- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- * A load bearing wall is supported by the I-joist at a location where the I-joist is supported by a member below. Please see manufacturer installation guidelines for requirements of blocking/squash blocks.

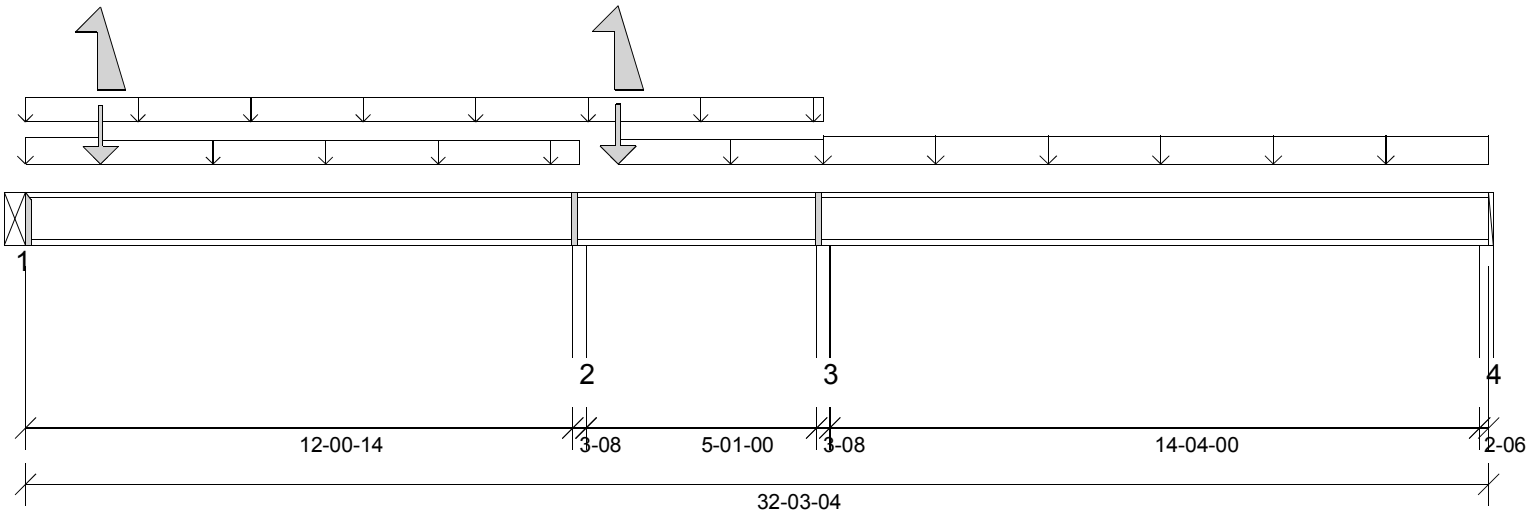

Graphical Illustration - Not To Scale
Member Cut Length - 32-03-04
MemberPitch - 0/12

Design Information:

| | | | | | | | |
|---------------------|---------|------------------|-------------------------|-----------------|-------------------------|-------------------|-------------------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft ² | Roof Dead Load: | 10.0 lb/ft ² | Ground Snow Load: | 20.0 lb/ft ² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft ² | Roof Live Load: | 20.0 lb/ft ² | | |
| | | Unbraced Length | Top: 0-00 | Bottom: | 14-04-00 | | |

Design Results:

| | Location | Design | Control | Result | LDF | Load Combination |
|-----------------------|----------|----------------|------------------------------|----------------|------|------------------|
| Critical Moment (Pos) | 26-01-06 | 1822.28 lb ft | 4530.03 lb ft | Passed - 40% | 1.00 | D + L |
| Critical Moment (Neg) | 17-07-02 | -2056.75 lb ft | 4530.03 lb ft | Passed - 45% | 1.00 | D + L |
| Critical Shear | 17-08-15 | 854.14 lb | 1730.00 lb | Passed - 49% | 1.00 | D + L |
| Live Load Deflection | 25-05-12 | 0-01 | 0-12 (L/480) | Passed - L/999 | - | L |
| Total Load Deflection | 25-05-14 | 0-02 | 1-00 (L/240) | Passed - L/999 | - | D + L |
| Max. Reaction | | | Supported Mt/ Supporting Mt/ | | | |
| | 0-00 | 737.40 lb | 1325.00 lb / 0.00 lb | Passed - 56% | 1.00 | D + L |
| | 0-00 | -309.61 lb | 0.00 lb / - | | 1.00 | D + L |
| | 12-02-10 | 1007.75 lb | 3130.00 lb / 7656.18 lb | Passed - 32% | 1.00 | D + L |
| | 12-02-10 | -475.54 lb | 0.00 lb / - | | 1.00 | D + L |
| | 17-07-02 | 1554.60 lb | 3130.00 lb / 7656.18 lb | Passed - 50% | 1.00 | D + L |
| | 32-01-14 | 624.82 lb | 1387.51 lb / 5195.45 lb | Passed - 45% | 1.00 | D + L |

Design Notes:

* The required bearing length for this member is the same for both with and without web stiffeners (112)

*

Loading:

| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|---------|----------|----------|-------------------|-------------------------|-------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Uniform | 0-00 | 17-07-02 | FC2 Floor Decking | 10 lb/ft | 40 lb/ft | - | - |
| Uniform | 0-00 | 1-07-14 | FC2 Floor Decking | 17 lb/ft | 67 lb/ft | - | - |
| Uniform | 1-07-14 | 12-02-10 | FC2 Floor Decking | 8 lb/ft | 31 lb/ft | - | - |
| Uniform | 13-00-14 | 17-07-02 | FC2 Floor Decking | 10 lb/ft | 40 lb/ft | - | - |
| Uniform | 17-07-02 | 32-03-04 | FC2 Floor Decking | 20 lb/ft | 80 lb/ft | - | - |
| Point | 1-07-14 | 1-07-14 | FJ6(i711) | -78.00 lb | 310.00/-434.00 lb | - | - |
| Point | 13-00-14 | 13-00-14 | FJ6(i721) | -40.00 lb | 321.00/-483.00 lb | - | - |

Support Information:

| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|----------|----------|------------|----------------------------|--------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 0-00 | 1BM2(i637) | 45.00 lb | 692.00/-698.00 lb | - | - |
| 2 | 12-00-14 | 12-04-06 | W25(i24) | 79.00 lb | 1287.00/-555.00 lb | - | - |
| 3 | 17-05-06 | 17-08-14 | W26(i26) | 263.00 lb | 1292.00/-65.00 lb | - | - |
| 4 | 32-00-14 | 32-03-04 | W18(i17) | 124.00 lb | 524.00/-219.00 lb | - | - |

Connector Information:


| Support | Manufacturer | Model | Nailing Requirements | | | Other Information |
|---------|--------------|------------|----------------------|------|--------|---|
| | | | Top | Face | Member | |
| 1 | | ITS2.56/14 | - | - | - | Connector manually specified by the user. |

Errors, Warnings & Notes:

- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- * A load bearing wall is supported by the I-joist at a location where the I-joist is supported by a member below. Please see manufacturer installation guidelines for requirements of blocking/squash blocks.

- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.

- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.

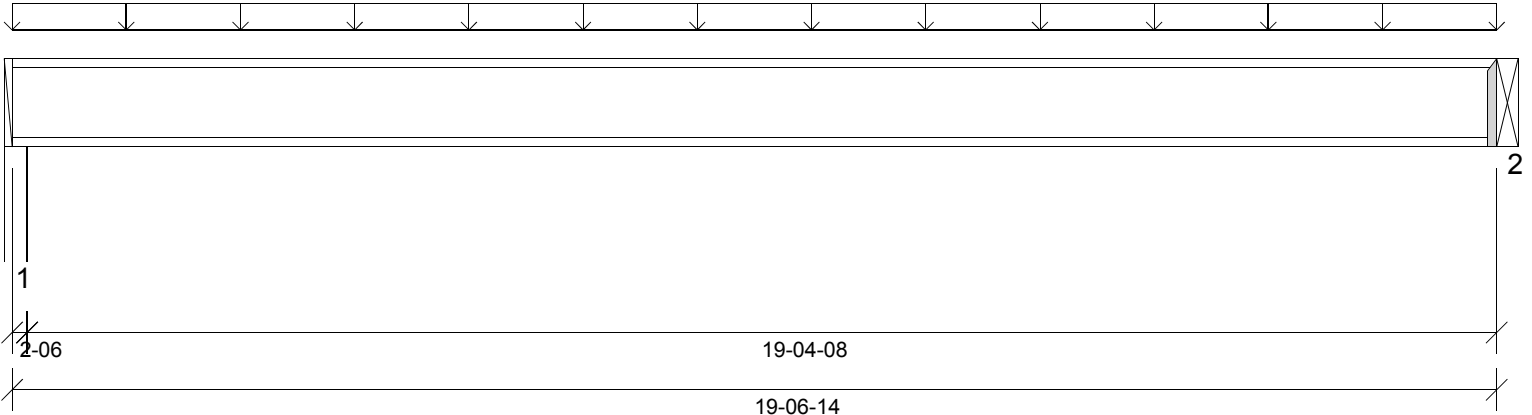

Graphical Illustration - Not To Scale
Member Cut Length - 19-06-14
MemberPitch - 0/12

Design Information:

| | | | | | | | |
|---------------------|---------|------------------|-------------------------|-----------------|-------------------------|-------------------|-------------------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft ² | Roof Dead Load: | 10.0 lb/ft ² | Ground Snow Load: | 20.0 lb/ft ² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft ² | Roof Live Load: | 20.0 lb/ft ² | | |
| | | Unbraced Length | Top: 0-00 | Bottom: | 19-04-08 | | |

Design Results:

| | Location | Design | Control | Result | LDF | Load Combination | |
|-----------------------|----------|---------------|----------------------------|-----------------------------|--------------|------------------|-------|
| Critical Moment (Pos) | 9-10-02 | 3154.66 lb ft | 4530.03 lb ft | Passed - 70% | 1.00 | D + L | |
| Critical Shear | 19-06-13 | 648.20 lb | 1730.00 lb | Passed - 37% | 1.00 | D + L | |
| Live Load Deflection | 9-10-02 | 0-05 | 0-12 (L/480) | Passed - L/781 | - | L | |
| Total Load Deflection | 9-10-02 | 0-06 | 1-00 (L/240) | Passed - L/625 | - | D + L | |
| Max. Reaction | 1-06 | 662.56 lb | Supported Mt 1387.50 lb | Supporting Mt 5195.29 lb | Passed - 48% | 1.00 | D + L |
| | 19-06-14 | 658.27 lb | 1325.00 lb | 0.00 lb | Passed - 50% | 1.00 | D + L |

Design Notes:

- * The required bearing length for this member is the same for both with and without web stiffeners (112)
- *

Loading:

| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|---------|-------|----------|-------------------|-------------------------|------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Uniform | 0-00 | 19-06-14 | FC2 Floor Decking | 13 lb/ft | 53 lb/ft | - | - |

Support Information:


| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|----------|----------|--------------|----------------------------|------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 2-06 | W16(i22) | 133.00 lb | 530.00 lb | - | - |
| 2 | 19-06-14 | 19-06-14 | 1BM3-2(i648) | 132.00 lb | 527.00 lb | - | - |

Connector Information:

| Support | Manufacturer | Model | Nailing Requirements | | | With Seal Length | Other Information |
|---------|--------------|------------|----------------------|------|--------|------------------|---|
| | | | Top | Face | Member | | |
| 2 | | ITS2.56/14 | - | - | - | N/A | Connector manually specified by the user. |

Errors, Warnings & Notes:

- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- * A load bearing wall is supported by the I-joist at a location where the I-joist is supported by a member below. Please see manufacturer installation guidelines for requirements of blocking/squash blocks.

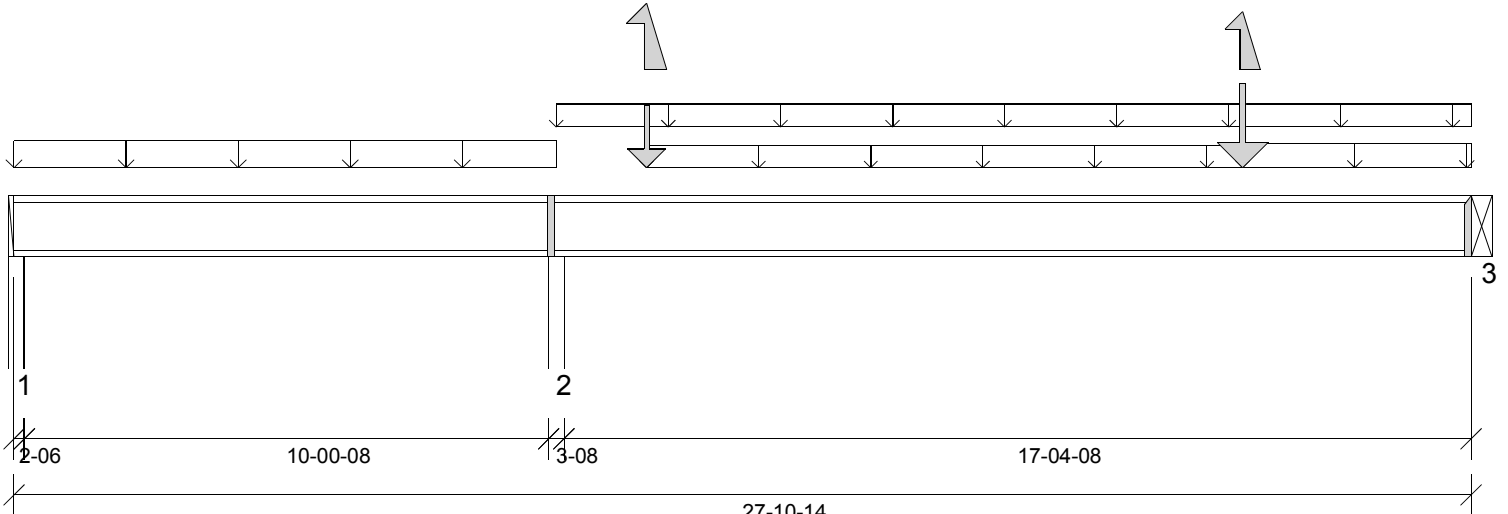

27-10-14
Graphical Illustration - Not To Scale
Member Cut Length - 27-10-14
MemberPitch - 0/12

Design Information:

| | | | | | | | |
|---------------------|---------|------------------|-------------|-----------------|-------------|-------------------|-------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft² | Roof Dead Load: | 10.0 lb/ft² | Ground Snow Load: | 20.0 lb/ft² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft² | Roof Live Load: | 20.0 lb/ft² | | |
| | | Unbraced Length | Top: 0-00 | Bottom: | 11-02-08 | | |

Design Results:

| | Location | Design | Control | Result | LDF | Load Combination | |
|-----------------------|----------|----------------|---------------|----------------|--------------|------------------|-------|
| Critical Moment (Pos) | 23-06-06 | 3555.83 lb ft | 4530.03 lb ft | Passed - 78% | 1.00 | D + L | |
| Critical Moment (Neg) | 10-04-10 | -3135.08 lb ft | 4530.03 lb ft | Passed - 69% | 1.00 | D + L | |
| Critical Shear | 10-06-07 | 1223.92 lb | 1730.00 lb | Passed - 71% | 1.00 | D + L | |
| Live Load Deflection | 20-03-05 | 0-04 | 0-12 (L/480) | Passed - L/842 | - | L | |
| Total Load Deflection | 20-03-08 | 0-05 | 1-00 (L/240) | Passed - L/738 | - | D + L | |
| Max. Reaction | | | Supported Mtl | Supporting Mtl | | | |
| | 1-06 | 370.49 lb | 1387.50 lb | 5195.33 lb | Passed - 27% | 1.00 | D + L |
| | 1-06 | -184.54 lb | 0.00 lb | - | 1.00 | D + L | |
| | 10-04-10 | 1962.00 lb | 3130.00 lb | 7656.28 lb | Passed - 63% | 1.00 | D + L |
| | 10-04-10 | -434.68 lb | 0.00 lb | - | 1.00 | D + L | |
| | 27-10-14 | 1007.20 lb | 1325.00 lb | 0.00 lb | Passed - 76% | 1.00 | D + L |
| | 27-10-14 | -158.91 lb | 0.00 lb | - | 1.00 | D + L | |

Design Notes:

* The required bearing length for this member is the same for both with and without web stiffeners (112)

*

Loading:

| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|---------|----------|----------|-------------------|-------------------------|-------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Uniform | 0-00 | 10-04-10 | FC2 Floor Decking | 17 lb/ft | 67 lb/ft | - | - |
| Uniform | 10-04-10 | 27-10-14 | FC2 Floor Decking | 7 lb/ft | 27 lb/ft | - | - |
| Uniform | 12-01-06 | 23-06-06 | FC2 Floor Decking | 5 lb/ft | 18 lb/ft | - | - |
| Uniform | 23-06-06 | 27-10-14 | FC2 Floor Decking | 10 lb/ft | 40 lb/ft | - | - |
| Point | 12-01-06 | 12-01-06 | FJ6(i711) | 9.00 lb | 447.00/-499.00 lb | - | - |
| Point | 23-06-06 | 23-06-06 | FJ6(i721) | 57.00 lb | 634.00/-407.00 lb | - | - |

Support Information:


| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|----------|----------|--------------|----------------------------|--------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 2-06 | W14(i14) | 46.00 lb | 325.00/-348.00 lb | - | - |
| 2 | 10-02-14 | 10-06-06 | W41(i41) | 270.00 lb | 1692.00/-705.00 lb | - | - |
| 3 | 27-10-14 | 27-10-14 | 1BM3-2(i648) | 139.00 lb | 868.00/-558.00 lb | - | - |

Connector Information:

| Support | Manufacturer | Model | Nailing Requirements | | Member | Min Seal Length | Other Information |
|---------|--------------|------------|----------------------|------|--------|-----------------|---|
| | | | Top | Face | | | |
| 3 | | ITS2.56/14 | - | - | - | N/A | Connector manually specified by the user. |

Errors, Warnings & Notes:

- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- * A load bearing wall is supported by the I-joist at a location where the I-joist is supported by a member below. Please see manufacturer installation guidelines for requirements of blocking/squash blocks.

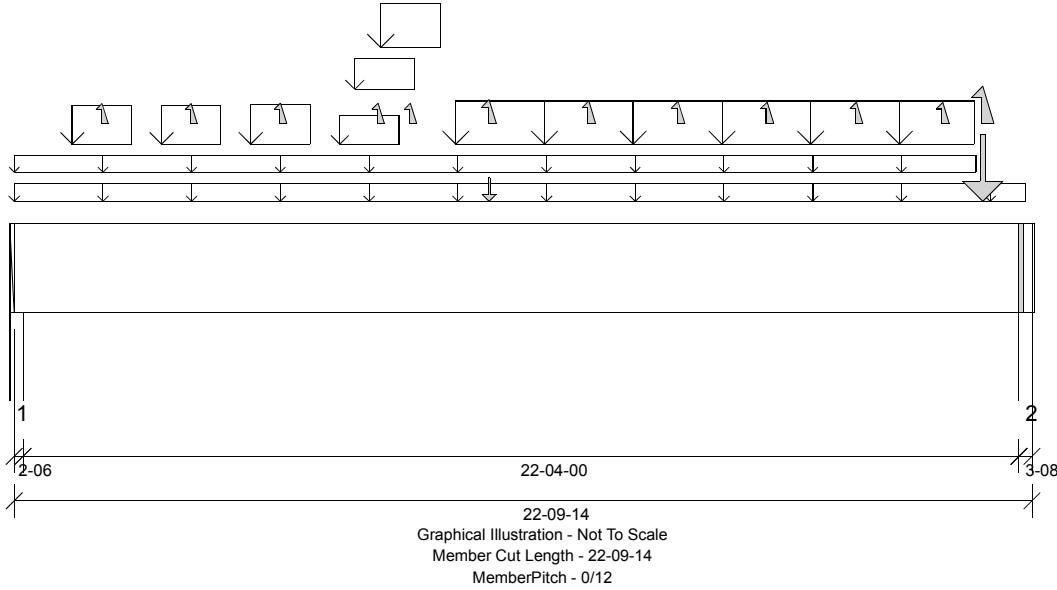

Design Information:

| | | | | | | | |
|---------------------|---------|----------------------|-------------------------|-----------------|-------------------------|-------------------|-------------------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft ² | Roof Dead Load: | 10.0 lb/ft ² | Ground Snow Load: | 20.0 lb/ft ² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft ² | Roof Live Load: | 20.0 lb/ft ² | | |
| | | Unbraced Length Top: | 0-00 | Bottom: | 11-01-06 | | |

Design Notes:

- * Member was not designed due to missing strength properties. If possible select a new material or change the orientation of the member.
- *

Loading:


| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|-------------|----------|----------|-------------------|-------------------------|-------------------|-------------------|------------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Self Weight | 0-00 | 22-09-14 | Self Weight | 24 lb/ft | - | - | - |
| Uniform | 0-00 | 22-08-02 | FC2 Floor Decking | 9 lb/ft | 35 lb/ft | - | - |
| Uniform | 0-00 | 21-06-14 | FC2 Floor Decking | - | 6 lb/ft | - | - |
| Uniform | 1-03-10 | 2-07-10 | W40(i34) | 222 lb/ft | - | 239 lb/ft | 100 lb/ft |
| Uniform | 3-03-10 | 4-07-10 | W40(i34) | 222 lb/ft | - | 239 lb/ft | 100 lb/ft |
| Uniform | 5-03-10 | 6-07-10 | W40(i34) | 227 lb/ft | - | 248 lb/ft | 104 lb/ft |
| Uniform | 7-03-10 | 8-07-10 | W40(i34) | 158 lb/ft | - | 110 lb/ft | 46 lb/ft |
| Uniform | 7-07-10 | 8-11-10 | W40(i34) | 194 lb/ft | - | 120 lb/ft | 50 lb/ft |
| Uniform | 8-02-10 | 9-06-10 | W40(i34) | 320 lb/ft | - | 269 lb/ft | 113 lb/ft |
| Uniform | 9-10-13 | 21-06-06 | W40(i34) | 274 lb/ft | - | 285 lb/ft | 119 lb/ft |
| Point | 10-07-12 | 10-07-12 | - | 205.00 lb | 897.00/-210.00 lb | - | - |
| Point | 1-11-10 | 1-11-10 | W40(i34) | - | - | - | - |
| Point | 3-11-10 | 3-11-10 | W40(i34) | - | - | - | - |
| Point | 5-11-10 | 5-11-10 | W40(i34) | - | - | - | - |
| Point | 8-01-15 | 8-01-15 | - | - | - | - | - |
| Point | 8-10-10 | 8-10-10 | W40(i34) | - | - | - | - |
| Point | 12-10-10 | 12-10-10 | W40(i34) | - | - | - | - |
| Point | 14-10-10 | 14-10-10 | W40(i34) | - | - | - | - |
| Point | 16-10-10 | 16-10-10 | W40(i34) | - | - | - | - |
| Point | 18-10-10 | 18-10-10 | W40(i34) | - | - | - | - |
| Point | 20-09-14 | 20-09-14 | W40(i34) | - | - | - | - |
| Point | 21-08-10 | 21-08-10 | W40(i34) | 2953.00 lb | - | 2910.00/-22.00 lb | 1200.00 lb |

Support Information:

| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|----------|----------|----------|----------------------------|-------------------|-------------------|------------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 2-06 | W14(i14) | 2924.00 lb | 960.00/-114.00 lb | 2373.00/-1.00 lb | 990.00 lb |
| 2 | 22-06-06 | 22-09-14 | W25(i24) | 6006.00 lb | 875.00/-96.00 lb | 5483.00/-21.00 lb | 2279.00 lb |

Errors, Warnings & Notes:

- * CAUTION: The maximum net analysis reaction exceeds the user-defined maximum uplift value at one or more supports.
- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.

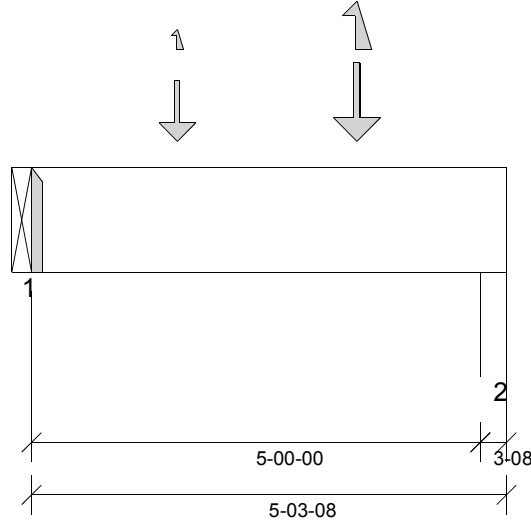

Graphical Illustration - Not To Scale
Member Cut Length - 5-03-08
MemberPitch - 0/12

Design Information:

| | | | | | | | |
|---------------------|---------|------------------|-------------------------|-----------------|-------------------------|-------------------|-------------------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft ² | Roof Dead Load: | 10.0 lb/ft ² | Ground Snow Load: | 20.0 lb/ft ² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft ² | Roof Live Load: | 20.0 lb/ft ² | | |
| | | Unbraced Length | Top: 0-00 | Bottom: | 1-09-08 | | |

Design Results:

| | Location | Design | Control | Result | LDF | Load Combination | |
|-----------------------|----------|---------------|--------------------------|------------------------|---------------|------------------|-------|
| Critical Moment (Pos) | 3-07-08 | 1963.76 lb ft | 14472.78 lb ft | Passed - 14% | 1.00 | D + L | |
| Critical Moment (Neg) | 3-07-08 | -431.96 lb ft | 14472.78 lb ft | Passed - 3% | 1.00 | D + L | |
| Critical Shear | 3-10-00 | 1342.95 lb | 4655.00 lb | Passed - 29% | 1.00 | D + L | |
| Live Load Deflection | 2-07-04 | 0-00 | 0-12 (L/360) | Passed - L/999 | - | L | |
| Total Load Deflection | 2-07-02 | 0-00 | 1-00 (L/240) | Passed - L/999 | - | D + L | |
| Max. Reaction | 0-00 | 1101.43 lb | Supported Mt/ 1101.43 lb | Supporting Mt/ 0.00 lb | Passed - 100% | 1.00 | D + L |
| | 0-00 | -5.80 lb | 0.00 lb | - | 1.00 | D + L | |
| | 5-01-00 | 1353.37 lb | 4593.73 lb | 5359.35 lb | Passed - 29% | 1.00 | D + L |
| | 5-01-00 | -289.40 lb | 0.00 lb | - | 1.00 | D + L | |

Design Notes:

*

Loading:

| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|-------------|---------|---------|-------------|-------------------------|--------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Self Weight | 0-00 | 5-03-08 | Self Weight | 7 lb/ft | - | - | - |
| Point | 1-07-08 | 1-07-08 | - | 197.00 lb | 794.00/-15.00 lb | - | - |
| Point | 3-07-08 | 3-07-08 | - | 183.00 lb | 1243.00/-698.00 lb | - | - |

Support Information:


| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|---------|---------|-------------|----------------------------|--------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 0-00 | 1BM1-2(i43) | 205.00 lb | 897.00/-210.00 lb | - | - |
| 2 | 5-00-00 | 5-03-08 | W24(i25) | 213.00 lb | 1140.00/-503.00 lb | - | - |

Connector Information:

| Support | Manufacturer | Model | Nailing Requirements | | | Will Seal Length | Other Information |
|---------|--------------|------------|----------------------|------|--------|------------------|---|
| | | | Top | Face | Member | | |
| 1 | | IUS1.81/14 | - | - | - | N/A | Connector manually specified by the user. |

Errors, Warnings & Notes:

- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.

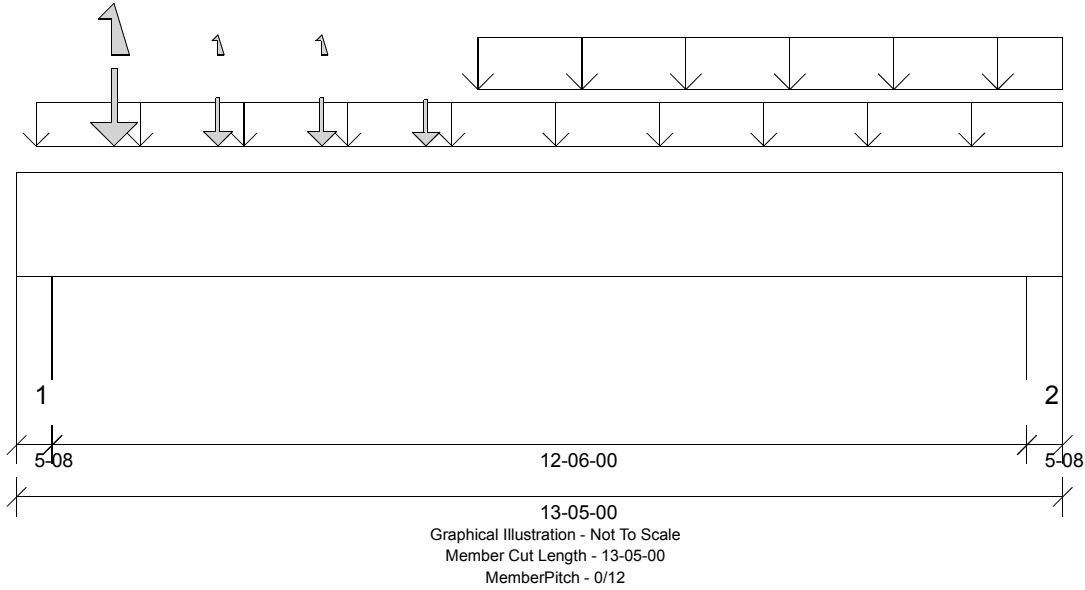

Design Information:

| | | | | | | | |
|---------------------|---------|----------------------|-------------------------|-----------------|-------------------------|-------------------|-------------------------|
| Building Code: | IRC2015 | Floor Dead Load: | 10.0 lb/ft ² | Roof Dead Load: | 10.0 lb/ft ² | Ground Snow Load: | 20.0 lb/ft ² |
| Design Methodology: | ASD | Floor Live Load: | 40.0 lb/ft ² | Roof Live Load: | 20.0 lb/ft ² | | |
| | | Unbraced Length Top: | 0-00 | Bottom: | 1-01-12 | | |

Design Results:

| | Location | Design | Control | Result | LDF | Load Combination |
|-----------------------|----------|----------------|---|----------------|------|------------------|
| Critical Moment (Pos) | 6-07-00 | 16695.13 lb ft | 37034.88 lb ft | Passed - 45% | 1.00 | D + L |
| Critical Moment (Neg) | 13-00-08 | -291.57 lb ft | 37034.88 lb ft | Passed - 1% | 1.00 | D + L |
| Critical Shear | 11-07-08 | 4930.75 lb | 10640.00 lb | Passed - 46% | 1.00 | D + L |
| Live Load Deflection | 6-08-10 | 0-03 | 0-12 (L/360) | Passed - L/919 | - | L |
| Total Load Deflection | 6-08-10 | 0-03 | 1-00 (L/240) | Passed - L/723 | - | D + L |
| Max. Reaction | 4-08 | 5429.08 lb | Supported Mtl: 14437.43 lb Supporting Mtl: 16843.66 lb | Passed - 38% | 1.00 | D + L |
| | 13-00-08 | 6354.01 lb | 14437.49 lb 16843.74 lb | Passed - 44% | 1.00 | D + L |

Design Notes:

* Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.

Loading:

| Type | Start | End | Source | Maximum Load Magnitudes | | | |
|-------------|---------|----------|---------------|-------------------------|-------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| Self Weight | 0-00 | 13-05-00 | Self Weight | 16 lb/ft | - | - | - |
| Uniform | 3-00 | 13-05-00 | - | 78 lb/ft | 313 lb/ft | - | - |
| Uniform | 5-11-00 | 13-05-00 | Smoothed Load | 106 lb/ft | 422 lb/ft | - | - |
| Point | 1-03-00 | 1-03-00 | FJ28(i702) | 139.00 lb | 868.00/-558.00 lb | - | - |
| Point | 2-07-00 | 2-07-00 | FJ28(i722) | 97.00 lb | 401.00/-15.00 lb | - | - |
| Point | 3-11-00 | 3-11-00 | FJ28(i731) | 97.00 lb | 401.00/-15.00 lb | - | - |
| Point | 5-03-00 | 5-03-00 | FJ20(i699) | 92.00 lb | 370.00 lb | - | - |

Support Information:

| Support | Start | End | Source | Maximum Analysis Reactions | | | |
|---------|----------|----------|----------|----------------------------|--------------------|-----------|------|
| | | | | Dead | Floor Live | Roof Live | Snow |
| 1 | 0-00 | 5-08 | W26(i26) | 1116.00 lb | 4336.00/-543.00 lb | - | - |
| 2 | 12-11-08 | 13-05-00 | W27(i27) | 1349.00 lb | 4982.00/-45.00 lb | - | - |

Errors, Warnings & Notes:

- * The dead loads used in the design of this member were applied to the structure as projected dead loads.
- * The member graphic, dimensions, and locations shown on this report are based on the centerline of the member.
- * Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.