

Harnett County Department of Public Healt Pivision of Environmental Health


Improvement Permit

www.harnett.org

A	building permit cannot be issued with only an Improvement	Permit	ozntv.Government Comple
ISSUED TO: D. R. Horton Inc.	PROPERTY LOCATION: 52 Long N SUBDIVISION Lafayette Mea	adows Ln. (Baptist	Cornelius Hame 2 Boulevar
NEW REPAIR EXPANSION Type of Structure: 3-Bedroom 38'x36' SF	N Site Improvements rec	quired prior to Construction Authori	zation Issuillington, NC 2754
Proposed Wastewater System Type: 25% Reduct			ph: 910-893-754
Projected Daily Flow: 360 GPD	6		fax: 910-893-937
Number of bedrooms: 3 Number of Occup Basement Yes No	ants: Omax		
	red based on final location and elevations of facilities		
	Well Distance from well NA feet	Permit valid for:	☒ Five years☒ No expiration
Authorized State Agent::	Date: 11/03/	2021 SEE ATT	ACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guaran	ntees the issuance of other permits. The permit holder is responsible for ch hanges. The Improvement Permit shall not be affected by a change in own	ecking with appropriate governing bodies in	meeting their requirements. This
	Construction Authorization		
	(Required for Building Permit)	em 8 90 is company or wild	
The construction and installation requirements of Rules 1950, 1952, 1952, with the attached system layout.	954, 1955, 1956, 1957, 1958, and 1959 are incorporated by references	into this permit and shall be met. Systems	shall be installed in accordance
ISSUED TO: D. R. Horton Inc.		ong Meadow Ln. (Ba	
Facility Type: 3-Bedroom 38'x36' SFD		Meadows	LUI # Z
	tures? Yes No		
Type of Wastewater System** Pump to 25°		(Initial) Wastewater Flow:	360 GPD
(See note below, if applicable)	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	(milal) materials	
	5% Reduction Sys. (Repair)		
Installation Requirements/Conditions	Number of trenches 4		
Septic Tank Size 1000 gallons	Exact length of each trench 75feet	Trench Spacing: 9	Feet on Center
Pump Tank Size 1000 gallons	Trenches shall be installed on contour at a	Soil Cover: 6-12	inches
	Maximum Trench Depth of: 18-24 inches	(Maximum soil cover shall r	
	(Trench bottoms shall be level to +/-1/4"	36" above the trench bott	com)
	in all directions)		
Pump Requirements:ft. TDH vs	GPM	NA	inches below pipe
D	A	Aggregate Depth: NA	inches above pipe
Conditions: Proposal by Hal Owen &	Associates, Inc.	NA	A inches total
WATER LINES (INCLUDING IRRIGATION) MUST E NO UTILITIES ALLOWED IN INITIAL OR REPAIR D	BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR DRAIN FIELD AREA.	REPAIR AREA.	
**If applicable: 1 understand the system type specified	is different from the type specified on the application	n. I accept the specifications of	this permit.
Owner/Legal Representative Signature:		Date:	
	plat, or the intended use changes. The Construction Authorization shall not f the Laws and Rules for Sewage Treatment and Disposal and to the condit		ATTACHED SITE SKETCH
computation Authorization is subject to compliance with the provisions of			
Authorized State Agent:	Date:	11/03/2021	
1-2012 5	Construction Authorization Expiration [late 11103/2026	


Harnett County Department of Public Health Site Sketch

Property Location: 52 Long Meadow Ln	n. (Baptist Grove Rd SR 1427)		(111-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-
Issued To: D. R. Horton Inc.	Subdivision Lafayette Meadows		Lot # 2
Authorized State Agent:	ANDRES CORUN	Date: _	11/03/2021

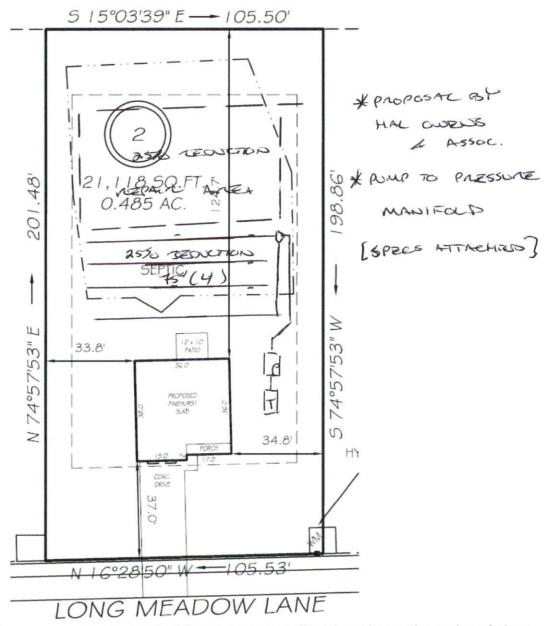

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.

Lot 2, Lafayette Meadows Subdivision

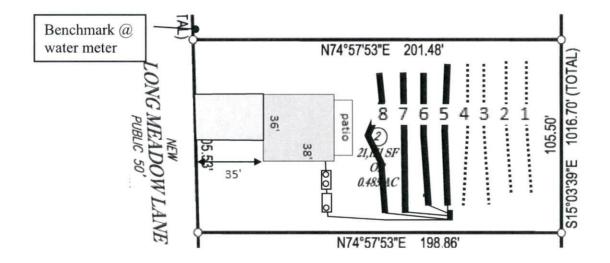

Design Flow (gal/day) = 360 Lines flagged at site on 9-ft centers.

Relative Elevation Drainline Line # Color North (ft) South (ft) Length(ft) 102.94 102.56 Y 75 2 В 102.44 102.90 75 3 W 102.83 102.3 75 4 R 102.64 102.27 75 5 Y 102.27 102.48 75 6 В 101.94 75 7 W 101.55 75 8 R 101.27 75 Benchmark 100.00 100.00



Scale 1 in = 50 ft

Distances are paced and approximate.
Not a survey.

This design represents our professional opinion but does not guarantee or represent permit approval by the Health Department.

3 bedroom home (360 gal/day)

Initial System

Pump to 4 X 75ft (pressure manifold distribution) Accepted Status System (25% reduction drainlines) installed on contour at 18-24 inch trench depth LTAR 0.3 gal/day/sqft

Repair System

Pump to 4 X 75ft (pressure manifold distribution) Accepted Status System (25% reduction drainlines) installed off contour at 18-24 inch trench depth LTAR 0.3 gal/day/sqft

Lafayette Meadows Lot 2

Pressure Manifold Design Criteria

Initial System

Line Color	Elevation	Drainline Length(ft)	Tap Size/ Schedule	Flow/tap (gpm)	gpd/ft	LTAR (gpd/sqft)
Υ	102.27	75	1/2"sch 40	7.11	1.200	0.400
В	101.94	75	1/2"sch 40	7.11	1.200	0.400
W	101.55	75	1/2"sch 40	7.11	1.200	0.400
R	102.48	75	1/2"sch 40	7.11	1.200	0.400
	Y B W R	Y 102.27 B 101.94 W 101.55 R 102.48	Y 102.27 75 B 101.94 75 W 101.55 75	Y 102.27 75 1/2"sch 40 B 101.94 75 1/2"sch 40 W 101.55 75 1/2"sch 40 R 102.48 75 1/2"sch 40	Y 102.27 75 1/2"sch 40 7.11 B 101.94 75 1/2"sch 40 7.11 W 101.55 75 1/2"sch 40 7.11 R 102.48 75 1/2"sch 40 7.11	Y 102.27 75 1/2"sch 40 7.11 1.200 B 101.94 75 1/2"sch 40 7.11 1.200 W 101.55 75 1/2"sch 40 7.11 1.200 R 102.48 75 1/2"sch 40 7.11 1.200

Pressure		otal Dialillic-	Total Flow-	20.44		
Head (ft)=	2	Target LTAR* (gpd/sf)=	4	LTAR + 5% _	4.20	_
Daily Flow=_	360	Total Flow (gpm)=	28.44	Daily PRT(min)=_	12.66	_
Dose Vol=	146.93	_gallons w/ Pipe Vol @%	75	Dose PRT (min)=_	5.17	

Repair System

Line Number	Line Color	Elevation	Drainline Length(ft)	Tap Size/ Schedule	Flow/tap (gpm)	gpd/ft	LTAR (gpd/sqft)
1	Υ	102.56	75	1/2"sch 40	7.11	1.200	0.400
2	В	102.90	75	1/2"sch 40	7.11	1.200	0.400
3	W	102.30	75	1/2"sch 40	7.11	1.200	0.400
4	R	102.27	75	1/2"sch 40	7.11	1.200	0.400

		Total Drainline=	300	Total Flow=	28.44		
Pressure Head (ft)=	2	Target LTAR	* (gpd/sf)=	4		LTAR + 5% _	4.20
Daily Flow=_	360	Total FI	ow (gpm)=	28.44	Dail	y PRT(min)=_	12.66
Dose Vol=	146.93	gallons w/ Pipe	Vol @%	75	Dose	PRT (min)=	5.17

^{*} Target LTAR: Convert LTAR for accepted system drainlines by dividing soil LTAR by 75%