

# Harnett County Department of Public Health

PERMIT # SFD 2110-0075

## Operation Permit

S 1427

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 52 LAFAYETTE MEADOW L.D. (GRIFFIN C.W. RD.)

Name: (owner) D.L. HORTON INC.      SUBDIVISION LAFAYETTE MEADOW      LOT # 2

System Installer: JASON MATTHEWS

Basement with plumbing:     Garage     Number of Bedrooms 3


Type of Water Supply:  Community    Public    Well    Distance from well N/A feet

System Type: 25% REDUCTION SYSTEM III B    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

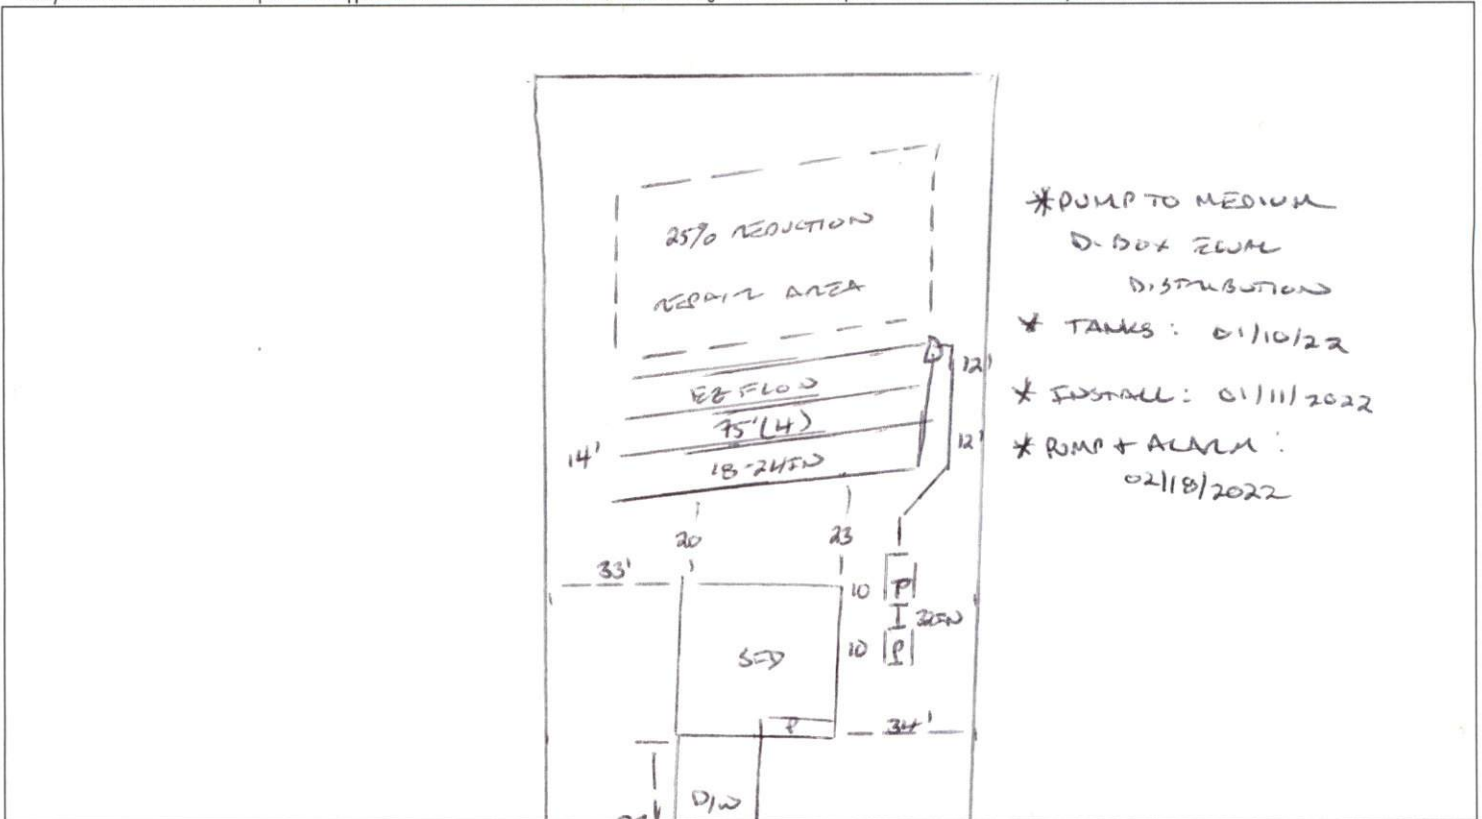

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: LAFAYETTE MEADOW L.D.  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box     Pump     Alarm     H2O Line     PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other E2 FLOW III B    Septic Tank: 1000 gallons    Pump Tank: 1600 gallons  
Subsurface      No. of      exact length      width of      depth of  
Drainage Field    ditches 4      of each ditch 75 feet      ditches 3 feet      ditches 18-24 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 02/18/2022