

Harnett County Department of Public Health

PERMIT # SD2110-0113

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 649 FRED BURNS RD. (SR 1451)

Name: (owner) CHRISTIAN KYLE PENDERHART SUBDIVISION _____ LOT # 1

System Installer: GENES BAEHNER

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well N/A feet

System Type: 25% REDUCTION S.S. IITG Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

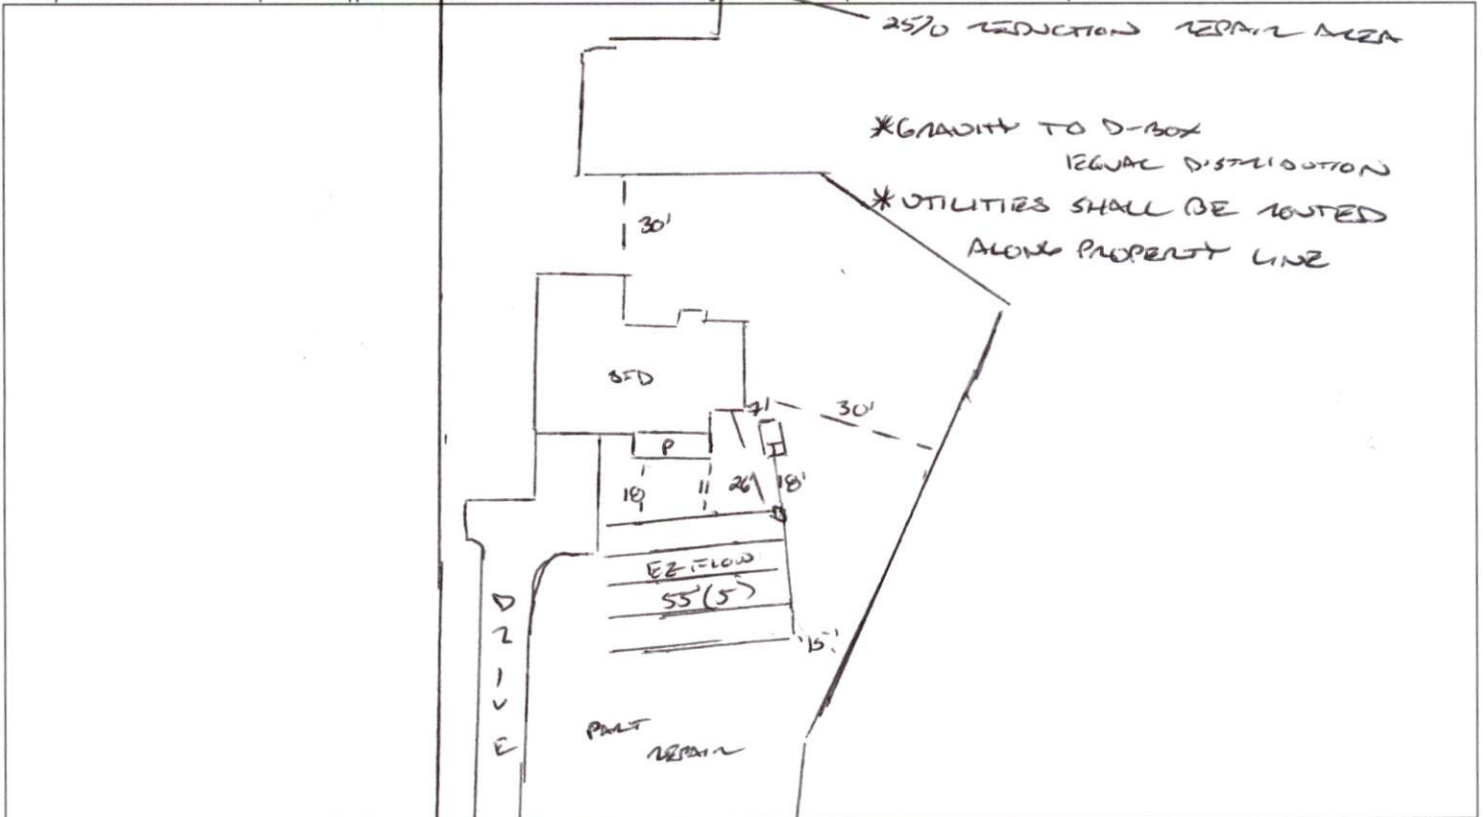

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961. FRED BURNS RD (SR 1451)
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other E2-FLOW IITG Septic Tank: 1000 gallons Pump Tank: _____ gallons
Subsurface No. of 5 exact length _____ width of _____ depth of _____
Drainage Field ditches _____ of each ditch 55 feet ditches 3 feet ditches 20 inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 09/14/2022