

Harnett County Department of Public Health

Operation Permit

PERMIT # SD 2111-0005

321436

New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion

PROPERTY LOCATION: 174 WALKER GROVE LN. (BATHING RD.)

Name: (owner) TRUE HOMES LLC SUBDIVISION WALKER GROVE LOT # 11

System Installer: BRANTLEY & SONS

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 2 1/2" REDUCTION S3-III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

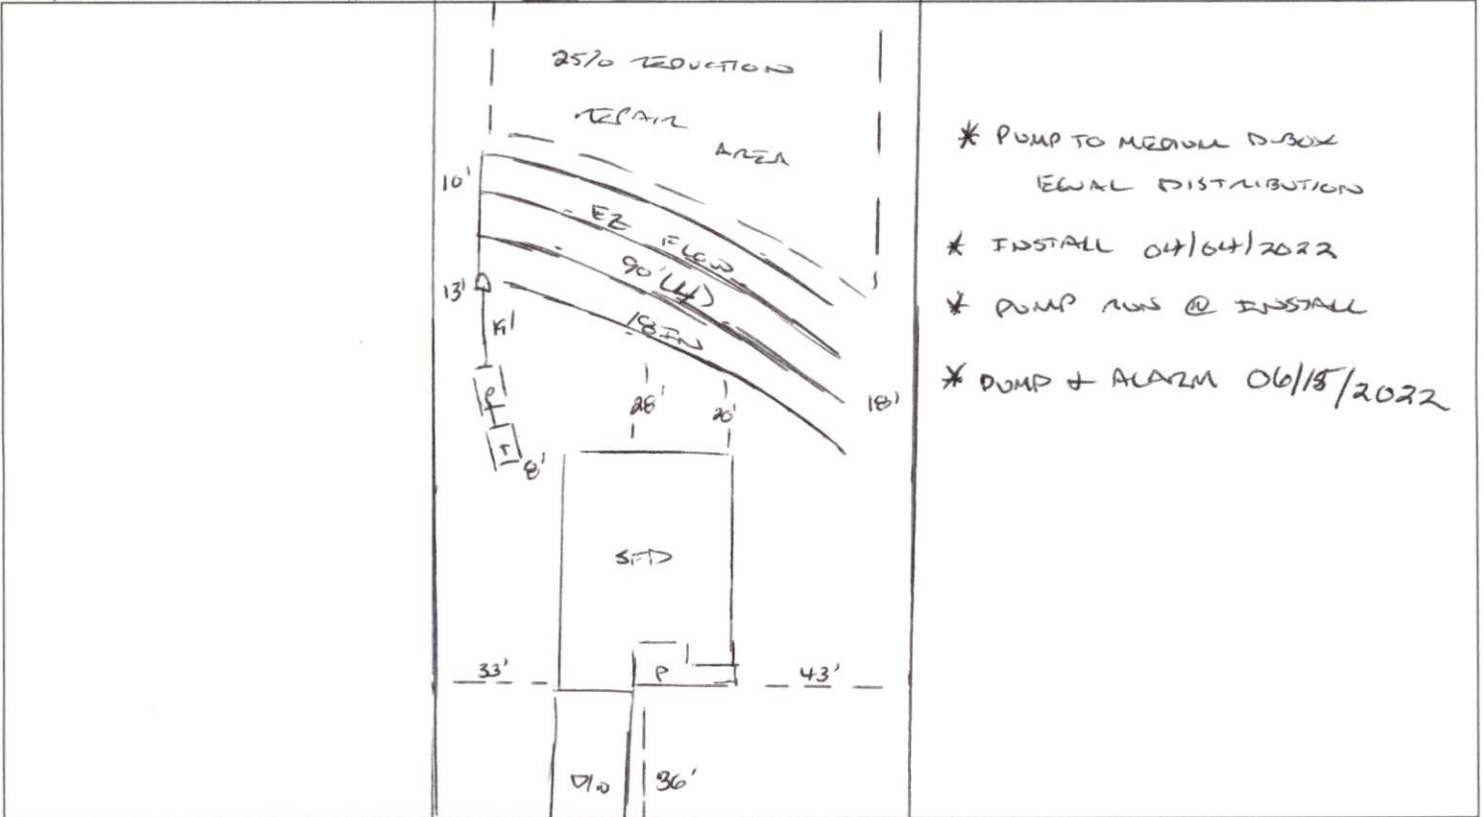

- * PUMP TO MEDIAN D-BOX
EUAL DISTRIBUTION
- * INSTALL 04/04/2022
- * PUMP RUN @ INSTALL
- * DUMP + ALARM 06/15/2022

PERMIT CONDITIONS:

- I. Performance: 2 System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EB FLOW III B Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 4 of each ditch 90 feet ditches 3 feet ditches 18 inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 06/15/2022