

FLOOR PLAN NOTES:

1. ALL STRUCTURAL INFORMATION SHOWN FOR REFERENCE PURPOSES ONLY. CONTRACTOR SHALL HAVE LICENSED STRUCTURAL ENGINEER REVIEW AND DESIGN ALL STRUCTURAL ELEMENTS SUCH AS ALL FRAMING WALLS, BEAMS, CONNECTIONS, HEADERS, JOISTS AND RAFTERS.
2. ALL DIMENSIONS ARE FROM FACE OF STUD TO FACE OF STUD UNLESS NOTED OTHERWISE.
3. WINDOW SIZES INDICATED ON PLANS ARE NOTED BY APPROXIMATE ROUGH OPENING SIZE. REFER TO PLANS AND EXTERIOR ELEVATIONS FOR WINDOW TYPES.
4. COORDINATE LOCATION OF UTILITY METERS WITH SITE PLAN AND LOCATE AWAY FROM PUBLIC VIEW. VISUAL IMPACT SHALL BE MINIMIZED, I.E. MOUNT AS LOW AS POSSIBLE.
5. PREFABRICATED FIREPLACE CONSTRUCTION SHALL MEET OR EXCEED ALL APPLICABLE CODES REGARDING USE OF FIRE SEPARATIONS, CLEARANCES, ETC. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT ALL ITEMS AND CONSTRUCTION MEET OR EXCEED CODE OVERALL FLUE HEIGHT SHALL BE COORDINATED TO MATCH HEIGHT SHOWN ON PLANS AND SHALL NOT EXCEED THE TOP OF CHIMNEY CHASE AS CONSTRUCTED.
6. CONTRACTOR SHALL COORDINATE ALL CLOSET SHELVING REQUIREMENTS.
7. DO NOT SCALE DRAWINGS, FOLLOW DIMENSIONS ONLY.
8. CONTRACTOR SHALL FIELD VERIFY ALL CABINET DIMENSIONS BEFORE FABRICATION.
9. BEDROOM WINDOWS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5-7 SQ.FT., A MINIMUM NET CLEAR OPENABLE WIDTH OF 20". A MINIMUM NET CLEAR OPENABLE HEIGHT OF 24" AND HAVE A MAXIMUM FINISH SILL HEIGHT OF 43" FROM FINISH FLOOR.
10. ALL GLASS LOCATED WITHIN 18" OF FLOOR, 12" OF A DOOR OR LOCATED WITHIN 60" OF FLOOR AT BATHUBS; WHIRLPOOLS, SHOWERS, SAUNAS, STEAM ROOMS OR HOT TUBS SHALL BE TEMPERED.
11. ALL EXPOSED INSULATION SHALL HAVE A FLAME SPREAD RATING OF LESS THAN 25 AND A SMOKE DENSITY RATING OF LESS THAN 450.
12. PROVIDE COMBUSTION AIR VENTS, WITH SCREEN AND BACK DAMPER, FOR FIREPLACES, WOOD STOVES AND ANY APPLIANCE WITH AN OPEN FLAME.
13. BATHROOMS AND UTILITY ROOMS SHALL BE VENTED TO THE OUTSIDE WITH A MINIMUM OF A 90 CFM FAN. RANGE HOODS SHALL ALSO BE VENTED TO OUTSIDE.
14. ATTIC HVAC UNITS SHALL BE LOCATED WITHIN 20" OF ITS SERVICE OPENING. RETURN AIR GRILLES SHALL NOT BE LOCATED WITHIN 10 FEET OF A GAS FIRED APPLIANCE.
15. ALL WALLS AND CEILINGS IN GARAGE AND GARAGE STORAGE AREAS TO HAVE 5/8" TYPE-X GYP. BOARD W/ 1-HOUR FIRE RATING. ALL EXT. DOORS IN GARAGE TO BE METAL OR SOLID CORE DOORS INCLUDING DOORS ENTERING HEAT/COOLED PORTION OF RESIDENCE.
16. ALL FIREPLACE CHASE WALLS SHALL BE INSULATED INSIDE AND OUTSIDE. PROVIDE HORIZONTAL "DRAFT STOPS" AT EACH FLOOR LEVEL BY PACKING 6" (R-19) INSULATION BETWEEN 2X4 JOISTS.
17. ALL INTERIOR WALLS SHALL BE COVERED WITH 1/2" GYPSUM BOARD, WITH METAL CORNER REINFORCING, TAPE, FLOAT AND SAND. (3 COATS) USE 5/8" GYPSUM BOARD ON CEILINGS WHEN SUPPORTING MEMBERS ARE 24" O.C. OR GREATER. USE 1/2" GYPSUM BOARD ON CEILING MEMBERS LESS THAN 24" O.C.
18. ALL BATH AND TOILET AREA WALLS AND CEILINGS SHALL HAVE WATER RESISTANT GYPSUM BOARD.

FLOOR PLAN SPECIFICATIONS


HEAT/COOLED: 2,888 SQ. FT.
 GARAGE, STORAGE: 1,092 SQ. FT.
 PORCHES: 1,064 SQ. FT.
 TOTAL: 5,044 SQ. FT.

- NOTE:**
- 1- ALL CEILINGS TO BE 10' UNLESS NOTED.
 - 2- BUILDER TO APPROVE & VERIFY ALL PLANS BEFORE CONSTRUCTION.
 - 3- VERIFY ALL PLANS W/ LOCAL BUILDING CODES.
 - 4- HVAC & W.H. TO BE IN ATTIC UNLESS OTHERWISE NOTED.
 - 5- PROVIDE SHUT-OFF VALVE FOR ALL GAS APPLIANCES. REFERENCE IRC SECTION G2419.
 - 6- ALL GLASS LOCATED WITHIN 18" OF FLOOR, 24" OF A DOOR OR LOCATED WITHIN 60" OF FLOOR AT BATHUBS, WHIRLPOOLS, SHOWERS, SAUNAS, STEAM ROOMS OR HOT TUBS SHALL BE TEMPERED TO COMPLY WITH IRC SECTION R308.4.8
 - 7- NARROW WALL SHEARWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH 2006 IRC SECTION R602.10 BRACED WALL LINES. SAID SHEARWALLS MAY ALSO BE CONSTRUCTED USING SIMPSON STRONG TIE PRODUCTS. REFER TO SIMPSON STRONG TIE FOR "STRONGWALL" APPLICATIONS. THIS MAY BE REQUIRED TO MEET ANY CODE REQUIREMENTS FOR NARROW WALLS NEXT TO GARAGE DOORS. CORRECT PRODUCT SELECTION IS SENSITIVE TO BOTH SEISMIC AND WIND ZONE PARAMETERS AND SHOULD BE VERIFIED LOCALLY PRIOR TO CONSTRUCTION. ALSO DUE TO THE NATURE OF THE SIMPSON INSTALLATION PROCESS, THE DECISION TO USE THE "STRONG-WALL" SYSTEM SHALL BE MADE PRIOR TO FOUNDATION CONCRETE PLACEMENT. SINCE THESE PLANS ARE NOT SITE OR LOCATION SPECIFIC THE MECHANICS TO MEET CODE REQUIREMENTS SHALL BE VERIFIED BY QUALIFIED PERSONS! AT THE LOCAL LEVEL PRIOR TO CONSTRUCTION.
 - 8- ALL EXTERIOR WALLS TO BE 2X6 STUDS @ 16" O.C. UNLESS NOTED

© 2022 NELSON DESIGN GROUP, LLC.

Reproduction of these plans, in any form, without the written consent of the Designer, is prohibited.


MAIN FLOOR PLAN / NOTES
 W/ 2X6 EXT. WALLS
The Gallaher Home

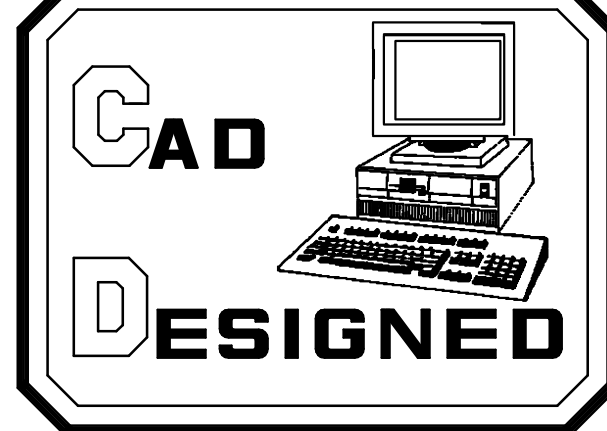

NOTICE OF COPYRIGHT
 NELSON DESIGN GROUP, LLC. or Michael E. Nelson assumes no liability for any HOME constructed from this plan. Release of these plans constitutes an agreement between the contractor and the designer. The contractor shall be responsible for obtaining all necessary permits and ensuring that the construction complies with all applicable codes and regulations. Any ambiguity or discrepancy in the plans shall be resolved by the contractor. The contractor shall retain the responsibility for any errors or omissions in the construction. The designer shall not be held responsible for any errors or omissions in the construction. For all dimensions and conditions on the plan, this office shall be notified of any variations from the dimensions and conditions shown. These drawings shall be submitted to this office for approval before proceeding with construction.

REVISIONS	BY

Nelson Design Group, LLC
 RESIDENTIAL PLANNERS - DESIGNERS
 NATIONALLY PUBLISHED
 Member AIBD • CPBD
 508 STADIUM BLVD
 SUITE E 104
 CHARLOTTE, NC 28217
 704.352.7777
 http://www.nelsondesigngroup.com

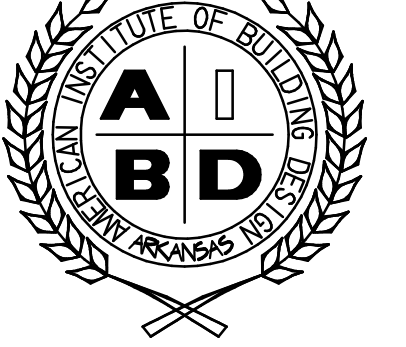

MICHAEL E. NELSON
 P.B.D. Cert. No. AR-104

DATE	1-13-2022
SCALE	1/4" = 1'-0"
BUILDER	
JOB	MENC245-21
DRAWN BY	SMN
1 OF 6	