
VENTILATION NOTES: CRAWL SPACE AREA: <u>844</u> S.F. 1500 S.F. PER I S.F. VENTS = 0.6 S.F. REQUIRED VENTS W V.B. + ONE VENT WITHIN 3' OF EA. CORNER= 2 VENT

FOUNDATION PLAN NOTES:


DOUBLE JOISTS UNDER ALL PARTITIONS


2. SILL TO BE P.T. WOOD 2x6

- 3. MAINTAIN MIN 12" BELOW GIRDERS # 18" BELOW JOISTS TO GRADE OR AS REQUIRED FOR MECHANICAL EQUIPMENT
- 4. PROVIDE VAPOR BARRIER AT CRAWL SPACE 5. FOUNDATION VENTS TO BE 8"HT.xI6"WD. W 50 SQ. IN. MIN. FREE VENT AREA
- 6. CRAWL SPACE ACCESS TO BE 22"x36" MIN CLEAR OPENING (FIELD-LOCATE) I. GIRDERS TO BE FLUSH FRAMED (SIZE AS
- 8. ANCHOR BOLTS @ 6'-O" O.C. AND I'-O" FROM EACH CORNER (EMBED 8" MIN. IN SOLID GROUT) 9. GC TO REVIEW TRUSS SHOP DRAWINGS & NOTIFY DESIGNER IF REQUIRED POINT LOAD
- PIERS OR BEARING WALLS ARE ADDED TO FOUNDATION PLAN IO. FRAMING SPANS BASED ON #2 SPF

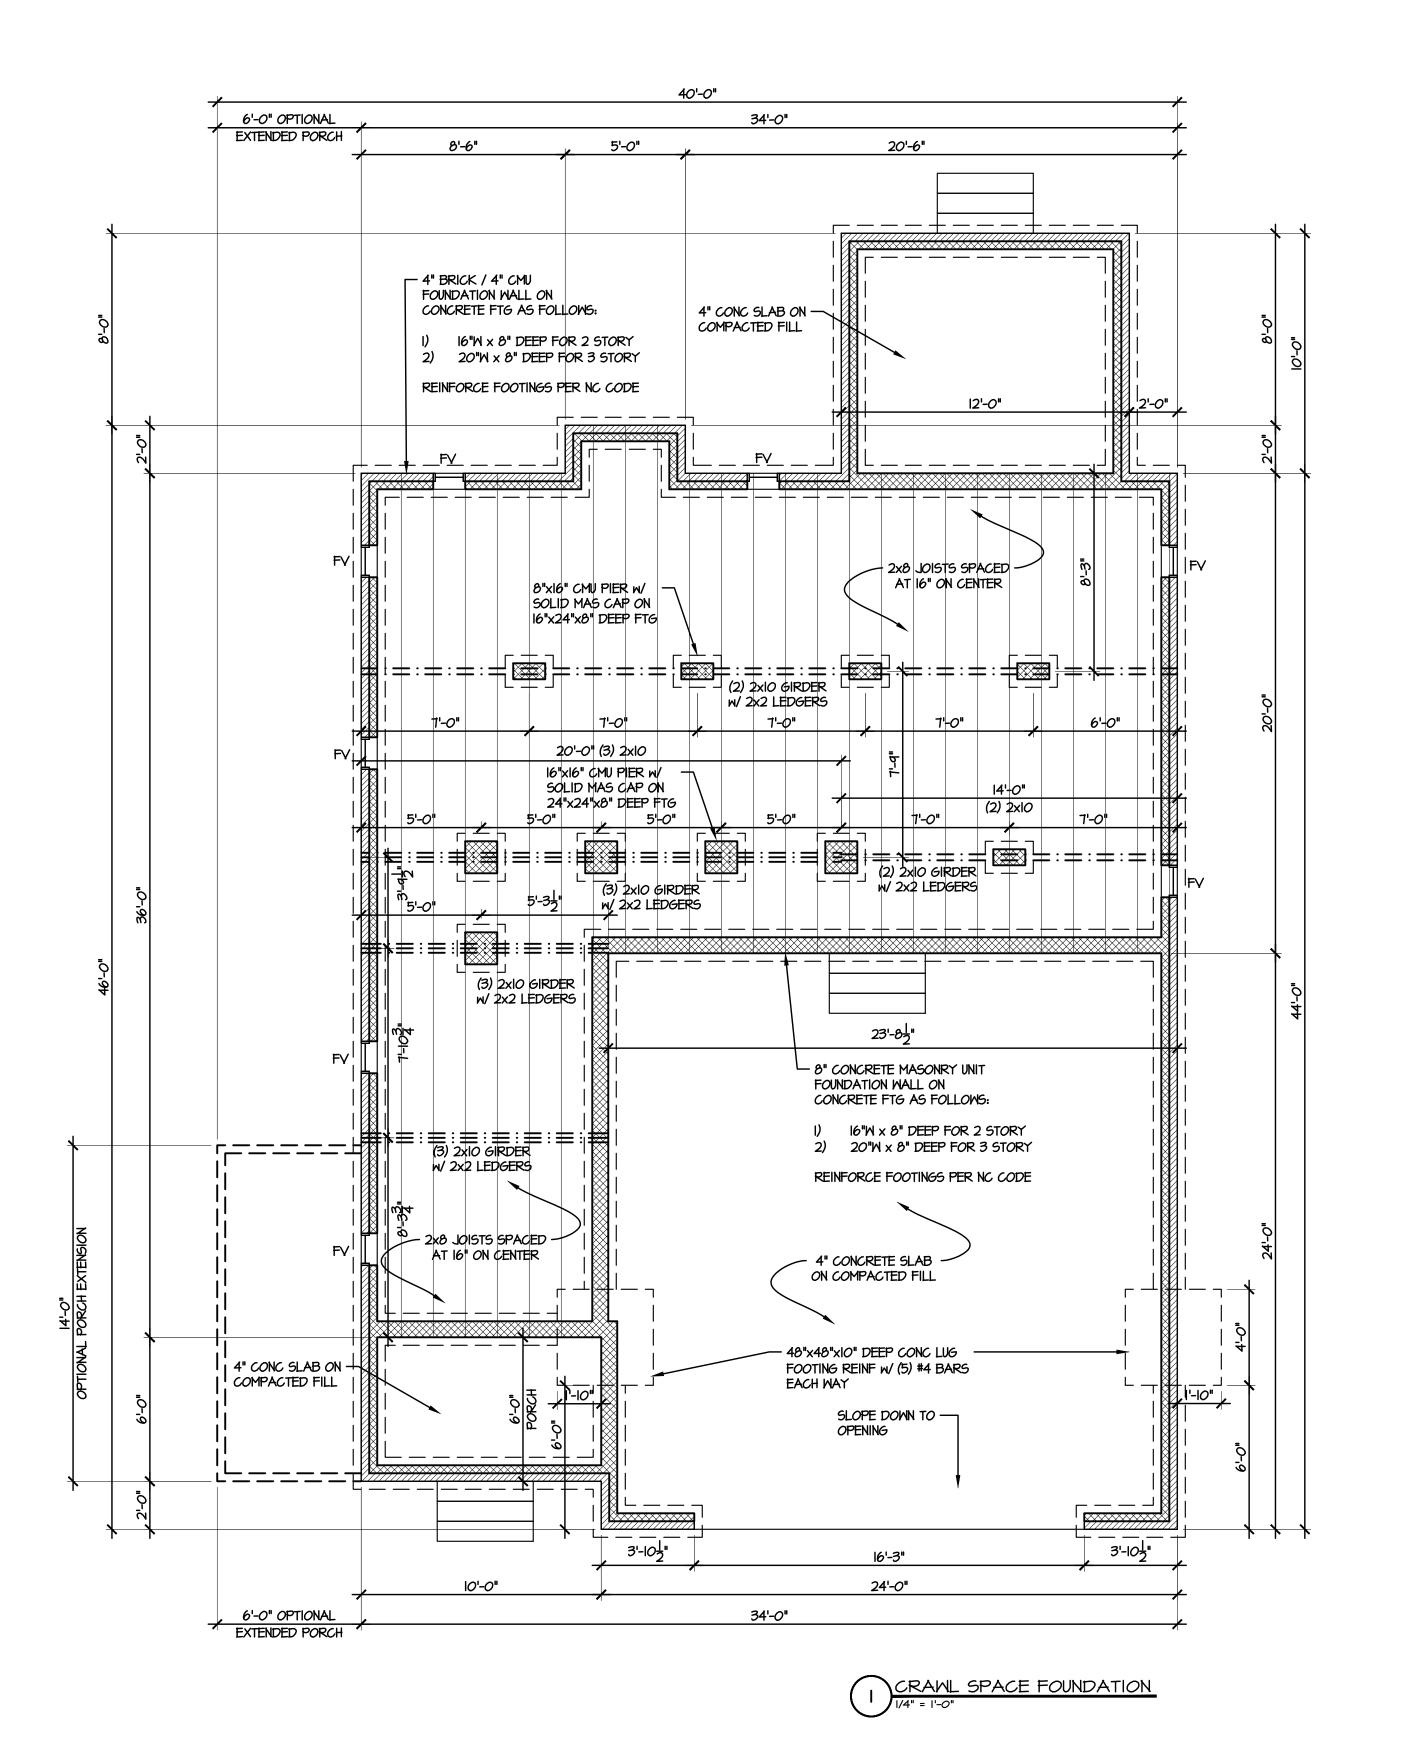








FORTIFIED-WISE™ PROFESSIONAL



S (1) Vind

CL 2136 237L

MAY 2018

REVISION DATE:

7-30-18 CRAWL SPACE FDN

SHEET NO: