

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0322-1082
Lot 37 Oak Haven

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I50504794 thru I50504813

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



March 2, 2022

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504799
J0322-1082	B1-GE	GABLE	1	1	Job Reference (optional)	


Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:00 2022 Page 1

ID:2W3hk9latme7Qcxb7tDGi8zptHE-NygUWUWMBByf3dDW0_DnUJvvuPg8tk7UJGwRLd1zfK8n




Scale = 1:88.8

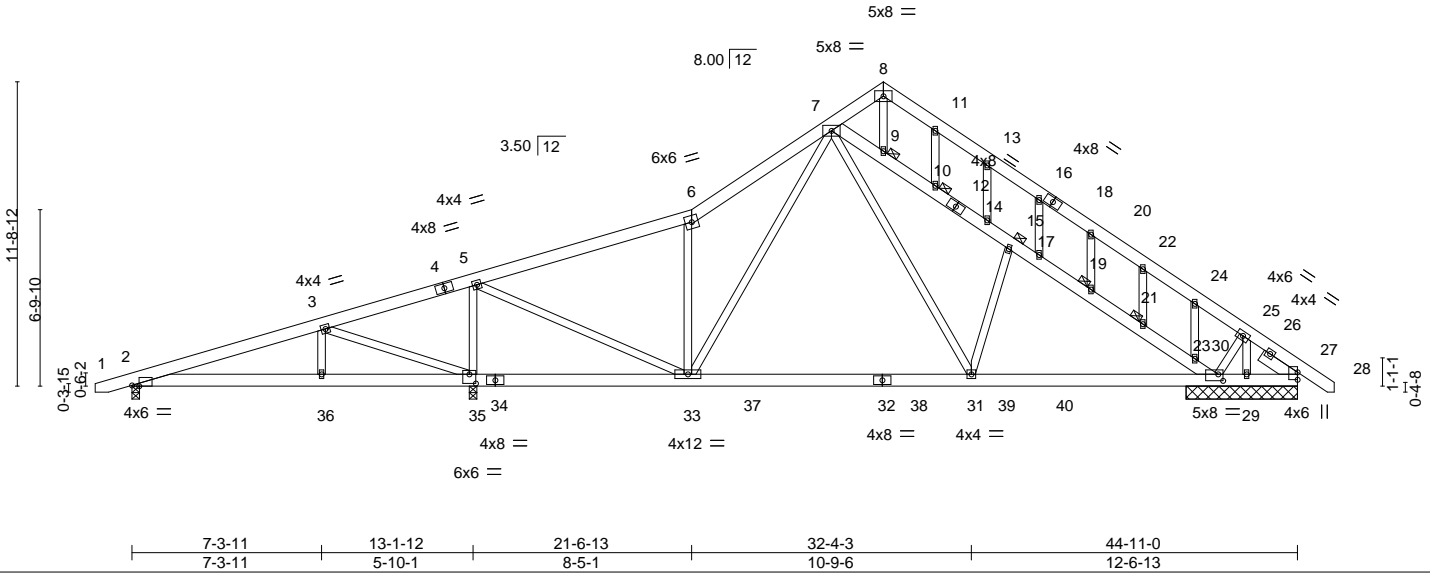

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504800
J0322-1082	B2	COMMON	4	1		

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:01 2022 Page 1
 ID:2W3hk9latme7Qcxb7tDGi8zptHE-r8EtjqX?yGnwFN5DYwljs6S4C4UuTcPzvaAvAUzfK8m

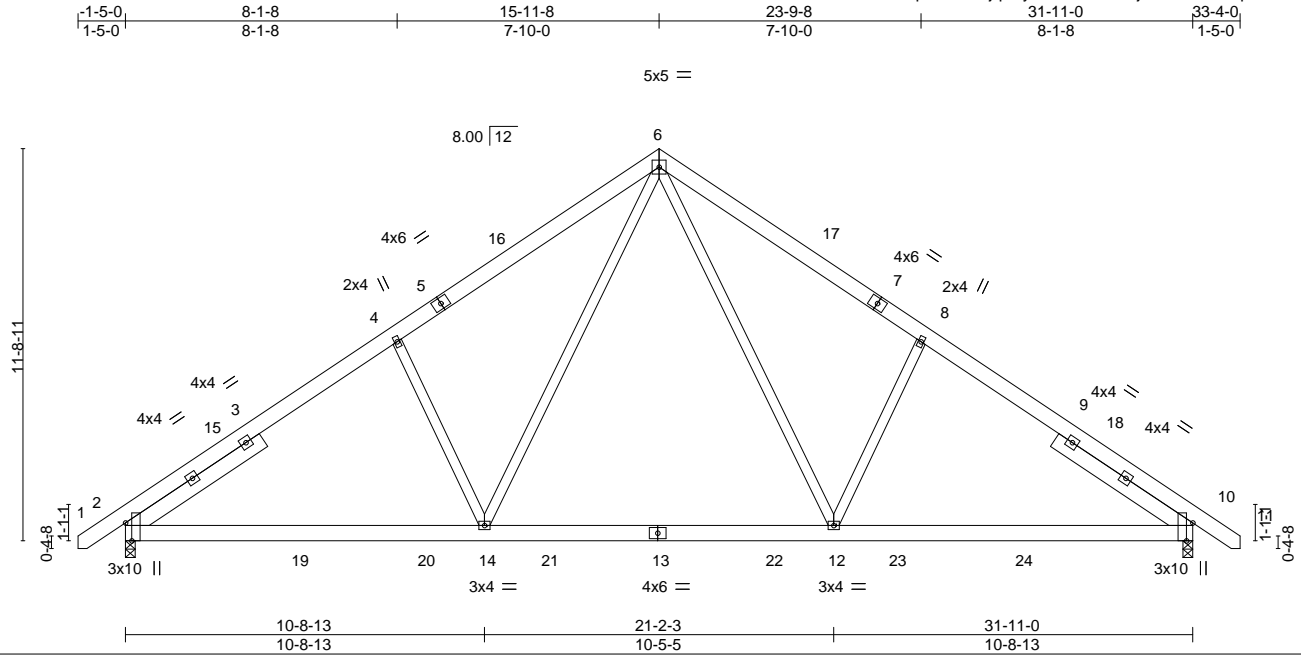

Scale = 1:68.9

Plate Offsets (X,Y)-- [2:0-6-7,Edge], [10:0-6-7,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.25	Vert(LL) -0.15	12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.53	Vert(CT) -0.21	12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.43	Horz(CT) 0.04	10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.03	14	>999	240		
							Weight: 249 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2
 SLIDER Left 2x6 SP No.1 4-10-4, Right 2x6 SP No.1 4-10-4

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
 Max Horz 2=-276(LC 10)
 Max Uplift 2=-84(LC 12), 10=-84(LC 13)
 Max Grav 2=1578(LC 19), 10=1578(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2051/369, 4-6=-1904/468, 6-8=-1904/468, 8-10=-2051/369
 BOT CHORD 2-14=-142/1764, 12-14=0/1195, 10-12=-149/1586
 WEBS 6-12=-163/958, 8-12=-477/306, 6-14=-163/957, 4-14=-477/306

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-3-7 to 3-1-6, Interior(1) 3-1-6 to 15-11-8, Exterior(2) 15-11-8 to 20-4-5, Interior(1) 20-4-5 to 33-2-7 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 2 and 84 lb uplift at joint 10.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504801
J0322-1082	B2-GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:02 2022 Page 1
 ID:2W3hk9latme7Qcxb71DGi8zptHE-JKoFxAxdiavnsXgP6epyPK?ISUyxC7dj8EwSiwzfK8I

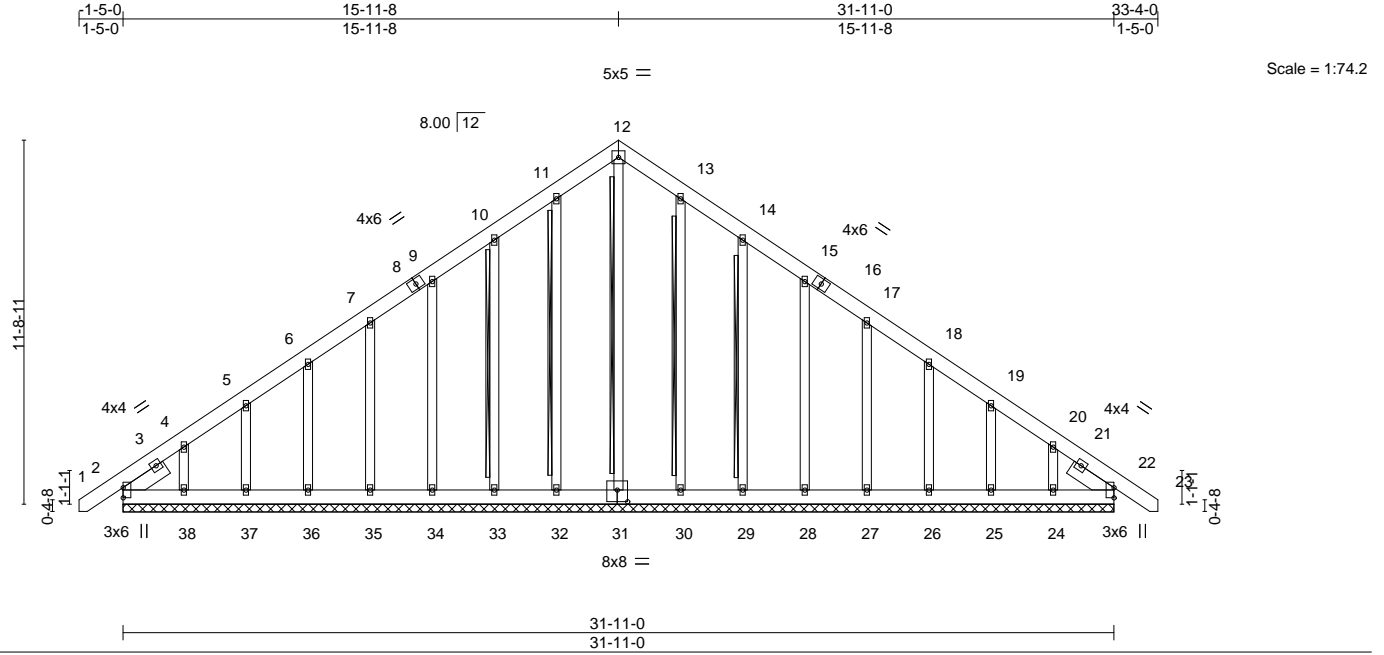


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [22:Edge,0-0-0], [31:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.05	Vert(LL) -0.00	22	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00	23	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.14	Horz(CT) 0.01	22	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 310 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	T-Brace: 2x4 SPF No.2 - 12-31, 11-32, 10-33, 13-30, 14-29
SLIDER Left 2x6 SP No.1 1-6-14, Right 2x6 SP No.1 1-6-14	Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. All bearings 31-11-0.
 (lb) - Max Horz 2=345(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 32, 33, 34, 35, 36, 37, 30, 28, 27, 26, 25, 22 except 2=129(LC 8), 38=191(LC 12), 29=103(LC 13), 24=168(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 31, 32, 33, 34, 35, 36, 37, 38, 30, 29, 28, 27, 26, 25, 24, 22 except 2=276(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-382/275, 4-5=-250/215, 10-11=-230/267, 11-12=-263/293, 12-13=-262/292, 20-22=-297/191
 BOT CHORD 2-38=-171/272, 37-38=-171/272, 36-37=-171/272, 35-36=-171/272, 34-35=-171/272, 33-34=-171/272, 32-33=-171/272, 31-32=-171/272, 30-31=-172/273, 29-30=-172/273, 28-29=-172/273, 27-28=-172/273, 26-27=-172/273, 25-26=-172/273, 24-25=-172/273, 22-24=-172/273

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 32, 33, 34, 35, 36, 37, 30, 28, 27, 26, 25, 22 except (jt=lb) 2=129, 38=191, 29=103, 24=168.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504802
J0322-1082	C1	ROOF SPECIAL	3	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:03 2022 Page 1

ID:2W3hk9latme7Qcxb7IDGi8zptHE-nXMd8WYFT1eUhfBfLLBxXXPhI9dxUisMuf?EMzfK8k



Scale = 1:78.1

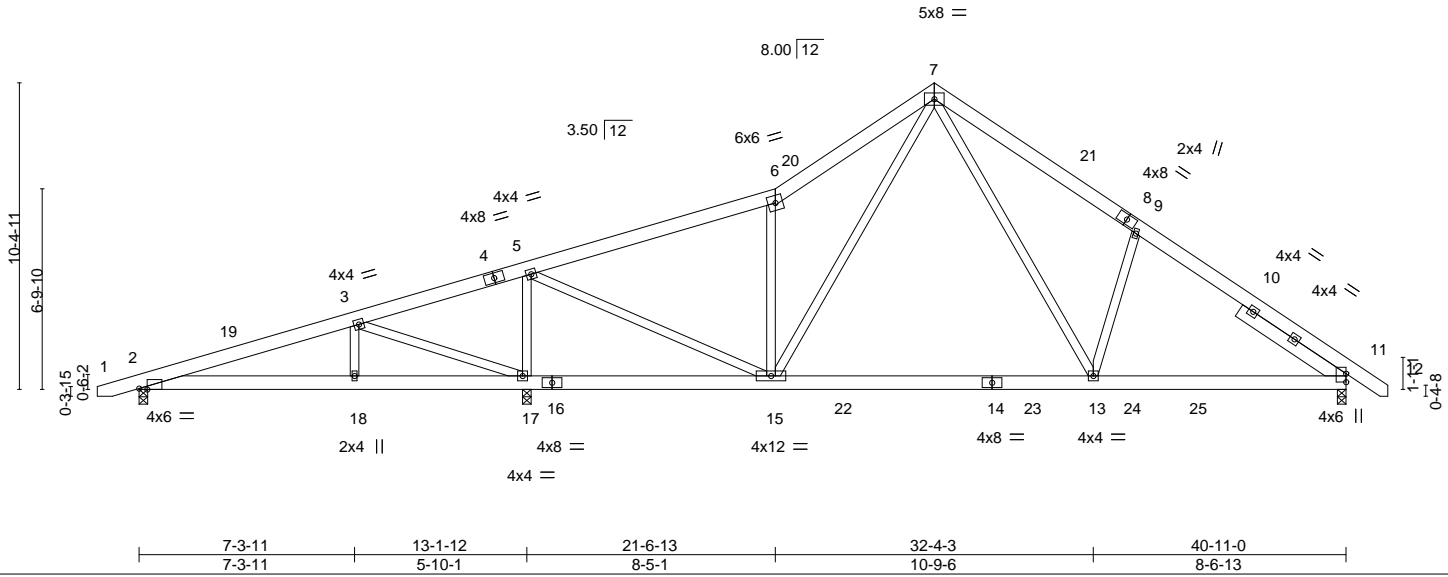


Plate Offsets (X,Y)--	[2:0-3-5,Edge]
-----------------------	----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.32	Vert(LL) -0.22	13-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.51	Vert(CT) -0.32	13-15	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.53	Horz(CT) 0.02	11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.04	2-18	>999	240		
							Weight: 299 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2
 SLIDER Right 2x6 SP No.1 4-3-0

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 15-17.

REACTIONS. (size) 2=0-3-8, 17=0-3-8, 11=0-3-8
 Max Horz 2=250(LC 11)
 Max Uplift 2=-213(LC 8), 17=-247(LC 8), 11=-84(LC 13)
 Max Grav 2=440(LC 23), 17=1873(LC 1), 11=1279(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-415/355, 3-5=-238/527, 5-6=-1171/144, 6-7=-1334/303, 7-9=-1582/374, 9-11=-1667/244
 BOT CHORD 2-18=-262/341, 17-18=-262/341, 15-17=-444/350, 13-15=0/813, 11-13=-62/1242
 WEBS 3-18=-226/267, 3-17=-809/653, 5-17=-1473/416, 5-15=-281/1543, 6-15=-699/298, 7-13=-178/910, 9-13=-428/289, 7-15=-89/476

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-1-15 to 3-2-14, Interior(1) 3-2-14 to 26-11-8, Exterior(2) 26-11-8 to 31-4-5, Interior(1) 31-4-5 to 42-2-7 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCCL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11 except (jt=lb) 2=213, 17=247.

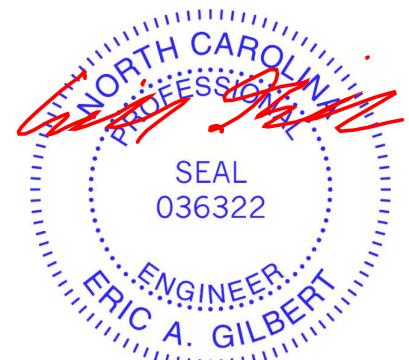


March 2, 2022

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven
J0322-1082	D1	ATTIC	5	1	150504803

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:04 2022 Page 1

ID:2W3hk9latme7Qcxb7tDGi8zptHE-Fjw?LsZtEB9V6rpoD3sQUi4R1HRGgze0bYPZmpzfK8j



4x6 =

Scale = 1:72.0

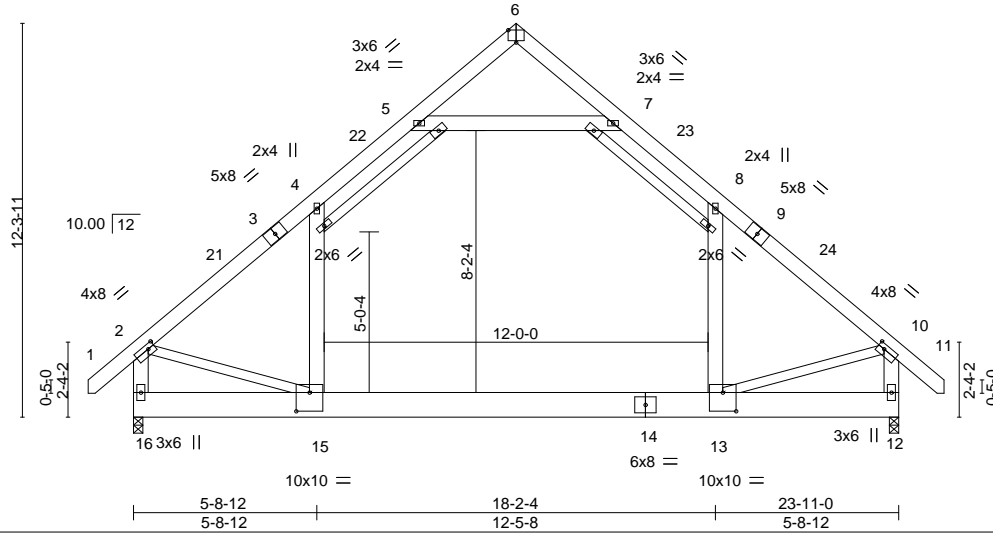


Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [6:0-3-0,Edge], [10:0-2-8,0-1-12], [13:0-5-0,0-7-0], [15:0-5-0,0-7-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.85	Vert(LL)	-0.27 13-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.81	Vert(CT)	-0.45 13-15	>620	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.43	Horz(CT)	0.01 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL)	0.08 13-15	>999	240		
							Weight: 256 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
17-18,19-20: 2x4 SP No.2
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
2-15,10-13: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-11-2 oc bracing.

REACTIONS.


(size) 16=0-3-8, 12=0-3-8
Max Horz 16=330(LC 11)
Max Grav 16=1617(LC 20), 12=1617(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1751/0, 4-5=-1171/137, 5-6=-58/279, 6-7=-58/279, 7-8=-1171/137, 8-10=-1751/0,
2-16=-1699/62, 10-12=-1700/63
BOT CHORD 15-16=-282/506, 13-15=0/1215, 12-13=-40/311
WEBS 5-7=-1397/118, 4-15=0/678, 8-13=0/678, 2-15=0/1045, 10-13=0/1048

NOTES-

- Unbalanced roof live loads HAVING been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-3-11 to 3-1-2, Interior(1) 3-1-2 to 11-11-8, Exterior(2) 11-11-8 to 16-4-5, Interior(1) 16-4-5 to 25-2-11 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).4-15, 8-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Attic room checked for L/360 deflection.

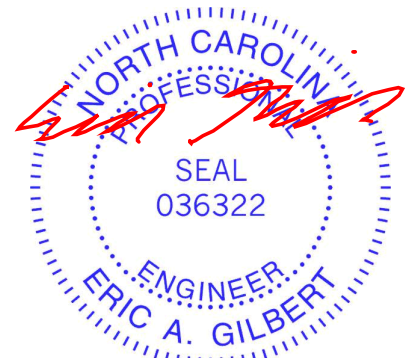

March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504804
J0322-1082	D1-GE	ATTIC	2	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:06 2022 Page 1

ID:2W3hk9latme7Qcxb7tDGi8zptHE-C52mmYa7moQDL8zALUuuZA9nW57k8wDI3sugrhzfk8h



Scale = 1:71.0

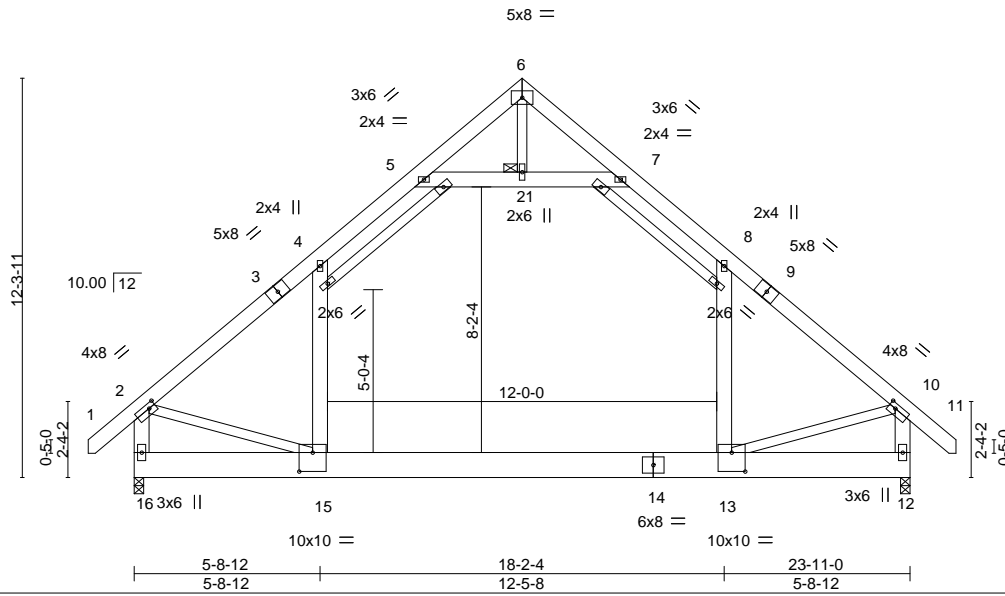


Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [10:0-2-8,0-1-12], [13:0-5-0,0-7-0], [15:0-5-0,0-7-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.85	Vert(LL) -0.27	13-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.81	Vert(CT) -0.45	13-15	>620	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.23	Horz(CT) 0.01	12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.11	13-15	>999	240	Weight: 260 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
17-18,19-20: 2x4 SP No.2
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
2-15,10-13,6-21: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-11-2 oc bracing.
JOINTS 1 Brace at Jt(s): 21

REACTIONS.


(size) 16=0-3-8, 12=0-3-8
Max Horz 16=-412(LC 10)
Max Grav 16=1613(LC 20), 12=1613(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1766/12, 4-5=-1173/184, 7-8=-1172/184, 8-10=-1766/12, 2-16=-1707/97,
10-12=-1707/97
BOT CHORD 15-16=-374/571, 13-15=0/1244, 12-13=-91/311
WEBS 5-21=-1330/231, 7-21=-1330/231, 4-15=-18/678, 8-13=-17/678, 2-15=0/1081,
10-13=0/1086

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-21, 7-21; Wall dead load (5.0psf) on member(s).4-15, 8-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Attic room checked for L/360 deflection.

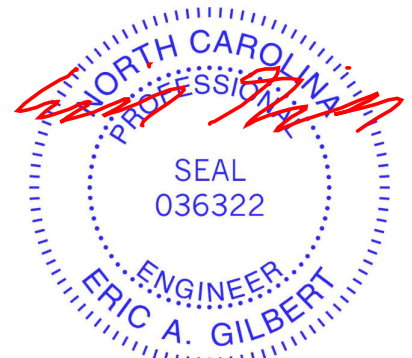

March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven
J0322-1082	D2	ATTIC	13	1	150504805

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:06 2022 Page 1

ID:2W3hk9latme7Qcxb7tDGt8zptHE-C52mmYa7moQDL8zALUuuZA9nQ57g8t5l3sugrhzfK8h



4x6 =

Scale = 1:71.0

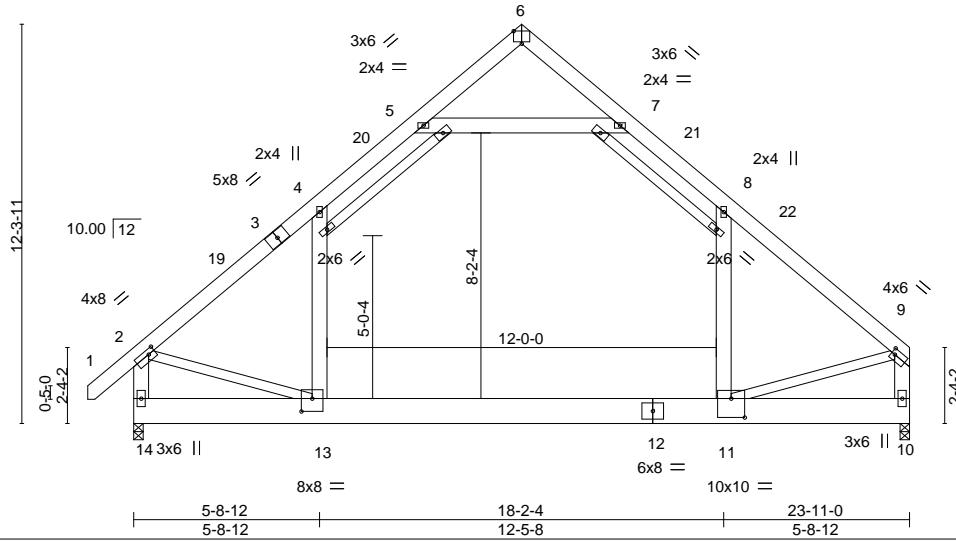


Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [6:0-3-0,Edge], [9:0-1-4,0-2-0], [11:0-5-0,0-7-0], [13:0-4-0,0-4-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.86	Vert(LL) -0.27	11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.81	Vert(CT) -0.46	11-13	>613	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.43	Horz(CT) 0.01	10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.08	11-13	>999	240		
							Weight: 252 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
15-16,17-18: 2x4 SP No.2
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
2-13,9-11: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-10-3 oc bracing.

REACTIONS.


(size) 14=0-3-8, 10=0-3-8
Max Horz 14=-296(LC 10)
Max Grav 14=1620(LC 20), 10=1531(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1755/0, 4-5=-1171/131, 5-6=-52/284, 6-7=-54/281, 7-8=-1176/142, 8-9=-1739/0,
2-14=-1703/56, 9-10=-1633/0
BOT CHORD 13-14=-275/482, 11-13=0/1195
WEBS 5-7=-1409/130, 4-13=0/683, 8-11=0/649, 2-13=0/1046, 9-11=0/1101

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-3-11 to 3-1-2, Interior(1) 3-1-2 to 11-11-8, Exterior(2) 11-11-8 to 16-4-5, Interior(1) 16-4-5 to 23-8-4 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).4-13, 8-11
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 11-13
- Attic room checked for L/360 deflection.

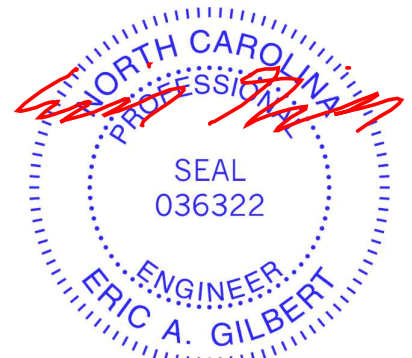

March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven
J0322-1082	D2A	ATTIC	3	1	150504806

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:07 2022 Page 1

ID:2W3hk9latme7Qcxb7tDGi8zptHE-glb8_ublX6Y4zlyMuBP76NiyavT1tKYSHWdDN7zfK8g



Scale = 1:72.0

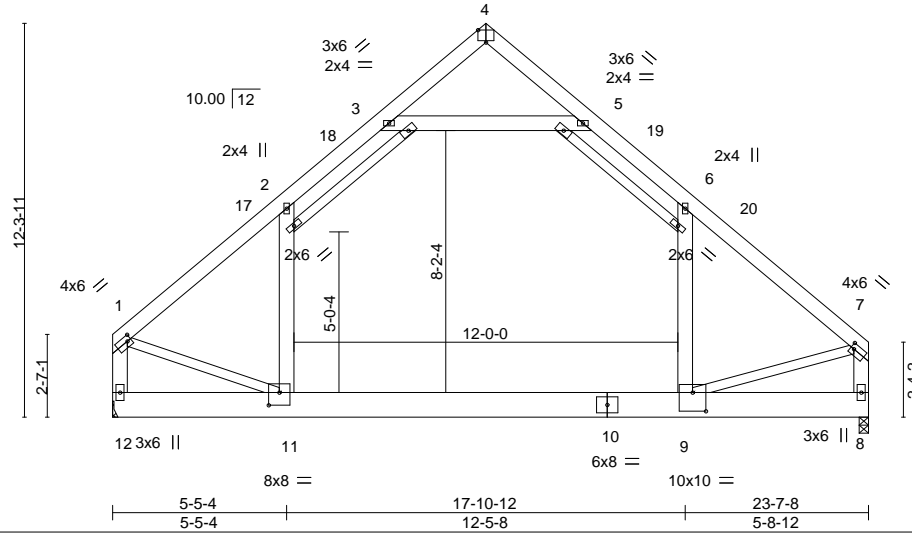


Plate Offsets (X,Y)-- [1:0-1-8,0-2-0], [4:0-3-0,Edge], [7:0-1-4,0-2-0], [9:0-5-0,0-7-0], [11:0-4-0,0-4-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.83	Vert(LL) -0.27	9-11	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.80	Vert(CT) -0.45	9-11	>622	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.42	Horz(CT) 0.01	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.08	9-11	>999	240	Weight: 247 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
13-14,15-16: 2x4 SP No.2
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
1-11,7-9: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-11-9 oc bracing.

REACTIONS.


(size) 12=Mechanical, 8=0-3-8
Max Horz 12=-289(LC 10)
Max Grav 12=1530(LC 21), 8=1514(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1700/0, 2-3=-1155/134, 3-4=-60/275, 4-5=-59/276, 5-6=-1156/141, 6-7=-1707/0,
1-12=-1679/0, 7-8=-1603/0
BOT CHORD 11-12=-260/365, 9-11=0/1171
WEBS 3-5=-1375/129, 2-11=-2/639, 6-9=-4/632, 1-11=0/1139, 7-9=0/1075

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-6-4 to 4-11-1, Interior(1) 4-11-1 to 11-11-8, Exterior(2) 11-11-8 to 16-4-5, Interior(1) 16-4-5 to 23-8-4 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 2-3, 5-6, 3-5; Wall dead load (5.0psf) on member(s).2-11, 6-9
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 9-11
- Refer to girder(s) for truss to truss connections.
- Attic room checked for L/360 deflection.

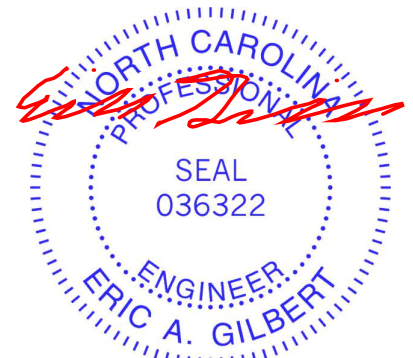

March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven
J0322-1082	D3	ATTIC	2	2	150504807

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:08 2022 Page 1

ID:2W3hk9latme7Qcxb7iDGi8zptHE-8U9WBEcOIQgxaS7ZSvwMebF5suotcqPbWANmvazfK8f



4x6 =

Scale = 1:71.0

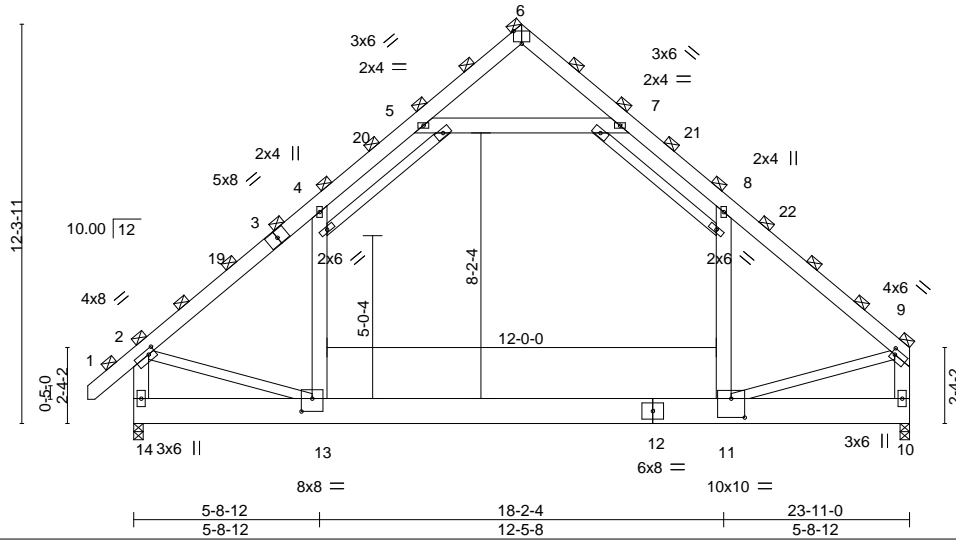


Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [6:0-3-0,Edge], [9:0-1-4,0-2-0], [11:0-5-0,0-7-0], [13:0-4-0,0-4-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.99	Vert(LL)	-0.27 11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.89	Vert(CT)	-0.46 11-13	>613	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.25	Horz(CT)	0.01 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL)	0.08 11-13	>999	240		
							Weight: 505 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
15-16,17-18: 2x4 SP No.2
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
2-13,9-11: 2x4 SP No.2

BRACING-

TOP CHORD 2-0-0 oc purlins (5-5-7 max.), except end verticals
(Switched from sheeted: Spacing > 2-8-0).
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 14=0-3-8, 10=0-3-8
Max Horz 14=639(LC 9)
Max Grav 14=3240(LC 20), 10=3058(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-3516/0, 4-5=-2345/270, 5-6=-104/568, 6-7=-108/563, 7-8=-2351/280, 8-9=-3475/0,
2-14=-3412/122, 9-10=-3268/0
BOT CHORD 13-14=-601/983, 11-13=0/2408, 10-11=-149/425
WEBS 5-7=-2817/252, 4-13=0/1365, 8-11=0/1298, 2-13=0/2097, 9-11=0/2211

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-3-11 to 3-1-2, Interior(1) 3-1-2 to 11-11-8, Exterior(2) 11-11-8 to 16-4-5, Interior(1) 16-4-5 to 23-8-4 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).4-13, 8-11
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 11-13
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Attic room checked for L/360 deflection.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504808
J0322-1082	VA-1	GABLE	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:09 2022 Page 1
ID:2W3hk9latme7Qcxb7tDGi8zptHE-cgjuPZd03jooCcil0cRbBonV8lJxLJdlIq6KS0zfK8e

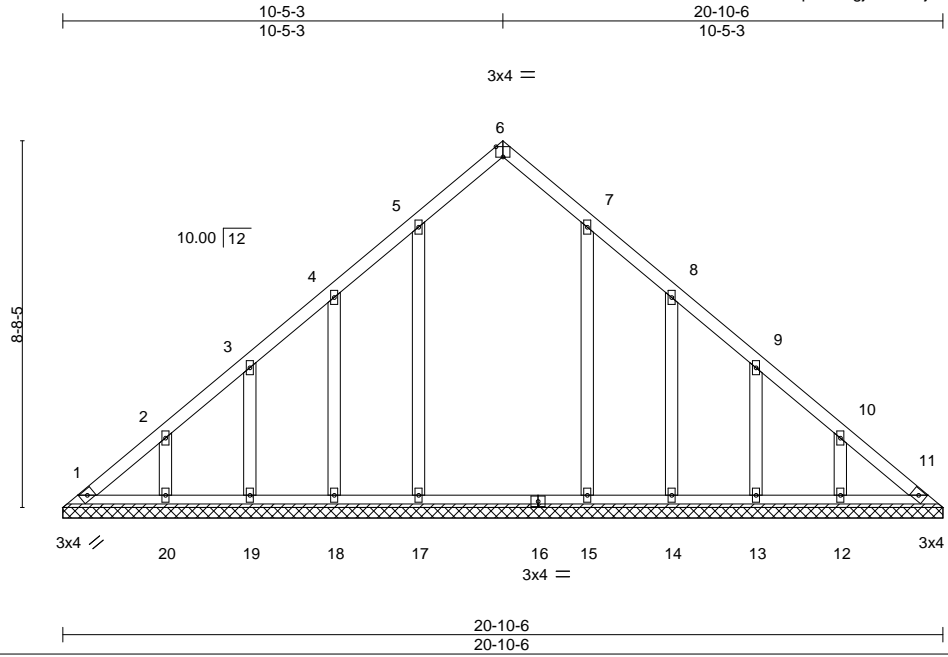

Scale = 1:54.6

Plate Offsets (X,Y)-- [6:0-2-0,Edge], [7:0-0-0,0-0-0], [8:0-0-0,0-0-0], [9:0-0-0,0-0-0], [10:0-0-0,0-0-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.14	Vert(CT) n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.12	Horz(CT) 0.01	11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 117 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.


All bearings 20-10-6.
(lb) - Max Horz 1=-250(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 17, 15 except 18=-128(LC 12), 19=-103(LC 12), 20=-127(LC 12), 14=-131(LC 13), 13=-102(LC 13), 12=-127(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 11, 18, 19, 20, 14, 13, 12 except 17=350(LC 19), 15=341(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-377/240, 2-3=-268/149, 9-10=-260/149, 10-11=-369/240
BOT CHORD 1-20=-199/313, 19-20=-199/313, 18-19=-199/313, 17-18=-199/313, 15-17=-199/313, 14-15=-199/313, 13-14=-199/313, 12-13=-199/313, 11-12=-199/313

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 17, 15 except (jt=lb) 18=128, 19=103, 20=127, 14=131, 13=102, 12=127.

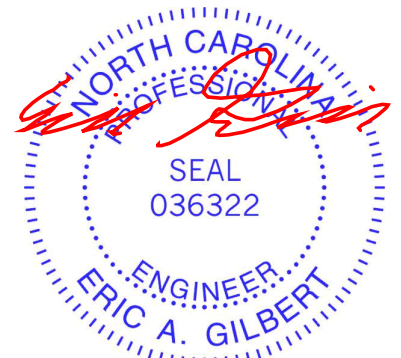

March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504809
J0322-1082	VA-2	GABLE	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:10 2022 Page 1
ID:2W3hk9latme7Qcxb7tDGi8zptHE-4tHGcveeq1wfmHxaJzjq0Kctibm4jeu_Tst_SzfK8d

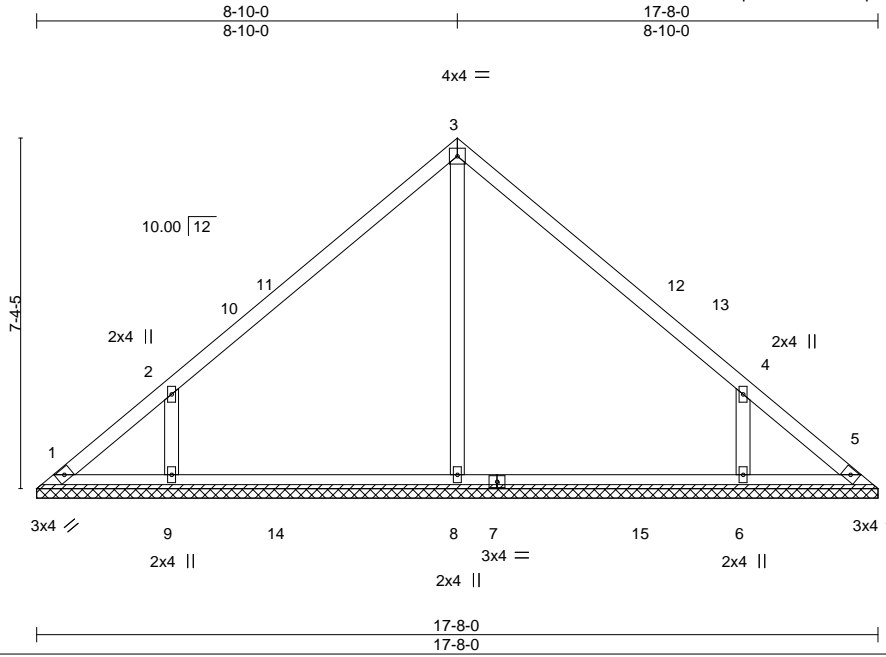

Scale: 1/4"=1'

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.32	Vert(LL) n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.35	Vert(CT) n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.20	Horz(CT) 0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S				Weight: 74 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 17-8-0.

(lb) - Max Horz 1=-168(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 9=-186(LC 12), 6=-186(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 8=612(LC 19), 9=548(LC 19), 6=548(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-9=-461/322, 4-6=-461/322

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 8-10-0, Exterior(2) 8-10-0 to 13-2-13, Interior(1) 13-2-13 to 17-3-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 9=186, 6=186.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504810
J0322-1082	VA-3	GABLE	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:11 2022 Page 1
 ID:2W3hk9latme7Qcxb7tDGi8zptHE-Y3rfqFeGbL2WRvs871U3GDtjR6xrpBM1C7bRWvzfK8c

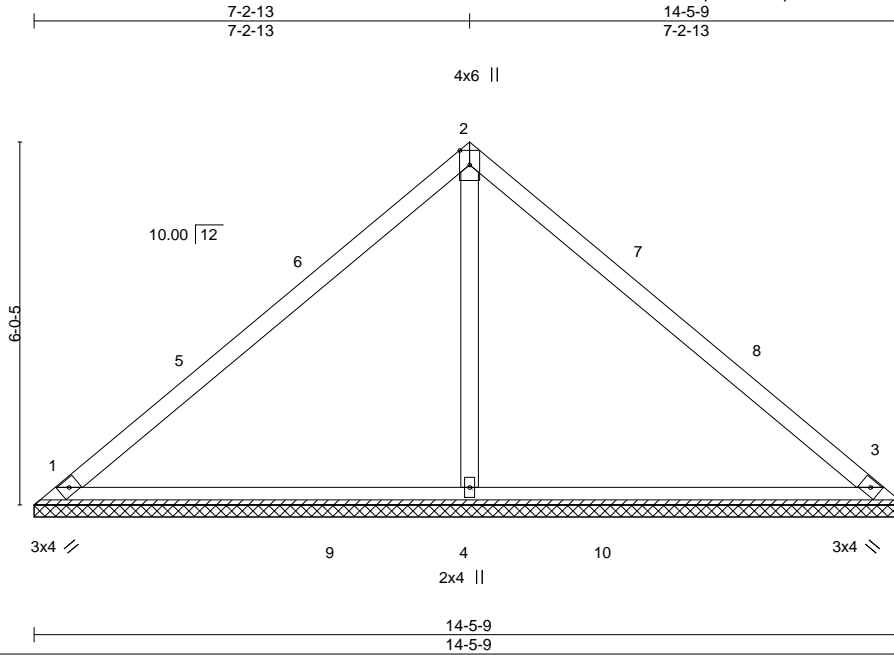

Scale = 1:38.3

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.52	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.17	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						Weight: 56 lb	FT = 20%
	Code IRC2015/TPI2014								

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=14-5-9, 3=14-5-9, 4=14-5-9
 Max Horz 1=-136(LC 8)
 Max Uplift 1=-32(LC 13), 3=-45(LC 13)
 Max Grav 1=292(LC 1), 3=292(LC 1), 4=671(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-4=-306/115

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 7-2-13, Exterior(2) 7-2-13 to 11-7-10, Interior(1) 11-7-10 to 14-0-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	I50504811
J0322-1082	VA-4	GABLE	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:12 2022 Page 1
ID:2W3hk9latme7Qcxb7tDGi8zptHE-0FP11bfuMeAM33RKhk?ipRPynWJbYf4BRnL_2LzfK8b

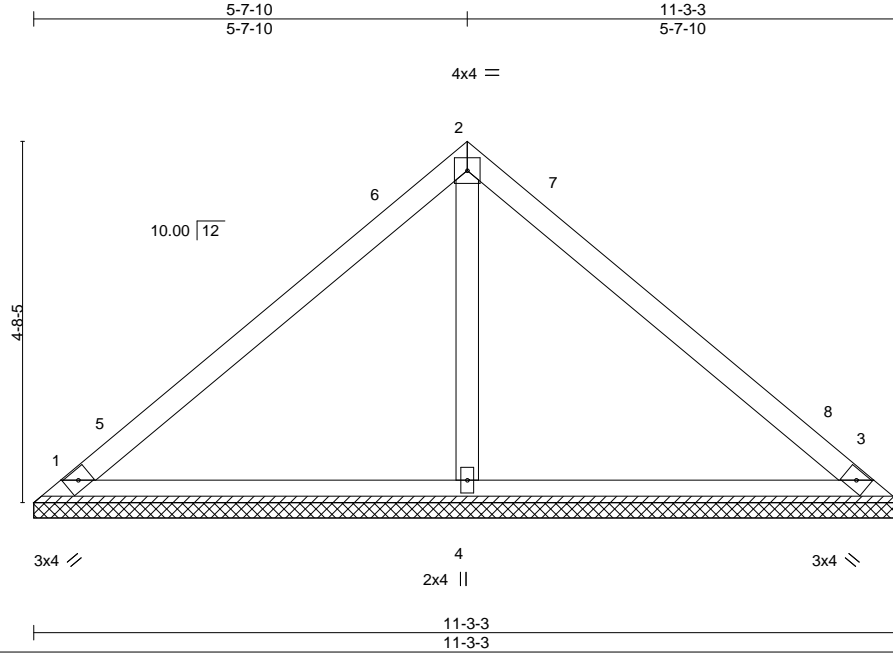

Scale = 1:29.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.29	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.20	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.08	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						Weight: 43 lb	FT = 20%
	Code IRC2015/TPI2014								

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=11-3-3, 3=11-3-3, 4=11-3-3
Max Horz 1=104(LC 8)
Max Uplift 1=25(LC 13), 3=34(LC 13)
Max Grav 1=223(LC 1), 3=224(LC 1), 4=390(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 5-7-10, Exterior(2) 5-7-10 to 10-0-6, Interior(1) 10-0-6 to 10-10-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

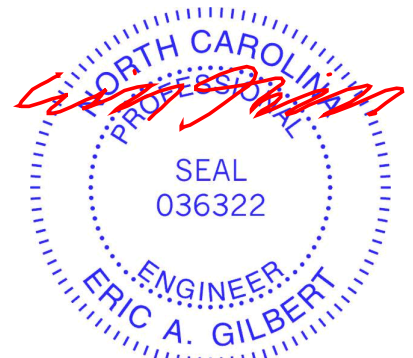

March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504812
J0322-1082	VA-5	VALLEY	1	1	Job Reference (optional)	


Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:13 2022 Page 1
 ID:2W3hk9latme7Qcxb7IDGi8zptHE-VSzPEXgW7yIDhD?WFSWXLeY84vhSH76KgR4XbnzFK8a



4x4 =

Scale = 1:22.5

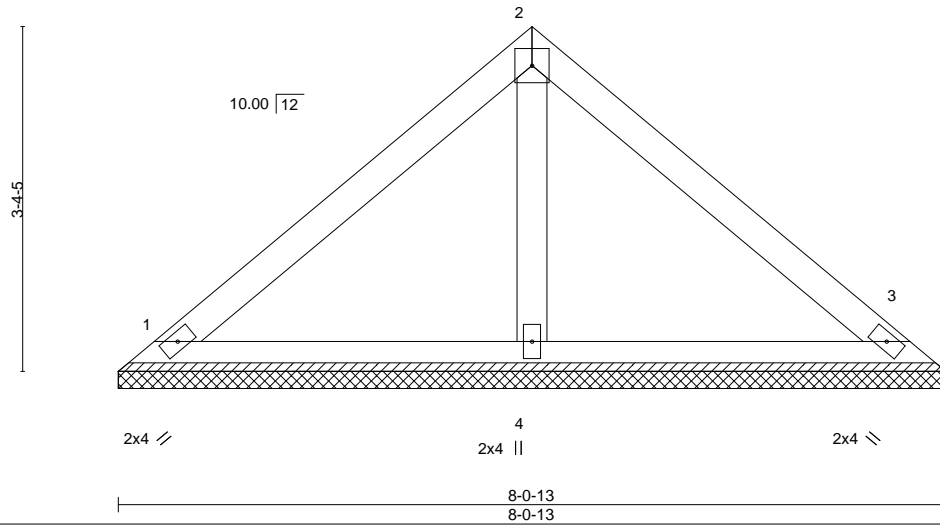

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.19	Vert(LL) n/a	-	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.10	Vert(CT) n/a	-	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00	3	-	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P						Weight: 30 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=8-0-13, 3=8-0-13, 4=8-0-13
 Max Horz 1=73(LC 9)
 Max Uplift 1=-25(LC 13), 3=-32(LC 13)
 Max Grav 1=168(LC 1), 3=168(LC 1), 4=245(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- Non Standard bearing condition. Review required.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 37 Oak Haven	150504813
J0322-1082	VA-6	Valley	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Mar 1 09:57:14 2022 Page 1
ID:2W3hk9latme7Qcxb7tDGi8zptHE-zeWnSHh8uGQ4INajp91musVLyJ2k0adUu5q57Dzfk8Z

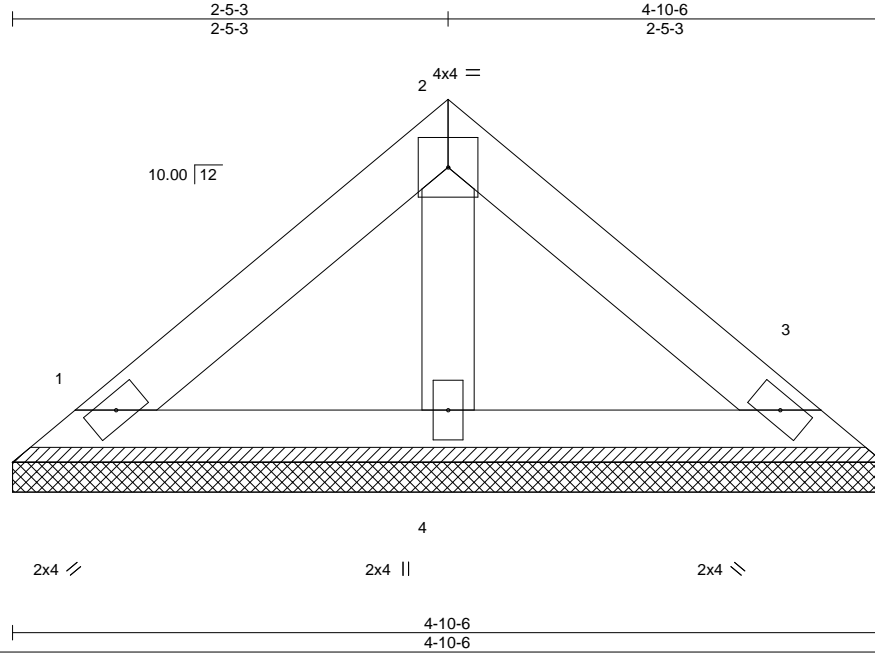

Scale = 1:12.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 17 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=4-10-6, 3=4-10-6, 4=4-10-6
Max Horz 1=-41(LC 8)
Max Uplift 1=-14(LC 13), 3=-18(LC 13)
Max Grav 1=94(LC 1), 3=94(LC 1), 4=137(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



March 2, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

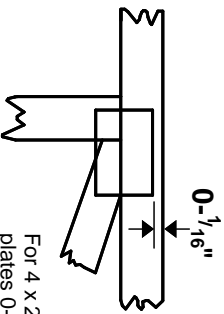

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)



JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.