

# Harnett County Department of Public Health

PERMIT # SFD 2261-0002

## Operation Permit

SU436

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 193 WALKER GROVE LN. (MATTHEWS RD)

Name: (owner) TRUE HOMES LLC      SUBDIVISION WALKER GROVE      LOT # 7

System Installer: DAVID BRANTLEY & SONS

Basement with plumbing:  Garage  Number of Bedrooms 4


Type of Water Supply:  Community    Public    Well   Distance from well NA feet

System Type: 25% REDUCTION SYSTEM III B      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

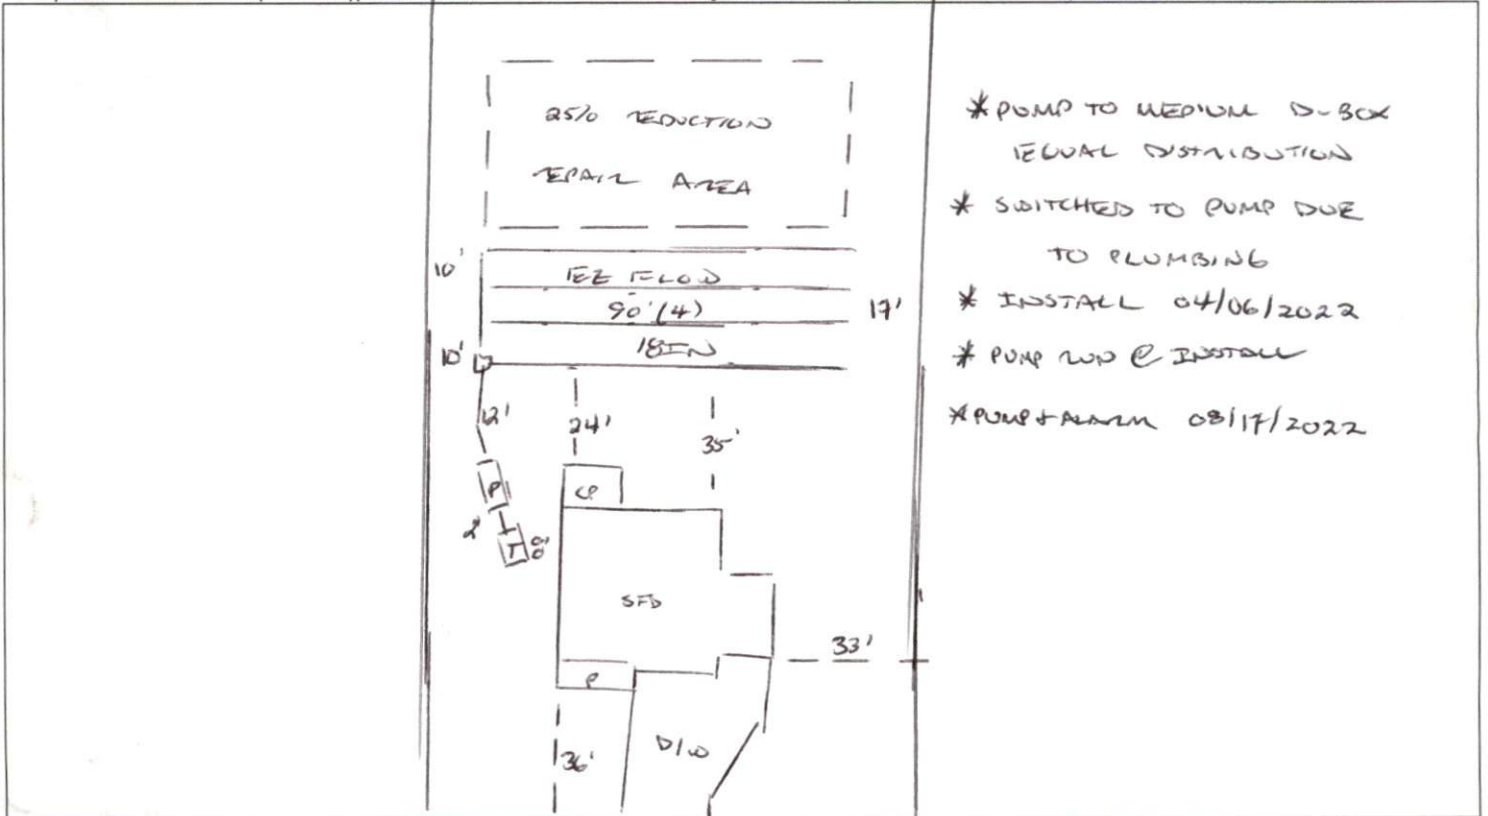

\* PUMP TO MEDIUM D-BOX  
EQUAL DISTRIBUTION  
\* SWITCHED TO PUMP DUE  
TO PLUMBING  
\* INSTALL 04/06/2022  
\* PUMP W/O @ INSTALL  
\* PUMP + ALARM 08/17/2022

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other E.F. FLOOD III B      Septic Tank: 1000 gallons      Pump Tank: 1000 gallons  
Subsurface      No. of      exact length      width of      depth of  
Drainage Field      ditches 4      of each ditch 90 feet      ditches 3 feet      ditches 18 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 08/17/2022