

# Harnett County Department of Public Health

PERMIT # SFD2201-0015

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 4870 Barbecue Church Rd (SR 1209)

Name: (owner) Lamco SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: Elvis Faircloth

Basement with plumbing:  Garage  Number of Bedrooms 5

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet


System Type: TYPE III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

*FUTURE REPAIR AREA*

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

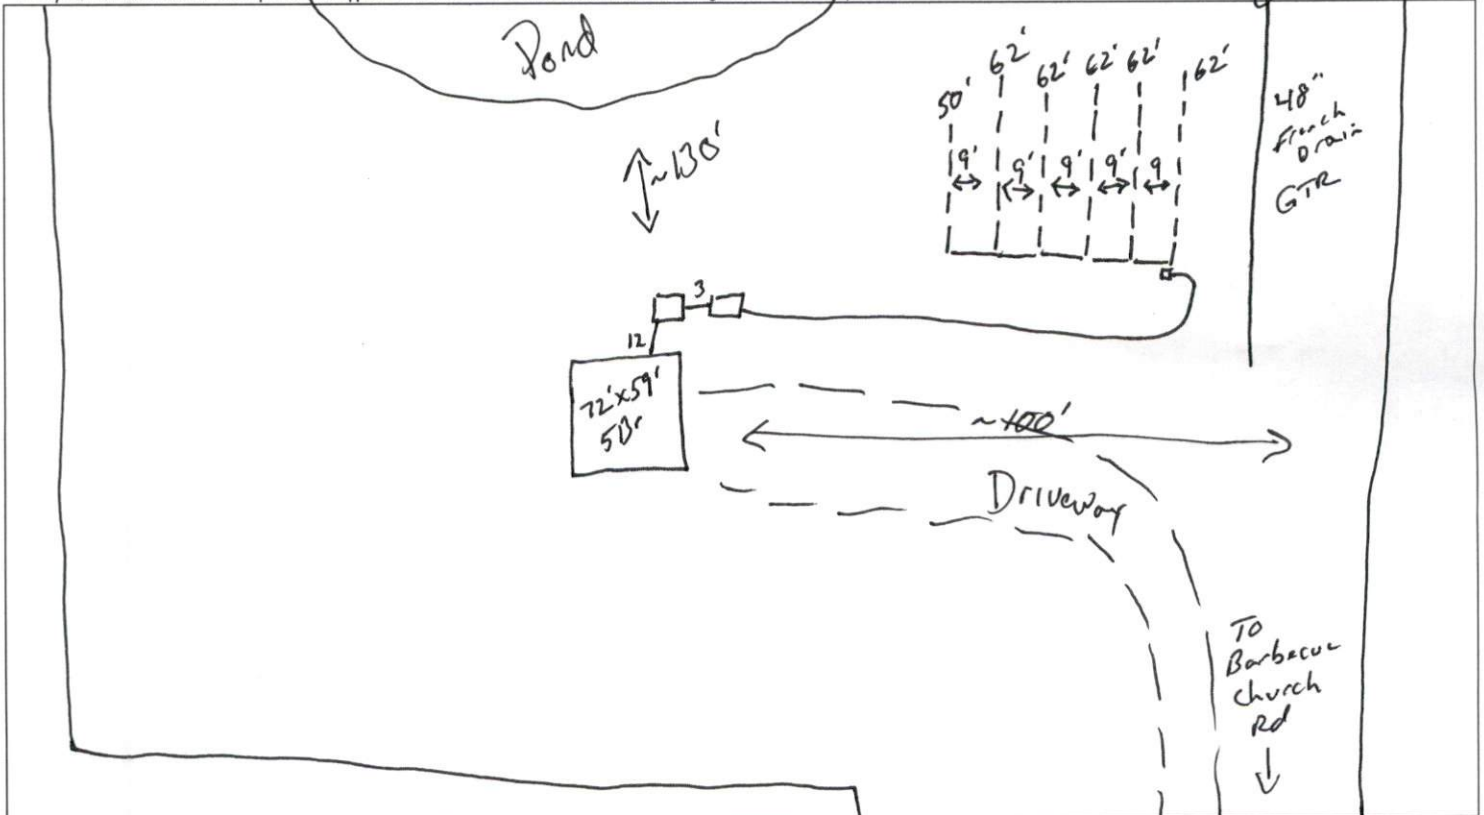

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 25% reduction IQU Septic Tank: 1250 gallons Pump Tank: 1000 gallons  
Subsurface No. of exact length width of depth of  
Drainage Field ditches 1 of each ditch 360 feet ditches 3 feet ditches 18-24 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent Mohd REHS Date 10-5-22