


Joe E Godwin Sr., P.E., P.L.S.

Joe E Godwin Jr., P.E.

Jason E Godwin, P.L.S.

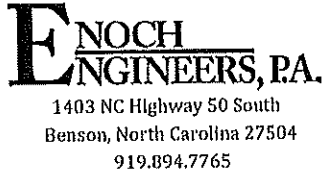

Email: [general@enochengineers.com](mailto:general@enochengineers.com)

[www.enochengineers.com](http://www.enochengineers.com)

## MATERIALS & TEST DIVISION

### FIELD REPORT

#### PROJECT

CLIENT: WELLONS CONST	DATE: 3.23.22
PROJECT: KEITH HILLS	CONTRACTOR: DEWAYNE STEPHENS
ADDRESS: 1280 KEITH HILLS DR	TECHNICIAN: BH
LOT #: 133	

#### TEST SUMMARY

PERFORMED SOIL BEARING CAPACITY EVALUATION FOR RETAINING WALL AT SITE NOTED ABOVE.  
 SOILS CONFIRMED A MINIMUM ALLOWABLE BEARING CAPACITY OF 2000PSF.

OK TO ADD #57 STONE TO FOOTING

#### TESTING RESULTS


SERVICE PERFORMED	TEST NO.	COMP %	WD PCF	DD PCF	MOISTURE %

#### RETURN VISIT REQUIRED?

YES   
 NO

DocuSigned by:  
  
 339EA4405059480..  
 4/11/2022

TECHNICIAN:

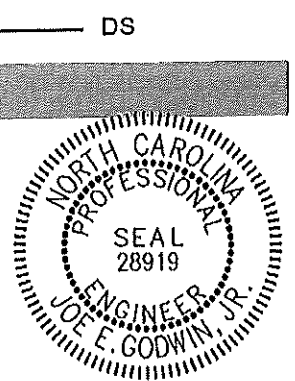


*Disclaimer:*  
 Soils & Material Inspections, testing results and on-site determinations contained in this report become void after 60 days of non-use of this report and/or following any inclement weather which causes structural soil or material deterioration. Additional testing will be required following a voided report determined by a North Carolina Building Code enforcement official or Enoch Engineers P.A. The client/contractor is responsible for notifying Enoch Engineers P.A. of any soil & material condition changes which could void this report.

Joe E Godwin Sr., P.E., P.L.S.

Joe E Godwin Jr., P.E.

Jason E Godwin, P.L.S.

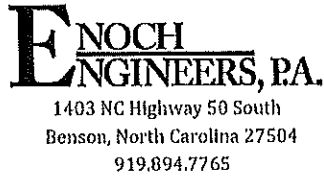

Email: [general@enochengineers.com](mailto:general@enochengineers.com)

[www.enochengineers.com](http://www.enochengineers.com)

### MATERIALS & TEST DIVISION FIELD REPORT

#### PROJECT

CLIENT: WELLONS CONST	DATE: 3.28.22
PROJECT: KEITH HILLS	CONTRACTOR: LAUREN WHITE
ADDRESS: 1280 KEITH HILLS DR	TECHNICIAN: BH
LOT #: 133	

#### TEST SUMMARY

PERFORMED NDT ON RETAINING WALL BACKFILL AT SITE NOTED ABOVE USING A TARGET DENSITY OF 118 PCF.  
SOILS CONFIRMED A COMPACTION GREATER THAN OR EQUAL TO 95%.  
LIFT 2

#### TESTING RESULTS

SERVICE PERFORMED	TEST NO.	COMP %	WD PCF	DD PCF	MOISTURE %
NDT	1	100+	115.8	129.6	8.1
NDT	2	100+	121.5	129.5	6.5

#### RETURN VISIT REQUIRED?

YES   
NO

DocuSigned by:

339EA4405059480..

TECHNICIAN:

4/11/2022

Disclaimer:

Soils & Material Inspections, testing results and on-site determinations contained in this report become void after 60 days of non-use of this report and/or following any inclement weather which causes structural soil or material deterioration. Additional testing will be required following a voided report determined by a North Carolina Building Code enforcement official or Enoch Engineers P.A. The client/contractor is responsible for notifying Enoch Engineers P.A. of any soil & material condition changes which could void this report.

DS

