PLANS FOR: LOT 59, PROVIDENCE CREEK



Meter

MATL

MECH

MED

MFR

MEMB

MAX

Masonry

Medicine Cabinet

Manufacture(er)(ing)

Mechanical

Medium

Membrane

RVS

SCHED

SHT GL

SHWR

SPEC

SIM

Reverse

Schedule

Storm Drain

Sheet Glass

Specification

Shower

Similar

DS DTL

DWG DWR

ELEV

EMER

Downspout

Expansion Joint

Electric Panel Board

Detail

Drawing

Drawer

Each

Elevation

MATTAMY HOMES - REDWOOD RH

ABBREVIATION LEGEND					PLAN	SET COM	POSITIO	ON		ELEVATI	ON			
AB ABV	Anchor Bolt Above	EQ E.W.	Equal Each Way	MIN MIR	Minimum Mirror	SQ SS	Square Solid Surface	PAGE#	LA	YOUT				
AC	Air Conditioner	EXIST	Existing	MISC	Miscellaneous	SS	Sanitary Sewer	T1.0-T1.1	TITLE SHEET A	ND REVISION	LOG			
ACC ACFL	Access/ Accessible Access Floor	EXP EXT	Exposed Exterior	MM MO	Millimeter Masonry Opening	SST ST	Stainless Steel Steel	GN1.0-GN1.1	GENERAL NOTE					
ADJ ADJ	Adjacent	F.A. FD	Flat Archway	MOV MTD	Movable	STA	Station			:3				
ADJ AFF	Adjustable Above Finished Floor	FDTN	Floor Drain Foundation	MTFR	Mounted Metal Furring	STC STD	Sound Transmission Class Standard	0.10-0.15	ELEVATIONS			CD	A ETC	SMAN
AGGR	Aggregate	FF	Finish Floor	MTL	Metal	STOR	Storage	0.20-0.21	BASEMENT FLO	OR PLANS		UR	4612	NI AIVIC
ALT	Alternate	FG	Fixed Glass	MULL	Mullion	STRUCT	Structural	1.0-1.4	1ST FLOOR PLA	NC		• • • • •	· · · ·	
ALUM ANC	Aluminum Anchor/Anchorage	FIN FLEX	Finish Flexible	NIC NOM	Not In Contract Nominal	SYS T	System Tread							
AP	Access Panel	FLR	Floor	NR	Noise Reduction	T.A.	Trimmed Archway	2.0-2.2	2ND FLOOR PLA	ANS				
APPROX	Approximate	F.O.	Framed Opening	NRC	Noise Reduction Coefficient	t TB	Towel Bar	3.0-3.1	3RD FLOOR PLA	ANS				
ARCH AUTO	Architect(ural) Automatic	FOC FOF	Face of Concrete Face of Finish	NTS OA	Not to Scale Overall	TEL TEMP	Telephone							
BD	Board	FOF	Face of Masonry	OC	Overall On Center	TEMP T&G	Temporary/ Temperature Tongue and Groove	4.0-4.1	SECTIONS / DET					_
BLDG	Building	FOS	Face of Studs	OD	Outside Diameter	THK	Thick(ness)	5.0-8.0	ELECTRICAL / H	IVAC PLANS			CODE	
BLK	Block(ing)	FPL FR	Fireplace Frame	OH	Overhead (Overhang)	THRES	Threshold							•
BOC BRG	Bottom of Curb Bearing	FTG	Frame Footing	OPNG PED	Opening Pedestal	TJ TMPD	Triple Joist Tempered							
BRG PL	Bearing Plate	FUR	Furring/ Furred	PL	Plate	TOC	Top of Curb/ Concrete						2018	
SMT	Basement	GA	Gauge	PL	Property Line	TOL	Tolerance					W0.DT// 0.4.5		5,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
UR	Built up Roof	GALV	Galvanized	PLAM	Plastic Laminate	TOS	Top of Slab					NORTH CAR	COLINA STATE	BUILDING CODE:
.A.	Curved Archway	GD	Grade/ Grading	PLAS	Plastic	TOST	Top of Steel						RESIDENTIAL (CODE
AB	Cabinet	GL	Glass/ Glazing	PLAS	Plaster	TOW	Top of Wall							
В	Catch Basin	G.T. GYP	Girder Truss	PL GL PLYWD	Plate Glass Plywood	TPD	Toilet Paper Dispenser							
ER IR	Ceramic Circle	HB	Gypsum Hose Bib	PLYWD	Panel	TV TYP	Television Typical							
J	Control Joint	HC	Hollow Core	P.T.	Pressure Treated Lumber	UFIN	Unfinish(ed)							
ĹG	Ceiling	HDBD	Hard Board	PT	Paint(ed)	UNO	Unless Noted Otherwise							
LG HT	Ceiling Height	HDR	Header	PT	Point	UR	Urinal		F	REDWOOD	SOLIAR	F FOOTA	GES	
LO	Closet	HM	Hollow Metal	PT	Porcelain Tile	VB	Vinyl Base			CEDVICOD	CQUAIN	LICOIA	JLU	
M	Centimeter	HORIZ	Horizontal	PTN PR	Partition	VCT	Vinyl Composition Tile			001.01.11.1	0045701441	FRENCH	TUDOD	E4514110110E
MU OL	Concrete Masonry Unit Column	HP HT	High Point Height	PRKG	Pair Parking	VER VERT	Verify Vertical	AREA		COLONIAL	CRAFTSMAN	COUNTRY	TUDOR	FARM HOUSE
ONC	Concrete	HTG	Heating	PSI	Pounds per Square Inch	VEST	Vestibule					000111111		
CONST	Construction	HVAC	Heating/ Ventilation/	PVC	Polyvinyl Chloride	VF.	Vinyl Flooring	1st FLOOF		1000 SQ. FT.	1000 SQ. FT.	1000 SQ. FT.	1000 SQ. FT.	1000 SQ. FT.
ONT	Continuous/ Continue		Air Conditioning	PVMT	Pavement	VJ	V(ee) Joint	1311 2001	`	1000 00.11.	1000 GQ.11.	1000 00.11.	1000 00.11.	1000 00.11.
ORR	Corridor	ID	Inside Diameter	QT	Quarry Tile	VNR	Veneer	2nd FLOO	D	1224 SO ET	1324 SQ. FT.	1324 SQ. FT.	1324 SQ. FT.	1324 SQ. FT.
PB	Carpet Base	INCL INSUL	Include(d) Insulate/ Insulation	R R	Radius Riser	VWC	Vinyl Wall Covering	Zilu FLOO	N.	1324 SQ. F1.	1324 SQ. F1.	1324 3Q. F1.	1324 SQ. F1.	1324 3Q. F1.
CPT CSMT	Carpet Casement	INSUL	Insulate/ Insulation Interior	RA	Riser Return Air	WB WD	Wood Base Wood	TOTALLI	//N/O	0004 00 FT	0004 00 FT	0004 00 FT	0004 00 FT	0004 00 FT
SIVI I T	Casement Ceramic Tile	INV	Invert	RB	Rubber Base	WDW	Window	TOTAL LIV	/ING	2324 SQ. F1.	2324 SQ. F1.	2324 SQ. FT.	2324 SQ. FT.	2324 SQ. FT.
TR	Center	J-Box	Junction Box	RCP	Reinforced Concrete Pipe	WGL	Wired Glass				1			
UFT	Cubic Foot	JST	Joist	RD	Roof Drain	WH	Water Heater	OPT LIPO	RADE SIDE		 			
U YD	Cubic Yard	JT	Joint	REF	Reference	WM	Wire Mesh	ELEVATION		N/A	9 SQ. FT.	9 SQ. FT.	N/A	N/A
VT	Ceramic Wall Tile	Kit	Kitchen	REFR	Refrigerator	W/O	Without	ELEVATION	'IN		 			
L	Double	L LAM	Length Laminate	REINF REQD	Reinforced Required	WPT WSC	Working Point							
H A	Double Hung Diameter	LAW	Lanimate Lag Bolt	RESIL	Resilient	WSC	Wainscot Wall Tile	GARAGE	- 2 CAR	434 SQ. FT.	434 SQ. FT.	434 SQ. FT.	434 SQ. FT.	434 SQ. FT.
AG	Diameter Diagonal	LH	Left Hand	RET	Return	WT	Weight		_ *,					
M	Dimension	LT	Light	REV	Revision	WWF	Welded Wire Fabric	FRONT PO	ORCH COVERED	60 SQ. FT.	82 SQ. FT.	46 SQ. FT.	74 SQ. FT.	140 SQ. FT.
SP.	Garbage Disposal	LTL	Lintel	RFG	Roofing				JACON DO VENED	00 00.11.	02 OQ. 1 1.	70 00.11.	77 00.11.	170 00.11.
J	Double Joist	LT WT	Light Weight	RM	Room	Œ.	Center Line		CLO	BAL OPTIC	JUNI SOI	INDE EOC	TACES	
N	Down	LVL LVR	Laminated Veneer Lumber Louver	RO ROW	Rough Opening Right of Wav	C PL	Channel Plate		GLU	DAL OF HIC	JINAL OU	JAKE FUC	TAGES	
DP	Deep													

OPT. COVERED VERANDA

OPT. SCREENED PORCH

OPT. SUNROOM

Plus or Minus

Property Line



MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

CONSULTING INFERING SURVEYING FENERGY

REDWOOD

21901789

DATE: 11/01/2021

120 SQ. FT.

120 SQ. FT.

120 SQ. FT.

CAR

TITLE SHEET

	PLAN REVISION	LOG	
DATE	REVISION DESCRIPTION	SHEETS	DFTR
-/-/-	PLAN CD RELEASE DATE	ALL	-



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

CONSULTING ONE OF THE STATE OF

NORTH CAROLINA

REDWOOD - RH

21901789

DATE: 11/01/2021

DRAWN BY:

CAR

REVISION LOG

(41) ROOF CONSTRUCTION

SPPG#TIJOH MFT#PWFS#&48#GFMU#OBOFS#+EPVCMF#MBZFS VOE FS MB ZN FOU#GPS #S PPGT #X JJI #B #Q JJD I #PG#MFTT #JI BO#7 =45 // :249 %#P TC #TIFB UIJOH #X JUI #%I %#D MJO T#P O#B O O S P W FE #S P P G US VTTFT ###TFF#S PPG#US VTT#E FTJH OT ,#PO SFGJD #BMVN 1 FBWFTUSPVHI#GBTDB#)#WFOUFE#TPGGJD#V101P1 +m 'a'm #UP #TIFFU#H O414#GPS #O1D 1#FOFS HZ #S FR VJS FN FOUT L

ROOF VENTILATION

POUDPO#4#N JO 1#W FOULMBULPO#BS FB #PG#463 3 #PG#UPUBM#BUUD #BS FB X JULY HN JO 1483 (#) HN BY 14:3 (#PG4S FR VJS FE 4D S PTT4W FOUJMBUJPO OSPW.RFR #W FOILMR UPST#MPD RUFR #10 #UTF#VOOFS #OPSUPO#PG UIF#TOBDF#BSF##N JD2#69%#BCPWF#FBWF#PS#DPSOJDF#WFOUT#XJUI UIF#CBMBODF#PG#UIF#SFRVJSFE#WFOUJMBUJPO#QSPWJEFE#CZ FBWF#PS#DPSODF#WFOUT

POULPO#5#N JO #W FOUJNBULPO#BSFB#PG#4-633 #PG#UPUBM#BUULD#BSFB X JUI#S FE VD UJP O #JD #D S P TT #W FO UJMB UJP O #X JUI #VTF #P G#W B Q P S CBSSJFS #MPDBUFE #CFUXFFO#DTVMBUJPO#) #ESZXBMM1

FRAME WALL CONSTRUCTION (2"X4") - SIDING

TJE JDH #B T#Q FS #FMFW B UJP O /#B Q Q S P W FE #I P VTF #X S B Q /#: 249 %#P T C S 46 #C B UU #LO T VMB ULP O /#425% #LO U1#E S Z X B MM #GLO JT I 1

+m 'a'm #UP #TIFFU#H O414#GPS #O1D1#FOFSHZ#SFRVJSFNFOUTL

FRAME WALL CONSTRUCTION (2"X4") - STONE

TZOUI FUOD #TUP OF #TD S B UD I #D P B U#O FS #N B OVGB D UVS FS T#TO FD T1 PWFS#HBMW1#NUM1#MBUT#)#BOOSPWFE#XFBUTFS#SFTJTUBOU CBSSJFS #: 249 %#PTC #FYUFSJPS #TIFBUIJDH #5%s 7 %#TUVE T#A #49 %#P ID 1 UP #43 *N B Y #I FJH I U #425 % #40 U #E S Z X B MM #GJO JT I 1

+m 'a'm #UP #TIFFU#H O412#GPS #O1D 1#FOFS H Z #S FR VJS FN FOUT1,

DRAINAGE

TJUF#TIBMM#HSBEF#UP#QSPWJEF#ESBJOBHF#VOEFS#BMM#QPSUJPOT PG#TUS VDUVSF#) #UP#ESBØ#TVSGBDF#XBUFS#BXBZ#GSPN#UIF TUS VD UVS F #H S B E F #T I B MM #GB MM #9 % #X JUI JO #GJS TU #43 *#B MM Q MVN C JOH #X P S L #T I B MM#D P N Q MZ #X JUI #UI F #D VS S FOU #S FT JE FOU JB M) #O MVN C JOH #D P E FT1

GROUND FLOOR SLAB ON GRADE

DPODSFUF#TMBC#QFS#TUSVDUVSBM#ESBXJOHT#PWFS#DMFBO UFS N JUF#US FBUFE #D PN Q BD U#GJMMJ#D I FN JD BM#Q S FOUS FBUN FOU#PG TP JM \ T \ HS FR V \ JS FE \ \ HC FGP S F \ \ HD B T U \ JD H \ \ HP G \ \ T T M B C \ \ \ HT B X \ \ \ HD V U \ \ HF W FS Z ±53 3 #T1G1

EXPOSED FLOOR TO EXTERIOR

QSPWJEF#NJDJ#S4<#CBUU#JDTVMBUJPO#JDJ#GMPPST#CFUXFFO DPOE JUPOFE#)#VODPOE JUPOFE#TOBDFT#BOOSPWFE#IPVTF XSBQ #GJDJTIFE #TPGGJJJ1

:1) BUUD #DTVMBUPO#m \a\m #UP#TIFFU#HO414#GPS#OD#SFRVJSFNFOU1 425 SHADU LHESZXBMMHDFJNJOH HGJDJTIHPSHBOOSPW FEHFRVBM

INTERIOR STAIRS: SITE BUILT

- TUS JOH FS T#TIB MM#C F#5%s 45%#TZQ 1&5#+Q S FTTVS F#US FB UFE #B U CBTF, #FRVBMMZ #TQBDFE #) #BODIPSFE #UP #5%s; %#IFBEFS#) Q 1U1#5%s 7 %#Q MB UF
- 51 US FBET#TIBMM#CF#5%s 45%#TZO 1&5#S JD OFE #EPXO#BT#S FR VJS FE 1 +H MVFE #) #OB JMFE ,
- 61 S JTFS T#TIB MM#C F#4%s; %#TZQ 165#S JQ Q FE #E PXO#B T#S FR VJS FE 1 +H MVFE #) #OB JMFE ,

71	N D #US FB E	?#< %
	N В Y #O Р Т ФН	?#40427 %
	N D #US FBE#) #OPT DH	?#< 0627 %
	NBY #SJTFS	?#; 0427%
	N D #I FB E S P P N	?#9 *0; %
	N B Y 1#W FS UJD B M#S JTF#GP S #GMJR I U#P G#TUB JS T	?#45*03 %
	N D #TUB S #X E UI	?#6*03 %
	N JD #D MFB S #TUB JS #X JE UI	?#6 418 %

FOR WINDER STAIRS

N JD #X JDE FS #US FBE #N FB TVS FE

45%#GSPN#ADTJEF#FEHF N $\texttt{JD} \not \texttt{HX} \not \texttt{JDE} \texttt{FS} \not \texttt{HUS} \texttt{FB} \texttt{E} \not \texttt{HN} \texttt{FB} \texttt{TVS} \texttt{FE} \not \texttt{HB} \texttt{U} \not \texttt{HB} \texttt{OZ} \not \texttt{HQ} \texttt{P} \not \texttt{DU}$ NBY #X DEFS #EFOUI

HAND RAIL

7	N OD HTUBOS #2#SBNQ#IBOESBJN#IFJHIU	?#67%
	NBY #TUBJS #2#SBNQ #IBOESBJM#IFJFIU	?#6;%
	N O HOUFS OPS HIVBSEHIF JHIU	?#69%
	N JD #FY UFS JP S #H VB S E #I FJH I U	?#69%

GADATIFE #SBANADH #BOE #HVBSE #SBAN#QADL FUT#TIBMM#CF#TQBDFE 7 % #P 1D 1#N B Y JN VN #C FUX FFO #Q JD L FUT 1#H VB S E T #B O E #S B JM JD H T TIBMM#OPU#IBWF#POFO.DHT#GSPN#UIF#XBML.DH#TVSGBDF#UP#UIF S FR VJS FE #H VB S E #I FJR I U#X I JD I #B MMP X #UI F #D B TTB H F #P G #B TQ IFS F#7 %#AD #E JB N FUFS 1

(43) WALLS BACKING ONTO ATTIC

XBMMT#XIJDI#TFQBSBUF#DPOEJUJPOFE#MJNJOH#TQBDF#GSPN VODPOEJUPOFE #BUUJD #TOBDF#TIBMM#CF#DTVMBUFE#BOE#TFBMFE X JITT #BO #B JS #C BSS JES #TZ TITEN #TP #M.N. JIT# DG MITS BTJ PO 1#F 1#W BV/MITE DFJMJDH #TL ZMJH IU #SBJTFE #DPGGFSFE #DFJMJDH1 +m 'a'm #UP #TIFFU#H O 414#GP S #O ID 1#FOFS H Z #S FR VJS FN FOUT 1,

41) CFBN #QPDLFU#PS#; %s; %#DPODSFUF#CMPDL#OJC#XBMMTJ#NJOJN VN CFBS JOH #6 0425%1

(451) WALL & CEILING BETWEEN GARAGE & LIVING SPACE

82; %#UZOF#VY *#ESZXBMM#PO#DFJMJDH#PG#HBSBHF#X2#MJMJDH#TOBDF BCPWF#) #425%#ESZXBMM#PO#XBMMT#TVOOPSUJOH#82; %#JZOF#Y #HXC X 2#IBCJUBCMF#TQBDF#BCPWF#BOE#CFUXFFO#IPVTF#BOE HBSBHF##OTVMBUF#XBMMT#BOE#DFJMJOH#CFUXFFO#HBSBHF#BOE DPOE JUJPOFE #TQBDF #UBQF#TFBM#) #TUS VDUVSBMMZ #TVQQPSU#BMM KP JOUT /HJO #PSEFS #UP #CF#HBT2GVNF#UJFIU1

+m 'a'm #UP #TIFFU#H O 412#GP S #O 1D 1#FOFS H Z #S FR VJS FN FOUT 1,

461) EPPS#BOE#GSBNF#HBTQSPPGFE##EPPS#FRVADQFE#XJDI#TFMG DMPTOH #E FW OF #BOE #X FBUIFSTUS QQOH 1

(47) CLOTHES DRYER VENT

ESZFS#FYIBVTU#WFOUFE#UP#FYUFSJPS#)#FRVJDOFE#X2#CBDL ESBGU#EBNOFS #NBY #168 #EVDU#MFOHUI#GSPN#UIF#DPOOFDUPO UP #IT F#US BOTJUPO#E VD U#GS PN #IT F#E S Z FS #IP #IT F#P VUMFU UFS N JDB M#X T FS F#GJUJOH T#B S F#VTFF #S FGFS #UP #N FD T B O JD B M DPEF#GPS #NBY #MFOHUI #SFEVDUJPOT #TFBM#XJJTI OPOODPNCVTULCMF#NBUFSBM#BQQSPWFE#GJSF#DBVMLJOH#PS#OPO DPNCVTUCMF#ESZFS#FYIBVTU#EVDU#XBMM#SFDFOUBDMF

ATTIC ACCESS

BUULD #BDDFTT#IBUDI#53 %s 63 %#XJUI#XFBUIFS 0#TUS JO OJOH #LOUP BOZ#BUUJD#FYDFFEJDH#63 #TG#s#63 %#WFSUJ#IFJHIUJ##BMMPX#63 % IFBESPPN #JD#BUUJD#BU#IBUDI#MPDBUJPO#m 043 #N JD#JDTVMBUJPO OR

O VMM#E PXO#TUB \$ #+O E T,#+TJ[F#O FS #O MBO,#X JUI X FB UI FS OTUS Q Q DH #) #DTVMB UFE #X JUI #+S 8 ,#S JH JE #DTVMB UJP O 1 +0 P O 0 S JH JE #JD T V MB U JP O #N B U F S JB M T #B S F #O P U #B M M P X F E ,

FIREPLACE CHIMNEYS

UP Q #P G#GJS FQ MB D F#D I JN OFZ #TIB MM#C F#N JD J#6*03 %#B C P W F#UI F T JE T FTU#O P JOUJ#B UJ#X T JD T #TU#O P N FT #JD P O G B D UJ#X JUT #UT F JE P P G BOE #5*03 %#BCPWF#UIF#SPPG#TVSGBDF#XJUIJD#B#IPSJ[#EJTUBODF PG#43 *03 %#GSPN#UIF#DIJNOFZ1

MJD FO #D MP TFU#P S #Q B O US Z #X 2#N JD \pm 45%#E FFQ #T I FMW FT \pm Q S P W JE F

MECHANICAL VENTILATION

N FD IB OJD B M#FY I B VTU#GB O AW FOUFE #E JS FD UMZ #UP #FY UFS APS AHIP OSPWEF#83 ah #DUFSN JUUFOU#PS#53 ah #DPOUJOVPVT#D CBUISPPNT#) #UP JMFU#SPPNT#OSPWJEF#EVDU#TDSFFOJ#TFF#IWBD

CABINET BLOCKING

- 69 %#B1G1G1#GPS#CBTF#DBCJ0FUT
- 87 %#B 1G1G1#GPS #CPUUPN #PG#VOOFS #DBC JOFUT ; 7 %#B 1G1G1#GPS #UPQ #PG#B#63 %#VQQFS#DBCJDFU
- < 9 %#B1G1G1#GPS #UPQ #PG#PQUPOBM#75%#VQQFST
- $_{53}$) $_{1}$ <u>Stud wall reinf. For Handicap Bathroo</u>m

X I F S F # I B O E JD B Q Q F E # B D D F T T JC JMJUZ #JT # S F R VJS F E ÆQ S P W JE F XPPE#CMPDL ODH #S FOOGPSDFN FOU#UP#TUVE #XBMMT##GPS#HSBC CBS #10 TUB MMB U.P O #10 #CBUT SPPN #466%069 %#B 1G1G1#CFT.10 E ##UP.1MFU1 66%#B1G1G1#PO#UIF#XBMM#PQQPTJUF#UIF#UIF#FOUSBODF#UP#UIF CBUIUVC #PS #TIPXFS

S4 RANGE HOOD VENT

SBOHF#IPPE#WFOUFE#UP#FYUFSJPSJ#)#FRVJQQFE#X2#CBDL ESBGU#EBNQFS #N DSPXBWFT #MPDBUFE #BCPWF #B #DPPL JOH BOOMBODF#TIBMM#DPOGPSN#UP#VM<561

(551) SLAB ON GRADE PORCH

DPODSFUF#TMBC#QFS#TUSVDUVSBM#ESBX.DHT#PWFS#DMFRO UFS N JUF#US FB UFE #D P N O B D U#GJMM#TVC UFS S B O FB O #UFS N JUF QPTUOUS FBUN FOU#NBZ#CF#CPSBDBSF#BQQMJFE#UP#HSPVOE GMPPS#XPPE#TVSGBDFT#JMP#TPJM#USFBUNFOU1

- EJS FD U#W FOU#GVS OB D F#UFS N JDB M#TFF#BQQ FOE JY OD #%FY JD UFS N JOB MT#P G#N FD I B O JO B M#E S B GU#B O E #E JS FD U#W FOU#W FOUJOH TZTUFN %#GPS #N JOJN VN #D MFBS BOD FT#UP #X JOE PX #) #E PPS POFOJOH T#HSBEF#FYIBVTU#) #JOUBLF#WFOUTJ#SFGFS#UP#HBT VUMNTBUNPO#DPEF1
- (57) E JS FD U#W FOU#H B T#GJS FQ MB D F #TFF#B Q Q FOE JY OD #%FY JJ#UFS N JD B MT PG#NFDIBOJDBM#ESBGU#BOE#EJSFDU#WFOU#NFOUJDH#TZTUFN%#GPS N JOJN VN #D MFBSBODFT#UP#XJOEPX#)#EPPS#PQFOJOHT/#HSBEF/ FYIBVTU#) #LOUBL F#W FOUTL#S FGFS #UP #H BT#VUJMJ[BUJPO#DPEF1

SUBFLOOR \$ FLOOR TRUSSES

627 %#U#) #H #TVC GMP P S #P O#Q S F0FOH JD FFS FE #GMP P S #US VTTFT#C Z S FH JTUFS FE #US VTT#N B OVGB D UVS FS 1##4TFF#TUS VD U#FOH JOFFS *T OBJMJOH #TD I FE VMF,

OSPWJEF#ESBGU#TUPOOJOH#FWFSZ#4333#TG1 CSBDJOH #JO#BDDPSEBODF#X 2#UOJZXUDB#CDTJI +427 %,#Q B O FM#UZ Q F#VO E FS MB Z #VO E FS #S FTJNJFO U#) #Q B S R V FU GMPPSJOH1

EXPOSED BUILDING FACE

XBMMT#MFTT#UIBO#8*03 %#GSPN#OSPOFSUZ#MJDF#TIBMM#IBWF#B GJS F#S BUJOH #PG#OP#MFTT#UIBO##IPVS#JO#BDDPSEBODF#XJJI B TUN #F#44< #PS #VM#596#XJUI #FYQPTVSF#GSPN#CPUI #TJEFT OSPKFDULPOT#CFUXFFO#5*03 %#) #8*03 %#GSPN#OSPOFSUZ#MDF#NVTU IBWF#B#SBUODH#PO#UIF#VOEFSTÆF#PG#OP#MFTT#UIBO##IPVS#O BDDPSEBODF#XJJJI#BTUN#F#44<#PS#VM#596 QSPKFDUPOT#MFTT#UIBO#8*03 %#GSPN#QSPQFSUZ#MDF#DBOOPU IBWF#B#WFOUMBUFE#TPGGJU

PQFO.DHT#.D#B#XBMM#MFTT#UIBO#6*03 %#GSPN#QSPQFSUZ#M.DF#BSF OPU#BMMPXFE

PQFO.DHT#D#B#XBMM#CFUXFFO#6*03 %#)#8*03 %#GSPN#UIF#QSPQFSUZ $\texttt{MJDF\#DBOOPU\#FYDFFE\#58(\#PG\#UIF\#NBYJNVN\#XBMM\#BSFB}}$ OFOFUS BUJPOT#MFTT#UIBO#8*03 %#GS PN #UIF#OS POFS UZ #MJDF#N VTU DPNOMZ#XJUI#DVSSFOU#OD#DPEF

X I F S F #C VJME JOH #GB D F #LT #X JUI JO #43 *03 % #P G #O S P O F S UZ #MJOF #B E E 82; %#HZQTVN #CPBSE#VOEFSMBZNFOU#A#TPGGJU

STEMBALL FOUNDATION \$ FOOTING

X T F S F ## S P VO E #CMP P S #TMB C #F V II F O E T #II P P #G B S #B C P W F #G ID 1 HSBEF#GPS#B#NPOPMJDIJD#TMBC#DPOTUSVDU#TUFNXBMM#EFUBJM Q FS #TUS VD UVS B M#FOH JOFFS *T#TQ FD JGJD B UJP OT1

TWO STORY VOLUME SPACES

CBMMPPO#GSBN JOH #QFS #TUS VDUVSBM#FOH JOFFS #0#SFGFS #UP GMP PS #OMB OT

UZO 144#IP VS #S BUFE #OBS UZ XBMM1#S FGFS #UP #E FUBJMT #GPS #UZO F BOE #TO FD T1

WOOD FRAME \$ CONCRETE BLOCK CONSTRUCTION NOTES

41 UFS N JUF#) #E FD B Z #Q S P UFD UJP O

CHEMICAL SOIL TREATMENT

UI F#D P OD FUS B U-P O#S B UF#P G#B Q Q MJD B U-P O#B OE #US FB UN FOU N FUI PE #P G#UI F#UFS N JUD JE F#T I B MM#C F#D P O TJT UF O U#X JUI #B O E OFW FS #MFTT#UIBO#UIF#UFS N JUJD JE F#MBC FM#BOE #TIBMM#C F BOOMFE#BDDPEOH#IP#ITF#TUBOEBSET#PG#ITF#OPSUT DBSPMJDB#EFOBSUNFOU#PG#BHSJDVMUVSF

GJFME #D VUT #O P UD I FT#B OE #E S JMMFE #I P MFT#TI B MM#C F US FB UFE #10 #UI F#GJFME #10 #B D D P S E B O D F #X JUI #B X Q B #N 71

B MM#X P P E #40 #E 45 FD U#D P O UB D U#X JU I #D P O D S F UF #P S #N B T P O S Z GP VOE BUJP O#X B MMT#T I B MM#FJIII FS #C F#O S FTTVS F#IS FB UFF XPPE #D#BDDPSEBODF#XJTT#BXOB#V4#TUBOEBSET#PS OSPUFDUFE #GSPN #DPOUBDU#CZ#BO#BOOSPW FE #JN OFSW JPVT NPJTUVSF#CBSSJFS

51 TFF#TUS VD UVS B M#FOH JDFFS *T#E S B X JDH T#GP S #TUFFM#MJDUFMT TVQQPSUJDH#BOZ#CSJDL#WFOFFS

WINDOWS:

41 N D #FN FS H FOD Z #FTD B O F #X DE P X #P O FO DH #T J FT N D #P G#P OF #FN FS H FOD Z #FTD B O F #X DE P X #S FR #D #FW FS Z TMFFO JOH#SPPN

N D #B S FB #GP S #H S P VOE #GMP P S #FN FS H FOD Z #FTD B Q F POFO.DH #?#813 #T1 IGo1 N D #BSFB #GPS #TFD POE #GMPPS #FN FSH FOD Z #FTD BQF

POFO.DH #?#81:#T1 1Go1 N JO JHI FJH I U#E JN FOTJP O #GPS #FN FS H FOD Z #FTD B O F#P O FOJOH #?

N D #X E UI #E JN FOT P O #GPS #FN FS H FOD Z #FTD B Q F #P Q FO JOH ##?

NBY #TJMM#IFJHIU#GPS #FNFSHFODZ#FTDBQF#PQFOJDH##?#77% BCPWF#GMPPS

51 N JOJN VN #X JOE P X #TJMM#I FJH I U

ID #F X FMM.DH #VO.TIT #X T FS F#IT F#P O FO.DH #P G#B O #P O FS B C MF X DEPX #IT #N PSF#UIBO#: 5%#BCPWF#GDIFE#HSBEF#PS TVS GB D F#C FMP X ÆUT F#MP X FTU#O B S U#P G#UT F#D MFB S #P O FO.DH TIBMM#CF#B#N JOJN VN #PG#57 %#BCPWF#UIF#GJOJTIFE#GMPPS1 BOZ#X ODE PX#57 %#PS#MFTT#GSPN#GOOTIFE#GMPPS#TIBMM#CF FR VJQ Q FE #X JUI #B O #P Q FO JO H #MJN JUJO H #E FW JD F1

- 61 GJYFE #H MBTT#SFRVJSFN FOUT-#GJYFE #H MBTT#JT#SFRJ#GPS X JDE PXT#MFTT#UIBO#57 %#BCPWF#GJDJTIFE#GMPPS1
- 71 GMB TT JDH AFFE MB OUT #B OF #X FB UT FS TUS JD O JDH #JD TUB MM BOOSPWFE #DPSSPTJPOOSFTJTUBOU#GMBTIJDH#BU#BMM FY UFS JPS #EPPST#) #X JDEPXT#UP #FY UFOE #UP #UIF#TVS GBDF#PG UT F#FY UFS JPS #X B MM#GJDJTT #PS #X B UFS #S FTJTUJW F#C B S S JFS 1 X JDE P X T#T I B MM#C F#TFB MFE #X JDI #N JD JN VN #R VB MJDZ #P G D B VMI, JDH #IP #C F#B TIIN #Tk \ ^ #< 53 #P S #45: 4#X JII #IFTIJDH #) OFSGPSNBODF#Dq\nn#58#PS#BBNB#Dq\nn#;33#PS#;451 S FD P N N FOE #T L B #53 41
- 81 NBYJN VN #UPMFSBODF#GPS#NBTPOSZ#SPVHI#PQFOJOH#TJ[F= NBTPOSZ#SPVHI#PQFOJOH#EJNFOTJPOT#TIBMM#QSPWJEF#GPS B #X JOEPX #Q FS JN FUFS #TFB MB OU#KP JOU#B #N BY JN VN #PG#427 %#JO
- 91 N JOJN VN #FOFSH Z #D P E F#S FR VJS FN FOUT #GPS #X JOE P X T1 OTUB MMFF #X OF PXT#TIB MM#IBW F#OS POFS UFT#B T#FGG.D FOU BT#X ODE PXT#VTFE #UP #D BMD VMBUF#GPS N #443 3 B 1##X ODE PX QFSGPSNBODF#DSJDFSJB#BSF#DPOUBJDFE#JD#UIF#FOFSHZ HBVHF#VTB2GMB2SFT#DPNQVUFS#QSPHSBN1 m 'a'm #UP #TIFFU#H O 424#GPS #N JOJN VN #OID #TPMBS #IFBU#H BJO DPFGGJDJFOU#TIHD.1 X DEPXT#X JDI#DFSUJGJFE#QFSGPSNBODF#TIBMM#IBWF#UIF OGS D #MB C FM#O S P W JE JOH #VOW B MVF#) #T T H D #IP #S FN B JO #P O #IT F X JDE PX#VOUJN#GJDBM#FOFS HZ#JDTOFDUJP01
- :1 BOZ#HMBTT#PS#X.DEPX#NVTU#CF#UFNOFSFE#UIBU#T= MFTT#UIBO#4; %#BCPWF#GJDJTI#GMPPS1 XJUIJD#93 %#PG#B#UVC#PS#TIPXFS1 X I F S F #O F B S F T U #W F S U D B M#F E H F #AT #X JU I JD #57 % #P G #B #E P P S BOE #C PUUPN #X DE PX #FEH F#T #MFTT #UIBO#93 %#BCPW F#GMPPS1 PWFS#<#n1a1#PG#HMBTT#BSFB1 MFTT#UIBO#93 %#GSPN#TUBJS#USFBE#PS#MBOEJOH1

GENERAL

- 41 UIF#GPMMPXJOH #XIFSF#OSFTFOU#TIBMM#CF#DBVMLFE/ HBTL FUFE #XFBUIFS OTUS QQFE #PS #PUIFS XJTF#TFBMFE #XJUI BO#BJS#CBSSJFS#NBUFSJBM=
 - B1 CMPDL JOH #BOE #TFB MJOH #GMPPS #2#D FJMJOH #TZ TUFN T#BOE VOE FS #LOFF#XBMMT#PQFO#UP#VODPOEJUPOFE#PS FYUFS PS #TO BD F
 - C 1 DBQQ JOH #BOE #TFB MJOH #TIB GUT#PS #DIB TFT#JOD MVE JOH GMVF#TTRGIIT
- D 1 D B Q Q JOH #B OE #TFB MJOH #TP GGJU#P S #E S P Q Q FE #D FJMJOH BSFBT
- E 1 UPO #BOE #C PUUPN #OMBUFT
- 51 Q FOFUS B U.P OT #X JMM#C F#TFB MFE #X JUI #B #Q S PE VD U#UI B U#N FFUT B TUN #F44< #\GJC FS H MB TT #\DTVMB UJP O #\JT #\O P U#\Q FS N JUUFE #\JP TFB M#B OZ #Q FOFUS B UJP OT1
- 61 H VB S F T#T I B MM#C F#MP D B IIFF #B MP OH #P O FOOT F F F #X B MI . TO H TVS GB D FT #LOD MVE JOH #GMP P S FE #B UUJD #B S FB T1



MATTAMY HOMES CHARLOTTE DIVISION PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

SU

AR

REDWOOD NORTH

21901789

RH

11/01/2021

MATTAMY HOME

CAR

GENERAL NOTES

North Carolina INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT

	(note a)									
CLIMATE ZONE	FENESTRATION U-FACTOR (notes b, j)	SKYLIGHT U-FACTOR (note b)	GLAZED FENESTRATION SHGC (notes b, k)	CEILING R-VALUE (note m)	WOOD FRAME WALL R-VALUE	MASS WALL <i>R</i> -VALUE (note i)	FLOOR R-VALUE	BASEMENT WALL R-VALUE (notes c, o)	SLAB R-VALUE AND DEPTH (note d)	CRAWL SPACE WALL R-VALUE (note c)
3	0.35	0.55	0.30	38 or 30ci	15 or 13 + 2.5 (note h)	5/13 or 5/10ci	19	5/13 (note f)	0	5/13
4	0.35	0.55	0.30	38 or 30ci	15 or 13 + 2.5 (note h)	5/13 or 5/10ci	19	10/15	10	10/15
5	0.35	0.55	NR	38 or 30ci	19 (note n) or 13 + 5 or 15 + 3 (note h)	13/17 or 13/12.5ci	30 (note g)	10/15	10	10/19

- a. R-VALUES ARE MINIMUMS. U-FACTORS AND SHGC ARE MAXIMUMS.
- b. THE FENESTRATION *U*-FACTOR COLUMN EXCLUDES SKYLIGHTS. THE SHGC COLUMN APPLIES TO ALL GLAZED FENESTRATION.
- c. "10/15" MEANS R-10 CONTINUOUS INSULATED SHEATHING ON THE INTERIOR OR EXTERIOR OF THE HOME OR R-15 CAVITY INSULATION AT THE INTERIOR OF THE BASEMENT WALL OR CRAWL SPACE WALL.
- d. R-5 SHALL BE ADDED TO THE REQUIRED SLAB EDGE R-VALUES FOR HEATED SLABS. FOR MONOLITHIC SLABS, INSULATION SHALL BE APPLIED FROM THE INSPECTION GAP DOWNWARD TO THE BOTTOM OF THE FOOTING OR A MAXIMUM OF 24 INCHES BELOW GRADE, WHICHEVER IS LESS. FOR FLOATING SLABS, INSULATION SHALL EXTEND TO THE BOTTOM OF THE FOUNDATION WALL OR 24", WHICHEVER IS LESS.
- . NOT USEI
- f. BASEMENT WALL INSULATION IS NOT REQUIRED IN WARM-HUMID LOCATIONS AS DEFINED BY FIGURE N1101.7 AND TABLE N1101.7.
- g. OR INSULATION SUFFICIENT TO FILL THE FRAMING CAVITY, R-19 MINIMUM.
- h. THE FIRST VALUE IS CAVITY INSULATION, THE SECOND VALUE IS CONTINUOUS INSULATION, SO "13 + 5" MEANS R-13 CAVITY INSULATION PLUS R-5 CONTINUOUS INSULATION. IF STRUCTURAL SHEATHING COVERS 25 PERCENT OR LESS OF THE EXTERIOR, INSULATING SHEATHING IS NOT REQUIRED WHERE STRUCTURAL SHEATHING IS USED. IF STRUCTURAL SHEATHING COVERS MORE THAN 25 PERCENT OF EXTERIOR, STRUCTURAL SHEATHING SHALL BE SUPPLEMENTED WITH INSULATED SHEATHING OF AT LEAST R-2.

- THE SECOND R-VALUE APPLIES WHEN MORE THAN HALF THE INSULATION IS ON THE INTERIOR OF THE MASS WALL.
- j. IN ADDITION TO THE EXEMPTION IN SECTION N1102.3.3, A MAXIMUM OF TWO GLAZED FENESTRATION PRODUCT ASSEMBLIES HAVING A U-FACTOR NO GREATER THAN 0.55 SHALL BE PERMITTED TO BE SUBSTITUTED FOR MINIMUM CODE COMPLIANT FENESTRATION PRODUCT ASSEMBLIES WITHOUT PENALTY.
- k. IN ADDITION TO THE EXEMPTION IN SECTION N1102.3.3, A MAXIMUM OF TWO GLAZED FENESTRATION PRODUCT ASSEMBLIES HAVING A SHGC NO GREATER THAN 0.70 SHALL BE PERMITTED TO BE SUBSTITUTED FOR MINIMUM CODE COMPLIANT FENESTRATION PRODUCT ASSEMBLIES WITHOUT PENALTY.
- I. R-30 SHALL BE DEEMED TO SATISFY THE CEILING INSULATION REQUIREMENT WHEREVER THE FULL HEIGHT OF UNCOMPRESSED R-30 INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES. OTHERWISE R-38 INSULATION IS REQUIRED WHERE ADEQUATE CLEARANCE EXISTS OR INSULATION MUST EXTEND TO EITHER THE INSULATION BAFFLE OR WITHIN 1" OF THE ATTIC ROOF DECK.
- m. TABLE VALUE REQUIRED EXCEPT FOR ROOF EDGE WHERE THE SPACE IS LIMITED BY THE PITCH OF THE ROOF, THERE THE INSULATION MUST FILL THE SPACE UP TO THE AIR BAFFLE.
- n. R-19 FIBERGLASS BATTS COMPRESSED AND INSTALLED IN A NOMINAL 2x6 FRAMING CAVITY IS DEEMED TO COMPLY. FIBERGLASS BATTS RATED R-19 OR HIGHER COMPRESSED AND INSTALLED IN A 2x4 WALL IS NOT DEEMED TO COMPLY.
- o. BASEMENT WALL MEETING THE MINIMUM MASS WALL SPECIFIC HEAT CONTENT REQUIREMENT MAY USE THE MASS WALL R-VALUE AS THE MINIMUM REQUIREMENT.



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES
RALEIGH DIVISION
PH: 919-752-4898

S CONSUÍTIOS
SIGN - ENGINEERING - SURVEYING - ENERGY
SERSEY CT. RALEIGH, NO 27617 919 480, 1075

DS Consulting PLLC; 8600 'D' JERS INFO@JDSCONSULTING.NI

PER, OR AS NOTED

AROLINA

REDWOOD - RH

PROJE

NO.: **21901789**

DATE: 11/01/2021

MATTAMY HOMES

CAR

GENERAL NOTES

GN1.1

USE CORROSION-RESISTANT FLASHING AT ALL ROOF-TO-WALL INTERSECTIONS



FRONT ELEVATION - CRAFTSMAN



REAR SIDE ELEVATION - CRAFTSMAN

mattamyHoMES

MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

DS CONSULTING

NA

REDWOOD - RH
ANDRE

TNO.: **21901789**


DATE: 11/01/2021

CAR


EXTERIOR ELEVATIONS

0.10



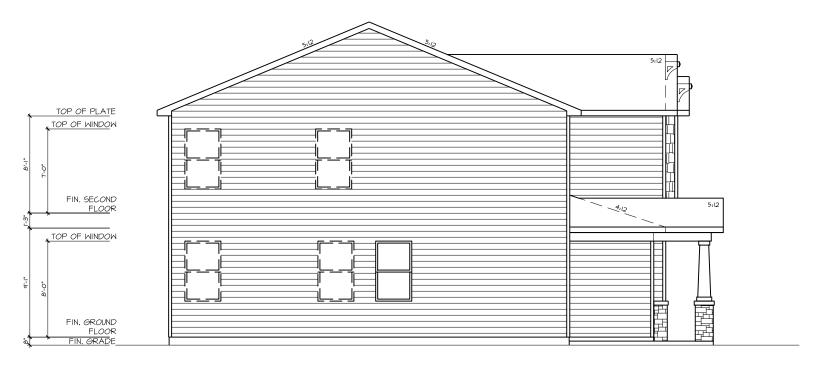

LEFT SIDE ELEVATION - CRAFTSMAN

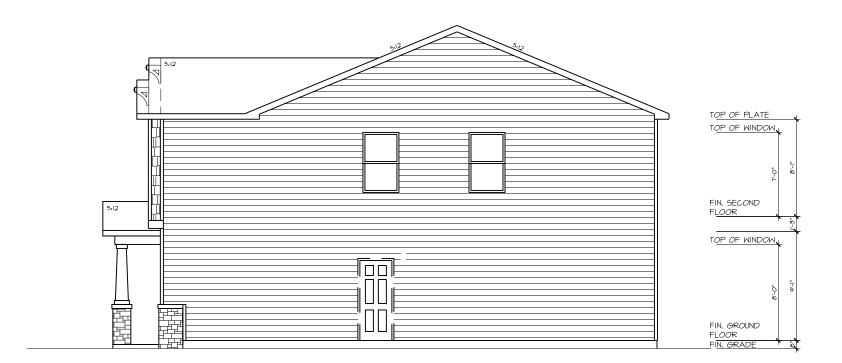

RIGHT SIDE ELEVATION - CRAFTSMAN

mattamyHOMES

MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

ODSUBLING SURVEYING - ENERGY

REDWOOD - RH

21901789

11/01/2021

MATTAMY HOMES

DRAWN BY: **CAR**

EXTERIOR ELEVATIONS

USE CORROSION-RESISTANT FLASHING AT ALL ROOF-TO-WALL INTERSECTIONS



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898



JDS Consulting PLLC; 8600 'D' JERSEY CT, RALEIGH, NC INFO@IDSCONSULTING.NET; WWW.JDSCONSULTING.NET; WWW.JDSCONSULTING.NET INBLE FOR CHANGES MAI CONSTRUCTION METHODS OR ANY CHANGES OF PLAN BY CONTRACTOR, OR BY OTHERS, DRAWINGS ARE PRO

NORTH CAROLINA

REDWOOD - RH

NO.: 21901789

DATE: 11/01/2021


MATTAMY HOMES

DRAWN BY:


CAR

EXTERIOR ELEVATIONS


0.12

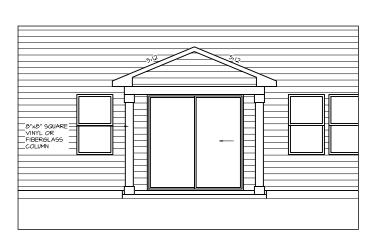





COVERED PORCH PPO - RIGHT ELEVATION

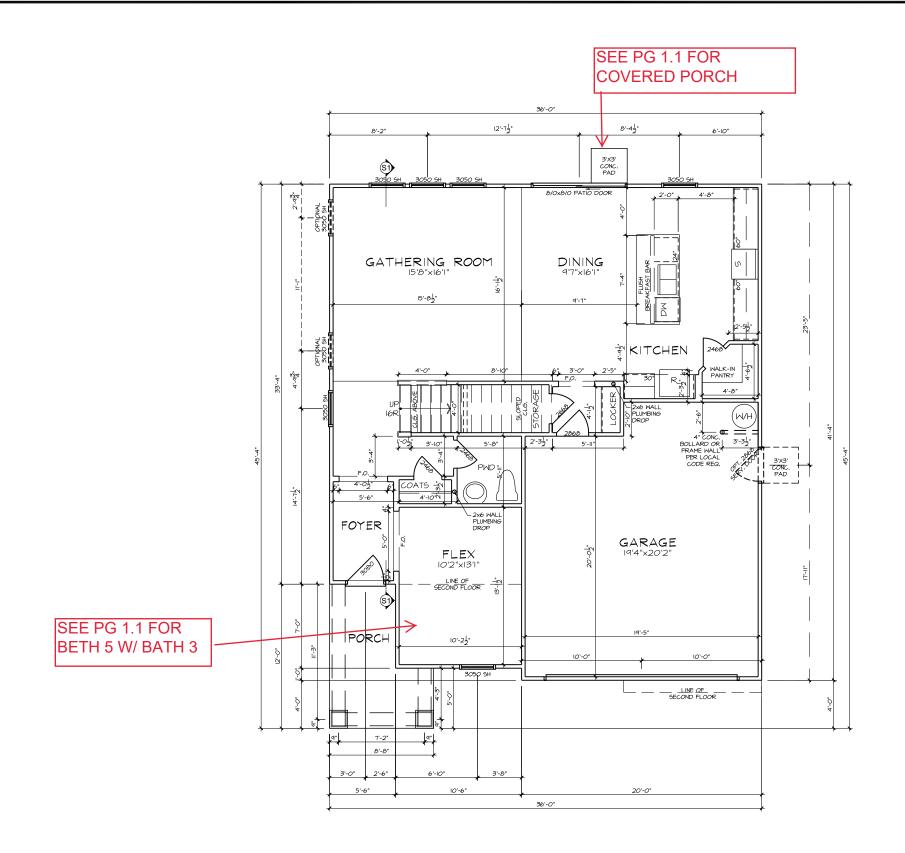

GROUND FLOOR PLAN - CRAFTSMAN

FLOOR PLAN NOTES

- ALL FRAMED OPENINGS (F.O.) @ 80" ON 1ST & 96" ON 2ND U.N.O.
- ON 2ND U.N.Y. 4 SHELVES MAX. @ ALL LINEN & PANTRIES. INSTALL HOUSE WRAP AT ALL ATTIC WALLS NEXT TO HEATED SPACES I.L.O. T-PLY.
- REFER TO GARAGE FRAMING DETAIL ON SHT.
- DTA3 FOR GOAL POST FRAMING.
 ALL STUD POCKETS TO BE 4 1/2" (3) STUDS U.N.O.
 ALL STUDS BEHIND SHOWER STALLS @ 16" O.C.



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

Onsulting

MATTAMY HOMES

AROLINA NORTH

21901789


- RH

REDWOOD

11/01/2021

CAR

FIRST FLOOR PLAN

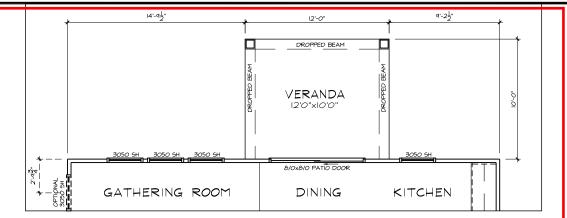

PPO - GROUND FLOOR PLAN COVERED VERANDA

FLOOR PLAN NOTES

- ALL FRAMED OPENINGS (F.O.) @ 80" ON 1ST & 96" ON 2ND U.N.O.
- A SHELVES MAX. @ ALL LINEN & PANTRIES.
 INSTALL HOUSE WRAP AT ALL ATTIC WALLS NEXT
 TO HEATED SPACES I.L.O. T-PLY.
- REFER TO GARAGE FRAMING DETAIL ON SHT.
- DTA3 FOR GOAL POST FRAMING.
 ALL STUD POCKETS TO BE 4 1/2" (3) STUDS U.N.O.
 ALL STUDS BEHIND SHOWER STALLS @ 16" O.C.



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

CONSULTING ENERGY

MATTAMY HOMES

- RH REDWOOD

NORTH


21901789

11/01/2021

CAR


CAROLINA

FIRST FLOOR OPTIONS FLOOR PLANS

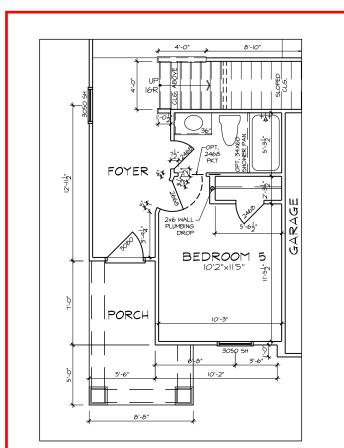

PPO - GROUND FLOOR PLAN BED 5/BATH 3 I.L.O. FLEX CRAFTSMAN

SEE PG 2.1 FOR BATH OASIS

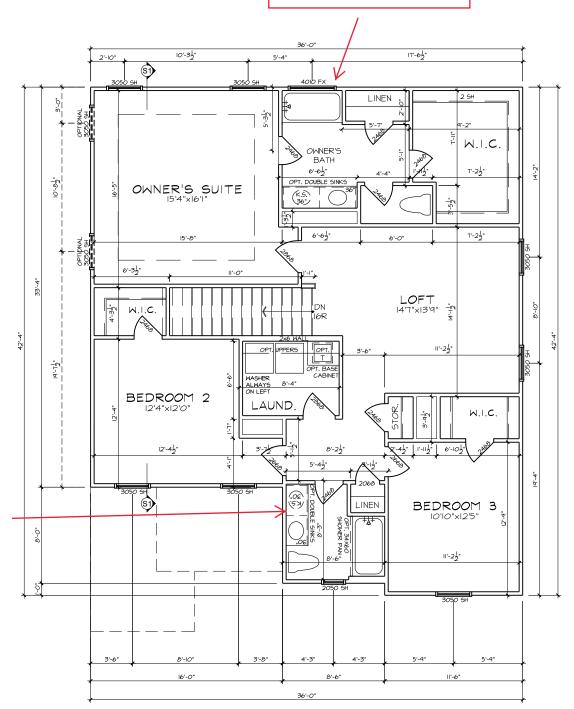

DOUBLE SINKS IN BATH 2

SECOND FLOOR PLAN - CRAFTSMAN

FLOOR PLAN NOTES

- ALL FRAMED OPENINGS (F.O.) @ 80" ON 1ST & 96" ON 2ND U.N.O.
- ON 2ND U.N.O.
 4 SHELVES MAX. @ ALL LINEN & PANTRIES.
 INSTALL HOUSE WRAP AT ALL ATTIC WALLS NEXT
 TO HEATED SPACES I.L.O. T-PLY.
- REFER TO GARAGE FRAMING DETAIL ON SHT.
- DTA3 FOR GOAL POST FRAMING.
 ALL STUD POCKETS TO BE 4 1/2" (3) STUDS U.N.O.
 ALL STUDS BEHIND SHOWER STALLS @ 16" O.C.



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898

CONSULTING ENERGY

CAROLINA

REDWOOD NORTH

21901789

- RH

11/01/2021

MATTAMY HOMES

DRAWN BY: CAR

SECOND FLOOR PLAN

2'-6" 4040 FX TEMP

PPO - SECOND FLOOR PLAN BATH OASIS

FLOOR PLAN NOTES

- ALL FRAMED OPENINGS (F.O.) @ 80" ON 1ST & 96" ON 2ND U.N.O.
- 4 SHELVES MAX. @ ALL LINEN & PANTRIES.
 INSTALL HOUSE WRAP AT ALL ATTIC WALLS NEXT
- TO HEATED SPACES I.L.O. T-PLY.
 REFER TO GARAGE FRAMING DETAIL ON SHT.
 DTA3 FOR GOAL POST FRAMING.

- ALL STUD POCKETS TO BE 4 1/2" (3) STUDS U.N.O. ALL STUDS BEHIND SHOWER STALLS @ 16" O.C.



MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES RALEIGH DIVISION PH: 919-752-4898



MATTAMY HOMES

- RH REDWOOD

NORTH


21901789


DATE: 11/01/2021


CAR


CAROLINA


SECOND FLOOR OPTIONS FLOOR PLANS














mattamyHOMES

MATTAMY HOMES
CHARLOTTE DIVISION
PH: 704-375-9373

MATTAMY HOMES
RALEIGH DIVISION
PH: 919-752-4898

JDS CONSULTING
DESIGN - ENGINEERING - SURVEYING - ENERGY

JDS Consulting PLLC IS NOT LIABL CONSTRUCTION METHODS OR AN BY CONTRACTOR OR BY OTHERS THE LOT MINARED BRODEDTY OF

= 1'-0" FOR 22x34 PAPER, OR AS NOTE

NORTH CAROLINA

21901789

- RH

REDWOOD

DATE: DRA 11/01/2021

MATTAMY HOMES

/01/2021 CAR

SECTIONS & DETAILS

4.0

STRUCTURAL PLANS FOR:



MATTAMY HOMES - REDWOOD RH

PLAN RELEASE / REVISIONS						
REV. DATE	ARCH PLAN VERSION	REVISION DESCRIPTION	DRFT			
			+			

NOTES

- 1. ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT, INCLUDING ROOF GEOMETRY. JDS Consulting, PLLC ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THE PLANS. ENGINEER TO BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE PLANS.
- DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS.
- 3. PLANS MUST HAVE SIGNED SEAL TO BE VALID AND ARE LIMITED TO THE FOLLOWING USES:
- A. IF THESE PLANS ARE ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR 18 MONTHS FROM THE DATE ON THE SEAL, UNLESS ANY CODE-REQUIRED UPDATES ARE PLACED IN EFFECT BY THE MUNICIPALITY.
- B. IF THESE PLANS ARE NOT ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR A CONDITIONAL, ONE-TIME USE FOR THE LOT OR ADDRESS SPECIFIED ON THE TITLE BLOCK


CODE

ALL CONSTRUCTION, WORKMANSHIP, AND MATERIAL QUALITY AND SELECTION SHALL BE PER:

2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE

ENGINEER OF RECORD

JDS Consulting, PLLC
ENGINEERING - DESIGN - ENERGY - SURVEYING
8600 'D' JERSEY COURT
RALEIGH, NC 27617
FIRM LIC. NO: P-0961
PROJECT REFERENCE: 21901789



P-0961



JDS Consulting PI CONSTRUCTION BY CONTRACTO THE LOT NUMBE

ROLINA

REDWOOD -



ROJECT NO.: **21901789**

DATE: 10/27/2021

21 DRAWN BY:

TITLE SHEET

SN1.0

NOTE: ALL CHAPTERS, SECTIONS, TABLES, AND FIGURES CITED WITHOUT A PUBLICATION TITLE ARE FROM THE APPLICABLE RESIDENTIAL CODE (SEE TITLE SHEET).

GENERAL

- 1. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. FURTHERMORE, CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, AND SAFETY ON SITE. NOTIFY JDS Consulting, PLLC IMMEDIATELY IF DISCREPANCIES ON PLAN EXIST.
- BRACED-WALL DESIGN IS BASED ON SECTION ROBE. 18 WALL
 BRACING. PRIMARY PRESCRIPTIVE METHOD TO BE CS-WSP. SEE
 WALL BRACING PLANS AND DETAILS FOR ADDITIONAL
 INFORMATION.

ALL NON-PRESCRIPTIVE SOLUTIONS ARE BASED ON GUIDELINES ESTABLISHED IN THE AMERICAN SOCIETY OF CIVIL ENGINEERS PUBLICATION ASCE 7 AND THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION - SPECIAL DESIGN PROVISIONS FOR WIND AND SEISMIC.

В

200 (pounds, concentrated)

SEISMIC DESIGN SHALL BE PER SECTION ROOM 22 - SEISMIC
PROVISIONS, INCLUDING ASSOCIATED TABLES AND FIGURES,
BASED ON LOCAL SEISMIC DESIGN CATEGORY.

DESIGN LOADS

FIRE ESCAPES
GUARDS AND HANDRAILS

ASSUMED SOIL BEARING-CAPACITY 2,000 PSF

	LIVE LEAD
ULTIMATE DESIGN WIND SPEED	115 MPH, EXPOSURE
GROUND SNOW	15 PSF
ROOF	20 PSF
RESIDENTIAL CODE TABLE R301.6	LIVE LOAD (PSF)
DWELLING UNITS	40
SLEEPING ROOMS	30
ATTICS WITH STORAGE	20
ATTICS WITHOUT STORAGE	10
STAIRS	40
DECKS	40
EXTERIOR BALCONIES	60
PASSENGER VEHICLE GARAGES	50

COMPONENT AND CLADDING LOADS, INCLUDING THOSE FOR DOORS AND WINDOWS, SHALL BE DERIVED FROM TABLES R301.222 AND R301.235 FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 35 FEET, LOCATED IN EXPOSURE B.

ABBREVIATI O NS			KS	KING STUD COLUMN
		<u> </u>	LVL	LAMINATED VENEER
	ABV	ABOVE		LUMBER
	AFF	ABOVE FINISHED FLOOR	MAX	MAXIMUM
	ALT	ALTERNATE	MECH	MECHANICAL
	BRG	BEARING	MFTR	MANUFACTURER
	BSMT	BASEMENT	MIN	MINIMUM
	CANT	CANTILEVER	NTS	NOT TO SCALE
	CJ	CEILING JOIST	OA	OVERALL
	CLG	CEILING	ОС	ON CENTER
	CMU	CONCRETE MASONRY UNIT	PT	PRESSURE TREATED
	co	CASED OPENING	R	RISER
	COL	COLUMN	REF	REFRIGERATOR
	CONC	CONCRETE	RFG	ROOFING
	CONT	CONTINUOUS	RO	ROUGH OPENING
	D	CLOTHES DRYER	RS	ROOF SUPPORT
	DBL	DOUBLE	sc	STUD COLUMN
	DIAM	DIAMETER	SF	SQUARE FOOT (FEET)
	DJ	DOUBLE JOIST	SH	SHELF / SHELVES
	DN	DOWN	SHTG	SHEATHING
	DP	DEEP	SHW	SHOWER
	DR	DOUBLE RAFTER	SIM	SIMILAR
	DSP	DOUBLE STUD POCKET	SJ	SINGLE JOIST
	EA	EACH	SP	STUD POCKET
	EE	EACH END		SPECIFIED
	EQ	EQUAL	SQ	SQUARE
	EX	EXTERIOR	T	TREAD
	FAU	FORCED-AIR UNIT	TEMP	TEMPERED GLASS
	FDN	FOUNDATION	THK	THICK(NESS)
	FF	FINISHED FLOOR	TJ	TRIPLE JOIST
	FLR	FLOOR(ING)	TOC	TOP OF CURB / CONCRETE
	FP	FIREPLACE	TR	TRIPLE RAFTER
	FTG	FOOTING	TYP	TYPICAL
	НВ		UNO	UNLESS NOTED OTHERWISE
	HDR		W WH	CLOTHES WASHER
	HGR	HANGER	WH WWF	WATER HEATER
	JS	JACK STUD COLUMN		
			XJ	EXTRA JOIST

MATERIALS

 INTERIOR / TRIMMED FRAMING LUMBER SHALL BE #2 SPRUCE PINE FIR (SPF) WITH THE FOLLOWING DESIGN PROPERTIES (#2 SOUTHERN YELLOW PINE MAY BE SUBSTITUTED):

Fb = 875 PSI Fv = 70 PSI E = 1.4E6 PSI

 FRAMING LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND, CONCRETE, OR MASONRY SHALL BE PRESSURE TREATED #2 SOUTHERN YELLOW PINE (SYP) WITH THE FOLLOWING DESIGN PROPERTIES:

Fb = 975 PSI Fv = 95 PSI E = 1.6E6 PSI

3. LVL STRUCTURAL MEMBERS TO BE LAMINATED VENEER LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2600 PSI Fv = 285 PSI F = 1.9F6 PSI

4. PSL STRUCTURAL MEMBERS TO BE PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2900 PSI Fv = 290 PSI E = 2.0E6 PSI

5. LSL STRUCTURAL MEMBERS TO BE LAMINATED STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2250 PSI Fv = 400 PSI E = 1.55E6 PSI

- STRUCTURAL STEEL WIDE-FLANGE BEAMS SHALL CONFORM TO ASTM A992. Fy = 50 KSI
- REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615, GRADE 60.
- 8. POURED CONCRETE COMPRESSIVE STRENGTH TO BE A MINIMUM 3,000 PSI AT 28 DAYS. MATERIALS USED TO PRODUCE CONCRETE SHALL COMPLY WITH THE APPLICABLE STANDARDS LISTED IN AMERICAN CONCRETE INSTITUTE STANDARD ACI 318 OR ASTM
- 9. CONCRETE SUBJECT TO MODERATE OR SEVERE WEATHERING PROBABILITY PER TABLE R301.2(1) SHALL BE AIR-ENTRAINED WHEN REQUIRED BY TABLE R402.2.
- 10. CONCRETE MASONRY UNITS (CMU) SHALL CONFORM TO AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES
- 11. MORTAR SHALL COMPLY WITH ASTM INTERNATIONAL STANDARD C270.
- 12. INDICATED MODEL NUMBERS FOR ALL METAL HANGERS, STRAPS, FRAMING CONNECTORS, AND HOLD-DOWNS ARE SIMPSON STRONG-TIE BRAND. EQUIVALENT USP BRAND PRODUCTS ARE ACCEPTABLE.
- 13. REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES.

FOUNDATION

- MINIMUM ALLOWABLE SOIL BEARING CAPACITY IS ASSUMED TO BE 2,000 PSF. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY SOIL BEARING CAPACITY IF UNSATISFACTORY CONDITIONS EYIST
- 2. CONCRETE FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION R464 OR AMERICAN CONCRETE INSTITUTE STANDARD ACI 318.
- 3. MASONRY FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION RADA AND/OR AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND/OR THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- 4. CONCRETE WALL HORIZONTAL REINFORCEMENT TO BE PER
 TABLE R494.1.2(1) OR AS NOTED OR DETAILED. CONCRETE WALL
 VERTICAL REINFORCEMENT TO BE PER TABLES R494.1.2(3) AND 49
 OR AS NOTED OR DETAILED. ALL CONCRETE WALLS SHALL
 COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
 - B. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R405
- PLAIN-MASONRY WALL DESIGN TO BE PER TABLE P484.1.111 OR AS NOTED OR DETAILED. MASONRY WALLS WITH VERTICAL REINFORCEMENT TO BE PER TABLES P484.1.12 THROUGH 4 OR AS NOTED OR DETAILED. ALL MASONRY WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 1
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
- WALL REINFORCING SHALL BE PLACED ACCORDING TO FOOTNOTE (c) OF THE TABLES (REINFORCING IS NOT CENTERED IN WALL).
 FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER
- C. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R485.
- WOOD SILL PLATES TO BE ANCHORED TO THE FOUNDATION WITH 1/2" DIAMETER ANCHOR BOLTS WITH MINIMUM 7" EMBEDMENT, SPACED A MAXIMUM OF 6'-0" OC AND WITHIN 12" FROM THE ENDS OF EACH PLATE SECTION. INSTALL MINIMUM (2) ANCHOR BOLTS PER SECTION. SEE SECTION FAIST.1.5 FOR SPECIFIC CONDITIONS.
- 7. THE UNSUPPORTED HEIGHT OF SOLID MASONRY PIERS SHALL NOT EXCEED TEN TIMES THEIR LEAST DIMENSION. UNFILLED, HOLLOW PIERS MAY BE USED IF THE UNSUPPORTED HEIGHT IS NOT MORE THAN FOUR TIMES THEIR LEAST DIMENSION.
- 8. CENTERS OF PIERS TO BEAR IN THE MIDDLE THIRD OF THE FOOTINGS, AND GIRDERS SHALL CENTER IN THE MIDDLE THIRD OF THE PIERS.
- 9. ALL FOOTINGS TO HAVE MINIMUM 2" PROJECTION ON EACH SIDE OF FOUNDATION WALLS (SEE DETAILS).
- 10. ALL REBAR NOTED IN CONCRETE TO HAVE AT LEAST 2" COVER FROM EDGE OF CONCRETE TO EDGE OF REBAR.
- 11. FRAMING TO BE FLUSH WITH FOUNDATION WALLS.
- 12. WITH CLASS 1 SOILS, VAPOR BARRIER AND CRUSHED STONE MAY BE OMITTED.

FRAMING

- ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED W/ MIN (1) JACK STUD AND (1) KING STUD EACH END, UNO.
- 2. ALL NON-BEARING HEADERS TO BE (2) 2x4, UNO.
- 3. NON-BEARING INTERIOR WALLS NOT MORE THAN 10' NOMINAL HEIGHT AND NOT SHOWN AS BRACED WALLS MAY BE FRAMED WITH 2x4 STUDS @ 24" OC.
- SOLID BLOCKING TO BE PROVIDED AT ALL POINT LOADS THROUGH FLOOR LEVELS TO THE FOUNDATION OR TO OTHER STRUCTURAL COMPONENTS.
- 5. ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION.
- 6. ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.
- 7. PORCH / PATIO COLUMNS TO BE 4x4 MINIMUM PRESSURE-TREATED
 - A. ATTACH PORCH COLUMNS TO SLAB / FDN WALL USING ABA, ABU, ABW, OR CPT SIMPSON POST BASES TO FIT COLUMN SIZES NOTED ON PLAN -OR-ANY OTHER COLUMN CONNECTION WITH 500# LIPLIET CAPACITY.
 - B. ATTACH PORCH COLUMNS TO PORCH BEAMS USING AC OR BC SIMPSON POST CAPS TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500# UPLIFT CAPACITY.
 - C. TRIM OUT COLUMN(S) AND BEAM(S) PER BUILDER AND DETAILS.
- 8. ALL ENGINEERED WOOD PRODUCTS (LVL, PSL, LSL, ETC.) SHALL BE INSTALLED WITH CONNECTIONS PER MANUFACTURER SPECIFICATIONS.
- ENGINEERED WOOD FLOOR SYSTEMS AND ROOF TRUSS SYSTEMS:
 A. SHOP DRAWINGS FOR THE SYSTEMS SHALL BE PROVIDED TO THE ENGINEER OF RECORD FOR REVIEW AND COORDINATION BEFORE CONSTRUCTION.
 - B. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER.
 - C. INSTALLATION OF THE SYSTEMS SHALL BE PER MANUFACTURER'S INSTRUCTIONS.
 - D. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN IN THESE DRAWINGS.
- 10. ALL BEAMS TO BE CONTINUOUSLY SUPPORTED LATERALLY AND SHALL BEAR FULL WIDTH ON THE SUPPORTING WALLS OR COLUMNS INDICATED, WITH A MINIMUM OF THREE STUDS, UNO.
- 11. ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MIN BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR TWO 1/2" x 4" LAG SCREWS, UNO.
- 12. STEEL FLITCH BEAMS TO BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM 307) WITH WASHERS PLACED UNDER THE THREADED END OF THE BOLT. BOLTS TO BE SPACED AT 24" OC (MAX) AND STAGGERED TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH TWO BOLTS TO BE LOCATED AT 6" FROM EACH END OF FLITCH BEAM.
- 13. WHEN A 4-PLY LVL BEAM IS USED, ATTACH WITH (1) 1/2" DIAMETER BOLT, 12" OC, STAGGERED TOP AND BOTTOM, 1 1/2" MIN FROM ENDS. ALTERNATE EQUIVALENT ATTACHMENT METHOD MAY BE USED, SUCH AS SDS, SDW, OR TRUSSLOK SCREWS (SEE MANUFACTURER SPECIFICATIONS).
- 14. FOR STUD COLUMNS OF 4-OR-MORE STUDS, INSTALL SIMPSON STRONG-TIE CS16 STRAPS ACROSS STUDS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).
- 15. FLOOR JOISTS ADJACENT AND PARALLEL TO THE EXTERIOR FOUNDATION WALL SHALL BE PROVIDED WITH FULL-DEPTH SOLID BLOCKING, NOT LESS THAN TWO (2) INCHES NOMINAL IN THICKNESS, PLACED PERPENDICULAR TO THE JOIST AT SPACING NOT MORE THAN FOUR (4) FEET. THE BLOCKING SHALL BE NAILED TO THE FLOOR SHEATHING, THE SILL PLATE, THE JOIST, AND THE EXTERIOR RIM JOIST / BOARD.
- 16. BRACED WALL PANELS SHALL BE FASTENED TO MEET THE UPLIFT-RESISTANCE REQUIREMENTS IN CHAPTERS 6 AND 8 OF THE APPLICABLE CODE (SEE TITLE SHEET). REQUIREMENTS OF THE STRUCTURAL DRAWINGS THAT EXCEED THE CODE MINIMUM SHALL BE MET.



P-0961

DS S

O

HOME

ATTAMY



INO CONSTRUCTION METHODS
BY CONTRACTOR OR DATE OF THE CONTRACTOR OF SHEET DIMENSIONS SHA

JDS Cons CONSTR BY CON THE LOT SHOTED

PR 22x34 PAPER, OR AS NC

CAROLINA

REDWOOD
ATTON:
NORTH CA

tamyHomes

RAWN BY

CAR



DJECT NO.: **21901789**

DATE: 10/27/2021

GENERAL NOTES

SN1.1

FASTENER SCHEDULE					
CONNECTION	3" x 0.131" NAIL	3" x 0.120" NAIL			
JOIST TO SILL PLATE	(4) TOE NAILS	(4) TOE NAILS			
SOLE PLATE TO JOIST / BLOCKING	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)			
STUD TO SOLE PLATE	(4) TOE NAILS	(4) TOE NAILS			
TOP OR SOLE PLATE TO STUD	(3) FACE NAILS	(4) FACE NAILS			
RIM JOIST OR BAND JOIST TO TOP PLATE OR SILL PLATE	TOE NAILS @ 6" OC	TOE NAILS @ 4" OC			
BLOCKING BETWEEN JOISTS TO TOP PLATE OR SILL PLATE	(4) TOE NAILS	(4) TOE NAILS			
DOUBLE STUD	NAILS @ 8" OC	NAILS @ 8" OC			
DOUBLE TOP PLATES	NAILS @ 12" OC	NAILS @ 12" OC			
DOUBLE TOP PLATES LAP (24" MIN LAP LENGTH)	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT			
TOP PLATE LAP AT CORNERS AND INTERSECTING WALLS	(3) FACE NAILS	(3) FACE NAILS			
OPEN-WEB TRUSS BOTTOM CHORD TO TOP PLATES OR SILL PLATE (PARALLEL TO WALL)	NAILS @ 6" OC	NAILS @ 4" OC			
BOTTOM CHORD OF TRUSS TO TOP PLATES OR SILL PLATE (PERPENDICULAR TO WALL)	(3) TOE NAILS	(3) TOE NAILS			

SEE TABLE R882.3(1) FOR ADDITIONAL STRUCTURAL-MEMBER FASTENING REQUIREMENTS.

DETAILS AND NOTES ON DRAWINGS GOVERN.

BALLOON WALL FRAMING SCHEDULE (USE THESE STANDARDS UNLESS NOTED OTHERWISE ON THE FRAMING PLAN SHEETS)

FRAMING MEMBER SIZE	MAX HEIGHT (PLATE TO PLATE) 115 MPH ULTIMATE DESIGN WIND SPEED
2x4 @ 16" OC	10'-0"
2x4 @ 12" OC	12'-0"
2x6 @ 16" OC	15'-0"
2x6 @ 12" OC	17'-9"
2v9 @ 46" OC	19'-0"
2x8 @ 16" OC	
2x8 @ 12" OC	22'-0"
(2) 2x4 @ 16" OC	14'-6"
(2) 2x4 @ 12" OC	17'-0"
(2) 2x6 @ 16" OC	21'-6"
(2) 2x6 @ 12" OC	25'-0"
(2) 2 10 (2) 12 00	25 -0
(2) 2x8 @ 16" OC	27'-0"
(2) 2x8 @ 12" OC	31'-0"

- a. ALL HEIGHTS ARE MEASURED SUBFLOOR TO TOP OF WALL PLATE.
- b. WHEN SPLIT-FRAMED WALLS ARE USED FOR HEIGHTS OVER 12', THE CONTRACTOR SHALL ADD 6' MINIMUM OF CS16 COIL STRAPPING (FULLY NAILED), CENTERED OVER THE WALL BREAK.
- c. FINGER-JOINTED MEMBERS MAY BE USED FOR CONTINUOUS HEIGHTS WHERE TRADITIONALLY MILLED LUMBER LENGTHS ARE
- d. FOR GREATER WIND SPEED, SEE ENGINEERED SOLUTION FOR CONDITION IN DRAWINGS.

ROOF SYSTEMS

TRUSSED ROOF - STRUCTURAL NOTES

1. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.



DENOTES OVER-FRAMED AREA

- 3. MINIMUM 7/16" OSB ROOF SHEATHING
- 4. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- 5. MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTION.
- 6. PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 7. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

STICK-FRAMED ROOF - STRUCTURAL NOTES

- PROVIDE 2x4 COLLAR TIES AT 48" OC AT UPPER THIRD OF RAFTERS. UNLESS NOTED OTHERWISE.
- 2. FUR RIDGES FOR FULL RAFTER CONTACT.
- 3. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.




DENOTES OVER-FRAMED AREA

- 5. MINIMUM 7/16" OSB ROOF SHEATHING
- 6. PROVIDE 2x4 RAFTER TIES AT 16" OC AT 45° BETWEEN RAFTERS AND CEILING JOISTS. USE (4) 16d NAILS AT EACH CONNECTION. RAFTER TIES MAY BE SPACED AT 48" OC AT LOCATIONS WHERE NO KNEE WALLS ARE INSTALLED.
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH RAFTER-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 8. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR

BRICK VENEER LINTEL SCHEDULE					
SPAN	STEEL ANGLE SIZE	END BEARING LENGTH			
UP TO 42"	L3-1/2"x3-1/2"x1/4"	8" (MIN. @ EACH END)			
UP TO 72"	L6"x4"x5/16"* (LLV)	8" (MIN. @ EACH END)			
OVER 72" L6"x4"x5/16"* (LLV) ATTACH LINTEL w/ 1/2" THRU BOLT @ 12" OC, 3" FROM EACH END					

* FOR QUEEN BRICK: LINTELS AT THIS CONDITION MAY BE 5"x3-1/2"x5/16"

NOTE: BRICK LINTELS AT SLOPED AREAS TO BE 4"x3-1/2"x1/4" STEEL ANGLE WITH 16D NAILS IN 3/16" HOLES IN 4" ANGLE LEG AT 12" OC TO TRIPLE RAFTER. WHEN THE SLOPE EXCEEDS 4:12 A MINIMUM OF 3"x3"x1/4" PLATES SHALL BE WELDED AT 24" OC ALONG THE STEEL ANGLE.



P-0961



CAROLIN

REDWOOD NORTH

mattamyHOMES


21901789

10/27/2021

MATTAMY HOMES

DRAWN BY CAR

GENERAL NOTES

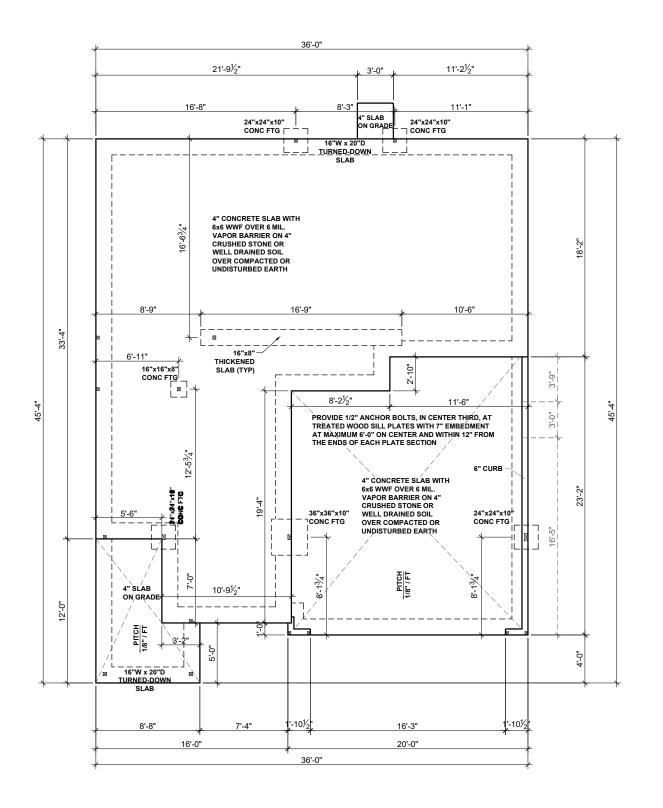

SLAB FOUNDATION PLAN - CRAFTSMAN

SCALE: 1/8"=1'-0"

BEAM & POINT LOAD LEGEND


INTERIOR LOAD BEARING WALL --- ROOF RAFTER / TRUSS SUPPORT ---- DOUBLE RAFTER / DOUBLE JOIST ---- STRUCTURAL BEAM / GIRDER

WINDOW / DOOR HEADER POINT LOAD TRANSFER POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

MAT CLT ONLY: ALL FOOTINGS TO HAVE

CONCRETE SLAS REINFORCING SUSSTITUTION OF SYNTHETIC FIBER MIX IN LIEU OF WWF IN NON STRUCTURAL SLASS:

- NO SUBSTITUTION ALLOWED IN SLABS INSTALLED ON RAISED METAL DECKING NO SUBSTITUTION ALLOWED IN SLABS WITH GRADE BEAMS UNLESS A REBAR MAT IS INSTALLED NO SUBSTITUTION ALLOWED IF ANY SOILS HAVE BEEN FOUND TO BE EXPANSIVE SOILS ON SITE NO SUBSTITUTION ALLOWED FOR SLAB POURS DIRECTLY ON GRADE; A "BASE MATERIAL OF CRUSHED STONE OR WELL DRAINING CLEAN SAND IS REQUIRED FOR SUBSTITUTION NO SUBSTITUTION ALLOWED FOR ANY SITES WITH A DCP BLOW COUNT OF 10 OR LESS. FIBER MIX VOLUMES MUST BE FOLLOWED PER THE MANUFACTURES SPECIFICATIONS



P-0961



CAROLIN REDWOOD

NORTH

mattamyHOMES


21901789

MATTAMY HOMES

10/27/2021

DRAWN BY: CAR

SLAB FOUNDATION PLAN

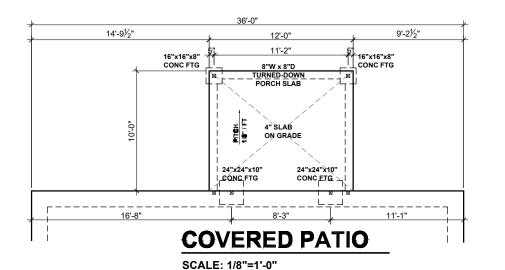


BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL
ROOF RAFTER / TRUSS SUPPORT
DOUBLE RAFTER / DOUBLE JOIST
STRUCTURAL BEAM / GIRDER
WINDOW / DOOR HEADER
POINT LOAD TRANSFER

POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

MAT CLT ONLY: ALL FOOTINGS TO HAVE

SEE FULL PLAN FOR ADDITIONAL INFORMATION



P-0961



Y HOMES

REDWOOD -



21901789


DATE: ID

DATE: DRAWN BY: **10/27/2021** CAR

PLAN OPTIONS
SLAB FOUNDATION PLANS

S.11

SLAB FOUNDATION OPTIONS - CRAFTSMAN

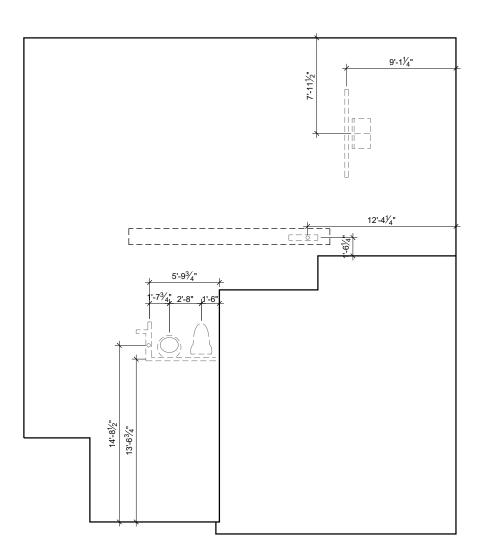

PLUMBING PLAN

SCALE: 1/8"=1'-0"

BEAM & POINT LOAD LEGEND


INTERIOR LOAD BEARING WALL --- ROOF RAFTER / TRUSS SUPPORT ---- DOUBLE RAFTER / DOUBLE JOIST

---- STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER POINT LOAD TRANSFER

POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

MAT CLT ONLY: ALL FOOTINGS TO HAVE CONTINUOUS (2) #4 REBAR.

PLUMBING LINES MAY PASS PEDIMING LINES MAY PASS
PERPENDICULARLY THROUGH THE BOTTOM
THIRD OF A FOOTING IF INSTALLED WITH
APPROPRIATE SLEEVE AND (2) 48" LONG #4
REBAR ARE INSTALLED CENTERED OVER THE SLEEVE.



P-0961



NORTH CAROLINA

REDWOOD

mattamyHOMES


21901789

10/27/2021

MATTAMY HOMES

DRAWN BY: CAR

PLAN OPTIONS SLAB FOUNDATION PLANS




MULTI HEADER DETAIL SINGLE COMMON KING STUD NTS

PLATES AT

AT OUTSIDE

DOUBLE JACK AT PERPENDICULAR

WALL CORNER

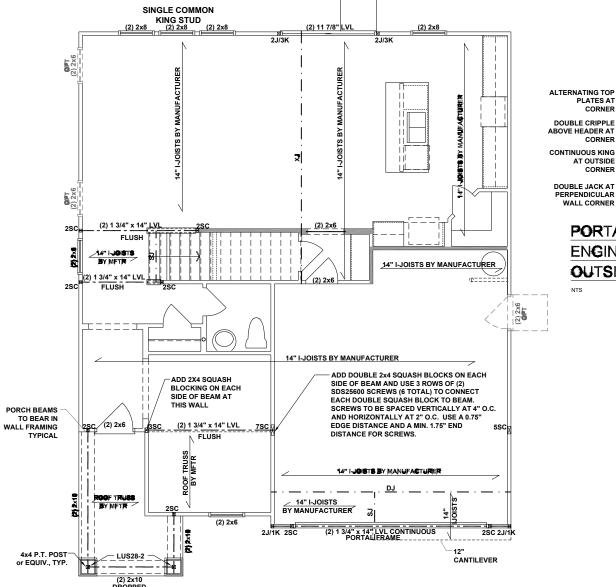

PORTAL FRAMED OR

ENGINEERED OPENING

OUTSIDE CORNER DETAIL

CRIPPLE FOR

HEADER PER

CS16 STRAP AT INSIDE OF WALL

FULL OUTSIDE SHEATHING WITH

NAILING PER PLAN

STRAP CONTINUITY TO

BEAM & POINT LOAD LEGEND INTERIOR LOAD BEARING WALL -- ROOF RAFTER / TRUSS SUPPORT ---- DOUBLE RAFTER / DOUBLE JOIST ---- STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER POINT LOAD TRANSFER POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - 18EE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS 1

- ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- MULTIPLE KING STUDS AS NOTED ON PLAN.
- ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J /
- PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY LARGER MEMBERS MAY SUBSTITUTED AS
 NEEDED FOR EASE OF CONSTRUCTION. MINIMUM
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED
- FRONT PORCH COLUMNS TO BE MIN 4v4 PT ATTACHED AT TOP AND BOTTOM USING SIMPSON (OR EQUIV) COLUMN BASE OR SST A24
- PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO
- WHEN A 4-PLY LVL IS USED. ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM ENDS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS)
- 12. FOR STUD COLUMNS OF 4 OR MORE, INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).


INIOIST SPACING NOT TO EXCEED 19.2" OC IN LOCATIONS WITH TILE FINISH FLOOR

ALL FLUSH BEAMS TO BE DIRECTLY SUPPORTED BY (2) 2X_STUDS UNLESS OTHERWISE NOTED. STUD
COLUMNS TO BE SUPPORTED BY SOLID BLOCKING TO FOUNDATION OR TO BEARING COMPONENT BELOW.

FLOOR FRAMING TO BE 14" DEEP T.II 210 SERIES OR EQUAL, 19.2" OC MAXIMUM SPACING

**REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES

EXTRA JOISTS UNDER ALL NON LOAD BEARING WALLS THAT RUN AT LEAST 30% OF THE JOIST SPAN.



P-0961

REDWOOD



21901789


10/27/2021

HOMES

DRAWN BY CAR

FIRST FLOOR CEILING FRAMING PLAN

FIRST FLOOR CEILING FRAMING PLAN - CRAFTSMAN

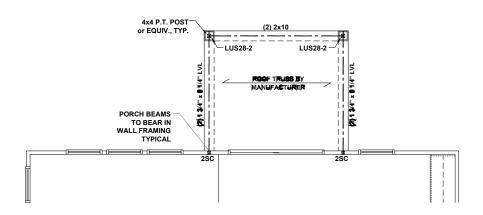

COVERED PATIO

SCALE: 1/8"=1'-0"

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL --- ROOF RAFTER / TRUSS SUPPORT ---- DOUBLE RAFTER / DOUBLE JOIST ---- STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER


POINT LOAD TRANSFER POINT LOAD FROM ABOVE

BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - 18EE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS 1

- ALL FRAMING TO BE #2 SPF MINIMUM.
- 2. ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- MULTIPLE KING STUDS AS NOTED ON PLAN.
- ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J /
- PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION. MINIMUM BEAM SUPPORT IS (1) 2x4 STUD.
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED
- FRONT PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT TOP AND BOTTOM USING SIMPSON (OR EQUIV) COLUMN BASE OR SST A24 BRACKETS. TRIM OUT PER BUILDER.
- 10. PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO PORCH HEADER / BAND.
- 1. WHEN A 4-PLY LVL IS USED, ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM ENDS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS).
- 12. FOR STUD COLUMNS OF 4 OR MORE, INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).

SEE FULL PLAN FOR ADDITIONAL INFORMATION



P-0961

REDWOOD

mattamyHOMES

21901789


DRAWN BY:

10/27/2021

CAR FIRST FLOOR OPTIONS

CEILING FRAMING PLANS

FIRST FLOOR CEILING FRAMING OPTIONS - CRAFTSMAN

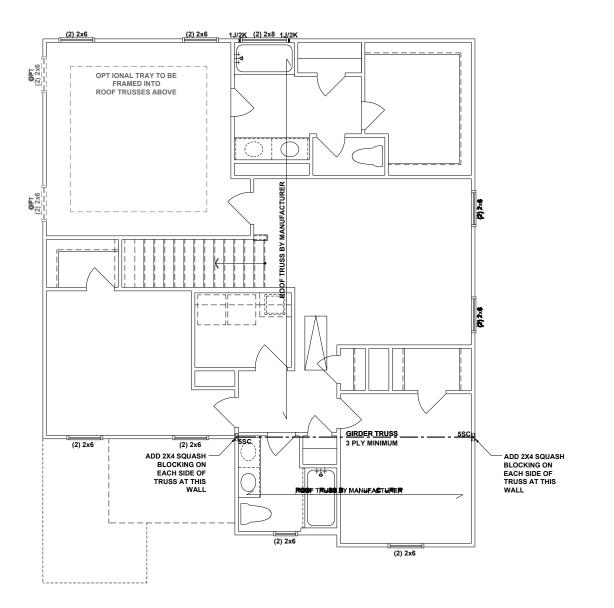

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL --- ROOF RAFTER / TRUSS SUPPORT ---- DOUBLE RAFTER / DOUBLE JOIST ---- STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER


POINT LOAD TRANSFER POINT LOAD FROM ABOVE

BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - 18EE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS 1

- ALL FRAMING TO BE #2 SPF MINIMUM.
- 2. ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- MULTIPLE KING STUDS AS NOTED ON PLAN.
- ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J /
- PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION. MINIMUM
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.
- FRONT PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT TOP AND BOTTOM USING SIMPSON (OR EQUIV) COLUMN BASE OR SST A24
- 10. PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO PORCH HEADER / BAND.
- 1. WHEN A 4-PLY LVL IS USED, ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM ENDS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS).
- 12. FOR STUD COLUMNS OF 4 OR MORE, INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).

ALL FLUSH BEAMS TO BE DIRECTLY SUPPORTED BY (2) 2X_STUDS UNLESS OTHERWISE NOTED. STUD COLUMNS TO BE SUPPORTED BY SOLID BLOCKING TO FOUNDATION OR TO BEARING COMPONENT BELOW.



P-0961



CAROLIN

REDWOOD

mattamyHOMES

21901789

10/27/2021

MATTAMY HOMES

DRAWN BY: CAR

SECOND FLOOR CEILING FRAMING PLAN

SECOND FLOOR CEILING FRAMING PLAN - CRAFTSMAN

SUNROOM, COVERED AND SCREENED PORCH

SCALE: 1/8"=1'-0"

MANUFACTURER


5:12 5:12

THE TOTAL NET-FREE VENTILATION AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF THE ATTIC SPACE TO BE VENTILATED. THE TOTAL VENTILATION MAY BE REDUCED TO 1/300 PROVIDED AT LEAST 50% BUT NOT MORE THAN 80% OF THE REQUIRED VENTILATION BE LOCATED IN THE UPPER PORTION OF THE AREA TO BE VENTILATED, OR AT LEAST 3' ABOVE THE SOFFIT VENTILATION INTAKE.

ATTIC VENTILATION

140 SQUARE FEET OF TOTAL ATTIC / 150 =

__93 SQUARE FEET OF NET-FREE VENTILATION REQUIRED

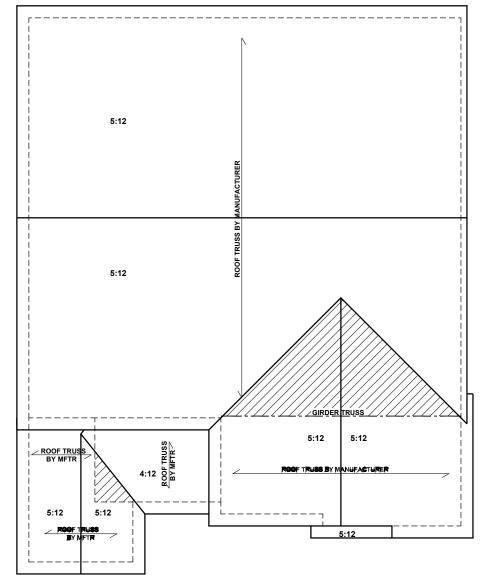

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL

ROOF RAFTER / TRUSS SUPPORT

DOUBLE RAFTER / DOUBLE JOIST

STRUCTURAL BEAM / GIRDER

WINDOW / DOOR HEADER

TRUSSED ROOF - STRUCTURAL NOTES

 PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.

2. DENOTE

DENOTES OVER-FRAMED AREA

- 3. MINIMUM 7/16" OSB ROOF SHEATHING
- 4. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- . MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTION.
- 6. PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

ATTIC VENTILATION

THE TOTAL NET-FREE VENTILATION AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF THE ATTIC SPACE TO BE VENTILATED. THE TOTAL VENTILATION MAY BE REDUCED TO 1/300 PROVIDED AT LEAST 50% BUT NOT MORE THAN 80% OF THE REQUIRED VENTILATION BE LOCATED IN THE UPPER PORTION OF THE AREA TO BE VENTILATED, OR AT LEAST 3' ABOVE THE SOFFIT VENTILATION INTAKE.

1681 SQUARE FEET OF TOTAL ATTIC / 150 =

_____11.2 SQUARE FEET OF NET-FREE VENTILATION REQUIRED

TRUSS UPLIFT CONNECTORS: EXPOSURE B, 116 MPH, ANY PITCH, 24" G.C. MAX ROOF TRUSS SPACING

TRUSSES SHALL BE ATTACHED TO SUPPORT WALL FOR UPLIFT RESISTANCE. CONTINUOUS OSB WALL SHEATHING BELOW PROVIDES CONTINUOUS UPLIFT RESISTANCE TO FOUNDATION. ALL TRUSSES SUPPORTED BY INTERMEDIATE SUPPORT WALLS, KNEEWALLS, OR BEAMS SHALL BE ATTACHED TO SUPPORTING MEMBED DEP SCHEDIU E.

ROOF SPAN IS MEASURED HORIZONTALLY BETWEEN FURTHEST SUPPORT POINTS.

UP TO 28'


OVER 28'

CONNECTOR

NAILING PER TABLE 602.3(1)
NCRBC 2018 EDITION

(1) SIMPSON H2.5A HURRICANE CLIP TO DBL TOP PLATE OR BEAM

OR (1) SIMPSON H3 CLIP TO SINGLE 2x4 PLATE



P-0961

• ENGINEERING • SURVEYING • ENERGY

• TO JERSEY CT. RALEIGH, NC 27617 919.480.1075

LTING, NET; WWW, JDSC ONSULTING, NET

JDS Consulting PLLC IS NOT LI CONSTRUCTION METHODS OR BY CONTRACTOR OR BY CONTRACTOR OF BY

PER. OR AS NOTED

LINA

TH CAROLIN

REDWOOD

LOCATION:

NORTH CAI



21901789


219017


DATE: DRAWN BY: CAR


ROOF FRAMING PLAN


S7.0


ROOF FRAMING PLAN - CRAFTSMAN

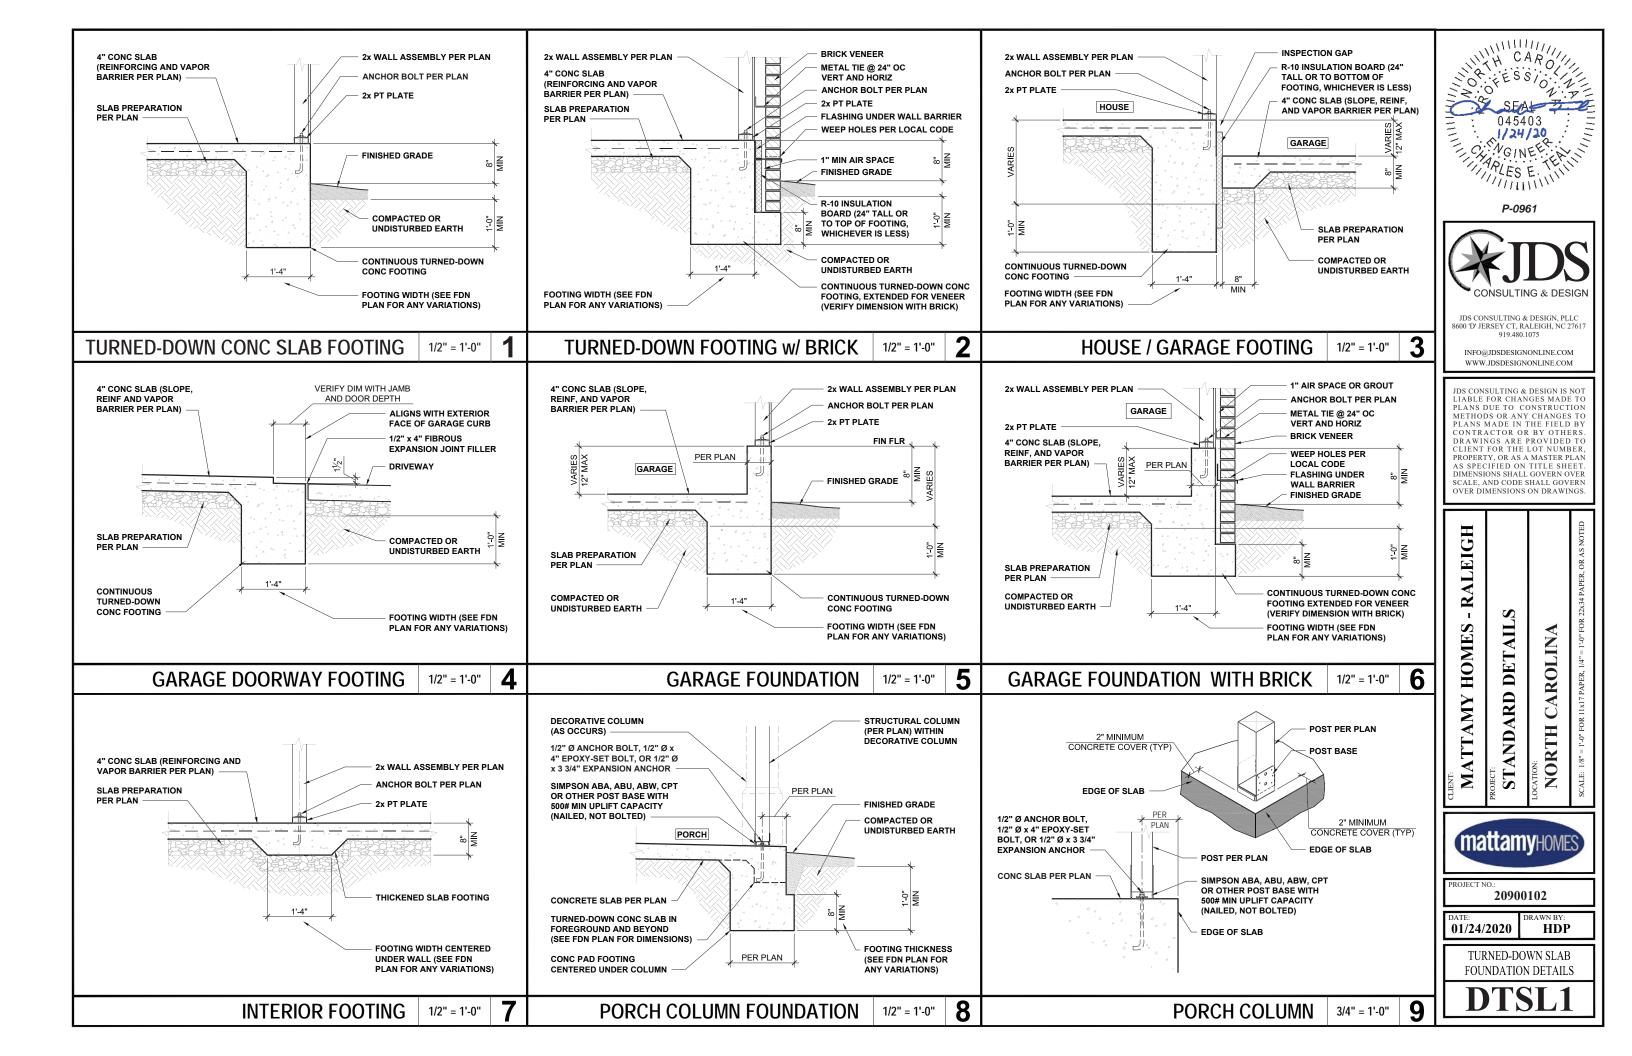


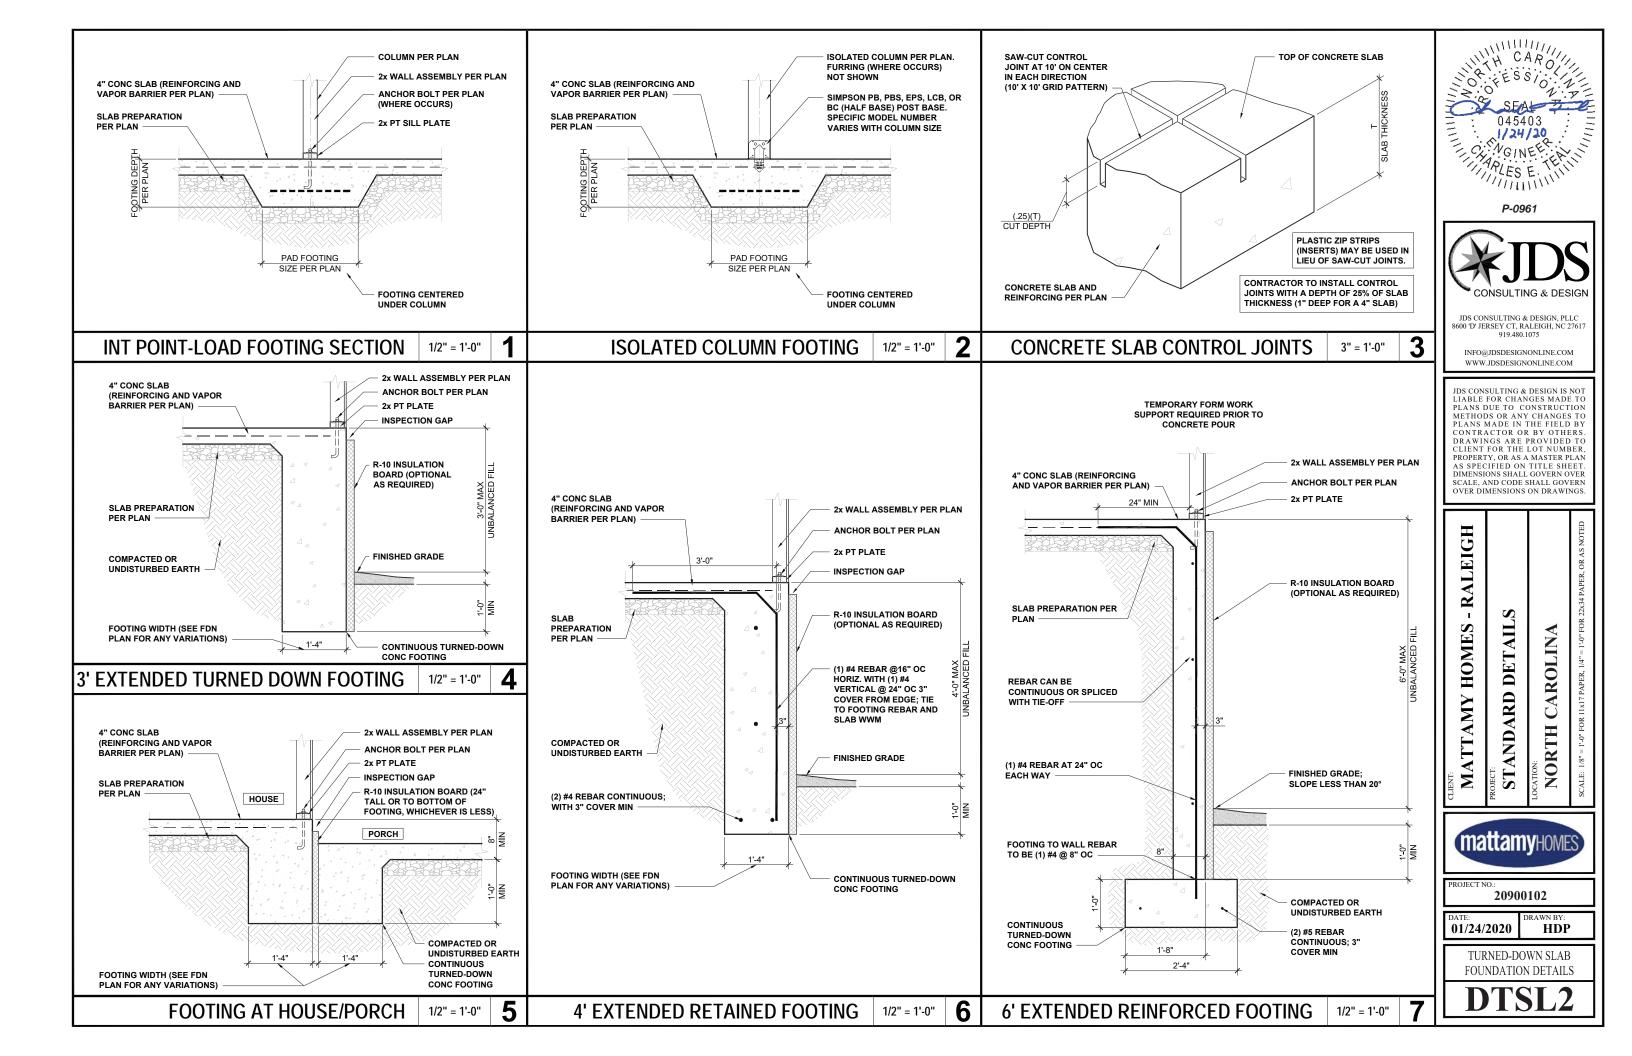


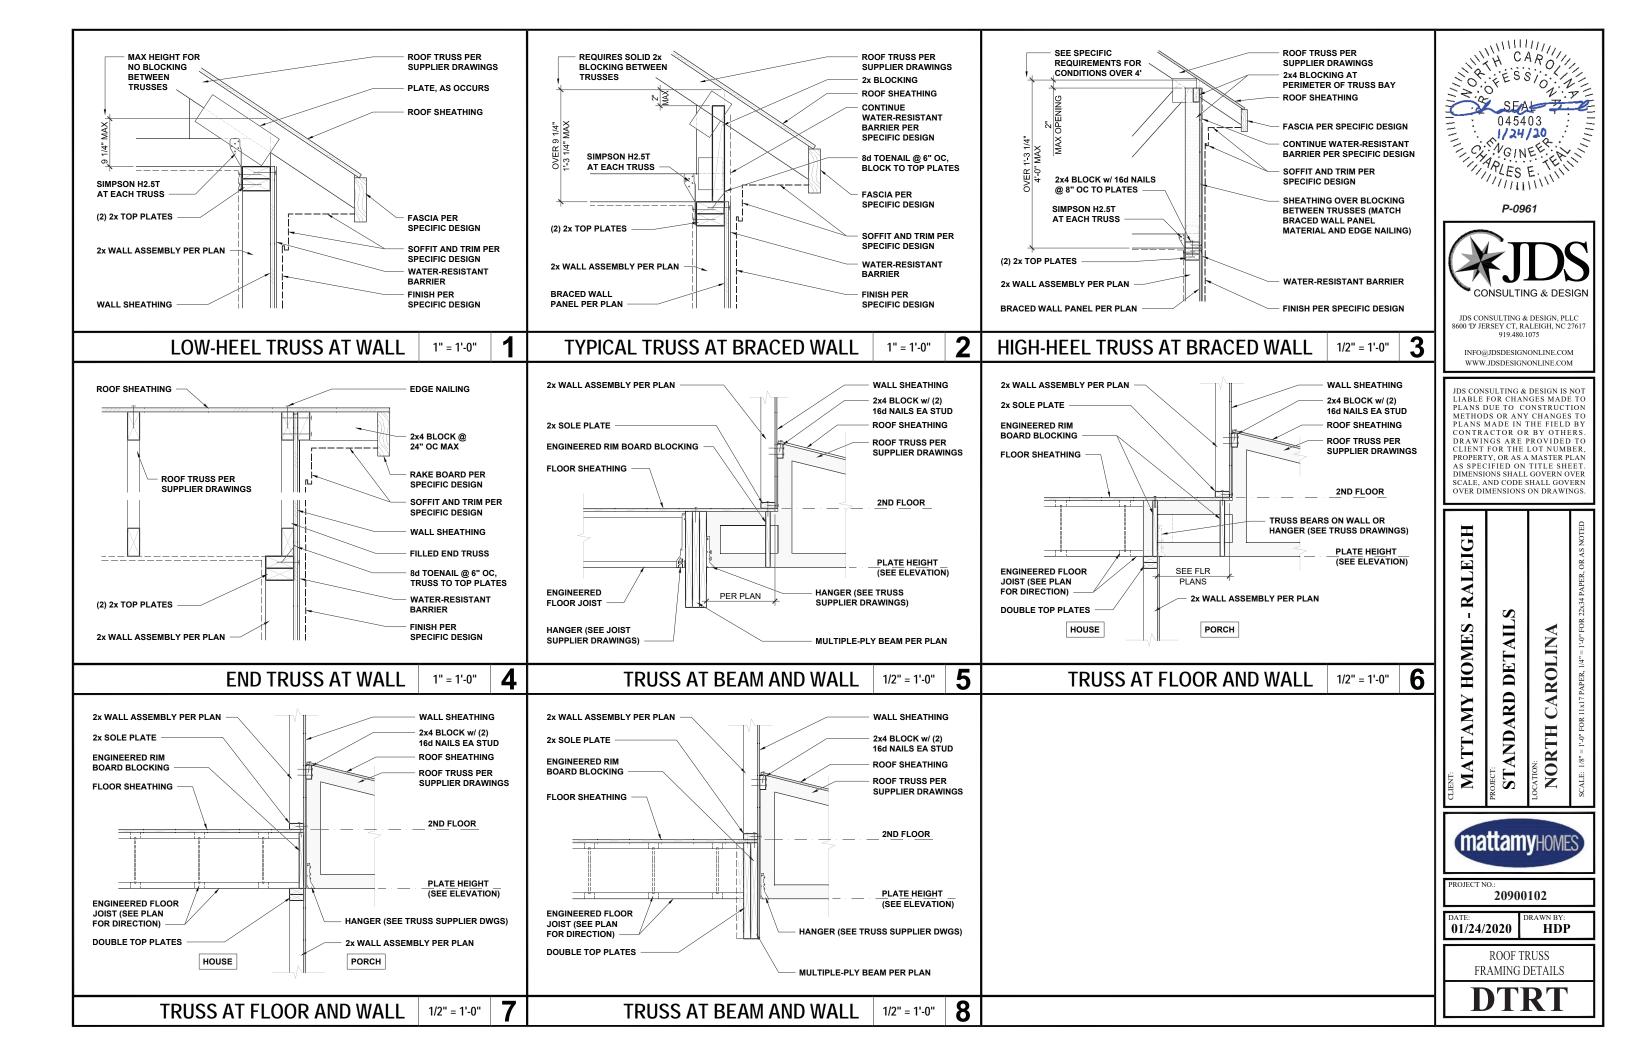


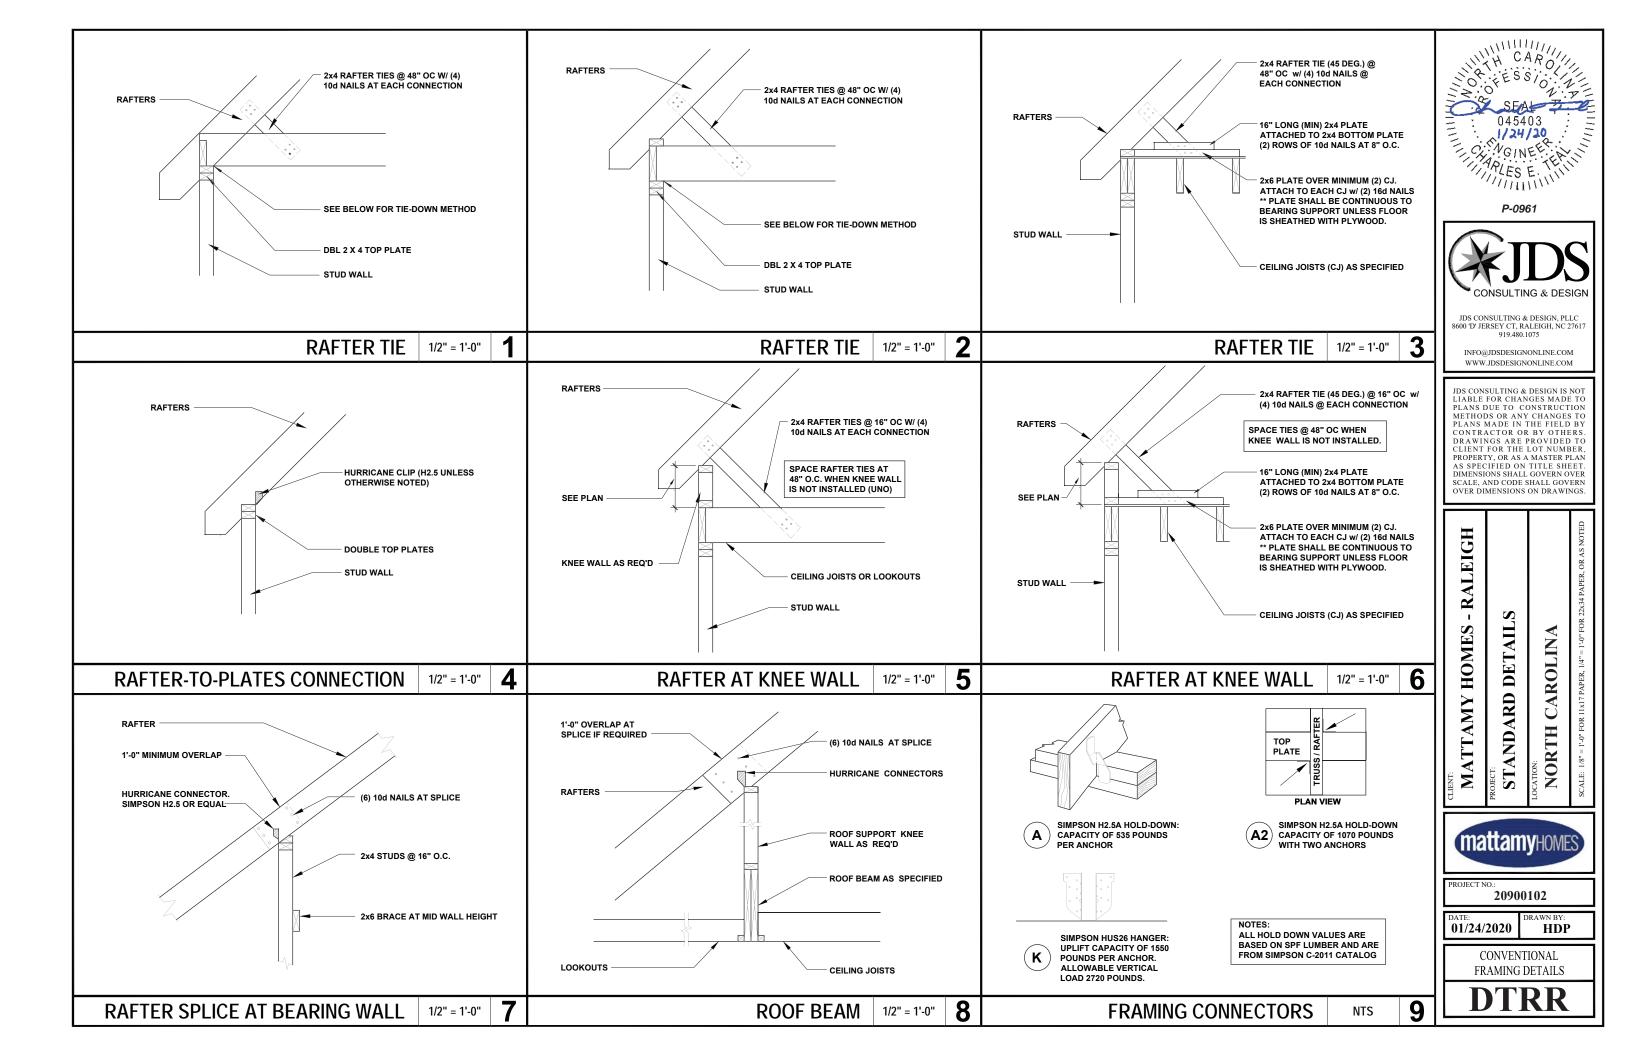

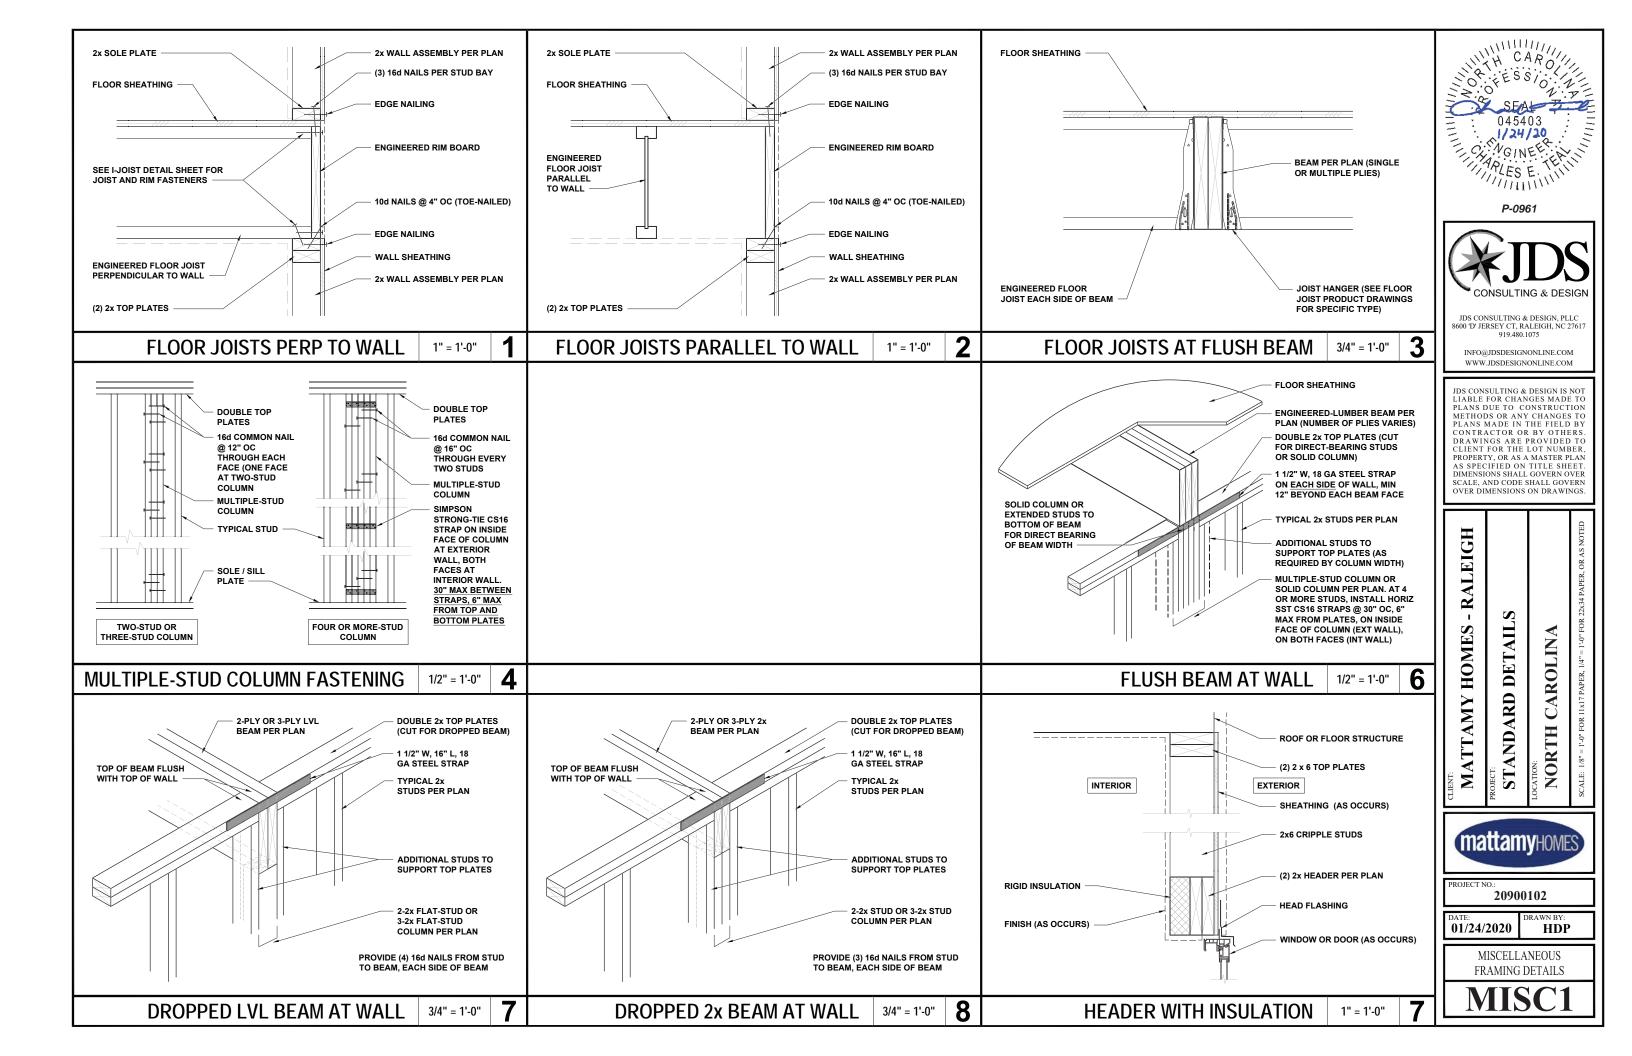

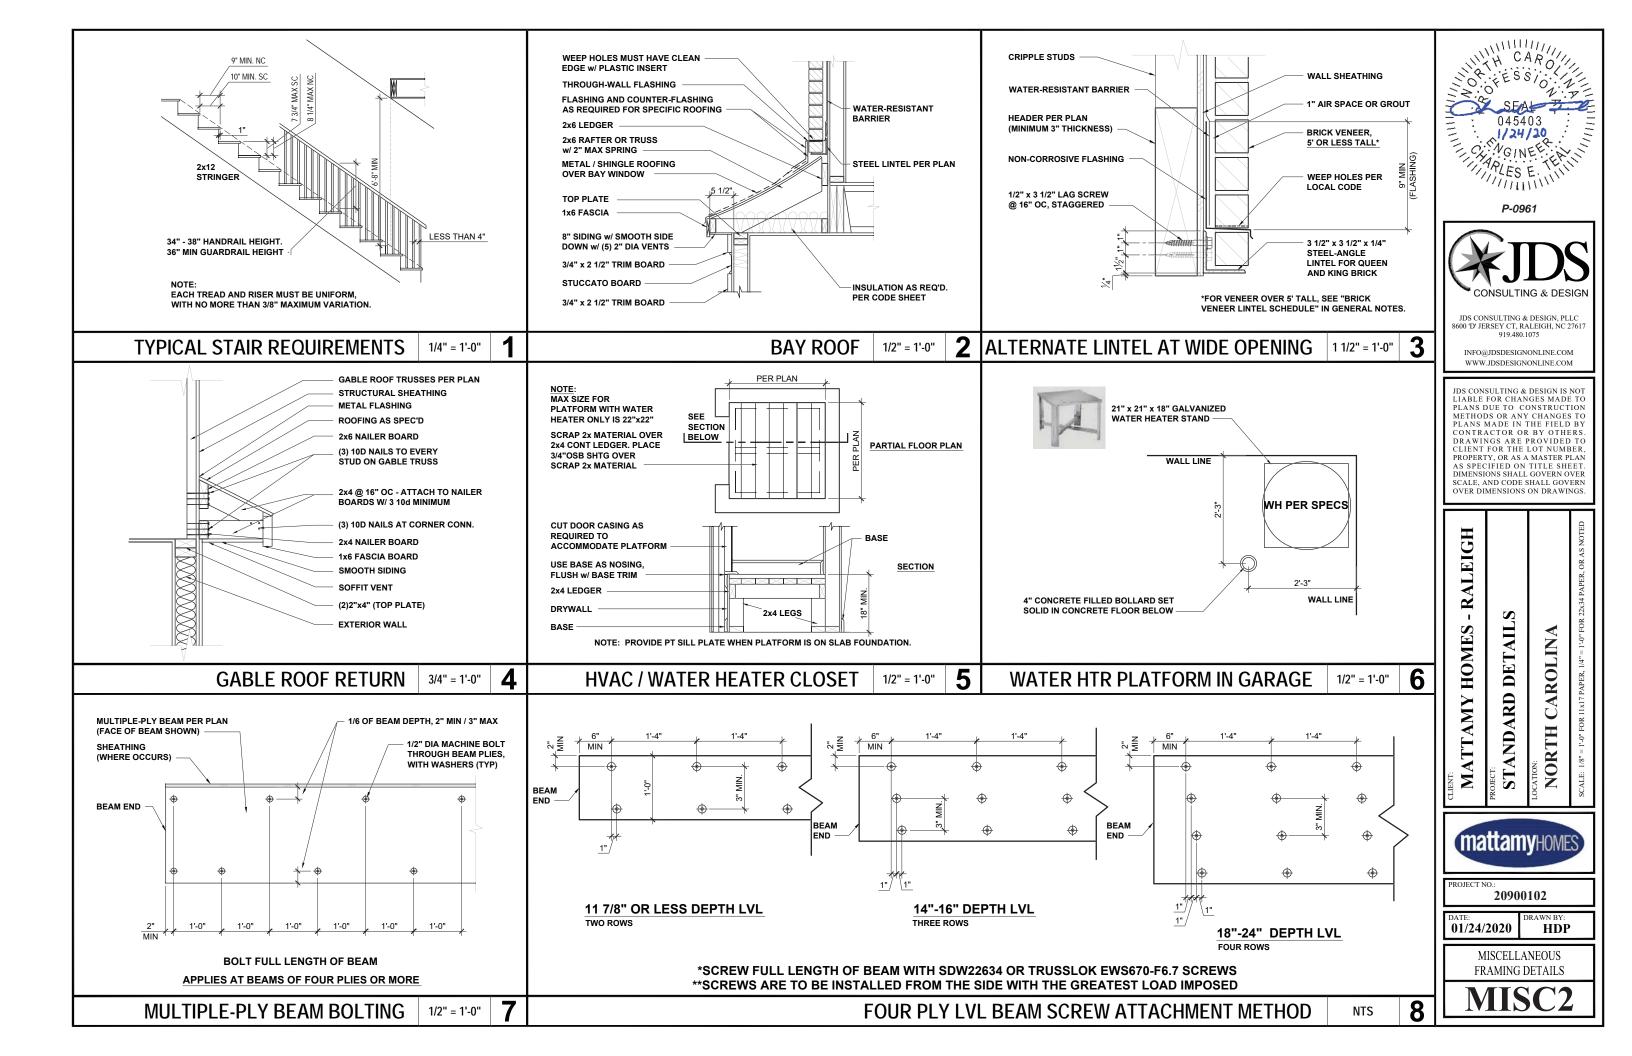

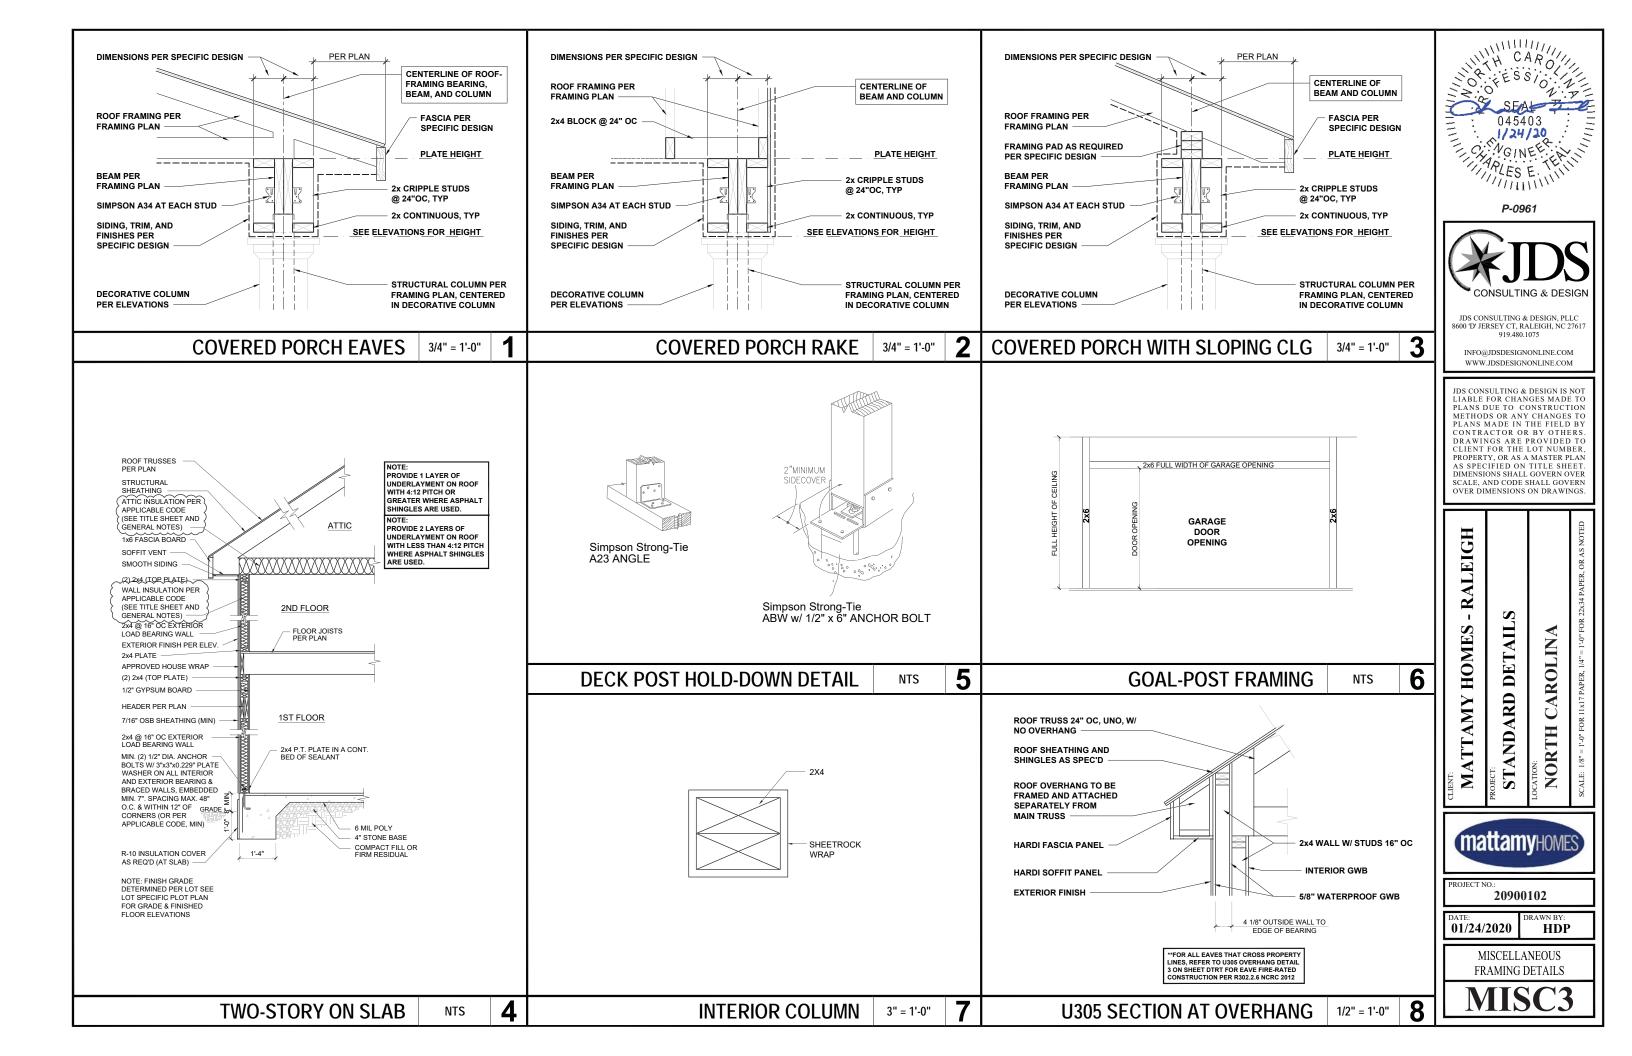

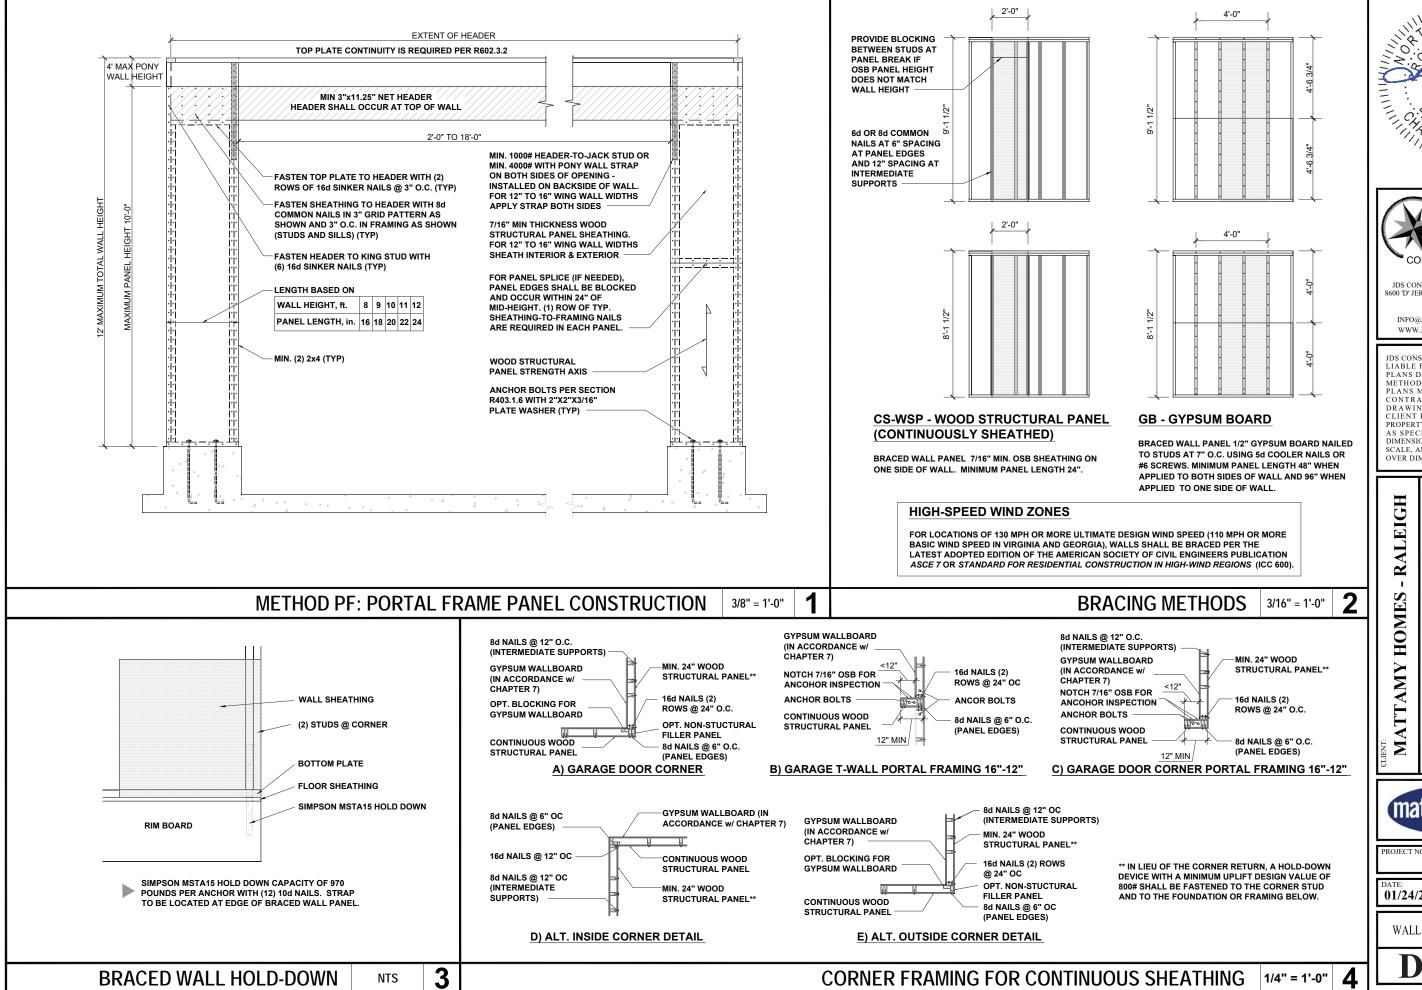

P-0961



JDS CONSULTING & DESIGN, PLLC 8600 'D' JERSEY CT, RALEIGH, NC 27617 919.480.1075

INFO@JDSDESIGNONLINE.COM WWW.JDSDESIGNONLINE.COM

LIABLE FOR CHANGES MADE TO PLANS DUE TO CONSTRUCTION METHODS OR ANY CHANGES TO PLANS MADE IN THE FIELD BY CONTRACTOR OR BY OTHERS DRAWINGS ARE PROVIDED TO CLIENT FOR THE LOT NUMBER PROPERTY, OR AS A MASTER PLAN AS SPECIFIED ON TITLE SHEET DIMENSIONS SHALL GOVERN OVER OVER DIMENSIONS ON DRAWINGS

STANDARD DETAIL

mattamyHOMES

20900102

01/24/2020

HDP

WALL BRACING DETAILS

JOIST DETAILS When sheathing thickness exceeds $\frac{7}{8}$ ", trim sheathing tongue at rim board IRC 502-7 requires lateral restraint (blocking) at all Load bearing or shear wall above must stack over wall below) **BEAM and COLUMN DETAILS** Plate nail - 16d (0.135" x 3½") at 16" on-center* Floor panel nail - 8d (0.131" x D0. D1. and D2 to BEARING AT WALL 1¹/₄" rim board or blocking 2x4 minimum for lateral support Web Stiffeners require each side at A3._W BEAM TO BEAM CONNECTION B1 B1W 11/4" LSL or 11/8" rim board. Toe nail Toe nail - 10d (0.131" x 3") Web stiffeners required each side TJI® rim joist (L1) For rim board thicker than 1 $\,^34$ " - Attach Joist to rim board with one 10d (0.128"x3") nail. [A2] A2W Must have 1¾" minimum joist bearing B2 B2W Top nail from joist into rim board. - Connect corner with four 10d (0.128"x3") nails. Toe nail required with shear wall at ends. Attach rim joist per A3 detail A3W from side of parallel closure into rim board INTERMEDIATE BEARING BEARING AT CONCRETE WALL Load bearing or shear wal NO LOAD BEARING WALL ABOVE above (must stack over wal Web stiffeners required Hanger height mus BEARING AT COLUMN Protect untreated contact with concre required on each 2x4 minimu Face mo ends at B4W End of joists at centerline Web stiffeners required if sides Use 2x4 minimum squash blocks (CS) to transfer load around joist of hanger do not laterally support at least $\frac{3}{8}$ " of joist top flange [H1] **FASTENING of FLOOR PANELS** * SEE I-JOIST EQUIVALENCE CHART FILLER and BACKER BLOCK SIZES Guidelines for Closest On-Center Spacing per Row * SEE I-JOIST EQUIVALENCE CHART I-JOIST I-Joists 110 EQ. * 210 EQ. * 230 or 360 EQ. * 560 EQ. * PSL 110 21 Nail Size 360 and 9½" or 14" or 14" or LSL or wide Depth 14" 117/8" | 16" | 20" and 230 FO 560 FQ 16" 16" 20" 111/8" 111/8" 8d (0.131" x 2½") Filler Block 2x8 + 3/8" $2x8 + \frac{1}{2}$ " $2x12 + \frac{1}{2}$ Two Two Two 2x6 + ½" 2x6 2x8 (Detail H2) sheathing sheathing sheathing sheathing 2x6 2x8 2x12 10d (0.148"x 3"), 12d (0.148"x 31/4") 4" 4" 4" 4" 4" 4" 2x6 2x10 $2x6 + \frac{3}{8}$ " $2x10 + \frac{3}{8}$ " $2x6 + \frac{1}{2}$ " $2x10 + \frac{1}{2}$ " 6"(2) 6"(2) 16d (0.162"x 3½") 6" 6" 8" Cantilever Filler 4'-0" 6'-0" sheathing sheathing sheathing (Detail E4) applicable (1) One row of fasteners permitted (two at abutting panel edges) for diaphragms. Stagger nails when long long 4'-0" long 6'-0" long 4'-0" long 6'-0" long using 4" on-center spacing and maintain 3/8" joist and panel edge distance. For other applications, Backer Block (1 2x6 2x8 2x12 3/4" or 7/8" multiple rows of fasteners are permitted if the rows are offset at least $\frac{1}{2}$ " and staggered. (Detail F1 or H2) (2) Can be reduced to 4" on-center if nail penetration into the narrow edge is no more than 1 3/8" (to avoid splitting). (1) If necessary, increase filler and backer block height for face mount hangers and maintain $\frac{1}{8}$ " gap at top of joist; see detail W. Filler and backer block lengths should accomodate required nailing • Recommended nailing is 12" on-center in field and 6" on-center along panel edge. Fastening requirements on engineered drawings supersede without splitting (12" minimum for backer blocks and 24" minimum for filler blocks). Joists must be laterally supported at cantilever and end bearings by blocking panels, hangers, or direct attachment to a rim board or rim joist. • Recommended use of a non-polyurethane subfloor adhesive on all contact points between panels and floor framing. Safety bracing (1x4 minimum) at 8' on-center (6' on-center for $\,$ 110 or equivalent Joists) and extended to a braced end wall. Fasten at each joist with two 8d (0.113" x 2 $\frac{v}{2}$ ") nails minimum (see WARNING). • Nailing rows must be offset at least $\frac{1}{2}$ " and staggered. • 14 ga. staples may be substituted for 8d (0.113" x 21/2") nails if minimum DO NOT bevel cut joist penetration of 1" into the joist or rim board is achieved. Rim board join • Maximum spacing of nails is 18" on-center for joists. DO NOT overhang seat cuts on beams beyond the inside face of support member Rim iois $1\frac{1}{4}$ " rim board. (L5) P Use B1 or B2 at see note 3 under (H1)

Protect untreate

wood from direct

Bearing plate to be

face of wall or bean


INSTALLATION TIPS

Subfloor adhesive will improve floor performance, but may not be required.

Squash blocks and blocking panels carry stacked vertical loads (details B1 and B2). Packing out the web of a joist (with web stiffeners) is not a substitute for squash blocks or blocking panels.

When joists are doubled at non-load bearing parallel partitions, space joists apart the width of the wall for plumbing or HVAC.

Additional joist at plumbing drop (see detail).



* I-JOIST EQUIVALENCY CHART

	EQUIVALENT IN SPAN AND SPACING						
Depth	Mftr & Series	Mftr & Series	Mftr & Series				
	TJI - 110	BCI 4500					
9 1 "	TJI - 210	BCI 5000					
7	TJI - 230	BCI 6000	EverEdge 20				
		BCI 6500					
	TJI - 110	BCI 4500					
	TJI - 210	BCI 5000					
11 7"	TJI - 230	BCI 6000	EverEdge 20				
		BCI 6500					
	TJI - 360	BCI 60'S	EverEdge 30				
	TJI - 560	BCI 90'S	EverEdge 50/60				
	TJI - 110	BCI 4500					
	TJI - 210	BCI 5000					
14"	TJI - 230	BCI 6000	EverEdge 20				
		BCI 6500					
li	TJI - 360	BCI 60'S	EverEdge 30				
	TJI - 560	BCI 90'S	EverEdge 50/60				
	TJI - 110	BCI 4500					
	TJI - 210	BCI 5000					
16"	TJI - 230	BCI 6000	EverEdge 20				
		BCI 6500					
	TJI - 360	BCI 60'S	EverEdge 30				
ألللا	TJI - 560	BCI 90'S	EverEdge 50/60				

JOIST NAILING REQUIREMENTS at BEARING

Joist to Bearing Plate

One 8d (0.113" x 21/2") nail each side. Drive nails at an angle at least 11/2" from end.

1¹/₄" rim board.

13/4" minimum bearing at end support; 31/2" minimum at intermediate support Shear transfer: Connections equivalent

One 10d (0.128" x 3") nail into each flange Also see detail B2

Squash Blocks to Joist

(Load bearing wall above)

Rim to Joist



DO NOT use

for rim board or blocking, as it may shrink after

to floor panel nailing schedule

 $1\frac{1}{4}$ " rim board or $1\frac{3}{4}$ " wide rim joist: One 10d (0.128" x 3") nail into each flange

2 1/16" - 2 5/16" wide rim joist: One 16d (0.135" x 3½") nail into each flange

nail with 10d (0.128" x 3") nails, one each side of TJI® joist flange rim joist

31/3" wide rim joist: Toe

31/2" wide floor jois Top View Locate rim board joint between joists.

BEAM ATTACHMENT at BEARING




One 10d (0.128" x 3") nail each side of member at bearing, 11/2" minimum from end

Drive nails at an angle to minimize

splitting of plate

 $1\frac{1}{4}$ " rim board.

See framing plan (if applicable) or iLevel® Framer's Pocket Guide for minimum end and intermediate bearing lengths



P-0961



JDS CONSULTING & DESIGN, PLLC 8600 'D' JERSEY CT, RALEIGH, NC 2761'

INFO@JDSDESIGNONLINE.COM WWW.JDSDESIGNONLINE.COM

JDS CONSULTING & DESIGN IS NOT LIABLE FOR CHANGES MADE TO PLANS DUE TO CONSTRUCTION METHODS OR ANY CHANGES TO PLANS MADE IN THE FIELD BY CONTRACTOR OR BY OTHERS.
DRAWINGS ARE PROVIDED TO CLIENT FOR THE LOT NUMBER PROPERTY, OR AS A MASTER PLAN AS SPECIFIED ON TITLE SHEET DIMENSIONS SHALL GOVERN OVER OVER DIMENSIONS ON DRAWINGS

> DETAIL CAROLIN ARD

HOMES

AMY

NORTH ST



R

20900102

01/24/2020 HDP

ENGINEERED JOIST

DETAILS