

LOT 998 -ANDERSON CREEK CARRIAGE GLEN 03.25.2022

1588 **Kilgore-RH** 'CLASSIC' ELEVATION

CTUR	CTURAL DRAWINGS					
	Sheet No.	Sheet Description				
ions (Slab)						
ions (Crawl)						
tions (Slab)						
tions (Crawl)						
)						
vl)						

DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN


SQUARE	E FOOT/	AGE
	ELEVAT	10N 'A'
	UNHEATED	HEATED
FIRST FLOOR	0	734
SECOND FLOOR	0	842
FRONT PORCH	122	0
1 CAR GARAGE	274	0
SUBTOTALS	396	1576
TOTAL UNDER ROOF	19	72
	-	
0	PTIONS	
	UNHEATED S.F.	HEATED S.F.
PATIO / DECK	80	-
COVERED PATIO / DECK	80	-

COPYRIGHT 2020 SOUTH DESIGNS, INC.	Wake (C (F	OUTI ESIG Promest, NG 9 Porrest, NG 9 1919-556-2 7 919-556-2 7 southdesig	NS 88 27588 2226 2228
	Design reproduct written co These di named client use. The the lot or and South Design for any he plans. Con all dimens constru- exercises these design	i when making	y not be expressed Designs, Inc. ered to the ional one time is limited to ecified herein, bocation. uses no liability d from these fer shall verify tions prior to must be changes to use or a mode
	CLENT	MCKee Homes, Inc.	5112 Pine Birch Dr. Raleigh, NC 27606 (913) 733-5237
E PLOTS	drawn by: Original rel Current rel	lease date: Lease date:	
ARE 1/2 SCAL		: / Description	
17 SHEETS			
OTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE 34x22 SHEETS - 11x17 SHEETS ARE 1/2 SCALE PLOTS	1588 - Kilgore-RH		Cover Sheet
OTE: SCALES	Sheet	0.0	a

General Floor Plan Notes

General Floor Plan Notes shall apply unless noted otherwise on plan.


- Wall Heights: Typically 9'-1 1/2" at first floor and wan regims. Ppictally 7-11/2 at this field and second floor, and 9-11/2 at attics UNO. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24° apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10" high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 7'-8" AFF at First Floor, and 7'-4" AFF at Second Floor U.N.O.
- 4. Jacks: Openings up to 3'-4" wide shall have (1) 2x4 jack stud SPF on each side. Openings greater than 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens <u>do</u> <u>not</u> include soffits over wall cabinetry.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner.
 Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- P. Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more there of "burger areas". than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30°. Minimum clear attic access shall be 20° x 30°. Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

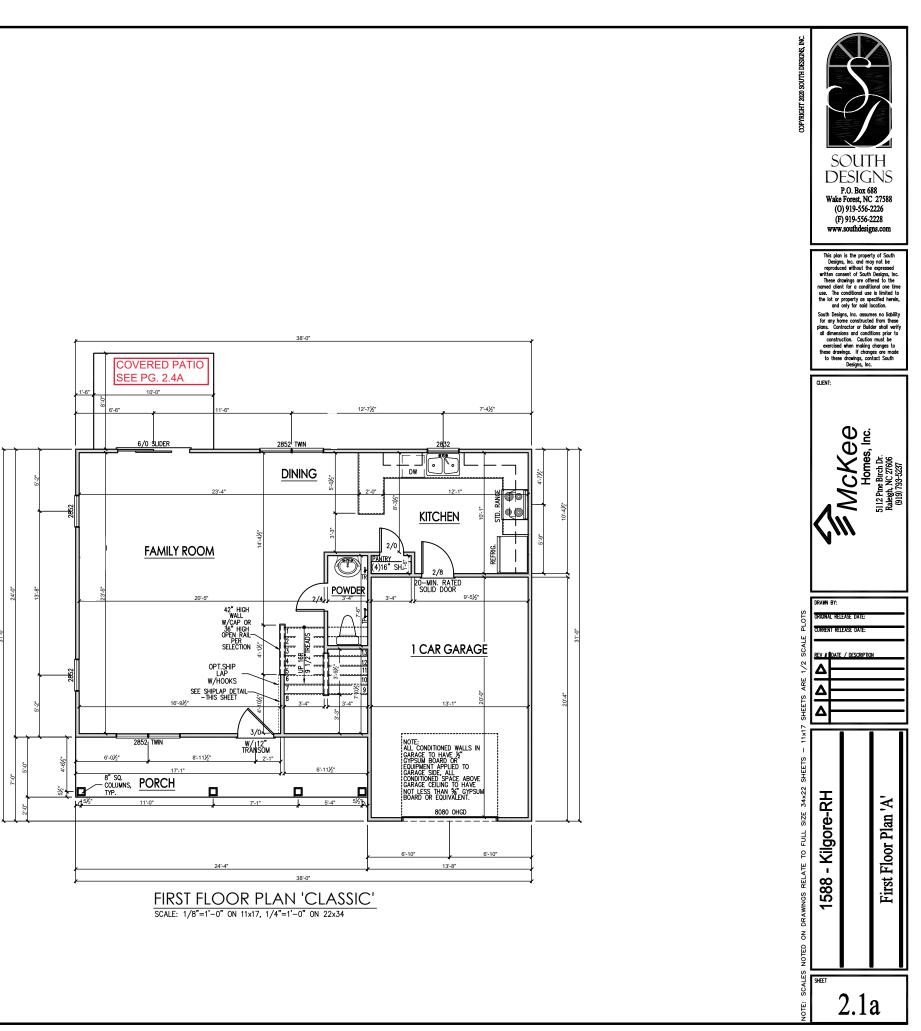


General Floor Plan Notes

General Floor Plan Notes shall apply unless noted otherwise on plan.

- . Wall Heights: Typically 9'-1 1/2" at first floor and wan regims. Ppictally 7-11/2 at this field and second floor, and 9-11/2 at attics UNO. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24° apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10" high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 7'-8" AFF at First Floor, and 7'-4" AFF at Second Floor U.N.O.
- 4. Jacks: Openings up to 3'-4" wide shall have (1) 2x4 jack stud SPF on each side. Openings greater than 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens <u>do</u> <u>not</u> include soffits over wall cabinetry.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure
- Closets for clothing or coat storage shall be equipped with 1 rod/sheft. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more there of "burger areas". than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30°. Minimum clear attic access shall be 20° x 30°. Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

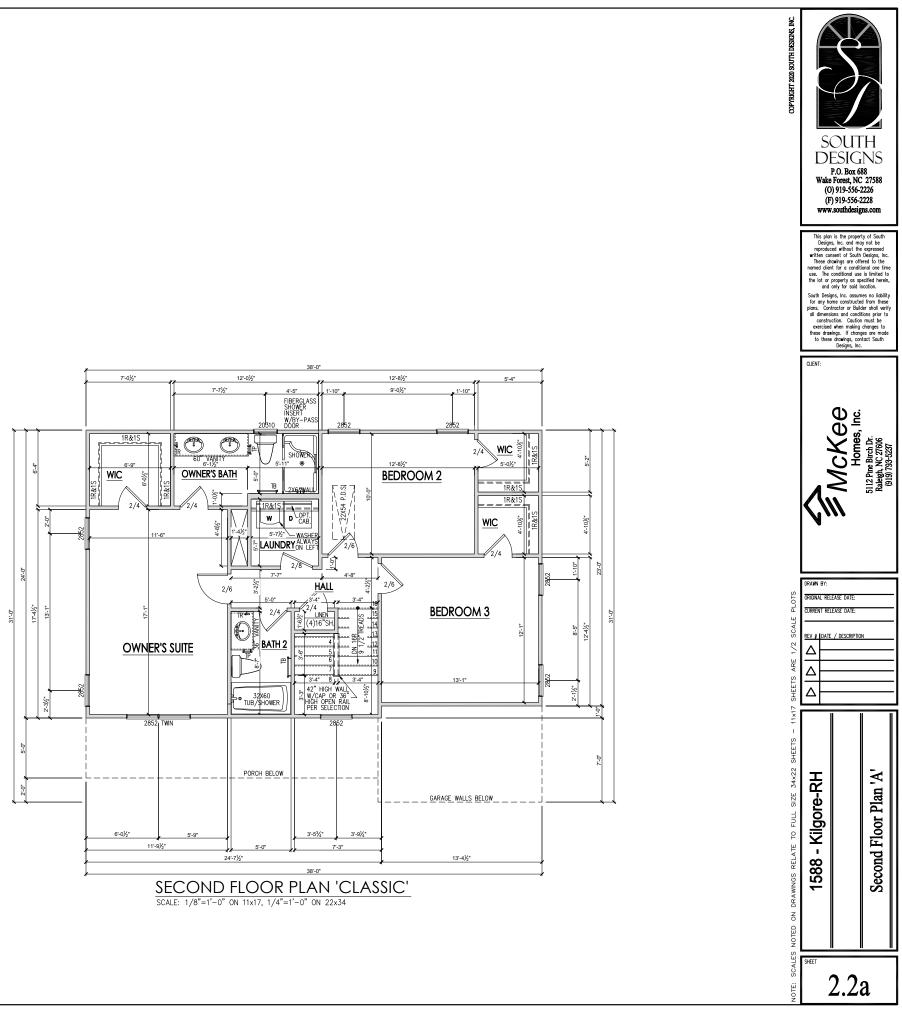


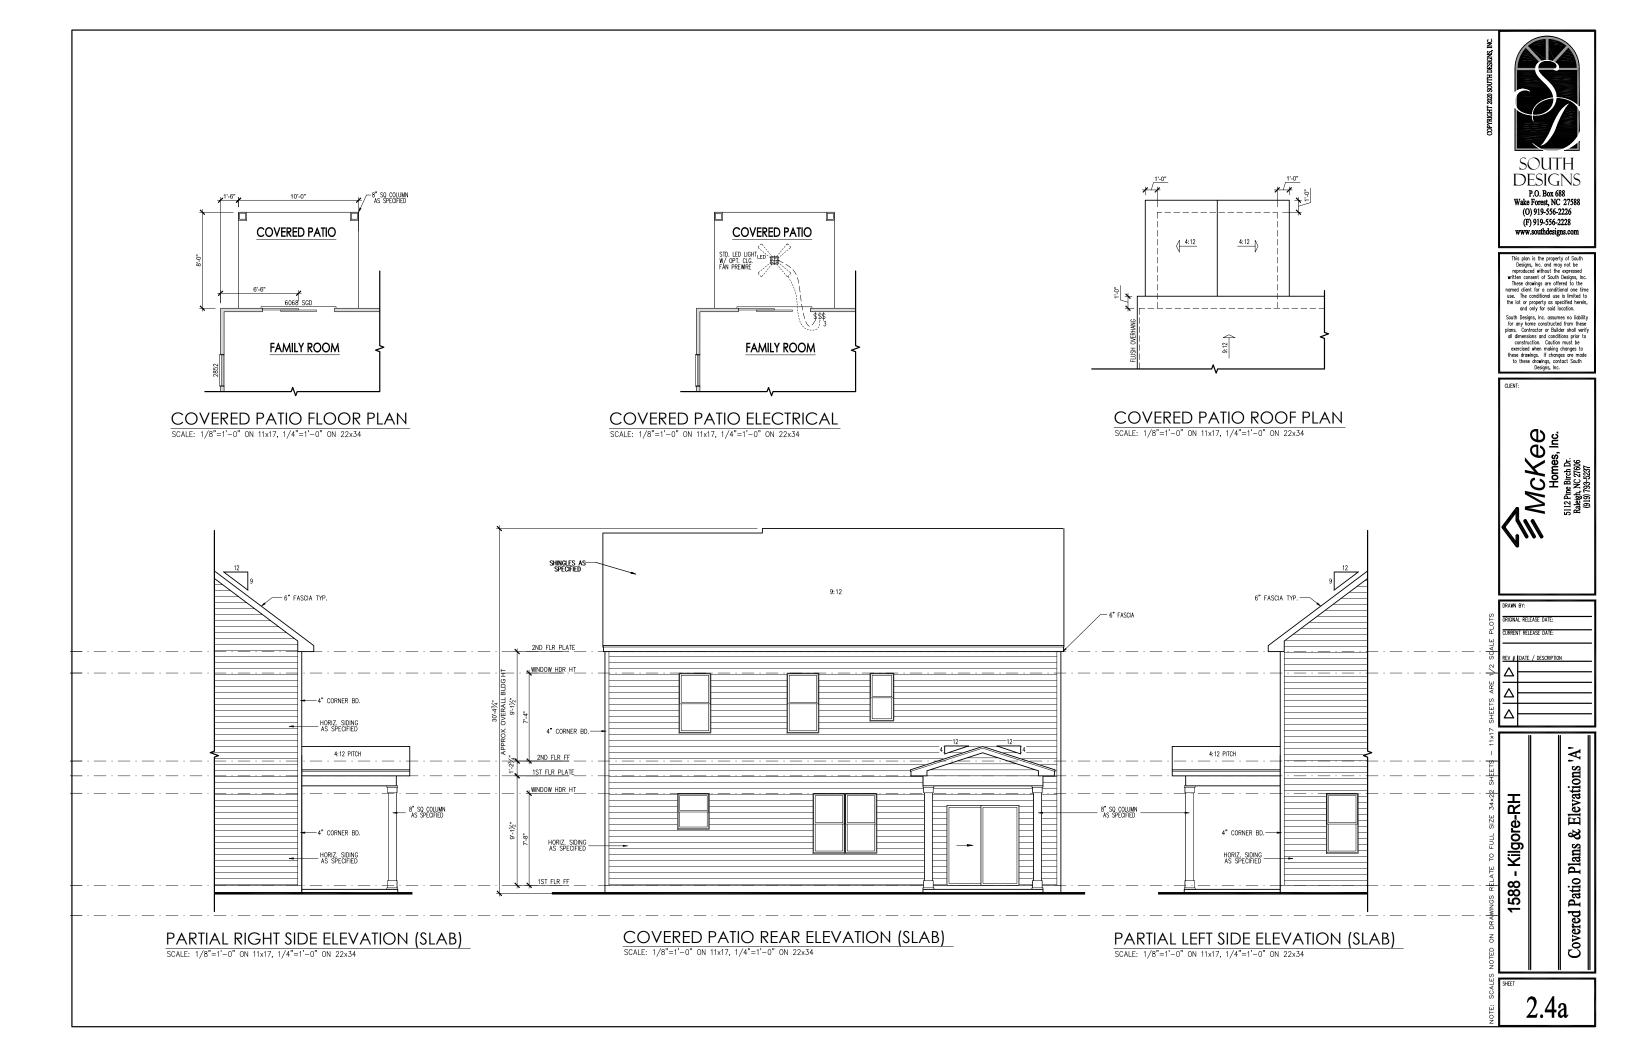

General Floor Plan Notes

General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9'-1 1/2" at first floor and second floor, and 9'-1 1/2" at atfirst floor. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures. Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 7'-8" AFF at First Floor, and 7'-4" AFF at Second Floor U.N.O.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4 jack stud SPF on each side. Openings greater than 3'-4" wide shall have (2) 2x4 jack studs SPF on each side.
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens <u>do</u> <u>not</u> include soffits over wall cabinetry.
- 6. Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closels with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/sheft. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30°. Minimum clear attic access shall be 20° x 30°. Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

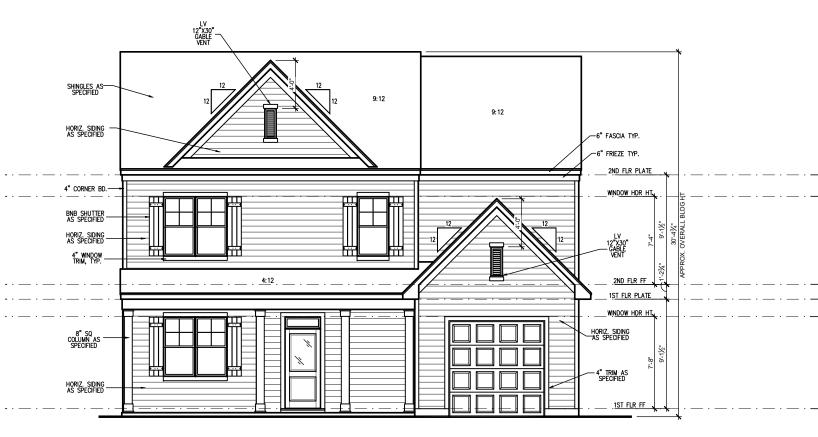





SOUTH DESIGNS P.O. Box 688 Wake Forest, NC 27588 (0) 919-556-2226 (F) 919-556-2228 www.southdesigns.com This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drawings are offered to the morted client for a conditional one time use. The conditional use is limited to the lot or property as specified herein, and only for soid location. and only for soil location. South Designs, hc. assumes no liability for any home constructed from these plans. Contractor or Builder shall writig al dimensions and conditions prior to construction. Caution must be exercised where making changes are made to these drawings, contact South Designs, Inc. CLIENT: MCKGG Homes, Inc. 5112 Pre Birch Dr. Rategy, NC 2766 DRAWN BY: ORIGINAL RELEASE URRENT RELEASE DAT REV # DAT Δ Σ Δ Front & Rear Elevations 'A' - Kilgore-RH 588 3.1a


General Elevation Notes

General Elevation Notes shall apply unless noted otherwise on plan.

- Roof shall be finished with architectural composition shingles with slopes as noted on plan.
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- 6. Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 34" high with guards spaced no more than 4" apart. Consult community specifications for material.
- 7. Finish Wall Material shall be as noted on elevation drawings.
- 8. Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 14" oc vertically so that no more than 2.67st of brick is supported by (1) tie. Space between face of wall and back face of brick shall be limited to a maximum of 1". Flashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be provided at a rate of 48" oc and shall not be less than 3.16" in diameter and shall be located immediately above flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited to L/600.


Masonry Opening Lintel Schedule

Oper	ning S	Size	Angle
up to	4'-0		3-1/2" x 3-1/2" x 5/16"
4'-1"	to	5'-6"	4" x 3-1/2" x 5/16" LLV
5'-7"	to	6'-6"	5" x 3-1/2" x 5/16" LLV
6'-7"	to	8'-4"	6" x 3-1/2" x 5/16" LLV
8'-5"	to	16'-4"	7" x 4" x 3/8" LLV

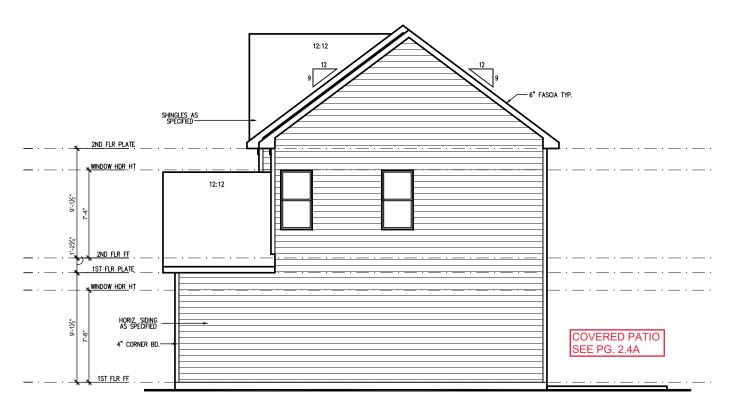


RIGHT SIDE ELEVATION 'CLASSIC' (SLAB)


SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

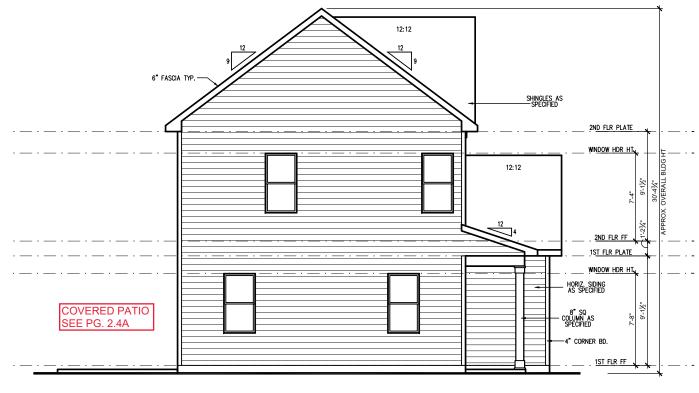

LEFT SIDE ELEVATION 'CLASSIC' (SLAB) SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

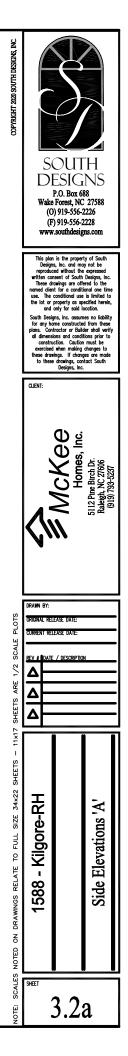

			_
MAIN	HOUSE		sc
VENT TYPE	SQ. FT. REQUIRED RANGE		s su
RIDGE VENT	1.20	1.50	
SOFFIT VENTS	1.80	1.50	
TOTAL (MIN)	3.00	3.00	
* SCHEDULE H	AS BEEN	CALCUL	ATE

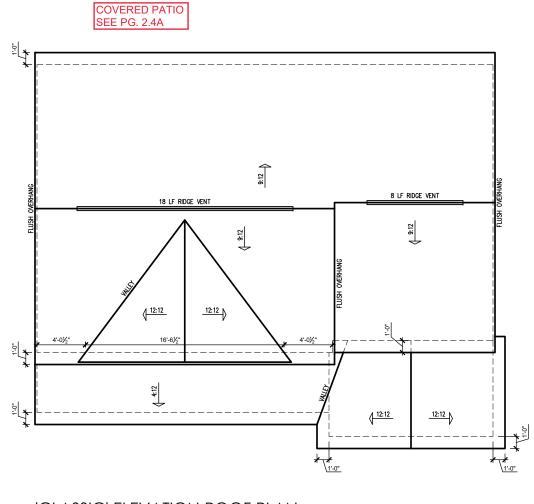


 'CLASSIC' ELEVATION ROOF PLAN

 SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

ATTIC VENT SCHEDULE 'CLASSIC' ELEVATION FTG 899 AT / NEAR RIDGE AT / NEAR EAVE Gas using a consumer a cons						
'CLASSIC' ELEVATION						
FTG	FTG 899 AT / NEAR RIDGE AT / NEAR EAVE					AR EAVE
Q. FT.	PERCENT OF TOTAL	POT LARGE (SQ. FT. EACH)	POT SMALL (SQ. FT. EACH)	RIDGE VENT (SQ. FT. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PER LF)
PLIED	SUPPLIED 0.4236		0.2778	0.125	0.1944	0.0625
3.25	50.98	0	0	26.00		
3.13	49.02				0	50.00
6.38	6.38 100.00 POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE					


SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50-60% OF TOTAL AND RIDGE AT 40-50% OF TOTAL REQUIRED VENTILATION



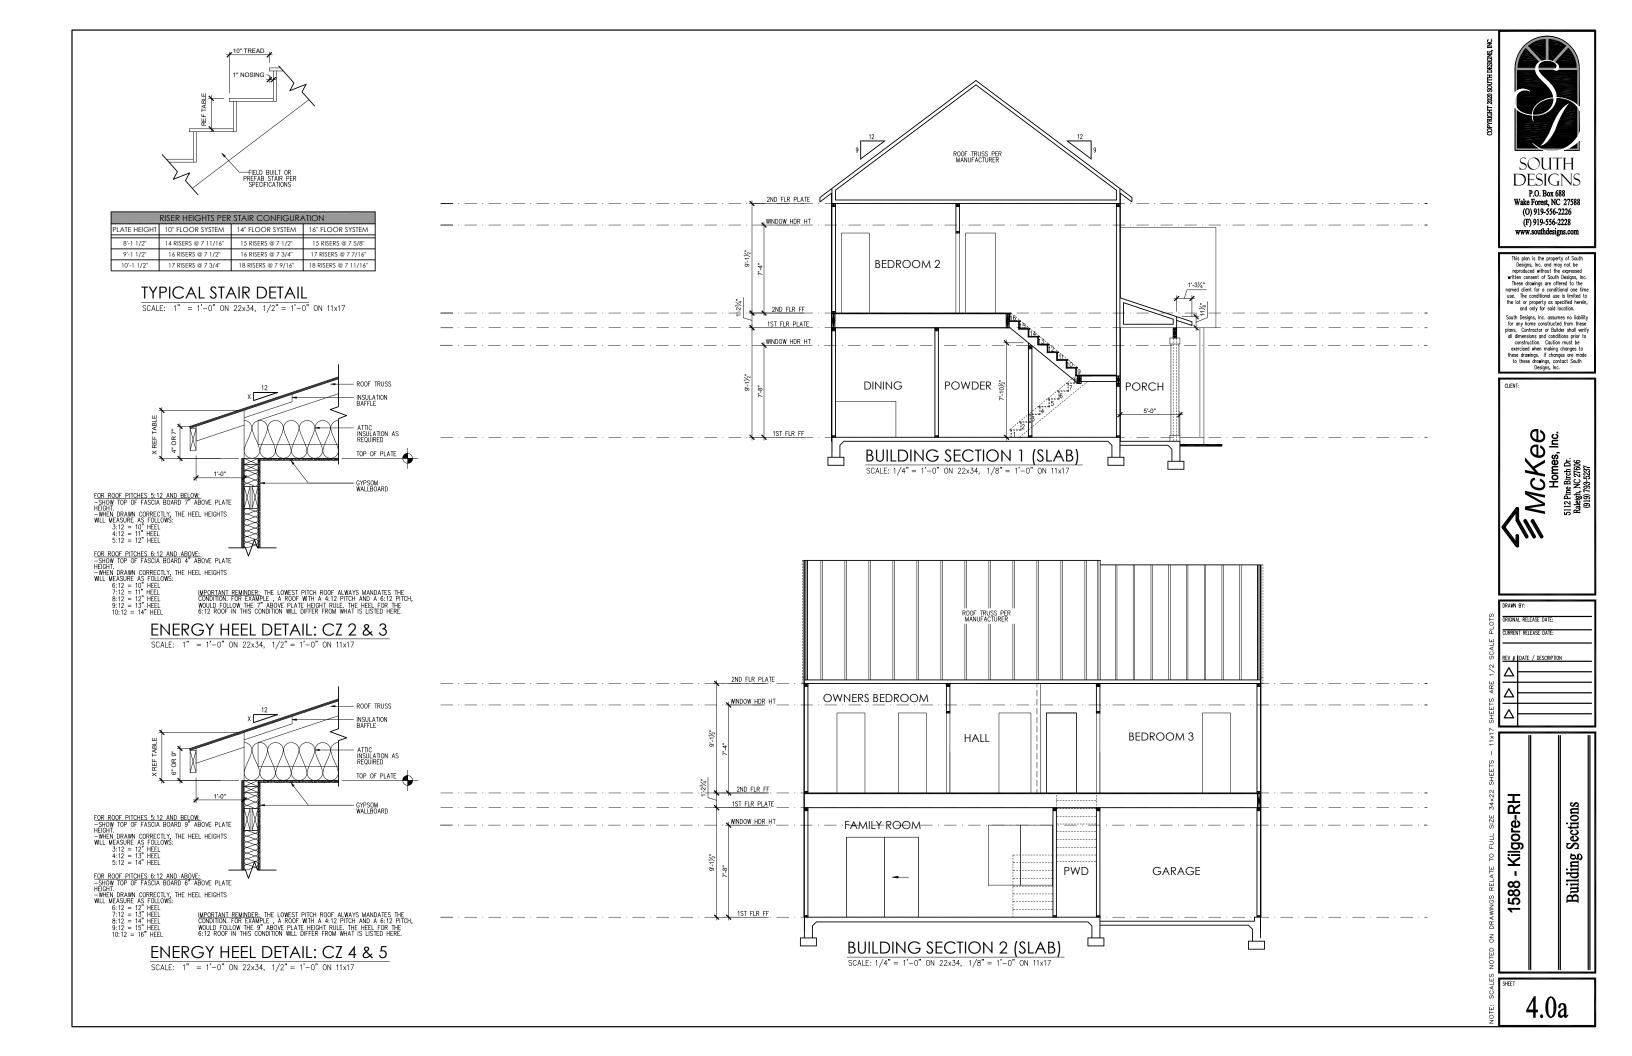

ELECTRICAL SYMBOL KEY

LIGHT FIXTURES RECESSED CAN LIGHT LED LED PUCK LIGHT WP RECESSED CAN LIGHT WATERPROOF RECESSED CAN - EYEBALL PENDANT LIGHTING WALL SCONCE HOUNT LIGHT FLOOD LIGHT OUTLETS SWITCHED 1/2 HOT DUPLEX OUTLET 220V OUTLET
 1
 220V OUTLET
 1
 TELEPHONE OUTLET
 CATV (TELEVISION) OUTLET
 WDER-COUNTER OR CONCEALED OUTLETS © CEILING MOUNTED DUP. OUTLET BELOOR HOUNTED DUP. OUTLET SWITCHES SINGLE POLE SWITCH \$ \$3 THREE-WAY SWITCH \$4 FOUR-WAY SWITCH MISC FIXTURES EXHAUST FAN UNCTION BOX ⊕_{220V} JUNCTION BOX 220V OCM OCARBON MONOXIDE DETECTOR OR SMOKE CO.SD CARBON MONOXIDE DETECTOR AND SMOKE ELECTRIC METER ELECTRICAL PANEL DOOR BELL CHIME DOOR BELL PUSH BUTTON FLUORESCENT LIGHT




General Power and Lighting:

General Power and Lighting Notes shall apply unless noted otherwise on plans.

All work shall be installed per the current NC Residential Building Code, and the National Electric Code. Alarm devices shall meet NFPA 72.

- Smoke Alarms Shall be provided as a minimum of (1) per floor, including basements (if applicable), (1) in each sleep room, and (1) outside each sleeping area, within the immediate vicinity of seeping rooms. When more than one alarm is required, the alarm devices shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms. Smoke alarms shall be hard wired to permanent power and shall have batter back-ups.
- Switches For lighting, fans, etc. shall be installed at heights illustrated on this page and shall be located a minimum of 4 1/2" from door openings to allow for the proper installation of door casings. Switches, thermostats, proper installation of door classings. Switches, internostas, security pads, and other similar devices shall be grouped together and installed thoughtfully for convenience of use and to avoid placement within centers of wall areas.

Note: This plan is a diagram showing approximate locations of convenience outlets based on requirements found in the NC Residential Code and N.E.C. Actual positions may vary from what is shown on plan.

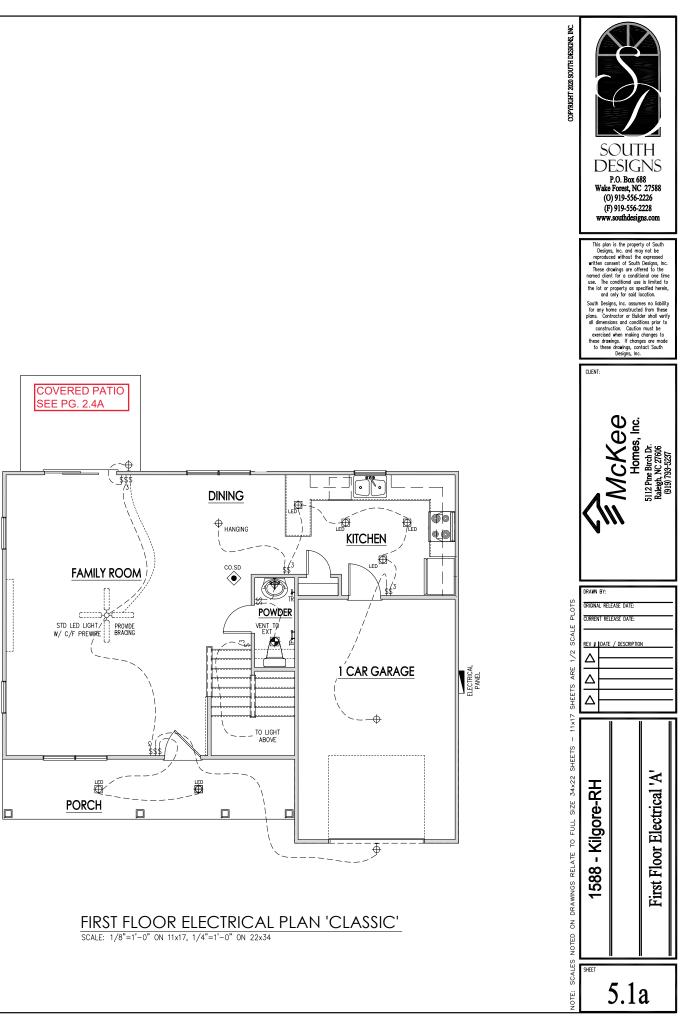

ELECTRICAL BOX HEIGHTS

ELECTRICAL SYMBOL KEY

LIGHT FIXTURES CEILING SURFACE MOUNT LIGHT RECESSED CAN LIGHT LED PUCK LIGHT W RECESSED CAN LIGHT WATERPROOF RECESSED CAN - EYEBALL WALL SCONCE HOUNT LIGHT OUTLETS SWITCHED 1/2 HOT DUPLEX OUTLET
 ⇒
 220∨ OUTLET

 I
 TELEPHONE OUTLET

 -∑
 CATV (TELEVISION) OUTLET
 = 🕀 UNDER-COUNTER OR CONCEALED OUTLET © CEILING MOUNTED DUP. OUTLET BELOOR HOUNTED DUP. OUTLET SWITCHES \$ SINGLE POLE SWITCH \$3 THREE-WAY SWITCH \$4 FOUR-WAY SWITCH MISC FIXTURES EXHAUST FAN UNCTION BOX · ⊕220V JUNCTION BOX 220V CARBON MONOXIDE DETECTOR OR SMOKE CARBON MONOXIDE DETECTOR AND SMOKE ELECTRIC METER ELECTRICAL PANEL DOOR BELL CHIME DOOR BELL PUSH BUTTON 6

> FIREPLACE) 4'-6" Hermosta TOHES & TV PHONE


General Power and Lighting:

General Power and Lighting Notes shall apply unless noted otherwise on plans.


All work shall be installed per the current NC Residential Building Code, and the National Electric Code. Alarm devices shall meet NFPA 72.


- Smoke Alarms Shall be provided as a minimum of (1) per floor, including basements (if applicable), (1) in each sleep room, and (1) outside each sleeping area, within the benefits whether the scheme the strengther that the the immediate vicinity of sleeping rooms. When more than one alarm is required, the alarm devices shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms. Smoke alarms shall be hard wired to permanent power and shall have batter back-ups.
- 2. Switches For lighting, fans, etc. shall be installed at heights illustrated on this page and shall be located a minimum of 4 1/2" from door openings to allow for the proper installation of door casings. Switches, thermostats, security pads, and other similar devices shall be grouped together and installed thoughtfully for convenience of use and to avoid placement within centers of wall areas.

Note: This plan is a diagram showing approximate locations of convenience outlets based on requirements found in the NC Residential Code and N.E.C. Actual positions may vary from what is shown on plan.

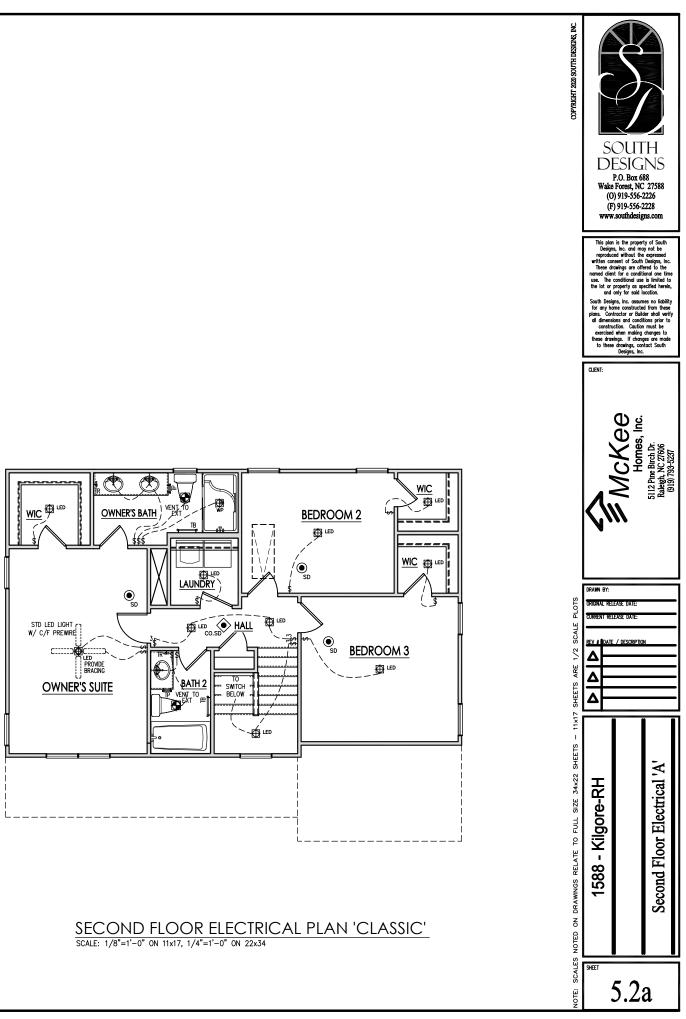

ELECTRICAL BOX HEIGHTS

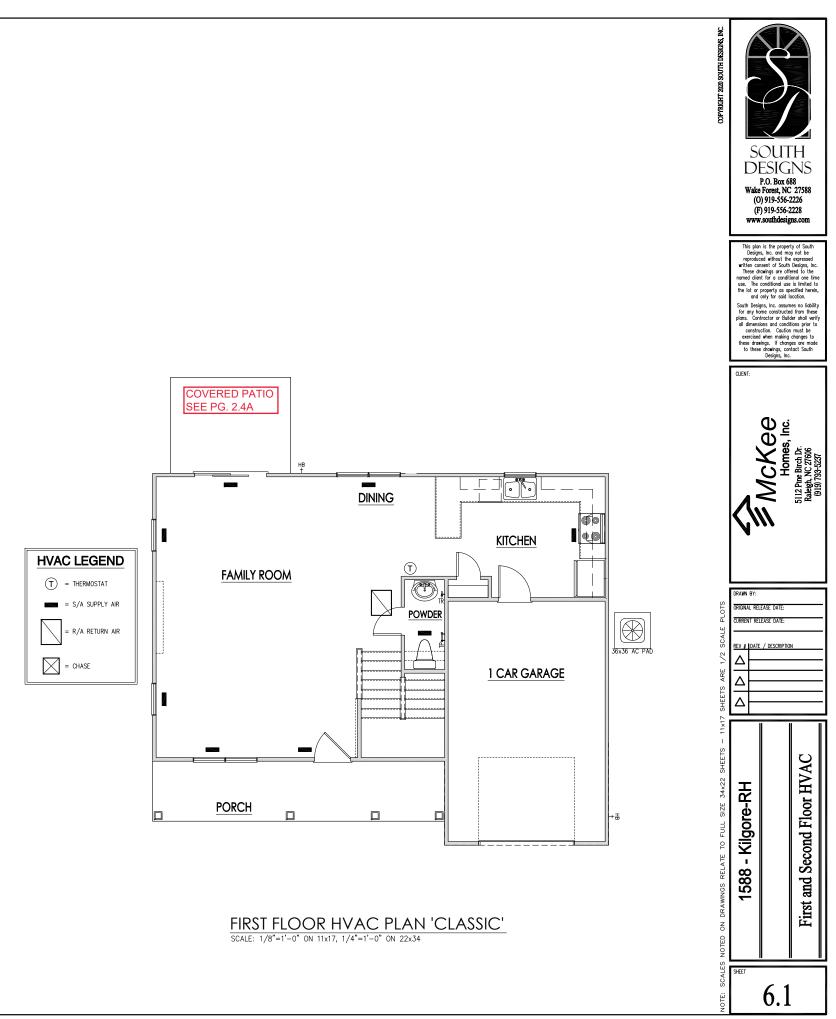


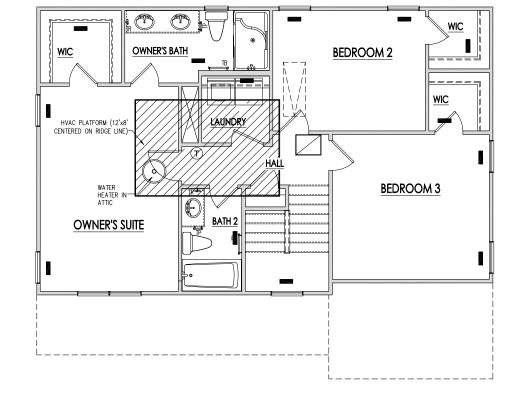

SECOND FLOOR HVAC PLAN 'CLASSIC'

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

	FOYER	ZONE 00	BATHROOM 2	ZONE 32
	KITCHEN / BUTLER PANTRY	ZONE 01	BATHROOM 3	ZONE 33
	POWDER ROOM	ZONE 02	BATHROOM 4	ZONE 34
	FAMILY ROOM	ZONE 03	BATHROOM 5	ZONE 35
	DINING	ZONE 04	JACK & JILL BATH	ZONE 36
	CAFE / BREAKFAST	ZONE 05	FINISHED BASEMENT	ZONE 37
	MORNING ROOM	ZONE 06	BASEMENT EXT @ SUNROOM	ZONE 38
	INFORMAL DINING	ZONE 07	EXERCISE ROOM	ZONE 39
	LIVING ROOM	ZONE 08		
	FLEX	ZONE 09		
	OFFICE	ZONE 10		
	LAUNDRY	ZONE 11		
	ENTRY	ZONE 12		
	SUNROOM	ZONE 13		
$\nabla \nabla \nabla$		ZONE 14		
	MASTER BATH	ZONE 15		
	SITTING ROOM	ZONE 16		
	MASTER BR WIC	ZONE 17		
	LOFT	ZONE 18		
	HALL	ZONE 19		
	STAIRS	ZONE 20		
	STORAGE	ZONE 21		
	BONUS ROOM	ZONE 22		
	GAME ROOM	ZONE 23		
	MEDIA ROOM	ZONE 24		
	BEDROOM 2	ZONE 25		
	BEDROOM 3	ZONE 26		
	BEDROOM 4	ZONE 27		
	BEDROOM 5	ZONE 28		
	BEDROOM 6	ZONE 29		
	GUEST SUITE	ZONE 30		
	GUEST BATH	ZONE 31		

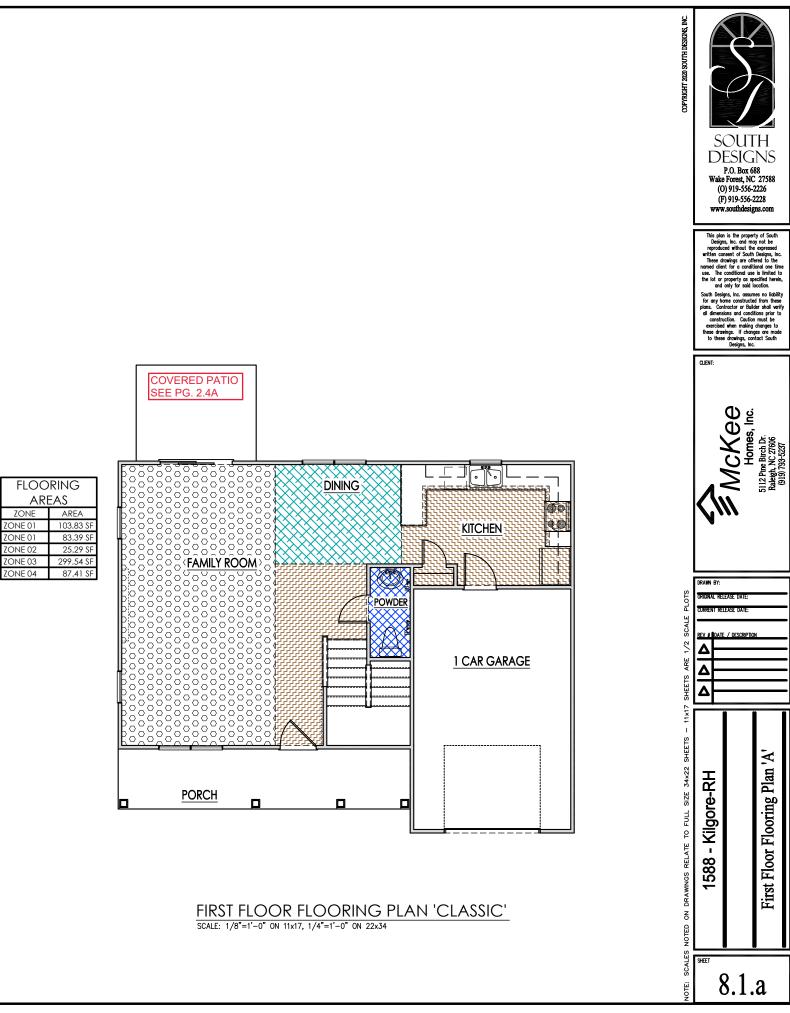

First Floor Flooring Plan 'A'

AREAS

ZONE 01

ZONE 01

	FOYER	ZONE 00	BATHROOM 2	ZONE 32
	KITCHEN / BUTLER PANTRY	ZONE 01	BATHROOM 3	ZONE 33
	POWDER ROOM	ZONE 02	BATHROOM 4	ZONE 34
200	FAMILY ROOM	ZONE 03	BATHROOM 5	ZONE 35
\bigotimes	DINING	ZONE 04	JACK & JILL BATH	ZONE 36
	CAFE / BREAKFAST	ZONE 05	FINISHED BASEMENT	ZONE 37
	MORNING ROOM	ZONE 06	BASEMENT EXT @ SUNROOM	ZONE 38
	INFORMAL DINING	ZONE 07	EXERCISE ROOM	ZONE 39
	LIVING ROOM	ZONE 08		
	FLEX	ZONE 09		
	OFFICE	ZONE 10		
	LAUNDRY	ZONE 11		
	ENTRY	ZONE 12		
	SUNROOM	ZONE 13		
\ \ \ \ \ \ \ \ \ \	MASTER BEDROOM	ZONE 14		
	MASTER BATH	ZONE 15		
	SITTING ROOM	ZONE 16		
	MASTER BR WIC	ZONE 17		
	LOFT	ZONE 18		
	HALL	ZONE 19		
	STAIRS	ZONE 20		
	STORAGE	ZONE 21		
	BONUS ROOM	ZONE 22		
	GAME ROOM	ZONE 23		
	MEDIA ROOM	ZONE 24		
	BEDROOM 2	ZONE 25		
	BEDROOM 3	ZONE 26		
	BEDROOM 4	ZONE 27		
	BEDROOM 5	ZONE 28		
	BEDROOM 6	ZONE 29		
	GUEST SUITE	ZONE 30		
	GUEST BATH	ZONE 31		


Floo	RING	
AR	EAS	
ZONE	AREA	
ONE 11	31.80 SF	
ONE 14	238.62 SF	
ONE 15	42.68 SF	
ONE 18	51.61 SF	
ONE 25	153.24 SF	
ONE 26	183.71 SF	
ONE 32	25.17 SF	
		L

ZONE ZONE 11

ZONE 14

ZONE 15 ZONE 18 ZONE 25

ZONE 26 ZONE 32

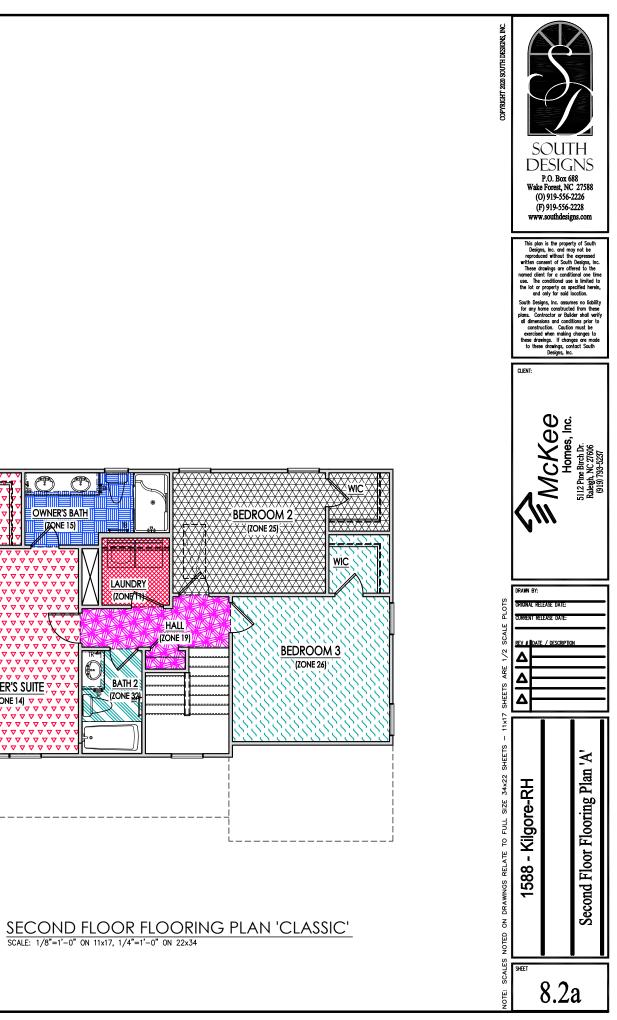

STRUCTURAL PLANS FOR:

KILGORE - RIGHT HAND

INDEX	OF SHEETS	REVISION LOG			
SHEET	TITLE	DATE	REVISED BY	REVISION	
Т	TITLE SHEET: PROJECT INFORMATION AND NOTES				
GN1.0	GENERAL NOTES				
GN1.1	GENERAL NOTES				
S0.1	SLAB FOUNDATION PLAN				
S0.9	CRAWLSPACE FOUNDATION PLAN				
S1.0	FIRST FLOOR CEILING FRAMING PLAN				
S2.0	SECOND FLOOR CEILING FRAMING PLAN				
S3.0	FIRST FLOOR WALL BRACING PLAN				
S4.0	SECOND FLOOR WALL BRACING PLAN				
S5.0	ROOF FRAMING PLAN				
D1.0 - D8.0	DETAILS				

NO	TES	CODE	ENGINEER OF F
 ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT, INCLUDING ROOF GEOMETRY. JDS Consulting, PLLC ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THE PLANS. ENGINEER TO BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE PLANS. DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS. 	 PLANS MUST HAVE SIGNED SEAL TO BE VALID AND ARE LIMITED TO THE FOLLOWING USES: A. IF THESE PLANS ARE ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR 18 MONTHS FROM THE DATE ON THE SEAL, UNLESS ANY CODE-REQUIRED UPDATES ARE PLACED IN EFFECT BY THE MUNICIPALITY. B. IF THESE PLANS ARE NOT ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR A CONDITIONAL, ONE-TIME USE FOR THE LOT OR ADDRESS SPECIFIED ON THE TITLE BLOCK. 	ALL CONSTRUCTION, WORKMANSHIP, AND MATERIAL QUALITY AND SELECTION SHALL BE PER: 2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE	JDS Consulting, PLLC ENGINEERING, BUILDING DESIG CONSULTING SERVICES 8600 'D' JERSEY COURT RALEIGH, NC 27617 FIRM LIC. NO: P-0961 PROJECT REFERENCE: 2190141

		SEA 04540 8/11 9/11/11/1 9-090	EER AL	
	Mains Consulting	GINEERING • SURVEYING • EMEROY JERSEY CT, RALEICH, NC 27617 919480.1075 G.NET; WWW JDSCONSULTING.NET	-	THE LOT NUMBER, PROPERTY, OR AS A MASTER PLAN AS SPECIFIED ON TITLE SHEET. DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS ON DRAWINGS.
F RECORD	CLIENT: MCKEE HOMES	PROTECT: KILGORE - RIGHT HAND	LOCATION: NORTH CAROLINA	SCALE: 1/8" = 1'-0" FOR 11x17 PAPER, 1/4" = 1'-0" FOR 22x34 PAPER, OR AS NOTED
	PROJECT N	21901		
01414	DATE: 08/09/	2021	AWN BY:	C
		TITLE SI	HEET	\dashv

NOTE: ALL CHAPTERS, SECTIONS, TABLES, AND FIGURES CITED WITHOUT A PUBLICATION TITLE ARE FROM THE APPLICABLE RESIDENTIAL CODE (SEE TITLE SHEET).

GENERAL

- IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. FURTHERMORE, CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONSTRUCTION MEANS METHODS AND SAFETY ON SITE NOTICY JDS Con-PLLC IMMEDIATELY IF DISCREPANCIES ON PLAN EXIST.
- BRACED-WALL DESIGN IS BASED ON SECTION R602.10 WALL 2 BRACING. PRIMARY PRESCRIPTIVE METHOD TO BE CS-WSP. SEE WALL BRACING PLANS AND DETAILS FOR ADDITIONAL INFORMATION.

ALL NON-PRESCRIPTIVE SOLUTIONS ARE BASED ON GUIDELINES ESTABLISHED IN THE AMERICAN SOCIETY OF CIVIL ENGINEERS PUBLICATION ASCE 7 AND THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION - SPECIAL DESIGN PROVISIONS FOR WIND AND SEISMIC.

SEISMIC DESIGN SHALL BE PER SECTION R301.2.2 - SEISMIC 3. PROVISIONS, INCLUDING ASSOCIATED TABLES AND FIGURES. BASED ON LOCAL SEISMIC DESIGN CATEGORY.

DESIGN LOADS

ASSUMED SOIL BEARING-CAPACITY	2,000 PSF
	LIVE LOAD
ULTIMATE DESIGN WIND SPEED	115 MPH, EXPOSURE B
GROUND SNOW	15 PSF
ROOF	20 PSF
RESIDENTIAL CODE TABLE R301.5	LIVE LOAD (PSF)
DWELLING UNITS	40
SLEEPING ROOMS	30
ATTICS WITH STORAGE	20
ATTICS WITHOUT STORAGE	10
STAIRS	40
DECKS	40
EXTERIOR BALCONIES	60
PASSENGER VEHICLE GARAGES	50
FIRE ESCAPES	40
GUARDS AND HANDRAILS	200 (pounds, concentrated)

COMPONENT AND CLADDING LOADS. INCLUDING THOSE FOR DOORS AND WINDOWS, SHALL BE DERIVED FROM TABLES R301.2(2) AND R301.2(3) FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 35 FEET, LOCATED IN EXPOSURE B

KING STUD COLUMN

LAMINATED VENEER

PRESSURE TREATED

SQUARE FOOT (FEET)

MINIMUM NOT TO SCALE

ROOFING ROUGH OPENING

TREAD TEMPERED GLASS

SINGLE JOIST

STUD POCKET

THICK(NESS)

TRIPLE JOIST

TRIPLE RAFTER

TOP OF CURB / CONCRETE

UNLESS NOTED OTHERWISE CLOTHES WASHER WATER HEATER WELDED WIRE FABRIC EXTRA JOIST

REFRIGERATOR

ROOF SUPPORT

STUD COLUMN

SHELF / SHELVES SHEATHING

MECHANICAL

MANUFACTURER

ABBREVIATIONS			KS	KING STUD
			LVL	LAMINATED
	ABV	ABOVE		LUMBER
	AFF	ABOVE FINISHED FLOOR	MAX	MAXIMUM
	ALT	ALTERNATE	MECH	MECHANIC
	BRG	BEARING	MFTR	MANUFACT
	BSMT	BASEMENT	MIN	MINIMUM
	CANT	CANTILEVER	NTS	NOT TO SC
	CJ	CEILING JOIST	OA	OVERALL
	CLG	CEILING	oc	ON CENTER
	CMU	CONCRETE MASONRY UNIT	РТ	PRESSURE
	со	CASED OPENING	R	RISER
	COL	COLUMN	REF	REFRIGERA
	CONC	CONCRETE	RFG	ROOFING
	CONT	CONTINUOUS	RO	ROUGH OPI
	D	CLOTHES DRYER	RS	ROOF SUPP
	DBL	DOUBLE	SC	STUD COLU
	DIAM	DIAMETER	SF	SQUARE FO
	DJ	DOUBLE JOIST	SH	SHELF / SH
	DN	DOWN	SHTG	SHEATHING
	DP	DEEP	SHW	SHOWER
	DR	DOUBLE RAFTER	SIM	SIMILAR
	DSP	DOUBLE STUD POCKET	SJ	SINGLE JOI
	EA	EACH	SP	STUD POCK
	EE	EACH END		SPECIFIED
	EQ	EQUAL	SQ	SQUARE
	EX	EXTERIOR	т	TREAD
	FAU	FORCED-AIR UNIT	TEMP	TEMPERED
	FDN	FOUNDATION	THK	THICK(NES
	FF	FINISHED FLOOR	TJ	TRIPLE JOI
	FLR	FLOOR(ING)	TOC	TOP OF CU
	FP	FIREPLACE	TR	TRIPLE RAP
	FTG	FOOTING	ТҮР	TYPICAL
	HB	HOSE BIBB	UNO	UNLESS NO
	HDR	HEADER	W	CLOTHES W
	HGR	HANGER	WH	WATER HEA
	JS	JACK STUD COLUMN	WWF	WELDED W
			XJ	EXTRA JOIS

MATERIALS

1. INTERIOR / TRIMMED FRAMING LUMBER SHALL BE #2 SPRUCE PINE FIR (SPF) WITH THE FOLLOWING DESIGN PROPERTIES (#2 SOUTHERN YELLOW PINE MAY BE SUBSTITUTED)

Fb = 875 PSI Fv = 70 PSI E = 1.4E6 PSI

2. FRAMING LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND, CONCRETE, OR MASONRY SHALL BE PRESSURE TREATED #2 SOUTHERN YELLOW PINE (SYP) WITH THE FOLLOWING DESIGN PROPERTIES

Fb = 975 PSI Fv = 95 PSI E = 1.6E6 PSI

3. LVL STRUCTURAL MEMBERS TO BE LAMINATED VENEER LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES

Fb = 2600 PSI Fv = 285 PSI E = 1.9E6 PSI

4. PSL STRUCTURAL MEMBERS TO BE PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Eb = 2900 PSI Ev = 290 PSI E = 2.0E6 PSI

5. LSL STRUCTURAL MEMBERS TO BE LAMINATED STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2250 PSI Fv = 400 PSI E = 1.55E6 PSI

- 6. STRUCTURAL STEEL WIDE-FLANGE BEAMS SHALL CONFORM TO ASTM A992. Fy = 50 KSI
- 7. REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615, GRADE 60.
- 8 POURED CONCRETE COMPRESSIVE STRENGTH TO BE A MINIMUM 3.000 PSI AT 28 DAYS, MATERIALS USED TO PRODUCE CONCRETE SHALL COMPLY WITH THE APPLICABLE STANDARDS LISTED IN AMERICAN CONCRETE INSTITUTE STANDARD ACI 318 OR ASTM
- 9. CONCRETE SUBJECT TO MODERATE OR SEVERE WEATHERING PROBABILITY PER TABLE R301.2(1) SHALL BE AIR-ENTRAINED WHEN REQUIRED BY TABLE R402.2.
- 10. CONCRETE MASONRY UNITS (CMU) SHALL CONFORM TO AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- 11. MORTAR SHALL COMPLY WITH ASTM INTERNATIONAL STANDARD
- 12. INDICATED MODEL NUMBERS FOR ALL METAL HANGERS, STRAPS, FRAMING CONNECTORS, AND HOLD-DOWNS ARE SIMPSON STRONG-TIE BRAND, EQUIVALENT USP BRAND PRODUCTS ARE ACCEPTABLE
- 13. REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES.

FOUNDATION

- MINIMUM ALLOWABLE SOIL BEARING CAPACITY IS ASSUMED TO BE 2,000 PSF. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY SOIL BEARING CAPACITY IF UNSATISFACTORY CONDITIONS EXIST
- CONCRETE FOUNDATION WALLS TO BE SELECTED AND 2. CONSTRUCTED PER SECTION R404 OR AMERICAN CONCRETE INSTITUTE STANDARD ACI 318.
- MASONRY FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION R404 AND/OR AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND/OR THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- CONCRETE WALL HORIZONTAL REINFORCEMENT TO BE PER TABLE R404.1.2(1) OR AS NOTED OR DETAILED. CONCRETE WALL VERTICAL REINFORCEMENT TO BE PER TABLES R404.1.2(3 AND 4) OR AS NOTED OR DETAILED, ALL CONCRETE WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM. B. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER
 - SECTION R405
- PLAIN-MASONRY WALL DESIGN TO BE PER <u>TABLE R404.1.1(1)</u> OR AS NOTED OR DETAILED. MASONRY WALLS WITH VERTICAL 5. REINFORCEMENT TO BE PER TABLES R404.1.1 (2 THROUGH 4) OR AS NOTED OR DETAILED. ALL MASONRY WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
 - B WALL REINFORCING SHALL BE PLACED ACCORDING TO FOOTNOTE (c) OF THE TABLES (REINFORCING IS NOT CENTERED IN WALL).
 - C. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R405
- WOOD SILL PLATES TO BE ANCHORED TO THE FOUNDATION WITH 6. 1/2" DIAMETER ANCHOR BOLTS WITH MINIMUM 7" EMBEDMENT. SPACED A MAXIMUM OF 6'-0" OC AND WITHIN 12" FROM THE ENDS OF EACH PLATE SECTION. INSTALL MINIMUM (2) ANCHOR BOLTS PER SECTION. SEE SECTION R403.1.6 FOR SPECIFIC CONDITIONS.
- THE UNSUPPORTED HEIGHT OF SOLID MASONRY PIERS SHALL NOT EXCEED TEN TIMES THEIR LEAST DIMENSION. UNFILLED, HOLLOW PIERS MAY BE USED IF THE UNSUPPORTED HEIGHT IS NOT MORE THAN FOUR TIMES THEIR LEAST DIMENSION
- CENTERS OF PIERS TO BEAR IN THE MIDDLE THIRD OF THE FOOTINGS, AND GIRDERS SHALL CENTER IN THE MIDDLE THIRD OF THE PIERS.
- ALL FOOTINGS TO HAVE MINIMUM 2" PROJECTION ON EACH SIDE OF FOUNDATION WALLS (SEE DETAILS)
- 10. ALL REBAR NOTED IN CONCRETE TO HAVE AT LEAST 2" COVER FROM EDGE OF CONCRETE TO EDGE OF REBAR.
- 11. FRAMING TO BE FLUSH WITH FOUNDATION WALLS.
- 12. WITH CLASS 1 SOILS, VAPOR BARRIER AND CRUSHED STONE MAY BE OMITTED.

FRAMING

- 4. STRUCTURAL COMPONENTS.
 - CONSTRUCTION

 - LUMBER
 - LIPLIET CAPACITY
 - DETAILS.
 - SPECIFICATIONS.

 - MANUFACTURER.
 - C.
 - D.

 - EACH END OF FLITCH BEAM

 - EXTERIOR RIM JOIST / BOARD.
 - SHALL BE MET.

1. ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED W/ MIN (1) JACK STUD AND (1) KING STUD EACH END, UNO.

2. ALL NON-BEARING HEADERS TO BE (2) 2x4, UNO.

3. NON-BEARING INTERIOR WALLS NOT MORE THAN 10' NOMINAL HEIGHT AND NOT SHOWN AS BRACED WALLS MAY BE FRAMED WITH 2x4 STUDS @ 24" OC.

SOLID BLOCKING TO BE PROVIDED AT ALL POINT LOADS THROUGH FLOOR LEVELS TO THE FOUNDATION OR TO OTHER

ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF

6. ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.

7. PORCH / PATIO COLUMNS TO BE 4x4 MINIMUM PRESSURE-TREATED

A. ATTACH PORCH COLUMNS TO SLAB / FDN WALL USING ABA ABU, ABW, OR CPT SIMPSON POST BASES TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500# UPLIFT CAPACITY.

ATTACH PORCH COLUMNS TO PORCH BEAMS USING AC OR BC SIMPSON POST CAPS TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500#

C. TRIM OUT COLUMN(S) AND BEAM(S) PER BUILDER AND

ALL ENGINEERED WOOD PRODUCTS (LVL, PSL, LSL, ETC.) SHALL BE INSTALLED WITH CONNECTIONS PER MANUFACTURER

9. ENGINEERED WOOD FLOOR SYSTEMS AND ROOF TRUSS SYSTEMS: A. SHOP DRAWINGS FOR THE SYSTEMS SHALL BE PROVIDED TO THE ENGINEER OF RECORD FOR REVIEW AND COORDINATION BEFORE CONSTRUCTION. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS

INSTALLATION OF THE SYSTEMS SHALL BE PER

MANUFACTURER'S INSTRUCTIONS. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO

COINCIDE WITH THE SUPPORT LOCATIONS SHOWN IN THESE

10. ALL BEAMS TO BE CONTINUOUSLY SUPPORTED LATERALLY AND SHALL BEAR FULL WIDTH ON THE SUPPORTING WALLS OR COLUMNS INDICATED, WITH A MINIMUM OF THREE STUDS, UNO

11. ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MIN BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR TWO 1/2" x 4" LAG SCREWS, UNO.


12. STEEL FLITCH BEAMS TO BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM 307) WITH WASHERS PLACED UNDER THE THREADED END OF THE BOLT. BOLTS TO BE SPACED AT 24" OC (MAX) AND STAGGERED TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH TWO BOLTS TO BE LOCATED AT 6" FROM

13. WHEN A 4-PLY LVL BEAM IS USED, ATTACH WITH (1) 1/2" DIAMETER BOLT, 12" OC, STAGGERED TOP AND BOTTOM, 1 1/2" MIN FROM ENDS. ALTERNATE EQUIVALENT ATTACHMENT METHOD MAY BE USED, SUCH AS SDS, SDW, OR TRUSSLOK SCREWS (SEE MANUFACTURER SPECIFICATIONS).

14. FOR STUD COLUMNS OF 4-OR-MORE STUDS, INSTALL SIMPSON STRONG-TIE CS16 STRAPS ACROSS STUDS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).

15. FLOOR JOISTS ADJACENT AND PARALLEL TO THE EXTERIOR FOUNDATION WALL SHALL BE PROVIDED WITH FULL-DEPTH SOLID BLOCKING, NOT LESS THAN TWO (2) INCHES NOMINAL IN THICKNESS, PLACED PERPENDICULAR TO THE JOIST AT SPACING NOT MORE THAN FOUR (4) FEET. THE BLOCKING SHALL BE NAILED TO THE FLOOR SHEATHING, THE SILL PLATE, THE JOIST, AND THE

16. BRACED WALL PANELS SHALL BE FASTENED TO MEET THE UPLIFT-RESISTANCE REQUIREMENTS IN CHAPTERS 6 AND 8 OF THE APPLICABLE CODE (SEE TITLE SHEET). REQUIREMENTS OF THE STRUCTURAL DRAWINGS THAT EXCEED THE CODE MINIMUM

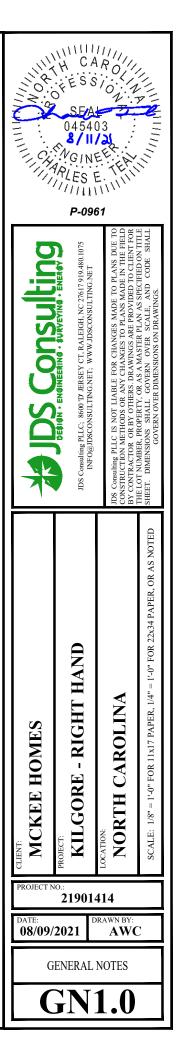

FASTENER SCHEDULE			
CONNECTION	3" x 0.131" NAIL	3" x 0.120" NAIL	
JOIST TO SILL PLATE	(4) TOE NAILS	(4) TOE NAILS	
SOLE PLATE TO JOIST / BLOCKING	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)	
STUD TO SOLE PLATE	(4) TOE NAILS	(4) TOE NAILS	
TOP OR SOLE PLATE TO STUD	(3) FACE NAILS	(4) FACE NAILS	
RIM JOIST OR BAND JOIST TO TOP PLATE OR SILL PLATE	TOE NAILS @ 6" OC	TOE NAILS @ 4" OC	
BLOCKING BETWEEN JOISTS TO TOP PLATE OR SILL PLATE	(4) TOE NAILS	(4) TOE NAILS	
DOUBLE STUD	NAILS @ 8" OC	NAILS @ 8" OC	
DOUBLE TOP PLATES	NAILS @ 12" OC	NAILS @ 12" OC	
DOUBLE TOP PLATES LAP (24" MIN LAP LENGTH)	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT	
TOP PLATE LAP AT CORNERS AND INTERSECTING WALLS	(3) FACE NAILS	(3) FACE NAILS	
OPEN-WEB TRUSS BOTTOM CHORD TO TOP PLATES OR SILL PLATE (PARALLEL TO WALL)	NAILS @ 6" OC	NAILS @ 4" OC	
BOTTOM CHORD OF TRUSS TO TOP PLATES OR SILL PLATE (PERPENDICULAR TO WALL)	(3) TOE NAILS	(3) TOE NAILS	

SEE <u>TABLE R602.3(1)</u> FOR ADDITIONAL STRUCTURAL-MEMBER FASTENING REQUIREMENTS.

DETAILS AND NOTES ON DRAWINGS GOVERN.

BALLOON WALL FRAMING SCHEDULE (USE THESE STANDARDS UNLESS NOTED OTHERWISE ON THE FRAMING PLAN SHEETS)

FRAMING MEMBER SIZE	MAX HEIGHT (PLATE TO PLATE) 115 MPH ULTIMATE DESIGN WIND SPEED
2x4 @ 16" OC	10'-0"
2x4 @ 12" OC	12'-0"
2x6 @ 16" OC	15'-0"
2x6 @ 12" OC	17'-9"
2x8 @ 16" OC	19'-0"
2x8 @ 12" OC	22'-0"
(2) 2x4 @ 16" OC	14'-6"
(2) 2x4 @ 12" OC	17'-0"

 (2) 2x6 @ 16" OC
 21'-6"

 (2) 2x6 @ 12" OC
 25'-0"

 (2) 2x8 @ 16" OC
 27'-0"

 (2) 2x8 @ 12" OC
 31'-0"

a. ALL HEIGHTS ARE MEASURED SUBFLOOR TO TOP OF WALL PLATE.

- b. WHEN SPLIT-FRAMED WALLS ARE USED FOR HEIGHTS OVER 12', THE CONTRACTOR SHALL ADD 6' MINIMUM OF CS16 COIL STRAPPING (FULLY NAILED), CENTERED OVER THE WALL BREAK.
- c. FINGER-JOINTED MEMBERS MAY BE USED FOR CONTINUOUS HEIGHTS WHERE TRADITIONALLY MILLED LUMBER LENGTHS ARE LIMITED.
- d. FOR GREATER WIND SPEED, SEE ENGINEERED SOLUTION FOR CONDITION IN DRAWINGS.

ROOF SYSTEMS

TRUSSED ROOF - STRUCTURAL NOTES

- 1. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- 2. DENOTES OVER-FRAMED AREA
- 3. MINIMUM 7/16" OSB ROOF SHEATHING
- 4. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- 5. MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTION.
- 6. PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 7. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.


STICK-FRAMED ROOF - STRUCTURAL NOTES


- 1. PROVIDE 2x4 COLLAR TIES AT 48" OC AT UPPER THIRD OF RAFTERS, UNLESS NOTED OTHERWISE.
- 2. FUR RIDGES FOR FULL RAFTER CONTACT.
- 3. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- 4. DENOTES OVER-FRAMED AREA
- 5. MINIMUM 7/16" OSB ROOF SHEATHING
- PROVIDE 2x4 RAFTER TIES AT 16" OC AT 45° BETWEEN RAFTERS AND CEILING JOISTS. USE (4) 16d NAILS AT EACH CONNECTION. RAFTER TIES MAY BE SPACED AT 48" OC AT LOCATIONS WHERE NO KNEE WALLS ARE INSTALLED.
- 7. PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH RAFTER-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 8. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.


BRICK VENEER LINTEL SCHEDULE			
SPAN	STEEL ANGLE SIZE	END BEARING LENGTH	
UP TO 42"	L3-1/2"x3-1/2"x1/4"	8" (MIN. @ EACH END)	
UP TO 72"	L6"x4"x5/16"* (LLV)	8" (MIN. @ EACH END)	
OVER 72" L6"x4"x5/16"* (LLV) ATTACH LINTEL w/ THRU BOLT @ 12" OC, 3" FROM EACH			

* FOR QUEEN BRICK: LINTELS AT THIS CONDITION MAY BE 5"x3-1/2"x5/16"

NOTE: BRICK LINTELS AT SLOPED AREAS TO BE 4"x3-1/2"x1/4" STEEL ANGLE WITH 16D NAILS IN 3/16" HOLES IN 4" ANGLE LEG AT 12" OC TO TRIPLE RAFTER. WHEN THE SLOPE EXCEEDS 4:12 A MINIMUM OF 3"x3"x1/4" PLATES SHALL BE WELDED AT 24" OC ALONG THE STEEL ANGLE.

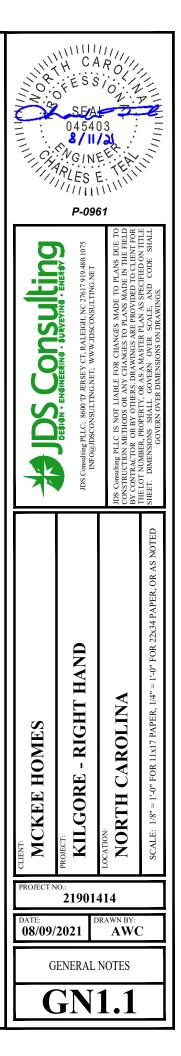

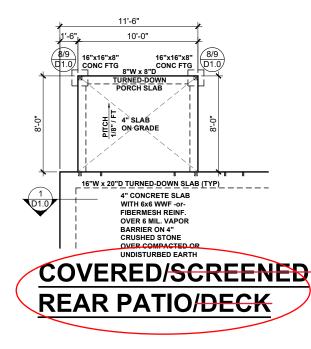

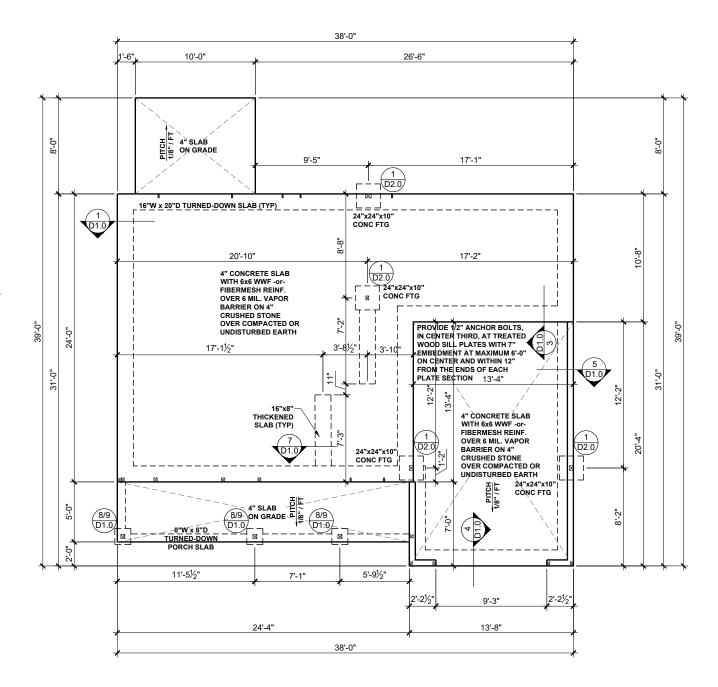

SLAB FOUNDATION PLAN - CLASSIC

SCALE: 1/8" = 1'-0"

BEAM & POINT LOAD LEGEND




INTERIOR LOAD BEARING WALL ----- ROOF RAFTER / TRUSS SUPPORT · - DOUBLE RAFTER / DOUBLE JOIST - STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER POINT LOAD TRANSFER POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

CONCRETE SLAB REINFORCING SUBSTITUTION OF SYNTHETIC FIBER MIX IN LIEU OF WWF IN NON STRUCTURAL SLABS:

- NO SUBSTITUTION ALLOWED IN SLABS INSTALLED ON RAISED METAL DECKING NO SUBSTITUTION ALLOWED IN SLABS WITH GRADE BEAMS UNLESS A REBAR MAT IS INSTALLED NO SUBSTITUTION ALLOWED IF ANY SOILS HAVE BEEN FOUND TO BE EXPANSIVE SOILS ON SITE NO SUBSTITUTION ALLOWED FOR SLAB POURS DIRECTLY ON GRADE; A 4" BASE MATERIAL OF CRUSHED STONE OR WELL DRAINING CLEAN SAND IS REQUIRED FOR SUBSTITUTION NO SUBSTITUTION ALLOWED FOR ANY SITES WITH A
- NO SUBSTITUTION ALLOWED FOR ANY SITES WITH A DCP BLOW COUNT OF 10 OR LESS. FIBER MIX VOLUMES MUST BE FOLLOWED PER THE MANUFACTURES SPECIFICATIONS
- mmin A CONTRACTOR OF THE CONTRACT ON THE CONTRACT OF THE CONTRACT. THE CONTRACT OF THE CONTRACT. THE CONTRACT OF THE CONTRACT OF THE CONTRACT OF THE CONTRACT OF THE CONTRACT. THE CONTRACT OF THE CONTRACT OF THE CONTRACT OF THE CONTRACT OF THE CONTRACT. THE CONTRACT OF THE CONT 045403 11/1000

P-0961 **Consulting** CT, RALEIGH, NC 27617 919.480 WWW.JDSCONSULTING.NET TING.NET; SOL 8600 SUL7 JDS Consulting PLLC; INFO@JDSCO R STRUCTION 20 FOR 22x34 PAPER, OR AS NOTED HAND - **RIGHT** CAROLIN **MCKEE HOMES** KILGORE NORTH SCALE 21901414 DATE DRAWN BY 08/09/2021 AWC SLAB FOUNDATION PLAN

S0.1A

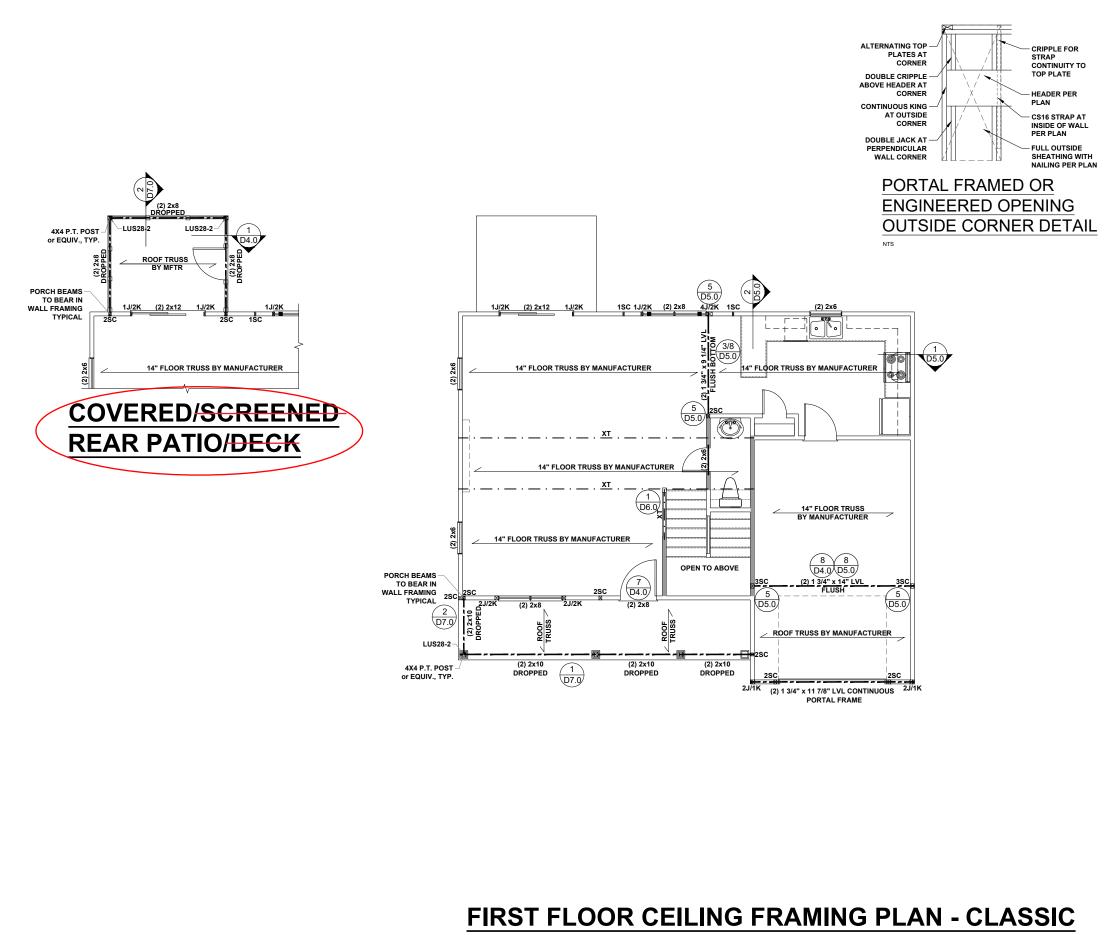

SCALE: 1/8" = 1'-0"

BEAM & POINT LOAD LEGEND





INTERIOR LOAD BEARING WALL ---- ROOF RAFTER / TRUSS SUPPORT DOUBLE RAFTER / DOUBLE JOIST STRUCTURAL BEAM / GIRDER VINDOW / DOOR HEADER POINT LOAD TRANSFER POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - (SEE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS.)

- ALL FRAMING TO BE #2 SPF MINIMUM
- ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTE w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- EXTERIOR WALL OPENINGS OVER 3' TO HAVE MULTIPLE KING STUDS AS NOTED ON PLAN.
- ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J (1) K, UNO.
- PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION. MINIMUM BEAM SUPPORT IS (1) 2x4 STUD.
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.
- FRONT PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT TOP AND BOTTOM USING SIMPSON (OR EQUIV) COLUMN BASE OR SST A24 BRACKETS. TRIM OUT PER BUILDER.
- PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED A BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO PORCH HEADER / BAND.
- WHEN A 4-PLY LVL IS USED, ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM ENDS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS).
- FOR STUD COLUMNS OF 4 OR MORE, INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, OF INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).

FLOOR FRAMING TO BE 14" DEEP FLOOR TRUSSES 24" O.C. MAXIMUM SPACING. SEE TRUSS ENGINEERING AND LAYOUT FOR SPECIFIC INFORMATION

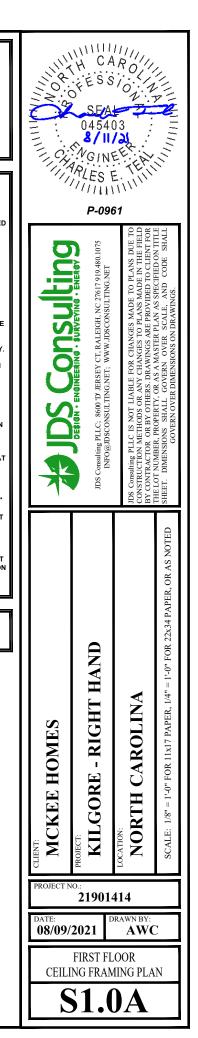

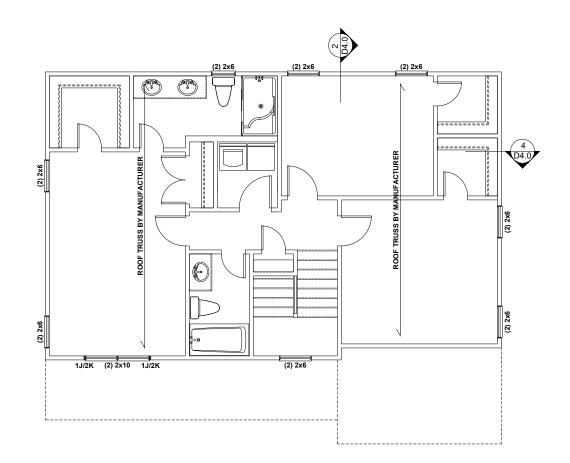

SECOND FLOOR CEILING FRAMING PLAN - CLASSIC

SCALE: 1/8" = 1'-0"


BEAM & POINT LOAD LEGEND




INTERIOR LOAD BEARING WALL ----- ROOF RAFTER / TRUSS SUPPORT ----- DOUBLE RAFTER / DOUBLE JOIST STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER POINT LOAD TRANSFER POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - (SEE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS.)

- ALL FRAMING TO BE #2 SPF MINIMUM
- ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- EXTERIOR WALL OPENINGS OVER 3' TO HAVE MULTIPLE KING STUDS AS NOTED ON PLAN.
- ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J / (1) K, UNO.
- PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
- ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION. MINIMUM BEAM SUPPORT IS (1) 2x4 STUD.
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.
- FRONT PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT TOP AND BOTTOM USING SIMPSON (OR EQUIV) COLUMN BASE OR SST A24 BRACKETS. TRIM OUT PER BUILDER.
- PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO PORCH HEADER / BAND.
- WHEN A 4-PLY LVL IS USED, ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM ENDS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS).
- . FOR STUD COLUMNS OF 4 OR MORE, INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).

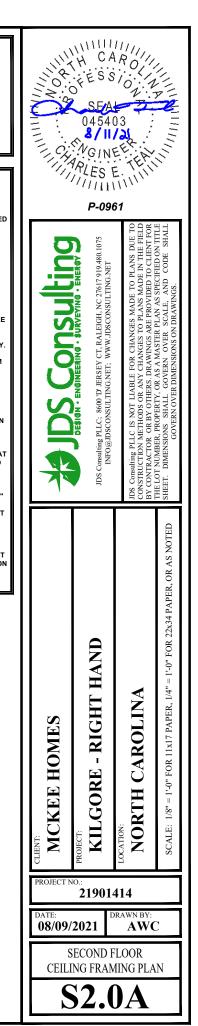


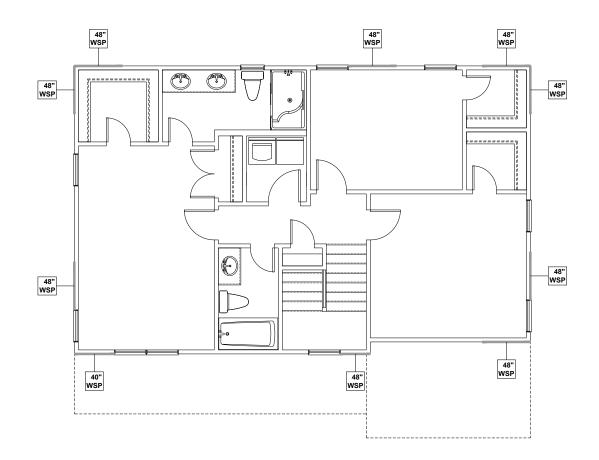



SEE SHEET D8.0 FOR WALL BRACING DETAILS

SECOND FLOOR WALL BRACING PLAN - CLASSIC

SCALE: 1/8" = 1'-0" LAYOUTS AND SPECIFICATIONS FOR ULTIMATE WIND SPEEDS LESS THAN 130 MPH ONLY

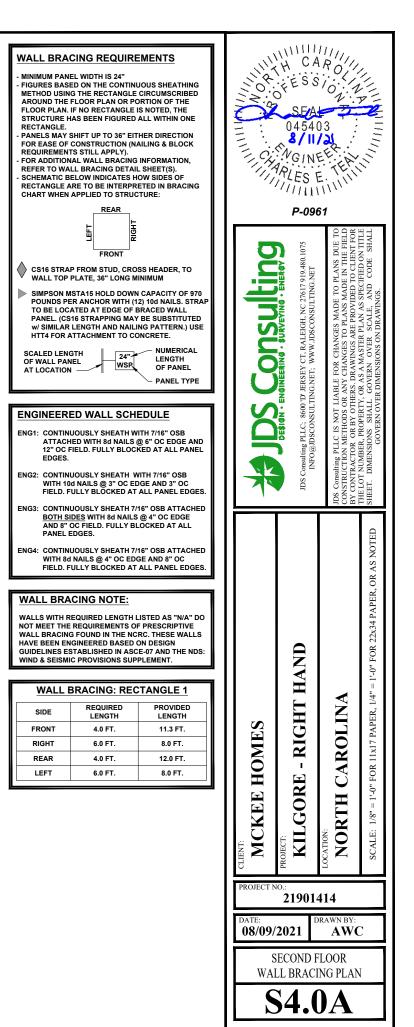

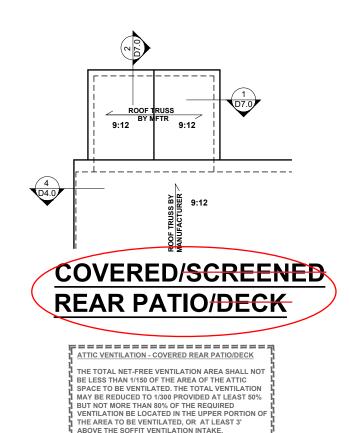

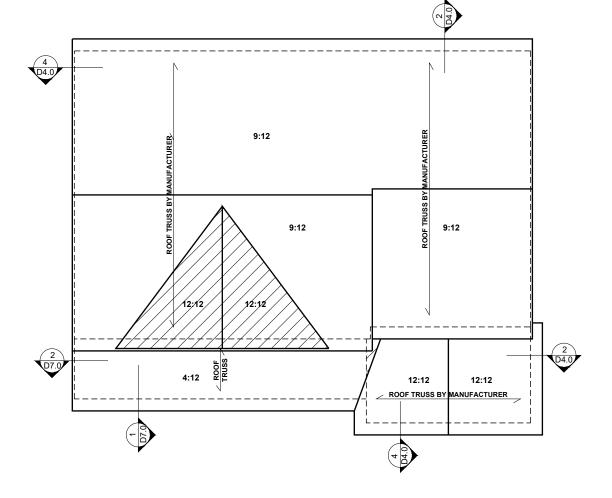

REQUIRED

L___________________

ROOF FRAMING PLAN - CLASSIC

SCALE: 1/8" = 1'-0"

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL ROOF RAFTER / TRUSS SUPPORT DOUBLE RAFTER / DOUBLE JOIST STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER POINT LOAD TRANSFER POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

TRUSSED ROOF - STRUCTURAL NOTES

- 1. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.
 - DENOTES OVER-FRAMED AREA
- 3. MINIMUM 7/16" OSB ROOF SHEATHING
- 4. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- 5. MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTION.
- 6. PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 7. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

ATTIC VENTILATION

THE TOTAL NET-FREE VENTILATION AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF THE ATTIC SPACE TO BE VENTILATED. THE TOTAL VENTILATION MAY BE REDUCED TO 1/300 PROVIDED AT LEAST 50% BUT NOT MORE THAN 80% OF THE REQUIRED VENTILATION BE LOCATED IN THE UPPER PORTION OF THE AREA TO BE VENTILATED, OR AT LEAST 3' ABOVE THE SOFFIT VENTILATION INTAKE.

- 1129 SQUARE FEET OF TOTAL ATTIC / 150 =
- 7.5 SQUARE FEET OF NET-FREE VENTILATION REQUIRED

TRUSS UPLIFT CONNECTORS: EXPOSURE B, 115 MPH, ANY PITCH, 24" O.C. MAX ROOF TRUSS SPACING

TRUSSES SHALL BE ATTACHED TO SUPPORT WALL FOR UPLIFT RESISTANCE. CONTINUOUS OSB WALL SHEATHING BELOW PROVIDES CONTINUOUS UPLIFT RESISTANCE TO FOUNDATION. ALL TRUSSES SUPPORTED BY INTERMEDIATE SUPPORT WALLS, KNEEWALLS, OR BEAMS SHALL BE ATTACHED TO SUPPORTING MEMBER PER SCHEDULE:

ROOF SPAN IS MEASURED HORIZONTALLY BETWEEN FURTHEST SUPPORT POINTS.


ROOF PLAN UP TO 28'


CONNECTOR NAILING PER TABLE 602.3(1) NCRBC 2018 EDITION


OVER 28'


(1) SIMPSON H2.5A HURRICANE CLIP TO DBL TOP PLATE OR BEAM


OR (1) SIMPSON H3 CLIP TO SINGLE 2x4 PLATE

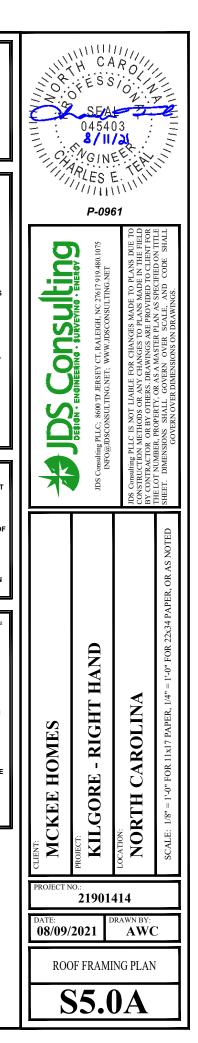

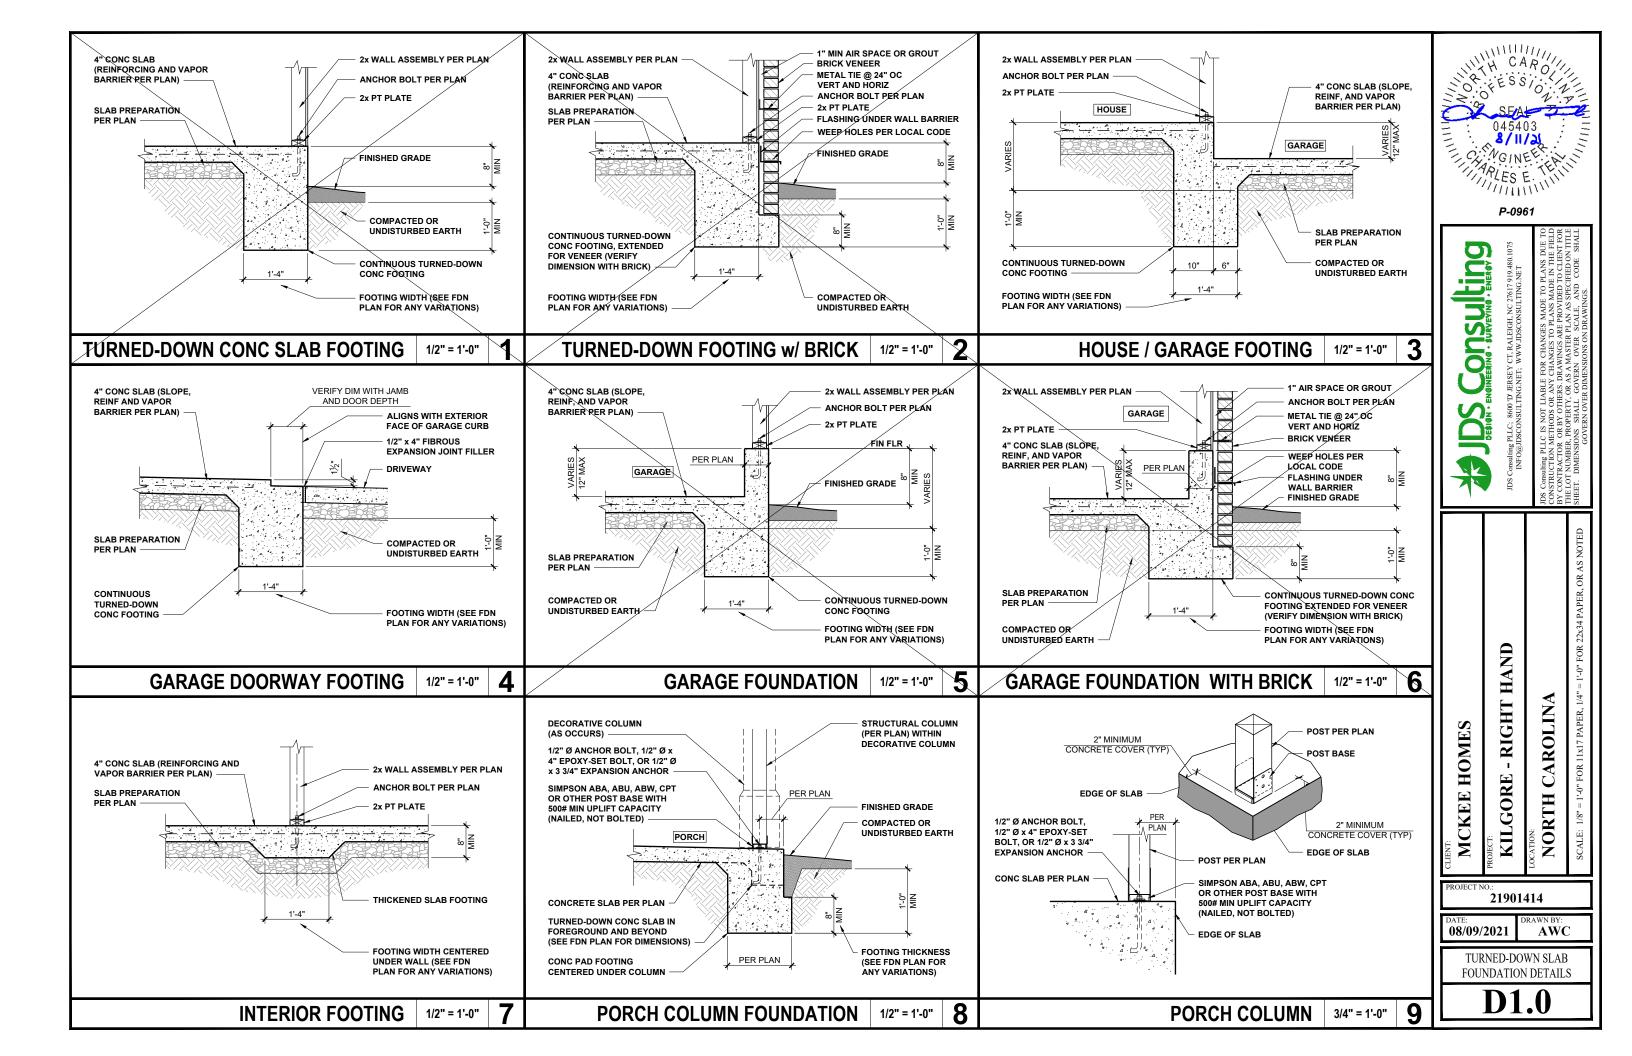

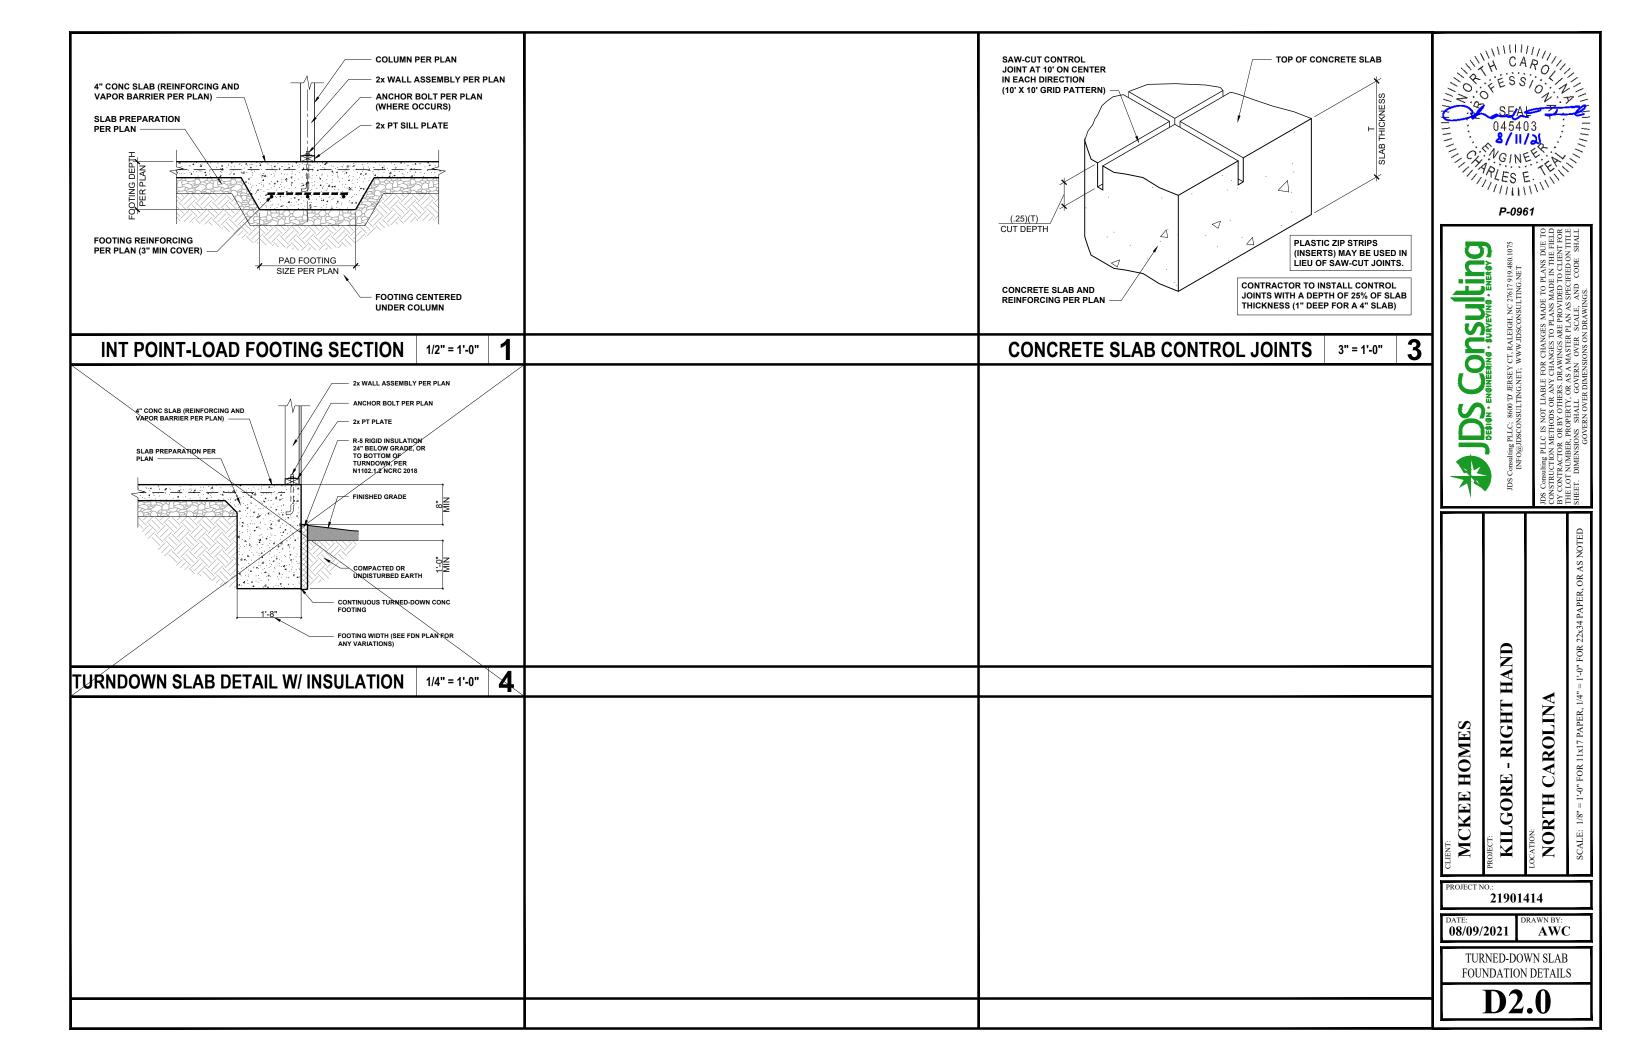

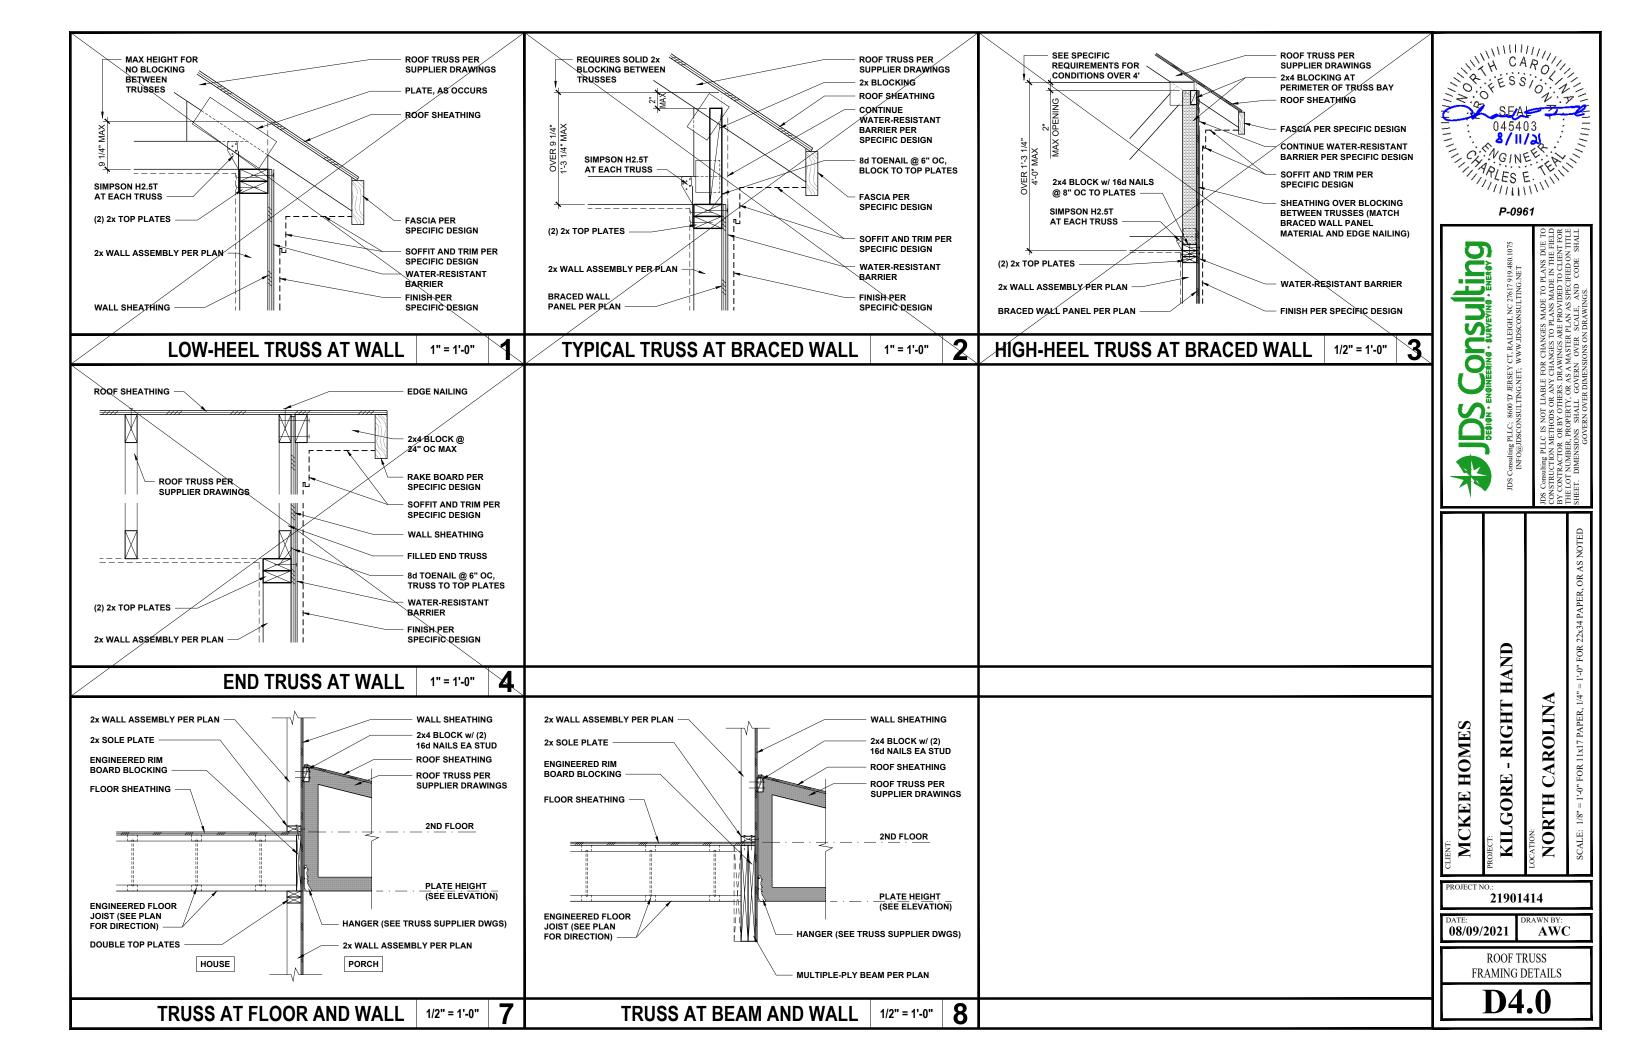

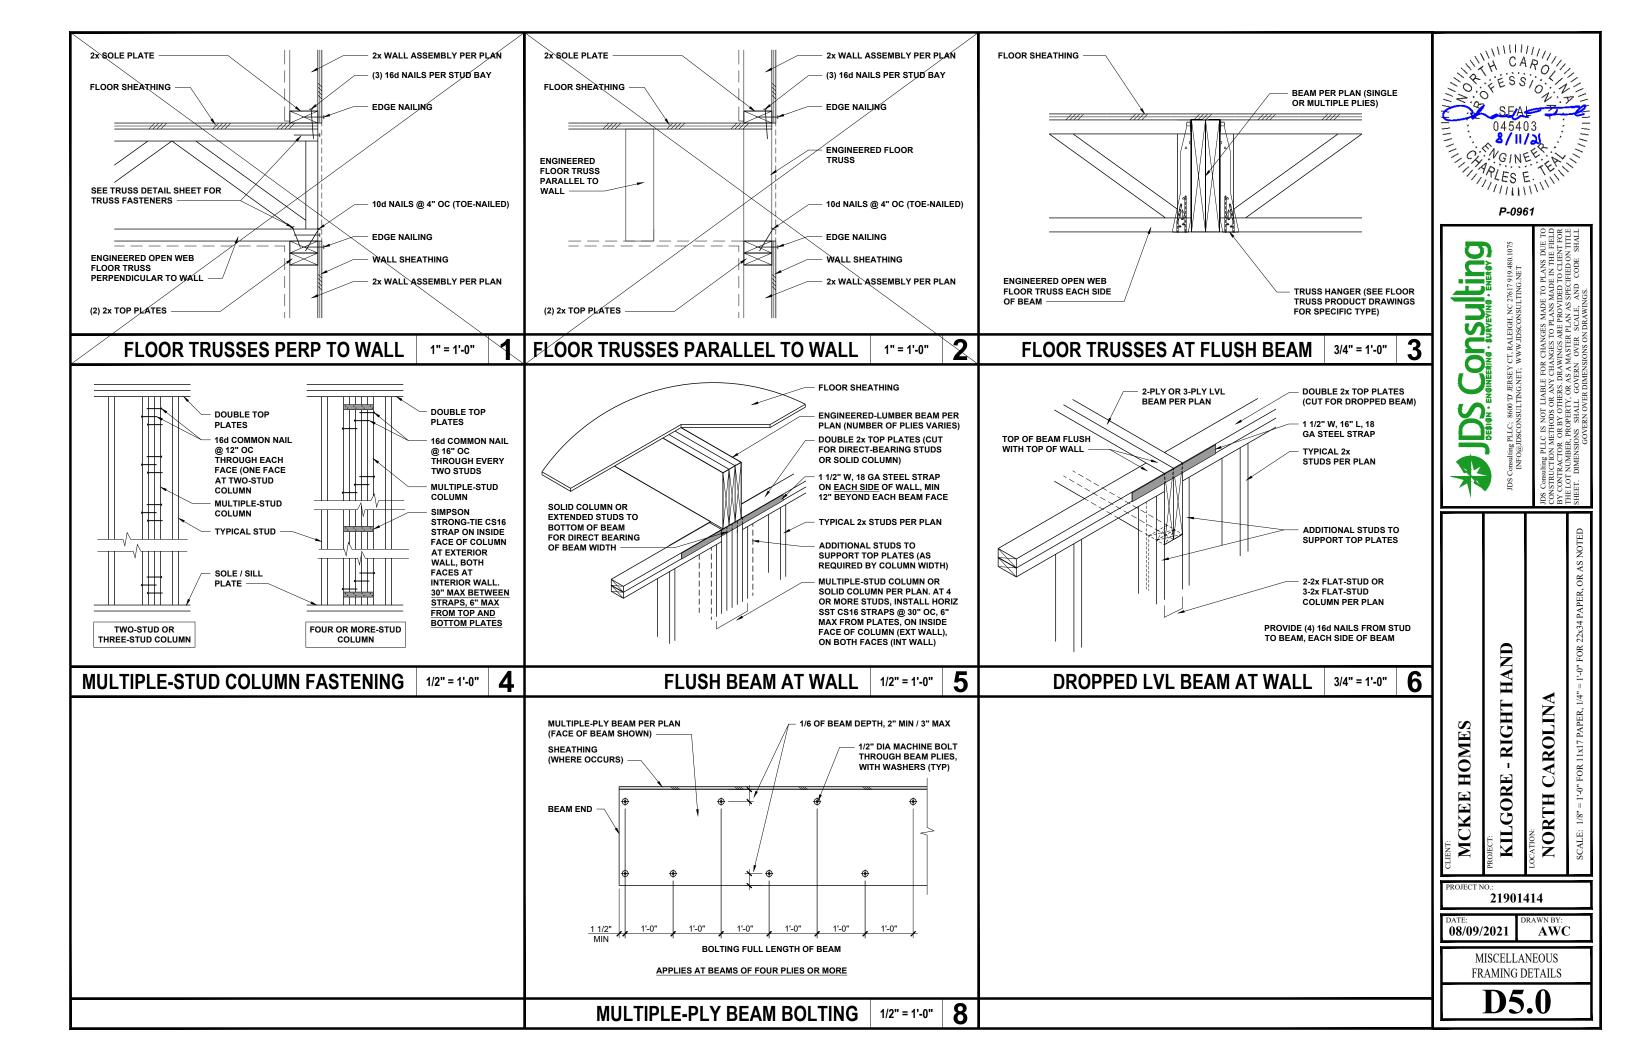

NOTE: EACH TREAD AND RISER MUST BE UNIFORM, WITH NO MORE THAN 3/8" MAXIMUM VARIATION.	
TYPICAL STAIR REQUIREMENTS 1/4" = 1'-0" 1	

