

Harnett County Department of Public Health

PERMIT # SFD2202-0032

Operation Permit

SL1412

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 78 ROYAL ELLA CT. (CHRISTIAN LT. 10)

Name: (owner) TRIPLE A HOMES INC. SUBDIVISION PRINCE PACE LOT # 13

System Installer: ADCOCK ESCAVATING

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 2570 1000 GALLON 1000 LARGE DIAMETER Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

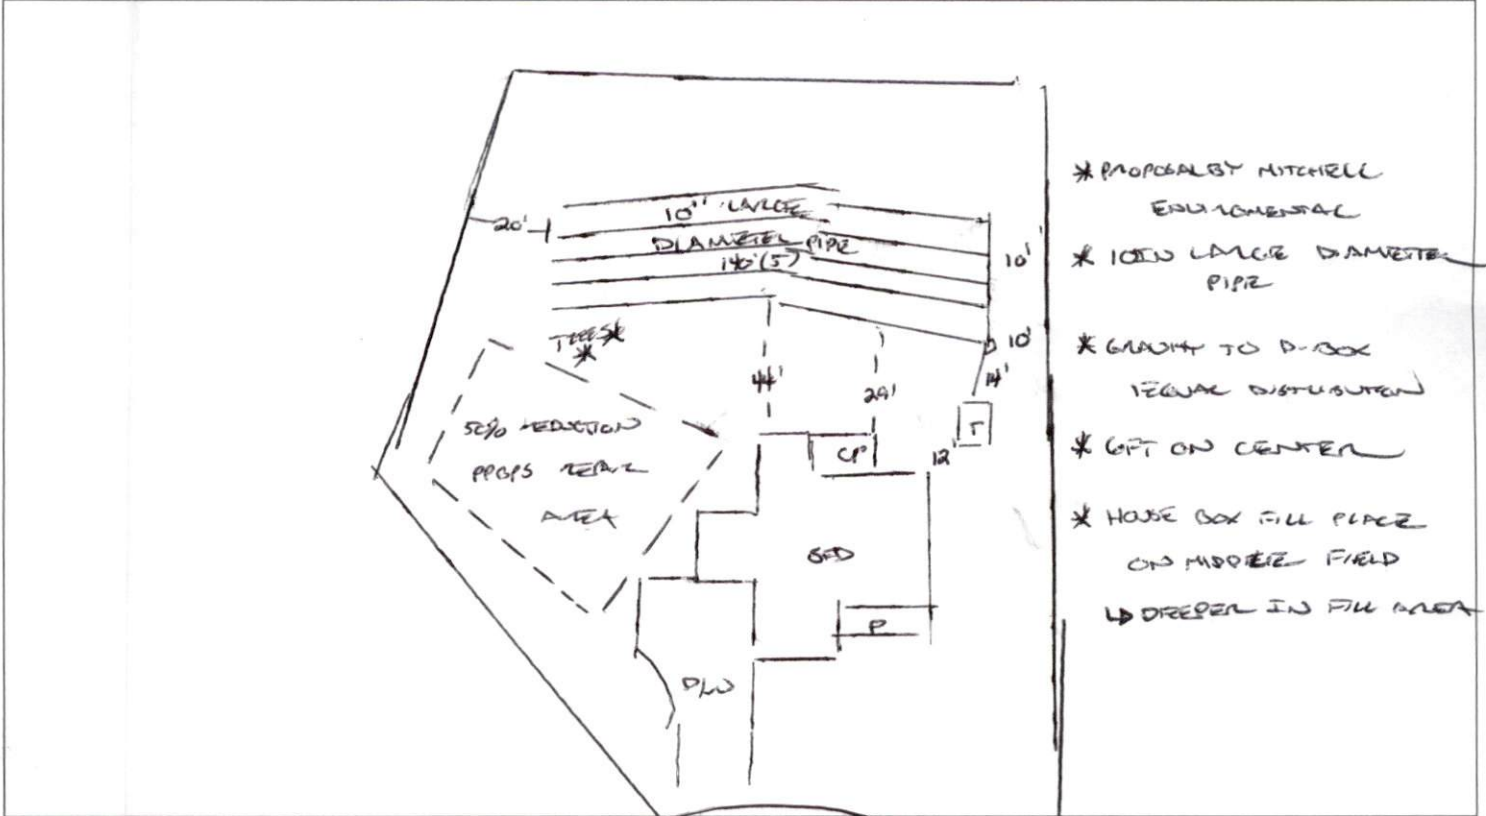

- * PROPOSED BY MITCHELL ENGINEERING
- * 1000 LARGE DIAMETER PIPE
- * GRADIENT TO D-BOX EQUAL DISTRIBUTION
- * 6FT ON CENTER
- * HOUSE BOX FULL PLACE ON MIDDLE FIELD
- * DRAINER IN FULL AREA

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 10" LARGE DIAMETER PIPE Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 5 of each ditch 140 feet ditches 3 feet ditches 16-20 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 08/31/2023