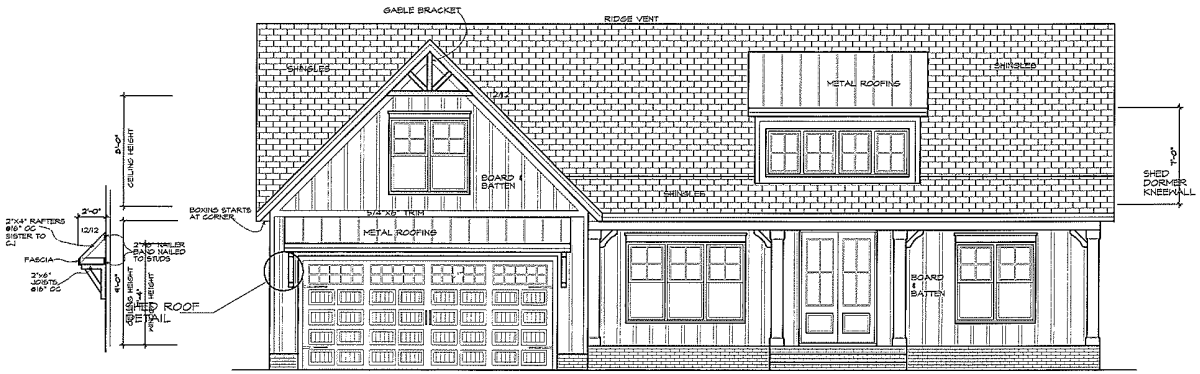

FRONT ELEVATION A

SCALE 1/4" = 1'-0"

ATTIC VENTILATION

THE NET FREE VENTILATING AREA SHALL BE NOT LESS THAN 1 TO 150 OF THE AREA OF THE SPACE VENTILATED EXCEPT THAT THE AREA MAY BE 1 TO 300, PROVIDED AT LEAST 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE THE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION TO BE PROVIDED BY EAVE OR CORNICE VENTS

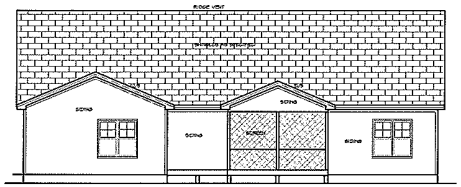

REAR ELEVATION

SCALE 1/8" = 1'0"

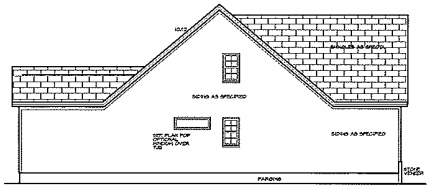

LEFT SIDE ELEVATION

SCALE 1/8" = 1'0"

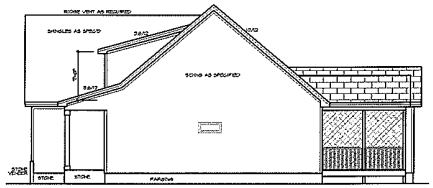

RIGHT SIDE ELEVATION

SCALE 1/8" = 1'0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction

MidTown Designs Inc assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2015 IRC)

NC 2018 NCRC / Wind - 115 - 120 mph

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE 8/9/2021

PROJECT # 210604

FRONT ELEVATION "B"

SCALE 1/4" = 1'0"

ATTIC VENTILATION

THE NET FREE VENTILATING AREA SHALL BE NOT LESS THAN 1 TO 150 OF THE AREA OF THE SPACE VENTILATED EXCEPT THAT THE AREA MAY BE 1 TO 300, PROVIDED AT LEAST 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE THE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION TO BE PROVIDED BY EAVE OR CORNICE VENTS.

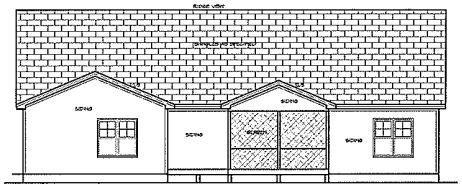

REAR ELEVATION

SCALE 1/8" = 1'0"

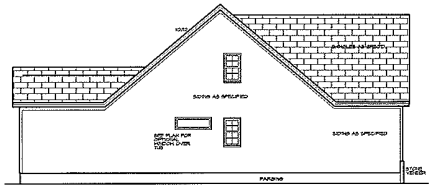

LEFT SIDE ELEVATION

SCALE 1/8" = 1'0"

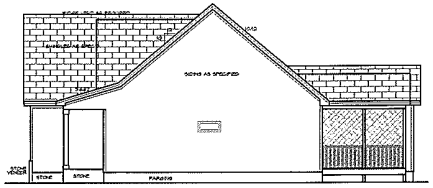

RIGHT SIDE ELEVATION

SCALE 1/8" = 1'0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2015 IRC)

NC 1009 NORTH , NW = 15 - 123 MPH

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE: 8/3/2021

PROJECT # 210604

STRUCTURAL DESIGN BY
SOUTHERN ENGINEERS, P.A
216 BENSON DR, RALEIGH, NC 27601
LICENSE: C-0251, PHONE: 919-872-1421
PROJECT #: 14-2361

- Engineer's seal applies only to structural components on this document. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions
- Any deviations or discrepancies on plans are to be brought to the immediate attention of Southern Engineers. Failure to do so will void Southern Engineer's liability
- Seal is valid for a project permitted one year from date of seal
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

REFER TO "SP" SHEETS FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES

NORTH CAROLINA PROFESSIONAL SEAL 16075 ENGINEER JAMES H. KEYES

FOUNDATION VENTING

SECTION R408 UNDER FLOOR SPACE

R408.1 Ventilation. The under-floor space between the bottom of the floor joists and the earth under any building (except space occupied by a basement or cellar) shall be provided with ventilation in accordance with Section R303.1. The minimum net area of ventilation openings shall not be less than 1 square foot for each 150 square feet (0.67 m square) for each 100 m square) of under-floor space area. One such ventilating opening shall be within 3 feet (914 mm) of each corner of said building.

CRAWL AREA TO BE VENTED: 1422 SQ.FT.
1422/150 = 9.48 NET FREE VENTING AREA REQUIRED

R408.3 Ground Vapor Retarder
Not less than 4 mil polyethylene vapor retarder shall be installed to cover all earth in the crawl space with joints lapped not less than 6".

FOUNDATION STRUCTURAL NOTES:

NC (2018 NCRC) MIN. 15-20 MPH

1. (5) 2x10 SYP #2 OR SPF#2 GIRDER, TYPICAL UNO
2. CONCRETE BLOCK PIER SIZE SHALL BE:

SIZE	HOLLOW MASONRY	SOLID MASONRY
8 x 16	UP TO 32" HIGH	UP TO 5'-0" HIGH
12 x 16	UP TO 42" HIGH	UP TO 5'-0" HIGH
16 x 16	UP TO 64" HIGH	UP TO 12'-0" HIGH
24 x 24	UP TO 96" HIGH	

MIN 32" x 32" x 16" CONCRETE FOOTING, UNO

3. WALL FOOTING AS FOLLOWS:
   DEPTH: 6" - UP TO 2-1/2 STORY; 10" - 3 STORY
   WIDTH: SIDING (OR EQUAL)
   - 16" - UP TO 2-1/2 STORY
   - 20" - 3 STORY
   BRICK VENEER
   - 16" - 1 STORY
   - 20" - 2 STORY
   - 24" - 3 STORY

   FOR FOUNDATION WALL HEIGHT AND BACKFILL REQUIREMENTS, REFER TO NORTH CAROLINA RESIDENTIAL CODE TABLE R404.1.1 (TABLE 4)
   NOTE: ASSUMED SOIL BEARING CAPACITY = 2000 PSF. CONTRACTOR MUST VERIFY SITE CONDITIONS AND CONTACT SOILS ENGINEER IF MARGINAL OR UNSUITABLE SOILS ARE ENCOUNTERED
4. (4) 2x10 SYP#2 OR SPF#2 GIRDER.
5. (2) 1.75x9.25 LVL OR LSL GIRDER
6. (3) 1.75x9.25 LVL OR LSL GIRDER
7. * DESIGNATES A CHOKEPOINT POINT LOAD TO HAVE SOLID BLOCKING TO PIER. SOLID BLOCK ALL BEAM BEARING POINTS NOTED TO HAVE THESE OR MORE STUDS TO PIER, TYPICAL
8. ABBREVIATIONS:
   "DJ" = DOUBLE JOIST
   "TJ" = TRIPLE JOIST

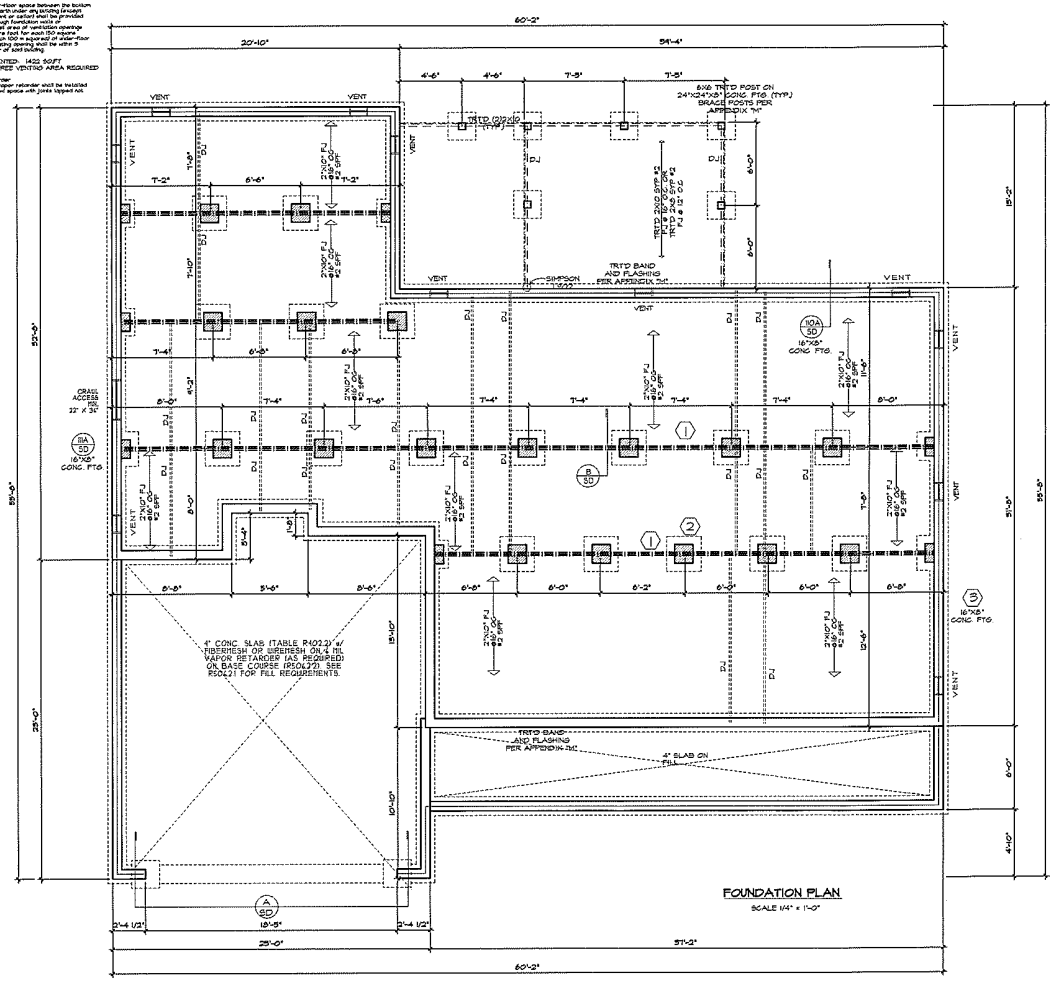

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs, Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2018 IRC)
NC (2018 NCRC) - WIND - 15 - 120 MPH

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE: 8/3/2021

PROJECT #: 210604

STRUCTURAL DESIGN BY:
SOUTHERN ENGINEERS, P.A.
376 BENSON DR., RALEIGH, NC 27604
LICENSE: C-0211, PHONE: 919-878-1471
PROJECT #: 19-2381

- Engineers seal applies only to structural components on the documents. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
- Any deviations or discrepancies on plans are to be brought to the awarded attention of Southern Engineers. Failure to do so will void Southern Engineer's liability.
- Seal is valid for a project permitted one year from date of seal.
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 16073 JAMES H. KIRKMAN

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES

FOUNDATION STRUCTURAL NOTES:

1. (3) 2 x 10 SPF #2 GIRDER DROPPED. TYPICAL UNO.
2. CONCRETE BLOCK PIER SIZE SHALL BE:

SIZE	HALLOW MASONRY	SOLID MASONRY
8 x 16	UP TO 52" HIGH	UP TO 3'-0" HIGH
12 x 16	UP TO 48" HIGH	UP TO 9'-0" HIGH
16 x 16	UP TO 64" HIGH	UP TO 12'-0" HIGH
24 x 24	UP TO 96" HIGH	

WITH 30" x 30" x 10" CONCRETE FOOTING, UNO

3. WALL FOOTING AS FOLLOWS:

DEPTH: 8" - UP TO 2-1/2 STORY
10" - 3 STORY

WIDTH: SIDING (OR EQUAL)
- 16" - UP TO 2-1/2 STORY
- 18" - 3 STORY

BRICK VENEER
- 16" - 1 STORY
- 20" - 2 STORY
- 24" - 3 STORY

FOR FOUNDATION WALL HEIGHT AND BACKFILL REQUIREMENTS, REFER TO NORTH CAROLINA RESIDENTIAL CODE TABLE R404.1.1 (1 THRU 4)
NOTE: ASSUMED SOIL BEARING CAPACITY = 2000 PSF
CONTRACTOR MUST VERIFY SITE CONDITIONS AND CONTACT SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.

ATTACH SILL PLATE WITH 1/2"ø ANCHOR BOLTS AT 6'-0" CENTERS (7" EMBEDMENT) AND 12" FROM EACH PLATE END. (SECTION R 403.1.6)

4. "B" DESIGNATES A SIGNIFICANT POINT LOAD TO HAVE SOLID BLOCKING TO PIER. SOLID BLOCK ALL BEAM BEARING POINTS NOTED TO HAVE THREE OR MORE STUDS TO PIER. TYPICAL.

5. ABBREVIATIONS:
"SJ" = SINGLE JOIST
"DJ" = DOUBLE JOIST
"TJ" = TRIPLE JOIST

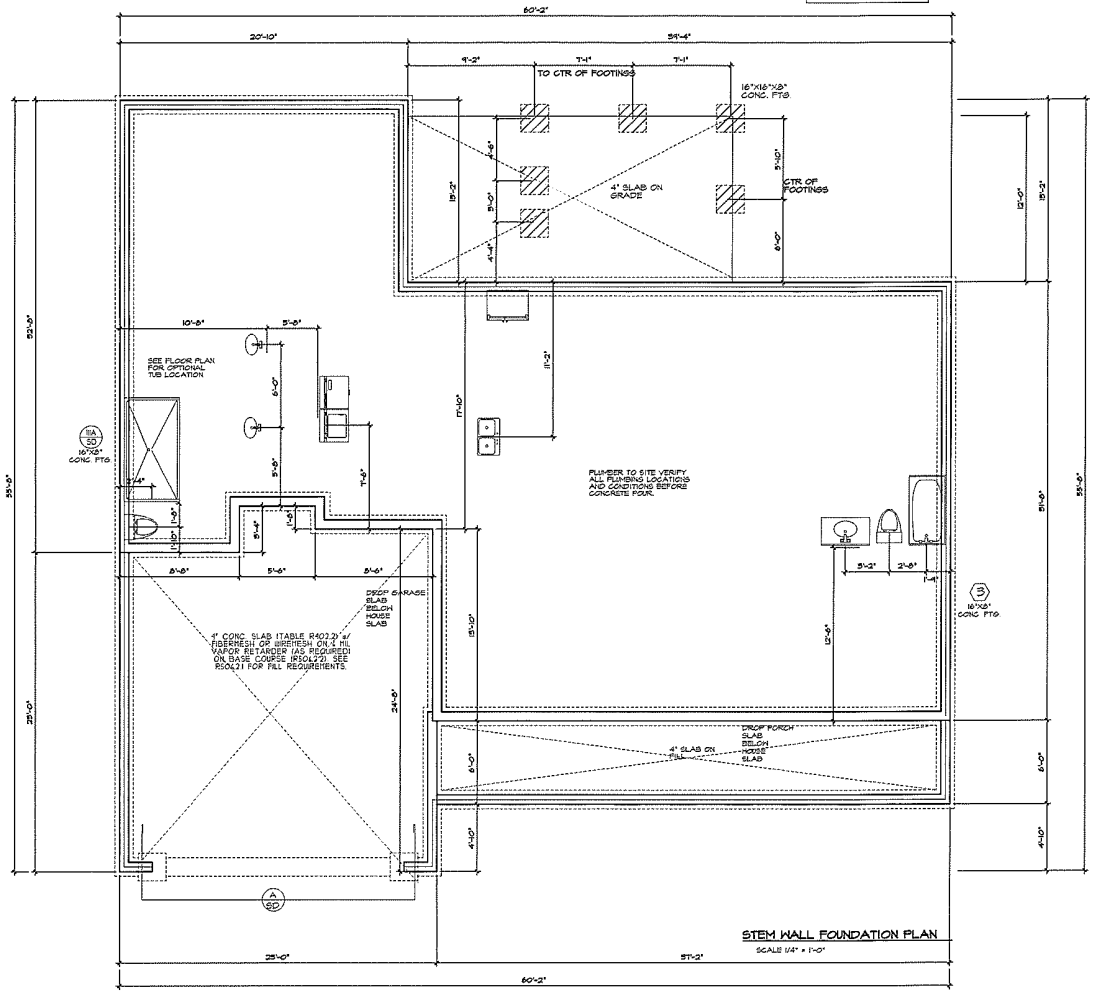

STEM WALL FOUNDATION PLAN

SCALE 1/4" = 1'-0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2018 IRC)
NC 2018 NCRC / NFPA - 13 - 13D NFPA

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

5/3/2021

PROJECT #
210604

TRUSS SYSTEM REQUIREMENTS
NC (2018 NCRC), Wind: 115-120 MPH

1. TRUSS SYSTEM LAYOUTS (IN ACCEPTANCE PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.

2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER

3. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS ONLY.

4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

5. INSTALL A TRUSS BELOW PARALLEL NON-LOAD BEARING WALLS OR BLOCK BETWEEN TRUSSES (BY TRUSS SUPPLIER) UNDER WALLS.

WHOLE HOUSE BRACING SUMMARY

TOTAL REQUIRED BRACING: 28
TOTAL PROVIDED BRACING: 106
(IN FEET)

HEADER/BEAM & COLUMN NOTES:

1. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2) 2x10 (4" WALL) OR (3) 2x10 (6" WALL) WITH (1) SUPPORT STUD, UNLESS NOTED OTHERWISE.

2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS SHALL BE ACCORDING TO ITEM "J" IN TABLE R602.3(5) OR AS BELOW:

- UP TO 4' SPAN: (1) KING STUD
- OVER 4' UP TO 8' SPAN: (2) KING STUDS
- OVER 8' UP TO 11' SPAN: (3) KINGS STUDS
- OVER 11' SPAN: (4) KING STUDS

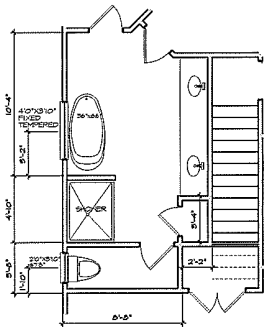

OPTIONAL BATH

FRAMING NOTES:
NC (2018 NCRC), Wind: 115-120 mph

1. BRACING METHOD AND TYPE CONTINUOUSLY SHEATHED WSP, CS-WSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING.

2. EXTERIOR WALL SHEATHING WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH GOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B, 7/16" EXPOSURE C, 15/32"). SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" O.C. AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS) INSTALL BLOCKING AT ALL PANEL EDGES.

3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE, BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. WSP SHEATHING BE ATTACHED TO ALL FRAMING MEMBERS ACROSS BUILDING CONTINUOUS ACROSS FLOOR SYSTEM (BY BLOCKING AT PANEL EDGES, EXTENDING 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD.

4. "HD" = HOLDOWN, HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY.
AT FOUNDATION/FIRST FLOOR, USE "HD HOLD-DOWN DETAIL" ON STRUCTURAL FOUNDATION.
HIGHER FLOORS, ATTACH BASE OF KING STUD WITH A SIMPSON CS22 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 1' MIN. ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (11) 8d NAILS.

5. INTERIOR BRACED WALL: (NOTED AS "BW" ON PLANS) ATTACH 1/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR SCREWS 7" O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.

6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL (NOTED AS "BW-WSP" ON PLANS) ATTACH ONE SIDE WITH 7/16" WSP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS) INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER WSP REQUIRED ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIN. OF 5d COOLER NAILS OR #4 SCREWS 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS

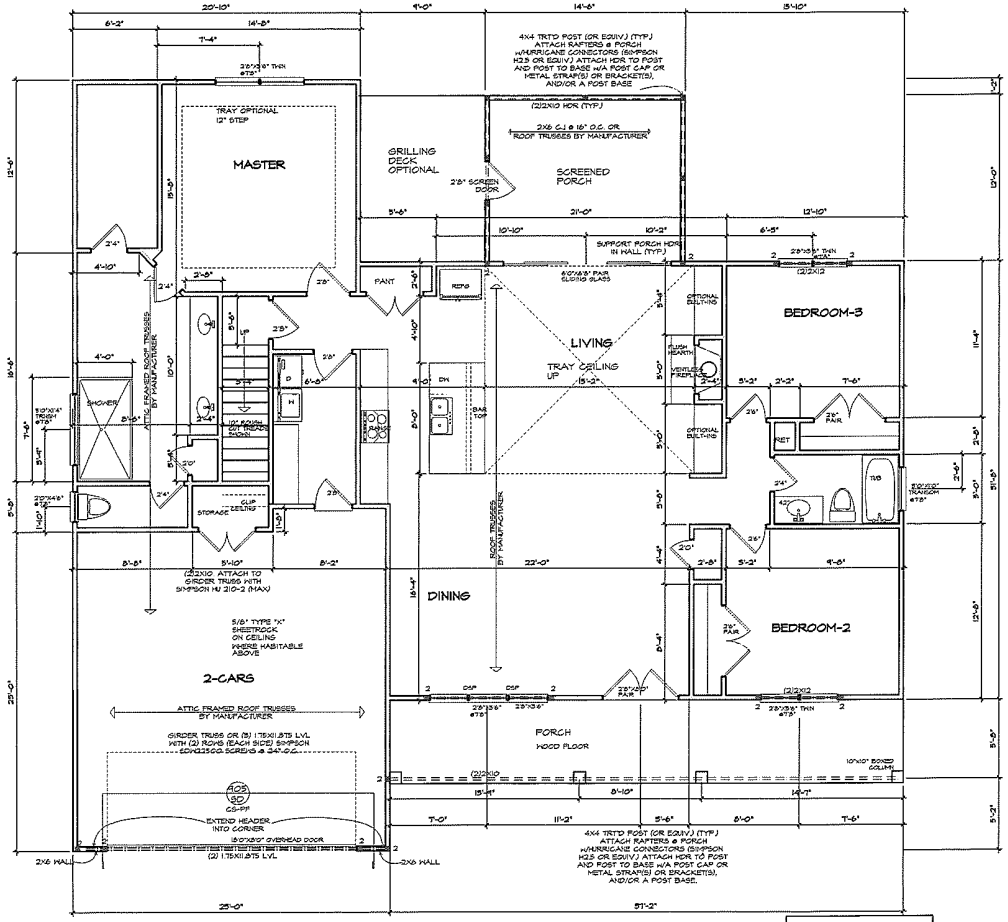

FIRST FLOOR PLAN
SCALE 1/4" = 1'-0"

SQUARE FOOTAGE	
FIRST FLOOR	1,571 SQ.FT.
OPTIONAL FLYROOM = 473 SQ.FT.	
TOTAL W/FLYROOM = 2044 SQ.FT.	
FRONT PORCH = 223 SQ.FT.	
REAR PORCH = 114 SQ.FT.	
DECK = 108 SQ.FT.	
GARAGE = 557 SQ.FT.	

STRUCTURAL DESIGN BY:
SOUTHERN ENGINEERS, P.A.
3716 BENSON DR., RALEIGH, NC 27609
LICENSE: C-0161, PHONE: 919-876-1611
PROJECT #: 19-2381

- Engineers seal applies only to structural components on the documents. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
- Any deviations or discrepancies on plans are to be brought to the immediate attention of Southern Engineers. Failure to do so will void Southern Engineer's liability.
- Seal is valid for a project permitted one year from date of seal.
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

NORTH CAROLINA PROFESSIONAL SEAL 16073 ENGINEER JAMES H. SMITH

REFER TO "SO" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc.
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2015 IRC)
NC (2018 NCRC) / Wind: 115 - 120 mph

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8826 www.midtowndesigns.com

DATE: 5/13/2021

PROJECT #: 210604

STRUCTURAL DESIGN BY:
SOUTHERN ENGINEERS, P.A.
374 BENSON DR., RALEIGH, NC 27609
LICENSE: C-081, PHONE: 919-878-121
PROJECT #: 19-2381

NORTH CAROLINA PROFESSIONAL SEAL 18073 ENGINEER JAMES N. ...

- Engineers seal applies only to structural components on this document. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
- Any deviations or discrepancies on plans are to be brought to the immediate attention of Southern Engineers. Failure to do so will void Southern Engineer's liability
- Seal is valid for a project permitted one year from date of seal.
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES

TRUSS SYSTEM REQUIREMENTS

NC (2018 NCRC), Wind: 115-120 MPH

1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.

2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.

3. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (DKI).

4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

5. INSTALL A TRUSS BELOW PARALLEL, NON-LOAD BEARING WALLS OR BLOCK BETWEEN TRUSSES (BY TRUSS SUPPLIER) UNDER WALLS.

HEADER/BEAM & COLUMN NOTES

1. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (3) 2x10 (4" WALL) OR (3) 2x12 (6" WALL) WITH (1) SUPPORT STUD, UNLESS NOTED OTHERWISE.

2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS AT EACH END OF HEADERS IN INTERIOR WALLS SHALL BE ACCORDING TO ITEM "2" IN TABLE R602.3(5) OR AS BELOW:

- UP TO 4' SPAN: (1) KING STUD
- OVER 4' UP TO 8' SPAN: (2) KING STUDS
- OVER 8' UP TO 11' SPAN: (3) KING STUDS
- OVER 11' SPAN: (4) KING STUDS

FRAMING NOTES

NC (2018 NCRC), Wind: 115-120 mph

1. BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED WSP, CS-WSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING.

2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B). 7/16" EXPOSURE C. (1/2"?). SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" O.C. AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.

3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. WSP SHEATHING BETWEEN FLOORS SHALL BE ATTACHED IN ACCORDANCE WITH VARIOUS FLOOR PLANS. SHEATHING ALSO SHALL BE ATTACHED TO EDGES, MINIMUM (3) STEP-DOWN FLOOR BREAKS OR OTHER APPROVED METHOD.

4. "HD" = HOLDOWN. ; HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY.
*HD ON FIRST FLOOR, USE "HD HOLD-DOWN DETAIL" ON SD SHEET FOR ROOF.
*HD ON SECOND FLOOR: ATTACH BASE OF KING STUD WITH A SIMPSON LSTD STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. ENTERED STRAP "T" HD ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (1) 8d NAILS.

5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH 1/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIX OF 8d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.

6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBW-WSP" ON PLANS). ATTACH ONE SIDE WITH 7/16" WSP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER WSP REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIX OF 8d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.

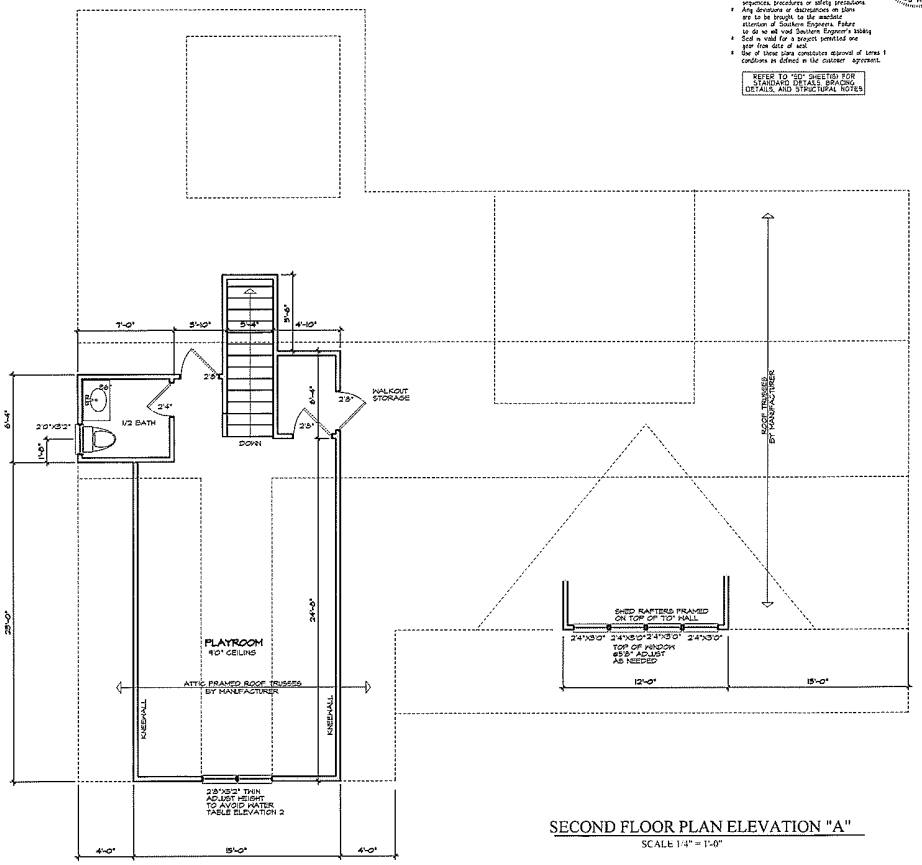

SECOND FLOOR PLAN ELEVATION "A"

SCALE 1/4" = 1'-0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction

MidTown Designs Inc assumes no liability for contractors practices and procedures

The ss drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2018 IRC)
NC (2018 NCRC) ; Wind = 115 - 120 mph

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtownd...

DATE: 6/9/2021

PROJECT #
210604

STRUCTURAL DESIGN BY
SOUTHERN ENGINEERS, P.A.
374 BENSON DR., RALEIGH, NC 27609
LICENCE: C-0281, PHONE: 919-878-1671
PROJECT #: 19-2381

- Engineers seal applies only to structural components on this document. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
- Any deviations or discrepancies on plans are to be brought to the immediate attention of Southern Engineers. Failure to do so will void Southern Engineer's liability.
- Seal is valid for a project permitted one year from date of seal.
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

NORTH CAROLINA PROFESSIONAL SEAL 16073 ENGINEER JAMES M. NEWSOM

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES

TRUSS SYSTEM REQUIREMENTS

NC (2018 NCRC), Wind: 115-120 MPH

1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.

2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.

3. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEVELERS ONLY.

4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

5. INSTALL A TRUSS BELOW PARALLEL NON-LOAD BEARING WALLS OR BLOCK BETWEEN TRUSSES (BY TRUSS SUPPLIER) UNDER WALLS.

HEADER/BEAM & COLUMN NOTES

1. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2) 2x10 (4" WALL) OR (3) 2x10 (6" WALL) WITH (1) SUPPORT STUD, UNLESS NOTED OTHERWISE.

2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS SHALL BE ACCORDING TO ITEM "J" IN TABLE R602.5(5) OR AS BELOW:

- UP TO 4' SPAN: (1) KING STUD
- OVER 4' UP TO 8' SPAN: (2) KING STUDS
- OVER 8' UP TO 11' SPAN: (3) KING STUDS
- OVER 11' SPAN: (4) KING STUDS

FRAMING NOTES:

NC (2018 NCRC), Wind: 115-120 mph

1. BRACING METHODS AND TYPES. CONTINUOUSLY SHEATHED WALL BRACING SHALL MEET THE MINIMUM BRACING AMOUNT PER R602.10. SEE PLANS DETAILS AND SPECIFICATIONS IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING.

2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING PER R602.10.4.1 (MIN. 7/16" STRUCTURAL PANEL SHEATHING SHALL BE APPLIED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" O.C. AT PANEL EDGES AND 12" O.C. AT INTER-MEDIATE SUPPORTS) INSTALL BLOCKING AT ALL PANEL EDGES.

3. HDP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. HDP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM WITH BLOCKING AT PANEL EDGES, MINIMUM 3") BEYOND FLOOR SHEAR OR OTHER APPROVED METHOD

4. "HD" = HOLDOWN. HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN ADD BOARD CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY.
**GROUND FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR SIMILAR).
SUPPORT FLOOR: ATTACH BASE OF KING STUD WITH A SIMPSON LSTB22 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 11" INTO ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (7) 8d NAILS.

5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH 1/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIX OF 8d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTER-MEDIATE SUPPORTS.

6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBWWSP" ON PLANS) ATTACH ONE SIDE WITH 7/16" HDP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" O.C. AT PANEL EDGES AND 12" O.C. AT INTER-MEDIATE SUPPORTS) INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER HDP REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIX OF 8d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTER-MEDIATE SUPPORTS.

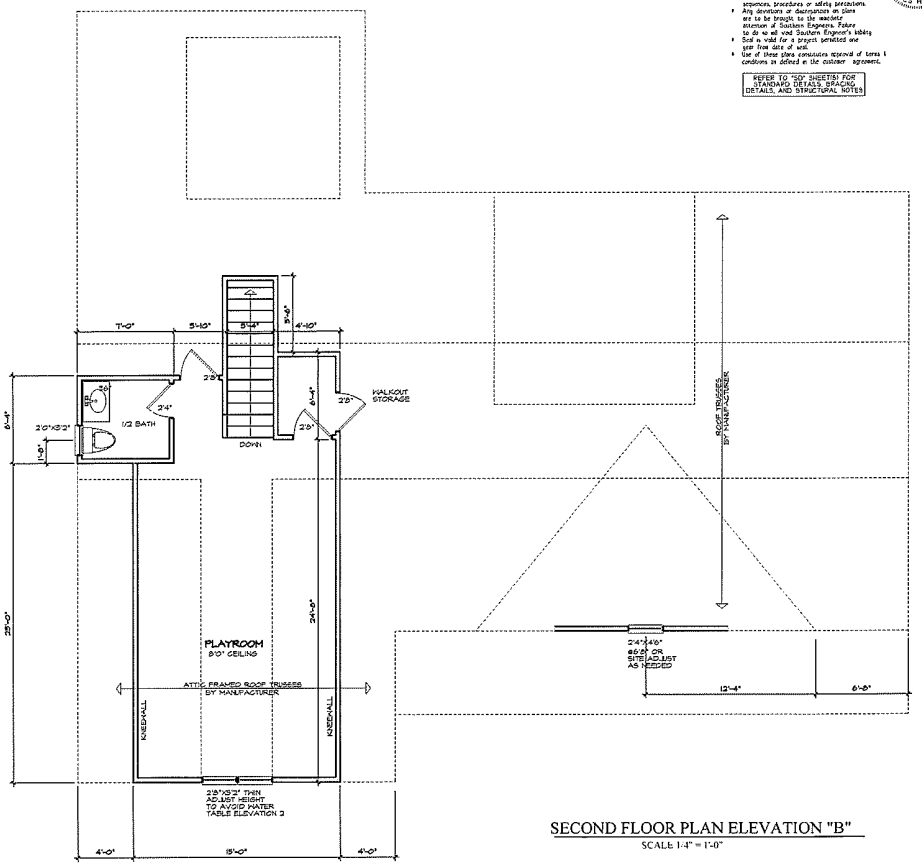

SECOND FLOOR PLAN ELEVATION "B"
SCALE: 1/4" = 1'-0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2018 IRC)
NC (2018 NCRC) / Wind: 115 - 120 mph

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtownd esigns.com

DATE: 8/9/2021

PROJECT #
210604

ROOF FRAMING NOTES

NC (2018 NCRC): Bnd. 85-120 MPH

1. 2x8 RAFTERS @ 16" O.C. WITH 2x10 RIDGE, UNO.
2. (2) 2x10 OR 1.75x11.875 LVL HIP. (2) 2x10 HIPS MAY BE SPLICED WITH A MIN. 2'-0" OVERLAP AT CENTER
3. (2) 2x10 OR 1.75x9.25 LVL VALLEY. DO NOT SPLICE VALLEYS
4. 1.75x11.875 LVL VALLEY
5. FALSE FRAME VALLEY ON 2x10 FLAT PLATE
6. 2x6 RAFTERS @ 16" O.C. W/ 2x8 RIDGE, UNO.
7. 2x10 RAFTERS @ 16" O.C. W/ 2x12 RIDGE, UNO.
8. EXTEND RIDGE 12" BEYOND INTERSECTION

- "SR" = SINGLE RAFTER
- "DR" = DOUBLE RAFTER
- "TR" = TRIPLE RAFTER
- "RS" = ROOF SUPPORT
- "■" = (3) STUD OR 4x4 POST FOR ROOF SUPPORT (USE 2X4 OR 4X4 FOR SUPPORT POSTS OVER 10'-0" IN HEIGHT)
- ATTACH VAULTED RAFTERS WITH HURRICANE CLIPS; SIMPSON "H2.5A" OR EQUIVALENT
- INSTALL RAFTER TIES AND COLLAR TIES PER SECTION R802.3.1 OF THE 2018 NC RESIDENTIAL CODE

TRUSS SYSTEM REQUIREMENTS

NC (2018 NCRC): Bnd. 85-120 MPH

1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
3. ALL GIRDERS SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.
5. INSTALL A TRUSS BELOW PARALLEL NON-LOAD BEARING WALLS OR BLOCK BETWEEN TRUSSES (BY TRUSS SUPPLIER) UNDER WALLS

STRUCTURAL DESIGN BY:
SOUTHERN ENGINEERS, P.A.
3116 BENSON DR., RALEIGH, NC 27609
LICENSE: C-0911, PHONE: 919-830-1411

PROJECT #: 19-2381

- Engineers seal applies only to structural components on the document. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
- Any deviations or discrepancies on plans are to be brought to the immediate attention of Southern Engineers. Failure to do so will void Southern Engineer's liability.
- Seal is valid for a project permitted one year from date of seal.
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

REFER TO "SO" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES

NORTH CAROLINA PROFESSIONAL SEAL 16073 ENGINEER JAMES H. HEATWOLE

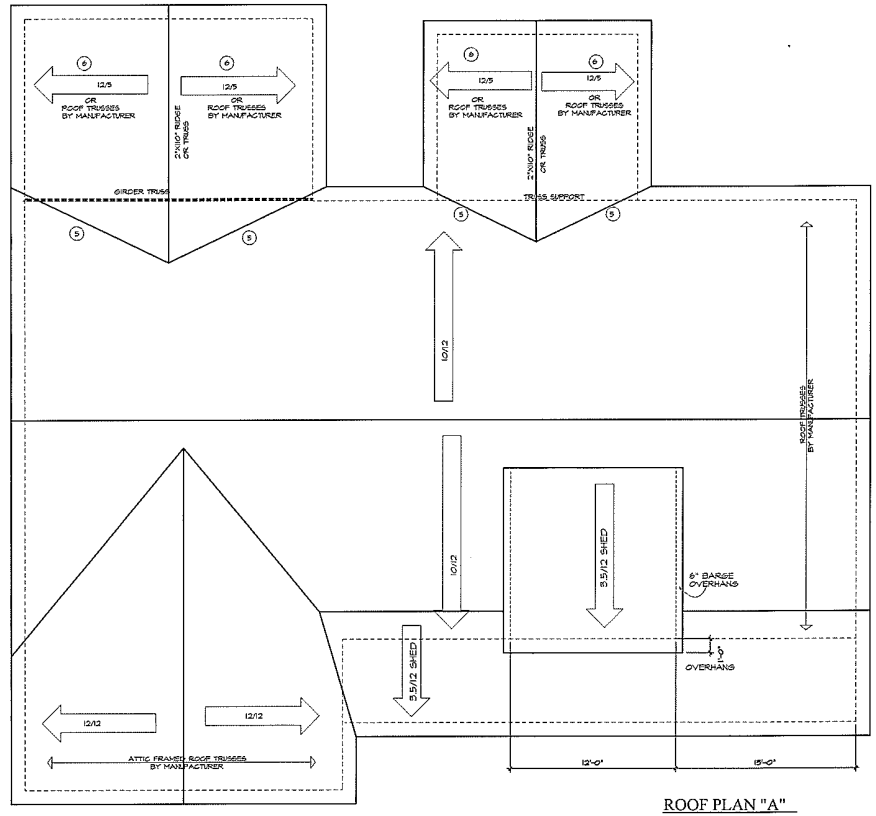

ROOF PLAN "A"

SCALE 1/4" = 1'-0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures.

These drawings are instruments of service and as such shall remain property of the designer.

© Copyright 2021
MidTown Designs Inc
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2018 IRC)

NC (2018 NCRC): Bnd. 85 - 120 MPH

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtownd designs.com

DATE: 5/3/2021

PROJECT #: 210604

ROOF FRAMING NOTES

NC (2018 NCRC), Vult. 115-120 MPH

1. 2x8 RAFTERS @ 16" O.C. WITH 2x10 RIDGE, UNO.
2. (2) 2x10 OR 1.75x11.875 LVL HIP. (2) 2x10 HIPS MAY BE SPLICED WITH A MIN. 4'-0" OVERLAP AT CENTER
3. (2) 2x10 OR 1.75x9.25 LVL VALLEY. DO NOT SPLICE VALLEYS
4. 1.75x11.875 LVL VALLEY
5. FALSE FRAME VALLEY ON 2x10 FLAT PLATE
6. 2x4 RAFTERS @ 16" O.C. W/ 2x8 RIDGE, UNO.
7. 2x10 RAFTERS @ 16" O.C. W/ 2x12 RIDGE, UNO.
8. EXTEND RIDGE 12" BEYOND INTERSECTION

- "SR" = SINGLE RAFTER
- "DR" = DOUBLE RAFTER
- "TR" = TRIPLE RAFTER
- "RS" = ROOF SUPPORT
- "■" = (3) STUD OR 4x4 POST FOR ROOF SUPPORT (USE 2X6 OR 2X4 FOR SUPPORT POSTS OVER 10'-0" IN HEIGHT)
- ATTACH VAULTED RAFTERS WITH HURRICANE CLIPS, SIMPSON "H2.5A" OR EQUIVALENT
- INSTALL RAFTER TIES AND COLLAR TIES PER SECTION R802.3.1 OF THE 2018 NC RESIDENTIAL CODE

TRUSS SYSTEM REQUIREMENTS

NC (2018 NCRC), Vult. 115-120 MPH

1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER
3. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON 2" X 4" #2 OR #3 PLATES OR LEDGERS (UNO)
4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS
5. INSTALL A TRUSS BELOW PARALLEL NON-LOAD BEARING WALLS OR BLOCK BETWEEN TRUSSES (BY TRUSS SUPPLIER) UNDER WALLS

STRUCTURAL DESIGN BY:
SOUTHERN ENGINEERS, P.A.
3716 BENSON DR., RALEIGH, NC 27609
LICENSE: C-0251, PHONE: 919-878-1411

PROJECT #: 19-2381

- Engineers seal applies only to structural components on the document. Seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
- Any deviations or discrepancies on plans are to be brought to the attending attention of Southern Engineers. Failure to do so will void Southern Engineer's liability.
- Seal is valid for a project permitted one year from date of seal.
- Use of these plans constitutes approval of terms & conditions as defined in the customer agreement.

REFER TO "ND" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES

NORTH CAROLINA PROFESSIONAL SEAL 16073 ENGINEER JAMES H. HERSHENSON

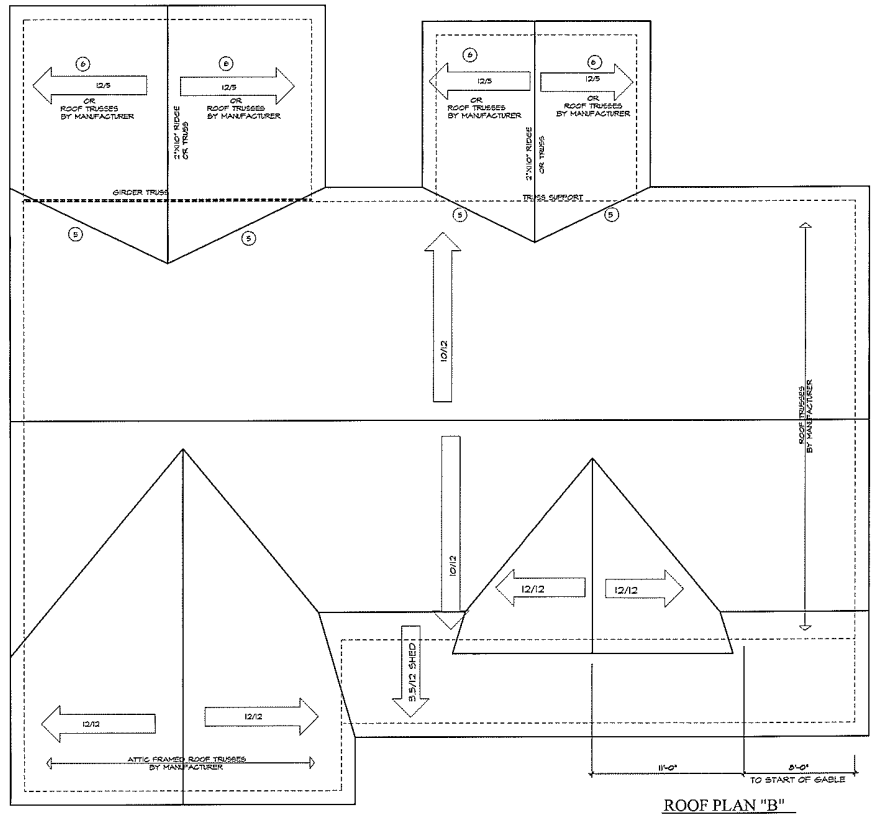

ROOF PLAN "B"

SCALE 1/4" = 1'-0"

MIDTOWN DESIGNS

Purchaser must verify all dimensions and conditions before beginning construction

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2021
MidTown Designs Inc.
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2015 IRC)
NC (2018 NCRC), Vult. 115 - 120 mph

The Front Porch

GEMSTONE HOMES

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8826 www.midtowndesigns.com

DATE: 8/9/2021

PROJECT #: 210604

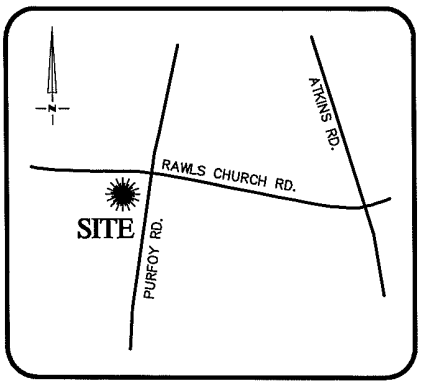

VICINITY MAP
Not To Scale

NORTH CAROLINA PROFESSIONAL SEAL L-4679 LAND SURVEYOR DEAN M. RHOADS

IMPERVIOUS SURFACE AREA	
DESCRIPTION	AREA
HOUSE & PORCH	2,652 S.F.
SC PORCH/HVAC	183 S.F.
DRIVEWAY & WALKS	783 S.F.
TOTAL =	3,618 S.F.
LOT AREA =	17,554 S.F.
% IMPERVIOUS AREA	=20.6%

SETBACKS: (PB 2021, PG 567-571)

FRONT – 35'
REAR – 20'
SIDE – 10'
CORNER SIDE – 10'

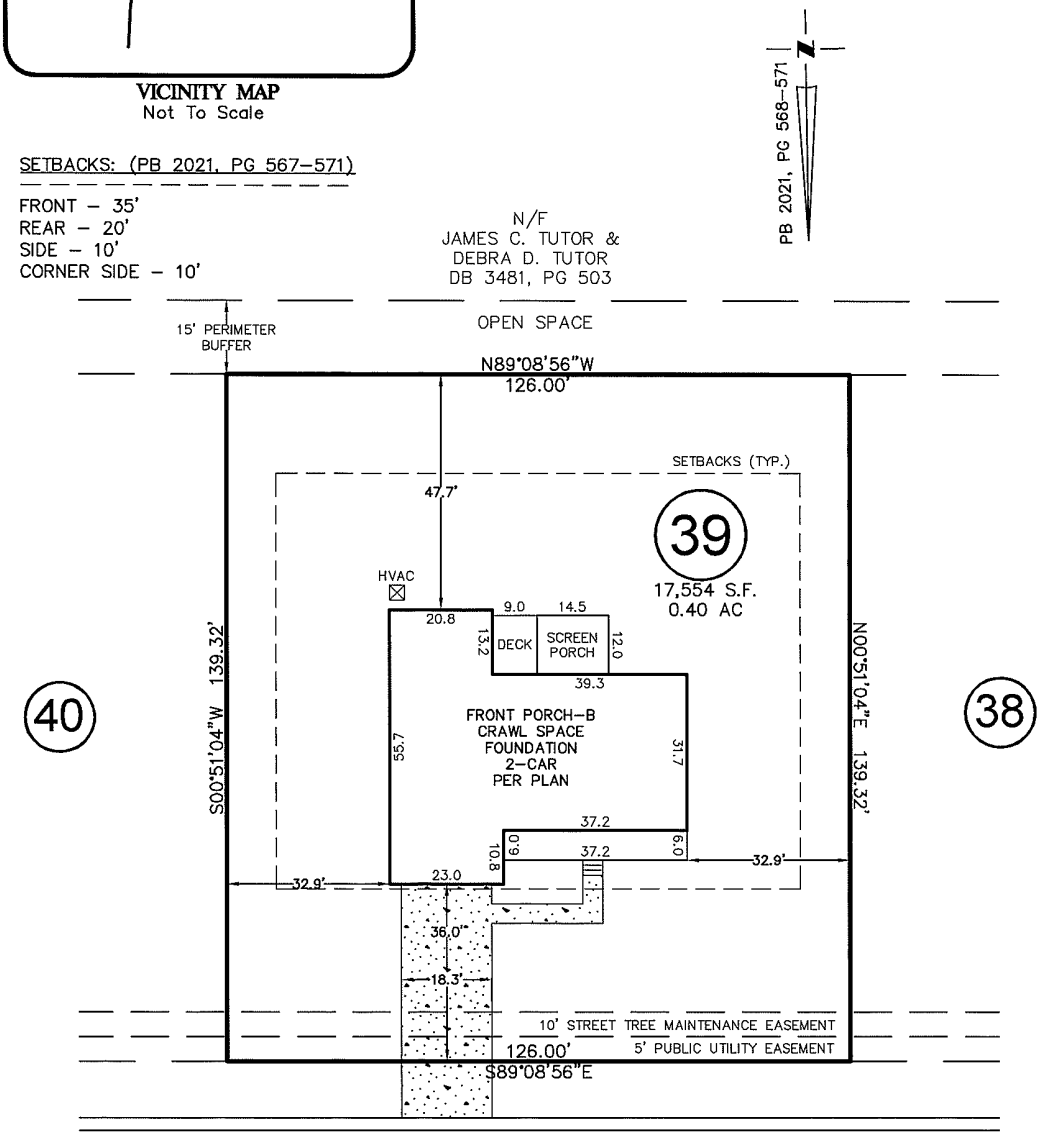

LAMBERT LANE

50' PUBLIC R/W & UTILITY EASEMENT

THIS DRAWING DOES NOT REFLECT AS-BUILT INFORMATION

PRELIMINARY PLAT
NOT FOR RECORDATION, CONVEYANCES, OR SALES.

THIS PROPERTY MAY BE SUBJECT TO ANY AND ALL APPLICABLE DEED RESTRICTIONS, EASEMENTS, RIGHT-OF-WAY, UTILITIES AND RESTRICTIVE COVENANTS WHICH MAY BE OF RECORD OR IMPLIED

30 0 30
SCALE: 1" = 30'

RESIDENTIAL LAND SERVICES, PLLC.
1917 Evans Road
Cary, North Carolina 27513
Phone (919) 378-9316
Firm License # P-0873

HOUSE LOCATION PLOT PLAN

FOR
#289 LAMBERT LANE
LOT 39, PURFOY PLACE SUBDIVISION
Hector's Creek Township, Harnett County, North Carolina

PROPERTY OF: GEMSTONE HOMES

MAP BOOK 2021 PAGE 568-571 DEED REFERENCE _____ PAGE _____

DRAWN BY: SMB | DATE: FEBRUARY 10, 2022