

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: 30487-30487A
34 PRINCE PLACE - ROOF

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by 84 Components - #2383.

Pages or sheets covered by this seal: I50248468 thru I50248509

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



February 15, 2022

Johnson, Andrew


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 30487-30487A	Truss A1E	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	150248468
---------------------	--------------	---------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:44 2022 Page 1

ID:BLJh1112d3vwZK_wUdDgFCyrbmE-IJE9vZZGZmVrDdAF7fhrccgq2bPolHrJzqCTyDLzkw4r

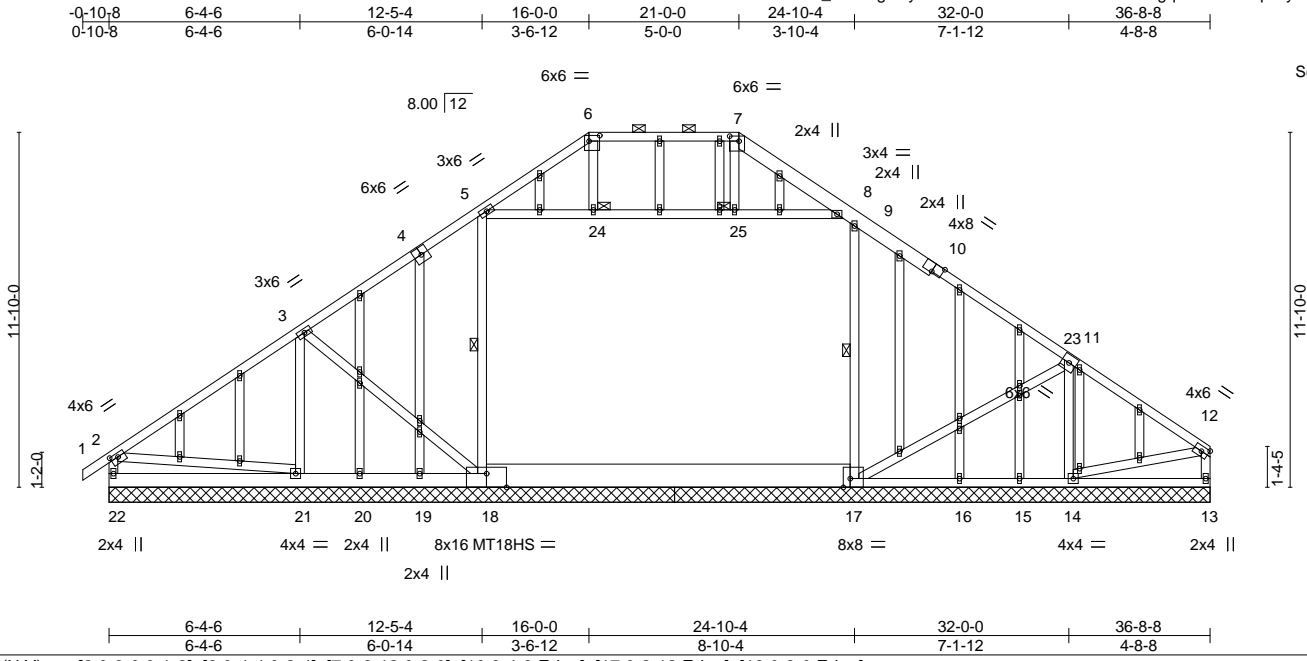

Scale = 1:76.8

Plate Offsets (X,Y)--	[2:0-3-0,0-1-8], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [10:0-4-0,Edge], [17:0-2-12,Edge], [18:0-8-0,Edge]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	-0.16 17-18	>915	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.82	Vert(CT)	-0.22 17-18	>671	180	MT18HS	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.18	Horz(CT)	0.00 13	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Attic	-0.16 17-18	909	360		
								Weight: 342 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 18-22: 2x6 SP DSS, 17-18: 2x10 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 9-8-5 oc bracing: 18-19 7-2-13 oc bracing: 17-18.
WEBS 2x4 SP No.3 *Except* 5-18,9-17,5-8: 2x4 SP No.2 or 2x4 SPF No.2	WEBS 1 Row at midpt 5-18, 9-17
OTHERS 2x4 SP No.3	JOINTS 1 Brace at Jt(s): 24, 25

REACTIONS. All bearings 18-10-4 except (jt=length) 17=17-10-4, 14=17-10-4, 13=17-10-4, 16=17-10-4, 15=17-10-4.
 (lb) - Max Horz 22=242(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 22, 14, 16 except 19=-853(LC 18)
 Max Grav All reactions 250 lb or less at joint(s) 16, 15 except 22=415(LC 1), 18=1798(LC 20), 21=473(LC 1), 17=1224(LC 21), 14=454(LC 1), 13=261(LC 1), 20=253(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-313/62, 3-5=-300/108, 5-6=-533/73, 6-7=-383/76, 7-8=-552/81, 8-9=-378/141, 9-11=-302/79, 2-22=-357/83
 BOT CHORD 21-22=-239/351, 20-21=-123/252, 19-20=-123/252, 18-19=-123/252
 WEBS 3-21=-362/73, 5-18=-573/78, 9-17=-659/111, 14-23=-394/119, 11-23=-381/149

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-8 to 2-9-9, Exterior(2) 2-9-9 to 16-0-0, Corner(3) 16-0-0 to 19-8-1, Exterior(2) 19-8-1 to 21-0-0, Corner(3) 21-0-0 to 24-10-4, Exterior(2) 24-10-4 to 36-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are MT20 plates unless otherwise indicated.
 - 6) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 7) Gable studs spaced at 2-0-0 oc.
 - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 10) Ceiling dead load (5.0 psf) on member(s). 8-9, 5-24, 24-25, 8-25; Wall dead load (5.0psf) on member(s).5-18, 9-17
 - 11) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 17-18
 - 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 22, 14, 16 except



Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss A1E	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF I50248468 Job Reference (optional)
---------------------	--------------	---------------------	----------	----------	---

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:44 2022 Page 2
ID:BLJh1112d3wvZK_wUdDgFCyrbmE-IJE9vZZGZmVrDdAF7fhrccq2bPoIHrJzqCTyDLzkw4r

NOTES-

- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 14) Attic room checked for L/360 deflection.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 30487-30487A	Truss A2	Truss Type ROOF TRUSS	Qty 6	Ply 1	34 PRINCE PLACE - ROOF	150248469
---------------------	-------------	--------------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:46 2022 Page 1

ID:BLJh112d3wvZK_wUdDgFCyrbmE-hhMvKfBw5NIZTwJeF4jKh5vGPDRflboGHWy2HEzkw4p



Scale = 1:71.1

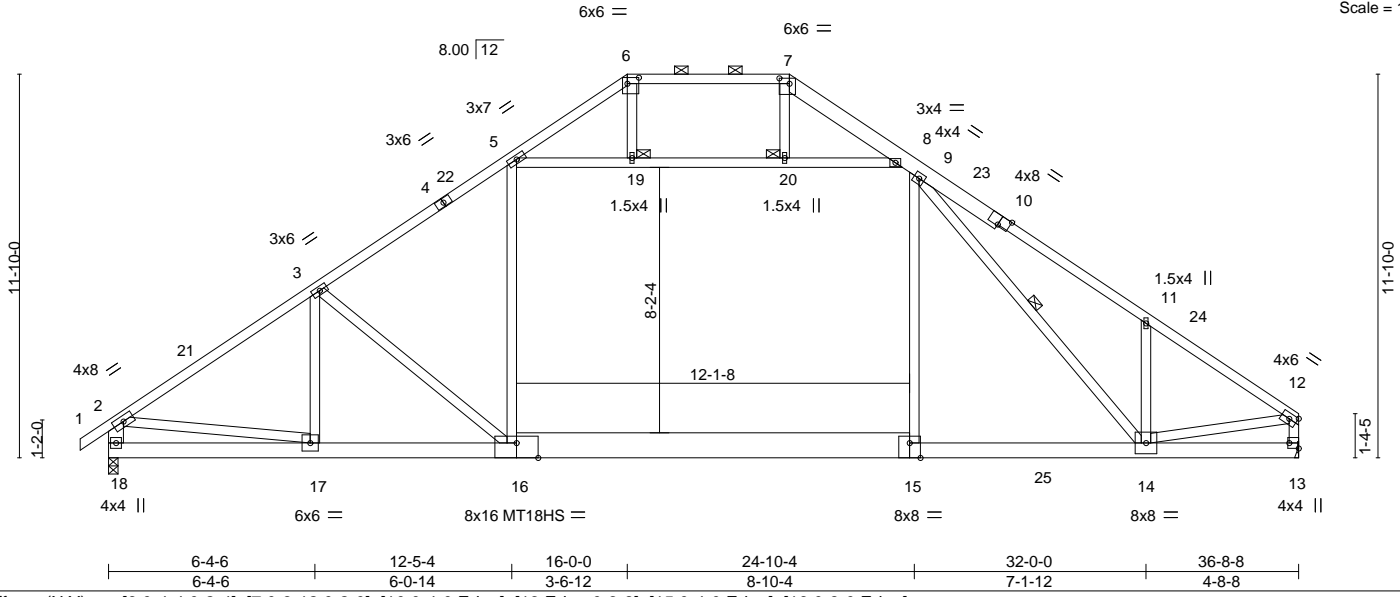


Plate Offsets (X, Y)--	[6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [10:0-4-0,Edge], [13:Edge,0-3-8], [15:0-4-0,Edge], [16:0-8-0,Edge]
------------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.96	Vert(LL)	-0.41	14-15	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.95	Vert(CT)	-0.49	14-15	>882	180	MT18HS	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.82	Horz(CT)	0.04	13	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-MS	Attic	-0.32	15-16	448	360		
									Weight: 285 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x6 SP No.2 *Except* 16-18: 2x6 SP DSS, 15-16: 2x10 SP DSS	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 5-16,9-15,5-8: 2x4 SP No.2 or 2x4 SPF No.2, 2-18: 2x6 SP No.2	WEBS 1 Row at midpt 9-14 JOINTS 1 Brace at Jt(s): 19, 20

REACTIONS. (size) 18=0-3-8, 13=Mechanical
Max Horz 18=241(LC 11)
Max Grav 18=1947(LC 20), 13=1953(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2529/0, 3-5=-2539/0, 5-6=-602/72, 6-7=-438/72, 7-8=-622/72, 8-9=-1938/0,
9-11=-2617/0, 11-12=-2525/0, 2-18=-1840/0, 12-13=-1911/0
BOT CHORD 17-18=-157/555, 16-17=0/2172, 15-16=0/2091, 14-15=0/2077
WEBS 3-17=-429/119, 3-16=-355/281, 5-16=0/917, 9-15=0/933, 9-14=-335/350,
11-14=-407/215, 2-17=0/1638, 12-14=0/1997, 5-19=-1689/0, 19-20=-1682/0,
8-20=-1689/0

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-9-9, Interior(1) 2-9-9 to 16-0-0, Exterior(2) 16-0-0 to 26-2-5, Interior(1) 26-2-5 to 36-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Ceiling dead load (5.0 psf) on member(s). 8-9, 5-19, 19-20, 8-20; Wall dead load (5.0psf) on member(s).5-16, 9-15
 - 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 15-16
 - 9) Refer to girder(s) for truss to truss connections.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 11) Attic room checked for L/360 deflection.

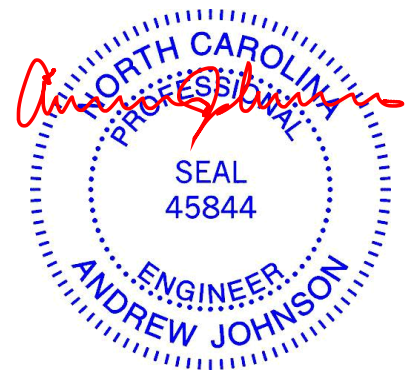


Job 30487-30487A	Truss A2A	Truss Type ROOF TRUSS	Qty 2	Ply 1	34 PRINCE PLACE - ROOF	150248470
---------------------	--------------	--------------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:48 2022 Page 1

ID:BLJh112d3wvZK_wUdDgFCyrbmE-d4TglwcnD??HiETOMVmomW_gf08RDTSZkqR9M6zkw4n



Scale = 1:71.1

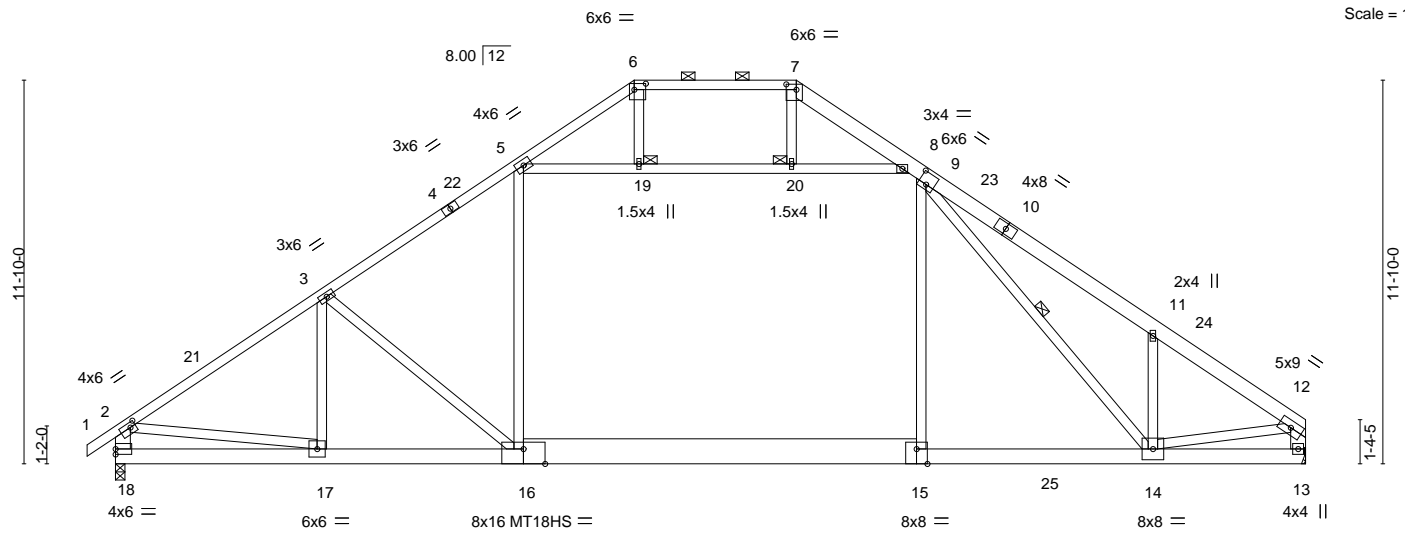


Plate Offsets (X, Y)--	[2:0-2-0,0-1-12], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [9:0-3-0,0-4-4], [15:0-4-0,Edge], [16:0-8-0,Edge]
------------------------	--

LOADING (psf)	SPACING- 2-4-8	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.72	Vert(LL) -0.42 14-15 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.87	Vert(CT) -0.51 14-15 >854 180	MT18HS	197/144
BCLL 0.0 *	Rep Stress Incr NO	WB 0.93	Horz(CT) 0.04 13 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Attic -0.34 15-16 430 360	Weight: 295 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10,10-12: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-10-2 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x6 SP DSS *Except* 15-16: 2x10 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 7-10-3 oc bracing: 16-17.
WEBS 2x4 SP No.3 *Except* 5-16,9-15,5-8: 2x4 SP No.2 or 2x4 SPF No.2, 2-18,12-13: 2x6 SP No.2	WEBS 1 Row at midpt 9-14
	JOINTS 1 Brace at Jt(s): 19, 20

REACTIONS. (size) 18=0-3-8, 13=Mechanical
 Max Horz 18=285(LC 9)
 Max Grav 18=2307(LC 20), 13=2317(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2996/0, 3-5=-3000/0, 5-6=-727/94, 6-7=-532/93, 7-8=-745/89, 8-9=-2288/0, 9-11=-3159/12, 11-12=-3021/0, 2-18=-2180/0, 12-13=-2244/0
 BOT CHORD 17-18=-192/658, 16-17=0/2574, 15-16=0/2477, 14-15=0/2459, 13-14=-3/279
 WEBS 3-17=-485/126, 3-16=-407/308, 5-16=0/1083, 9-15=0/1131, 9-14=-419/475, 11-14=-534/271, 2-17=0/1946, 12-14=0/2266, 5-19=-1994/0, 19-20=-1985/0, 8-20=-1993/0

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-8 to 2-9-9, Interior(1) 2-9-9 to 16-0-0, Exterior(2) 16-0-0 to 26-2-5, Interior(1) 26-2-5 to 36-5-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Ceiling dead load (5.0 psf) on member(s). 8-9, 5-19, 19-20, 8-20; Wall dead load (5.0psf) on member(s).5-16, 9-15
 - 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 15-16
 - 9) Refer to girder(s) for truss to truss connections.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 11) Attic room checked for L/360 deflection.




Job 30487-30487A	Truss A3G	Truss Type ROOF TRUSS	Qty 1	Ply 2	34 PRINCE PLACE - ROOF Job Reference (optional)	150248471
---------------------	--------------	--------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:50 2022 Page 1

ID:BLJh112d3wvZK_wUdDgFCyrbmE-ZSbQAce18cF?xYdPUwoGrx42lqsThPvsC8wGQ?zkw4l



Scale = 1:72.3

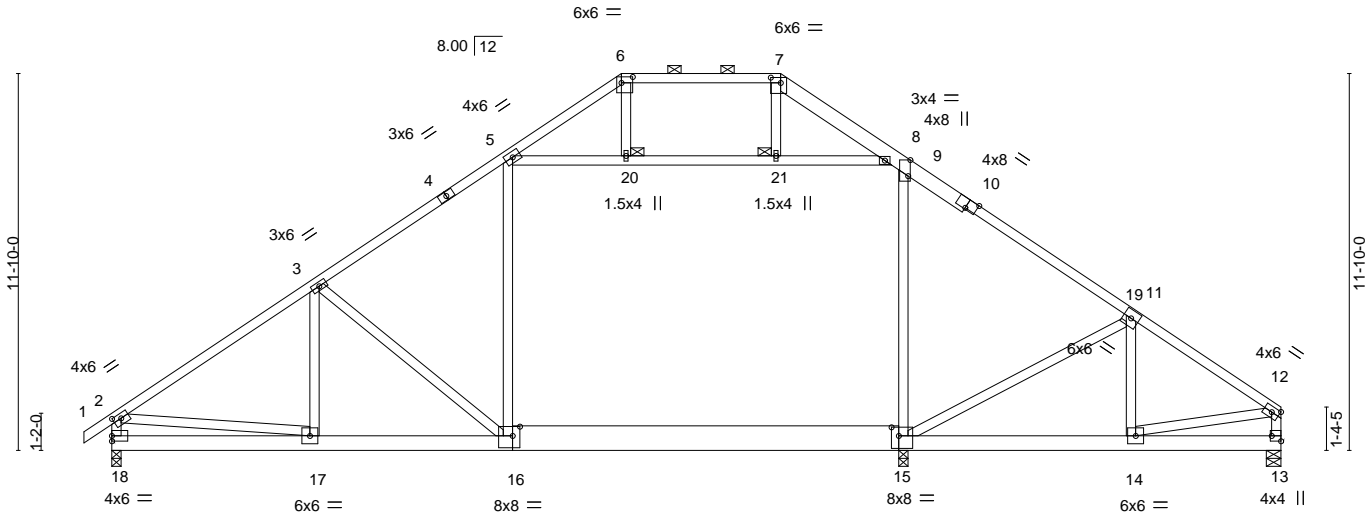


Plate Offsets (X,Y)--	[2:0-3-0,0-1-12], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [9:0-6-1,Edge], [10:0-4-0,Edge], [13:Edge,0-3-8], [15:0-2-12,0-3-4], [16:0-2-12,0-3-8]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.58	Vert(LL)	-0.18 15-16	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.71	Vert(CT)	-0.37 16-17	>806	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.81	Horz(CT)	0.04 13	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Attic	-0.10 15-16	1512	360		
								Weight: 559 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-10-5 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x6 SP DSS *Except* 15-16: 2x10 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 5-16,9-15,5-8: 2x4 SP No.2 or 2x4 SPF No.2	JOINTS 1 Brace at Jt(s): 20, 21

REACTIONS.
(size) 18=0-3-8, 15=0-3-8, 13=0-5-8 Max Horz 18=240(LC 5) Max Uplift 18=110(LC 8), 15=1063(LC 20), 13=80(LC 8) Max Grav 18=3854(LC 42), 15=1644(LC 7), 13=3695(LC 42)

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. TOP CHORD 2-3=-5434/165, 3-5=-5495/195, 5-6=-690/40, 6-7=-523/40, 7-8=-760/49, 8-9=-4048/199, 9-11=-5560/250, 11-12=-4711/153, 2-18=-3749/145, 12-13=-3517/101 BOT CHORD 17-18=-236/695, 16-17=-186/4586, 15-16=-107/4642, 14-15=-76/3830, 13-14=-11/252 WEBS 3-17=-409/52, 3-16=-222/308, 5-16=-98/2575, 9-15=-228/2421, 15-19=-177/911, 14-19=-1082/84, 11-19=-698/104, 2-17=0/3929, 12-14=-81/3726, 5-20=-4160/256, 20-21=-4148/257, 8-21=-4162/257

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (5.0 psf) on member(s). 8-9, 5-20, 20-21, 8-21; Wall dead load (5.0psf) on member(s).5-16, 9-15
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 15-16
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13 except (jt=lb) 18=110, 15=1063.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.



Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248471
30487-30487A	A3G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:50 2022 Page 2
ID:BLJh112d3wvZK_wUdDgFCyrbmE-ZSbQAcE18cF?xYdPUwoGrx42lqsThPvsC8wGQ?zkw4l

NOTES-

- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 13) This truss has large uplift reaction(s) from gravity load case(s). Proper connection is required to secure truss against upward movement at the bearings. Building designer must provide for uplift reactions indicated.
- 14) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1100 lb down at 24-10-4, and 2277 lb down and 203 lb up at 12-5-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 15) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-2277(B) 15=-1100(F)
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1990(B) 15=-1100(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-20, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-40, 15-16=-30, 13-15=-40, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1703(B) 15=-1100(F)
- 4) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-14, 6-7=18, 7-8=5, 8-9=-1, 9-12=5, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-8, 2-6=2, 7-12=17, 2-18=12, 12-13=16
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=195(B) 15=-1100(F)
- 5) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 6-7=18, 7-8=-14, 8-9=-20, 9-12=-14, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-13, 2-6=-17, 7-12=-2, 2-18=-16, 12-13=-12
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=195(B) 15=-1100(F)
- 6) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-31, 6-7=2, 7-8=-12, 8-9=-22, 9-12=-12, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Horz: 1-2=7, 2-6=11, 7-12=8, 2-18=21, 12-13=7
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=203(B) 15=-1100(F)
- 7) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-12, 6-7=2, 7-8=-31, 8-9=-41, 9-12=-31, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Horz: 1-2=-13, 2-6=-8, 7-12=-11, 2-18=-7, 12-13=-21
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=203(B) 15=-1100(F)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-18=10, 12-13=15
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=195(B) 15=-1100(F)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-18=-15, 12-13=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=195(B) 15=-1100(F)
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-18=10, 12-13=15
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=195(B) 15=-1100(F)
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248471
30487-30487A	A3G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:50 2022 Page 3
ID:BLJh112d3wvZK_wUdDgFCYrbmE-ZSbQAcE18cF?xYdPUwoGrx42lqsThPvsC8wGQ?zkw4l

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-18=-15, 12-13=-10
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=195(B) 15=-1100(F)
- 12) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-6=2, 6-7=-12, 7-8=-12, 8-9=-22, 9-12=-12, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Horz: 1-2=-26, 2-6=-22, 7-12=8, 2-18=19, 12-13=6
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=203(B) 15=-1100(F)
- 13) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-12, 6-7=-12, 7-8=2, 8-9=-8, 9-12=2, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Horz: 1-2=-13, 2-6=-8, 7-12=22, 2-18=-6, 12-13=19
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=203(B) 15=-1100(F)
- 15) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-20, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-20, 15-16=-110, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 16) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-55, 2-6=-58, 6-7=-34, 7-8=-44, 8-9=-54, 9-12=-44, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Horz: 1-2=5, 2-6=8, 7-12=6, 2-18=16, 12-13=5
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-15(B) 15=-1100(F)
- 17) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 6-7=-34, 7-8=-58, 8-9=-68, 9-12=-58, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Horz: 1-2=-10, 2-6=-6, 7-12=8, 2-18=-5, 12-13=16
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-15(B) 15=-1100(F)
- 18) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-6=-34, 6-7=-44, 7-8=-44, 8-9=-54, 9-12=-44, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Horz: 1-2=-19, 2-6=-16, 7-12=6, 2-18=14, 12-13=5
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-15(B) 15=-1100(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 6-7=-44, 7-8=-34, 8-9=-44, 9-12=-34, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Horz: 1-2=-10, 2-6=-6, 7-12=16, 2-18=-5, 12-13=14
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-15(B) 15=-1100(F)
- 20) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-2277(B) 15=-1100(F)
- 21) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-2277(B) 15=-1100(F)
- 22) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-1990(B) 15=-1100(F)
- 23) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Continued on page 4

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248471
30487-30487A	A3G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:50 2022 Page 4
ID:BLJh112d3wvZK_wUdDgFCYrbmE-ZSbQAcE18cF?xYdPUwoGrx42lqsThPvsC8wGQ?zkw4!

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
- Concentrated Loads (lb)
Vert: 16=-1990(B) 15=-1100(F)
- 24) Reversal: Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 25) Reversal: Dead + 0.75 Roof Live (balanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 27) Reversal: Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-20, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-20, 15-16=-110, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 28) Reversal: 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 29) Reversal: 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 30) Reversal: 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-20, 8-9=-30, 9-12=-20, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 31) Reversal: 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-20, 2-6=-20, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1129(B) 15=-1100(F)
- 32) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-14, 6-7=18, 7-8=5, 8-9=-1, 9-12=5, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-8, 2-6=2, 7-12=17, 2-18=12, 12-13=16
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1538(B) 15=-1100(F)
- 33) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 6-7=18, 7-8=-14, 8-9=-20, 9-12=-14, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
Horz: 1-2=-13, 2-6=-17, 7-12=-2, 2-18=-16, 12-13=-12
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1538(B) 15=-1100(F)
- 34) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-31, 6-7=2, 7-8=-12, 8-9=-22, 9-12=-12, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Horz: 1-2=7, 2-6=11, 7-12=8, 2-18=21, 12-13=7
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1530(B) 15=-1100(F)
- 35) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-12, 6-7=2, 7-8=-31, 8-9=-41, 9-12=-31, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
Horz: 1-2=-13, 2-6=-8, 7-12=-11, 2-18=-7, 12-13=-21
Drag: 5-16=-10, 9-15=-10
Concentrated Loads (lb)
Vert: 16=-1530(B) 15=-1100(F)

Continued on page 5

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248471
30487-30487A	A3G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:50 2022 Page 5
 ID:BLJh112d3wvZK_wUdDgFCyrbmE-ZSbQAcE18cF?xYdPUwoGrx42lqsThPvsC8wGQ?zkw4!

LOAD CASE(S) Standard

- 36) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-18=10, 12-13=15
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-1538(B) 15=-1100(F)
- 37) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-18=-15, 12-13=-10
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-1538(B) 15=-1100(F)
- 38) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-18=10, 12-13=15
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-1538(B) 15=-1100(F)
- 39) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 16-18=-12, 15-16=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-18=-15, 12-13=-10
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-1538(B) 15=-1100(F)
- 40) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=6, 2-6=2, 6-7=-12, 7-8=-12, 8-9=-22, 9-12=-12, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-26, 2-6=-22, 7-12=8, 2-18=19, 12-13=6
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-1530(B) 15=-1100(F)
- 41) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-7, 2-6=-12, 6-7=-12, 7-8=2, 8-9=-8, 9-12=2, 16-18=-20, 15-16=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-13, 2-6=-8, 7-12=22, 2-18=-6, 12-13=19
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-1530(B) 15=-1100(F)
- 42) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-55, 2-6=-58, 6-7=-34, 7-8=-44, 8-9=-54, 9-12=-44, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=5, 2-6=8, 7-12=6, 2-18=16, 12-13=5
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-2076(B) 15=-1100(F)
- 43) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-40, 2-6=-44, 6-7=-34, 7-8=-58, 8-9=-68, 9-12=-58, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=-10, 2-6=-6, 7-12=8, 2-18=5, 12-13=16
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-2076(B) 15=-1100(F)
- 44) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-31, 2-6=-34, 6-7=-44, 7-8=-44, 8-9=-54, 9-12=-44, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=-19, 2-6=-16, 7-12=6, 2-18=14, 12-13=5
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-2076(B) 15=-1100(F)
- 45) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-40, 2-6=-44, 6-7=-44, 7-8=-34, 8-9=-44, 9-12=-34, 16-18=-20, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=-10, 2-6=-6, 7-12=16, 2-18=5, 12-13=14
 Drag: 5-16=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 16=-2076(B) 15=-1100(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss A4G	Truss Type ROOF TRUSS	Qty 1	Ply 2	34 PRINCE PLACE - ROOF Job Reference (optional)	150248472
---------------------	--------------	--------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334, 8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:52 2022 Page 1



Scale = 1:72.5

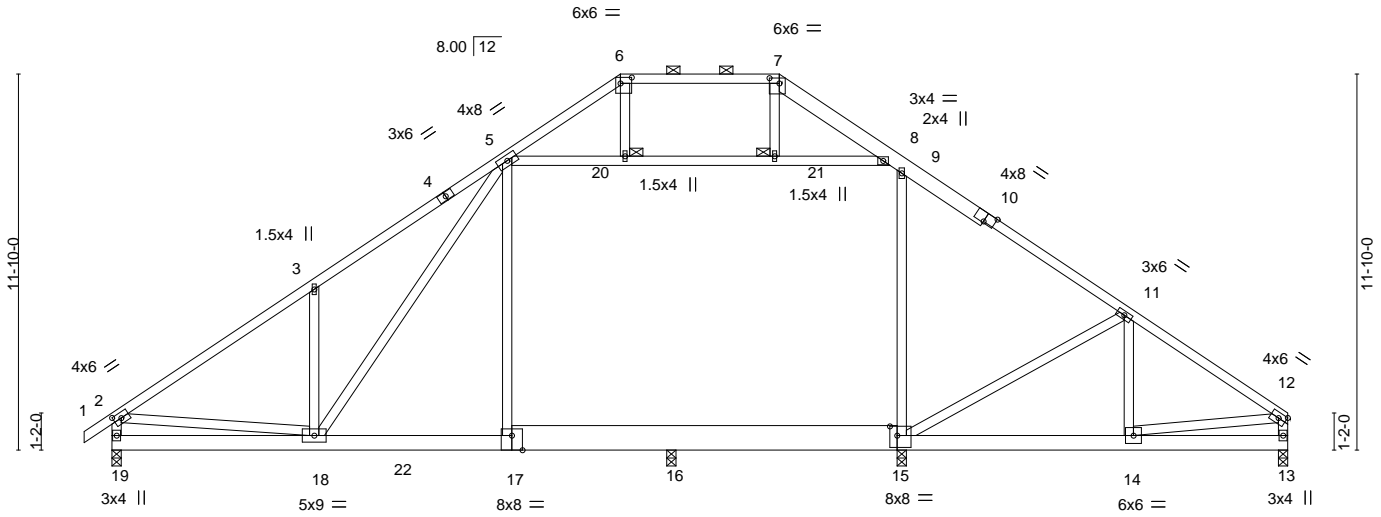


Plate Offsets (X, Y)--	[2:0-2-14,0-2-0], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [10:0-4-0,Edge], [15:0-2-12,0-3-8], [17:0-4-0,Edge]
------------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.48	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 1.00	Vert(LL) -0.15 17-18 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.64	Vert(CT) -0.31 17-18 >667 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.03 13 n/a n/a		
	Code IRC2015/TPI2014		Attic -0.13 16-17 927 360	Weight: 572 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 7-10: 2x6 SP No.2
 BOT CHORD 2x6 SP No.2 *Except*
 15-17: 2x10 SP No.2
 WEBS 2x4 SP No.3 *Except*
 5-17,9-15,5-8: 2x4 SP No.2 or 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-8-8 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 JOINTS 1 Brace at Jt(s): 20, 21

REACTIONS. All bearings 0-3-8.
 (lb) - Max Horz 19=238(LC 7)
 Max Uplift All uplift 100 lb or less at joint(s) except 19=137(LC 8), 13=105(LC 8), 15=869(LC 20)
 Max Grav All reactions 250 lb or less at joint(s) except 19=3006(LC 1), 13=2817(LC 1), 16=1861(LC 42), 15=1676(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-4228/202, 3-5=-4220/351, 5-6=-640/41, 6-7=-477/41, 7-8=-699/51, 8-9=-2980/236, 9-11=-3959/302, 11-12=-3848/194, 2-19=-2957/170, 12-13=-2739/126
 BOT CHORD 18-19=-237/537, 17-18=-167/3249, 16-17=-170/3303, 15-16=-170/3287, 14-15=-111/3139, 13-14=-20/255
 WEBS 3-18=-386/207, 5-18=-251/545, 5-17=-218/1549, 9-15=-270/1657, 11-15=-269/379, 11-14=-419/97, 2-18=-10/3077, 12-14=-108/2929, 5-20=-2841/299, 20-21=-2832/300, 8-21=-2843/299

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Ceiling dead load (5.0 psf) on member(s). 8-9, 5-20, 20-21, 8-21; Wall dead load (5.0psf) on member(s).5-17, 9-15
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 16-17, 15-16
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 137 lb uplift at joint 19, 105 lb uplift at joint 13 and 69 lb uplift at joint 15.



Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248472
30487-30487A	A4G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:52 2022 Page 2

ID:BLJh112d3wvZK_wUdDgFCyrbmE-WrjBalfHgDVjBmobLqkxM9QQdTO9M49fSPNVtzkw4j

NOTES-

- 11) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1100 lb down at 25-0-0, and 2261 lb down and 202 lb up at 12-5-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 14) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-2261(F) 15=-1100(F)
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1976(F) 15=-1100(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-6=-20, 6-7=-20, 7-8=-20, 8-9=-30, 9-12=-20, 17-19=-40, 15-17=-30, 13-15=-40, 5-8=-10
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1691(F) 15=-1100(F)
- 4) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-4, 2-6=-14, 6-7=18, 7-8=5, 8-9=-1, 9-12=5, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-8, 2-6=2, 7-12=17, 2-19=12, 12-13=16
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=194(F) 15=-1100(F)
- 5) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=1, 2-6=5, 6-7=18, 7-8=-14, 8-9=-20, 9-12=-14, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=-2, 2-19=-16, 12-13=-12
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=194(F) 15=-1100(F)
- 6) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-27, 2-6=-31, 6-7=2, 7-8=-12, 8-9=-22, 9-12=-12, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=7, 2-6=11, 7-12=8, 2-19=21, 12-13=7
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=202(F) 15=-1100(F)
- 7) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-7, 2-6=-12, 6-7=2, 7-8=-31, 8-9=-41, 9-12=-31, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-13, 2-6=-8, 7-12=-11, 2-19=-7, 12-13=-21
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=202(F) 15=-1100(F)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-19=10, 12-13=15
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=194(F) 15=-1100(F)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-19=-15, 12-13=-10
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=194(F) 15=-1100(F)
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-19=10, 12-13=15
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=194(F) 15=-1100(F)
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248472
30487-30487A	A4G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:52 2022 Page 3

ID:BLJh112d3wvZK_wUdDgFCyrbmE-WrjBalfHgDVjBmobLqkxM9QQdTO9M49fSPNVtzkw4j

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-19=-15, 12-13=-10
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=194(F) 15=-1100(F)

12) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=6, 2-6=2, 6-7=-12, 7-8=-12, 8-9=-22, 9-12=-12, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-26, 2-6=-22, 7-12=8, 2-19=19, 12-13=6
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=202(F) 15=-1100(F)

13) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-7, 2-6=-12, 6-7=-12, 7-8=2, 8-9=-8, 9-12=2, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-13, 2-6=-8, 7-12=22, 2-19=-6, 12-13=-19
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=202(F) 15=-1100(F)

15) Dead + Uninhabitable Attic Storage: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 1-2=-20, 2-6=-20, 6-7=-20, 7-8=-20, 8-9=-30, 9-12=-20, 19-22=-20, 17-22=-60, 16-17=-110, 15-16=-110, 13-15=-20, 5-8=-10
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-1120(F) 15=-1100(F)

16) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-55, 2-6=-58, 6-7=-34, 7-8=-44, 8-9=-54, 9-12=-44, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=5, 2-6=8, 7-12=6, 2-19=16, 12-13=5
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-15(F) 15=-1100(F)

17) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-40, 2-6=-44, 6-7=-34, 7-8=-58, 8-9=-68, 9-12=-58, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=-10, 2-6=-6, 7-12=8, 2-19=-5, 12-13=-16
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-15(F) 15=-1100(F)

18) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-31, 2-6=-34, 6-7=-44, 7-8=-44, 8-9=-54, 9-12=-44, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=-19, 2-6=-16, 7-12=6, 2-19=14, 12-13=5
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-15(F) 15=-1100(F)

19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-40, 2-6=-44, 6-7=-44, 7-8=-34, 8-9=-44, 9-12=-34, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 Horz: 1-2=-10, 2-6=-6, 7-12=16, 2-19=-5, 12-13=-14
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-15(F) 15=-1100(F)

20) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-20, 8-9=-30, 9-12=-20, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-2261(F) 15=-1100(F)

21) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-20, 2-6=-20, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-2261(F) 15=-1100(F)

22) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Continued on page 4

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248472
30487-30487A	A4G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:52 2022 Page 4
ID:BLJh112d3wvZK_wUdDgFCyrbmE-WrjBalfHgdVjBmrobLqkxM9QQdTO9M49fSPNVtzkw4j

LOAD CASE(S) Standard

- Uniform Loads (plf)
 - Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-20, 8-9=-30, 9-12=-20, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
- Concentrated Loads (lb)
 - Vert: 17=-1976(F) 15=-1100(F)
- 23) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-20, 2-6=-20, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1976(F) 15=-1100(F)
- 24) Reversal: Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 25) Reversal: Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 27) Reversal: Dead + Uninhabitable Attic Storage: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 1-2=-20, 2-6=-20, 6-7=-20, 7-8=-20, 8-9=-30, 9-12=-20, 19-22=-20, 17-22=-60, 16-17=-110, 15-16=-110, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 28) Reversal: 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-60, 2-6=-60, 6-7=-60, 7-8=-20, 8-9=-30, 9-12=-20, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 29) Reversal: 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-20, 2-6=-20, 6-7=-60, 7-8=-60, 8-9=-70, 9-12=-60, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 30) Reversal: 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-50, 2-6=-50, 6-7=-50, 7-8=-20, 8-9=-30, 9-12=-20, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 31) Reversal: 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-20, 2-6=-20, 6-7=-50, 7-8=-50, 8-9=-60, 9-12=-50, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1120(F) 15=-1100(F)
- 32) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-4, 2-6=-14, 6-7=18, 7-8=5, 8-9=-1, 9-12=5, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 - Horz: 1-2=8, 2-6=2, 7-12=17, 2-19=12, 12-13=16
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1532(F) 15=-1100(F)
- 33) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=1, 2-6=5, 6-7=18, 7-8=-14, 8-9=-20, 9-12=-14, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 - Horz: 1-2=-13, 2-6=-17, 7-12=-2, 2-19=-16, 12-13=-12
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1532(F) 15=-1100(F)
- 34) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-27, 2-6=-31, 6-7=2, 7-8=-12, 8-9=-22, 9-12=-12, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 - Horz: 1-2=7, 2-6=11, 7-12=8, 2-19=21, 12-13=7
 - Drag: 5-17=-10, 9-15=-10
 - Concentrated Loads (lb)
 - Vert: 17=-1524(F) 15=-1100(F)

Continued on page 5

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	34 PRINCE PLACE - ROOF	I50248472
30487-30487A	A4G	ROOF TRUSS	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:52 2022 Page 5

ID:BLJh112d3wvZK_wUdDgFCyrbmE-WrjBalfHgDVjBmobLqkxM9QQdTO9M49fSPNVtzk4j

LOAD CASE(S) Standard

- 35) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-7, 2-6=-12, 6-7=2, 7-8=-31, 8-9=-41, 9-12=-31, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-13, 2-6=-8, 7-12=-11, 2-19=-7, 12-13=-21
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1524(F) 15=-1100(F)
- 36) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-19=10, 12-13=15
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1532(F) 15=-1100(F)
- 37) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-19=-15, 12-13=-10
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1532(F) 15=-1100(F)
- 38) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-6=18, 6-7=5, 7-8=5, 8-9=-1, 9-12=5, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-26, 2-6=-30, 7-12=17, 2-19=10, 12-13=15
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1532(F) 15=-1100(F)
- 39) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=1, 2-6=5, 6-7=5, 7-8=18, 8-9=12, 9-12=18, 17-19=-12, 15-17=-18, 13-15=-12, 5-8=-6
 Horz: 1-2=-13, 2-6=-17, 7-12=30, 2-19=-15, 12-13=-10
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1532(F) 15=-1100(F)
- 40) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=6, 2-6=2, 6-7=-12, 7-8=-12, 8-9=-22, 9-12=-12, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-26, 2-6=-22, 7-12=8, 2-19=19, 12-13=6
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1524(F) 15=-1100(F)
- 41) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-7, 2-6=-12, 6-7=-12, 7-8=2, 8-9=-8, 9-12=2, 17-19=-20, 15-17=-30, 13-15=-20, 5-8=-10
 Horz: 1-2=-13, 2-6=-8, 7-12=22, 2-19=-6, 12-13=-19
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-1524(F) 15=-1100(F)
- 42) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left):
 Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-55, 2-6=-58, 6-7=-34, 7-8=-44, 8-9=-54, 9-12=-44, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20,
 5-8=-10
 Horz: 1-2=5, 2-6=8, 7-12=6, 2-19=16, 12-13=5
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-2065(F) 15=-1100(F)
- 43) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right):
 Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-40, 2-6=-44, 6-7=-34, 7-8=-58, 8-9=-68, 9-12=-58, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20,
 5-8=-10
 Horz: 1-2=-10, 2-6=-6, 7-12=-8, 2-19=-5, 12-13=-16
 Drag: 5-17=-10, 9-15=-10
 Concentrated Loads (lb)
 Vert: 17=-2065(F) 15=-1100(F)
- 44) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 6

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss A4G	Truss Type ROOF TRUSS	Qty 1	Ply 2	34 PRINCE PLACE - ROOF I50248472 Job Reference (optional)
---------------------	--------------	--------------------------	----------	-----------------	---

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:52 2022 Page 6
ID:BLJh1112d3wvZK_wUdDgFCyrbmE-WrjBalfHgDVjBmobLqkxM9QQdTO9M49fSPNVtzkw4j

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 1-2=-31, 2-6=-34, 6-7=-44, 7-8=-44, 8-9=-54, 9-12=-44, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
Horz: 1-2=-19, 2-6=-16, 7-12=6, 2-19=14, 12-13=5
Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-2065(F) 15=-1100(F)

45) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-40, 2-6=-44, 6-7=-44, 7-8=-34, 8-9=-44, 9-12=-34, 19-22=-20, 17-22=-50, 16-17=-90, 15-16=-90, 13-15=-20, 5-8=-10
Horz: 1-2=-10, 2-6=-6, 7-12=16, 2-19=-5, 12-13=-14
Drag: 5-17=-10, 9-15=-10

Concentrated Loads (lb)

Vert: 17=-2065(F) 15=-1100(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601 **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




818 Soundside Road
Edenton, NC 27932

Job 30487-30487A	Truss A5	Truss Type ROOF TRUSS	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	150248473
---------------------	-------------	--------------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:53 2022 Page 1

ID:BLJh112d3wvZK_wUdDgFCyrbmE-1HZoegvRXdao?M_92MzTaiY31pun_lu68w1Kzkw4i



Scale = 1:71.2

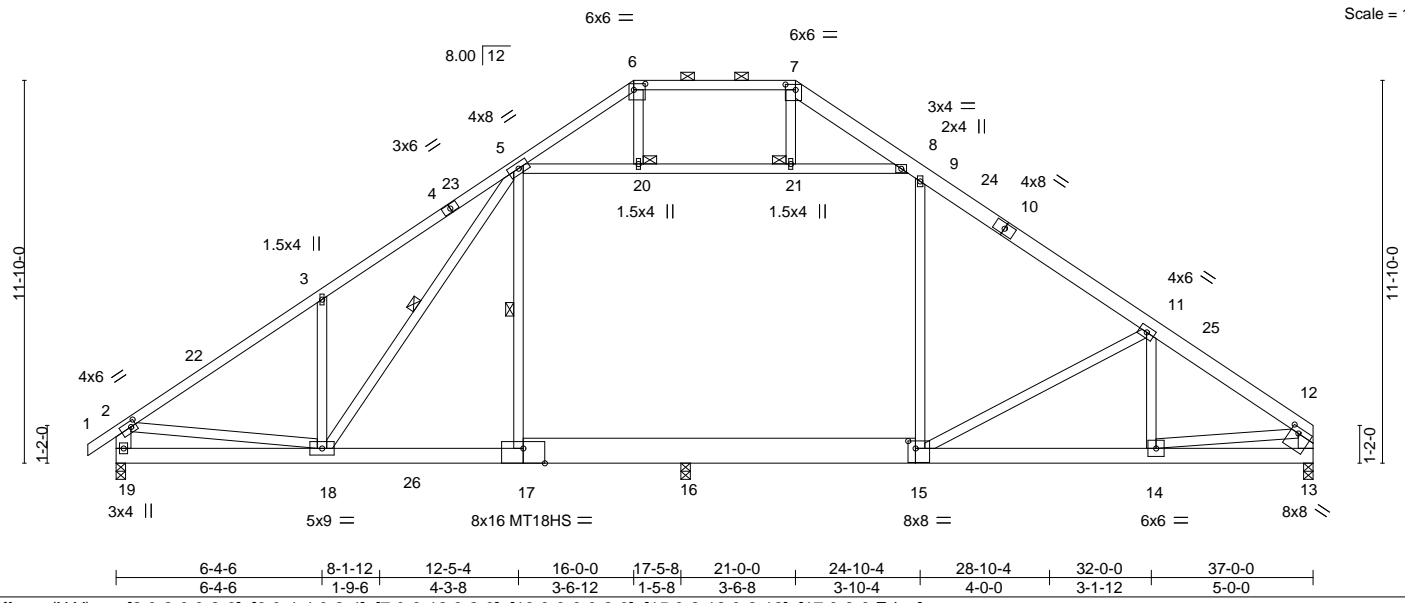


Plate Offsets (X, Y)--	[2:0-2-0,0-2-0], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [13:0-3-0,0-2-0], [15:0-2-12,0-2-12], [17:0-8-0,Edge]
------------------------	---

LOADING (psf)	SPACING-	2-5-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.68	Vert(LL)	-0.40	14-15	>569	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.58	14-15	>400	180	MT18HS	197/144
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.72	Horz(CT)	0.03	13	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-MS	Attic	-0.30	16-17	401	360		
									Weight: 296 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
7-10,10-12: 2x6 SP No.2
BOT CHORD 2x6 SP DSS *Except*
15-17: 2x10 SP No.2
WEBS 2x4 SP No.3 *Except*
5-17,9-15,5-8: 2x4 SP No.2 or 2x4 SPF No.2, 2-19,12-13: 2x6 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-5-2 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-18, 5-17
JOINTS 1 Brace at Jt(s): 20, 21

REACTIONS. (size) 19=0-3-8, 13=0-3-8, 16=0-3-8
Max Horz 19=288(LC 9)
Max Grav 19=1782(LC 1), 13=1789(LC 21), 16=1267(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2274/0, 3-5=-2264/91, 5-6=-741/98, 6-7=-539/97, 7-8=-739/95, 8-9=-1617/70, 9-11=-2089/0, 11-12=-2465/0, 2-19=-1674/27, 12-13=-1752/0
BOT CHORD 18-19=-200/566, 17-18=0/1625, 16-17=0/1645, 15-16=0/1643, 14-15=0/1976, 13-14=-13/277
WEBS 3-18=-451/251, 5-18=-365/674, 5-17=-319/619, 9-15=0/485, 11-15=-577/243, 2-18=0/1449, 12-14=0/1757, 5-20=-1255/56, 20-21=-1244/56, 8-21=-1248/53

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-9-14, Interior(1) 2-9-14 to 16-0-0, Exterior(2) 16-0-0 to 26-2-13, Interior(1) 26-2-13 to 36-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Ceiling dead load (5.0 psf) on member(s). 8-9, 5-20, 20-21, 8-21; Wall dead load (5.0psf) on member(s).5-17, 9-15
 - 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 16-17, 15-16
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 10) Attic room checked for L/360 deflection.

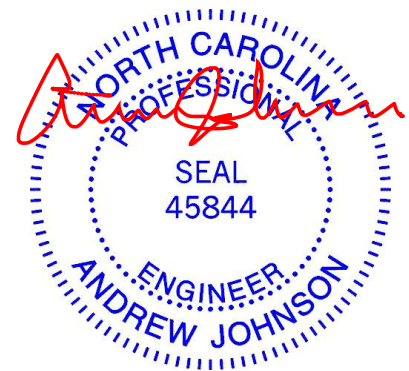


Job 30487-30487A	Truss A6	Truss Type ROOF TRUSS	Qty 2	Ply 1	34 PRINCE PLACE - ROOF	150248474
---------------------	-------------	--------------------------	----------	----------	------------------------	-----------



84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:55 2022 Page 1

ID:BLJh1112d3wvZK_wUdDgFCyrbmE-wQPJDKiAz8tH2JWNHTORY?nqVrZKMiQbLPd16Czkw4g



Scale = 1:73.0

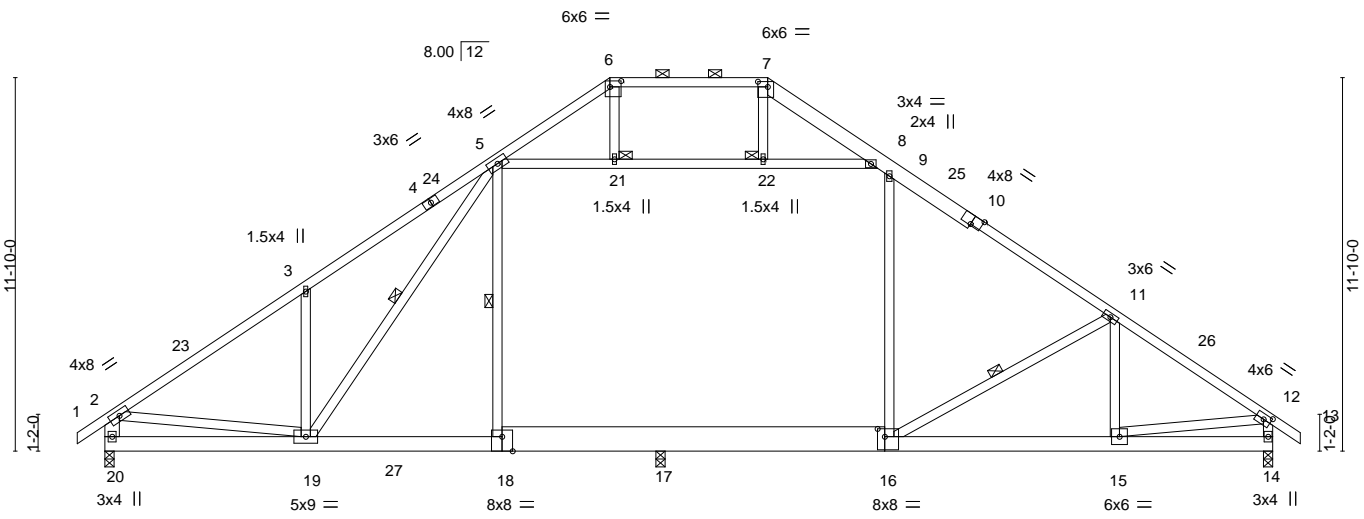

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.94	Vert(LL)	-0.36	15-16	>637	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.73	Vert(CT)	-0.52	15-16	>444		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.60	Horz(CT)	0.02	14	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Attic	-0.26	17-18	463	Weight: 288 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x6 SP DSS *Except* 16-18: 2x10 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 5-18,9-16,12-14,5-8: 2x4 SP No.2 or 2x4 SPF No.2, 2-20: 2x6 SP No.2	WEBS 1 Row at midpt 5-19, 5-18, 11-16
	JOINTS 1 Brace at Jt(s): 21, 22

REACTIONS. (size) 20=0-3-8, 14=0-3-8, 17=0-3-8
 Max Horz 20=244(LC 10)
 Max Grav 20=1472(LC 1), 14=1537(LC 21), 17=1063(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1875/0, 3-5=-1864/78, 5-6=-596/73, 6-7=-430/73, 7-8=-602/76, 8-9=-1341/64,
 9-11=-1713/0, 11-12=-2009/0, 2-20=-1380/25, 12-14=-1514/10
 BOT CHORD 19-20=-158/475, 18-19=0/1345, 17-18=0/1362, 16-17=0/1360, 15-16=0/1598
 WEBS 3-19=-372/208, 5-19=-302/561, 5-18=-273/528, 9-16=0/380, 11-16=-432/188,
 2-19=0/1191, 12-15=0/1490, 5-21=-1067/72, 21-22=-1058/72, 8-22=-1062/70

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-9-14, Interior(1) 2-9-14 to 16-0-0, Exterior(2) 16-0-0 to 26-2-13, Interior(1) 26-2-13 to 37-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Ceiling dead load (5.0 psf) on member(s). 8-9, 5-21, 21-22, 8-22; Wall dead load (5.0psf) on member(s).5-18, 9-16
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 17-18, 16-17
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Attic room checked for L/360 deflection.



Job 30487-30487A	Truss A6A	Truss Type ROOF TRUSS	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248475
---------------------	--------------	--------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:56 2022 Page 1

ID:BLJh1112d3wvZK_wUdDgFCyrbmE-OcyhQfiokS?8fT4ZqBvg5CK2IFtX57yka3NaefzkW4f

0-10-8 6-4-6 8-1-12 12-5-4 16-0-0 21-0-0 24-10-4 28-10-4 31-10-4 32-0-0 37-0-0 37-10-8
 0-10-8 6-4-6 1-9-6 4-3-8 3-6-12 5-0-0 3-10-4 4-0-0 3-0-0 0-1-12 5-0-0 0-10-8

Scale = 1:74.2

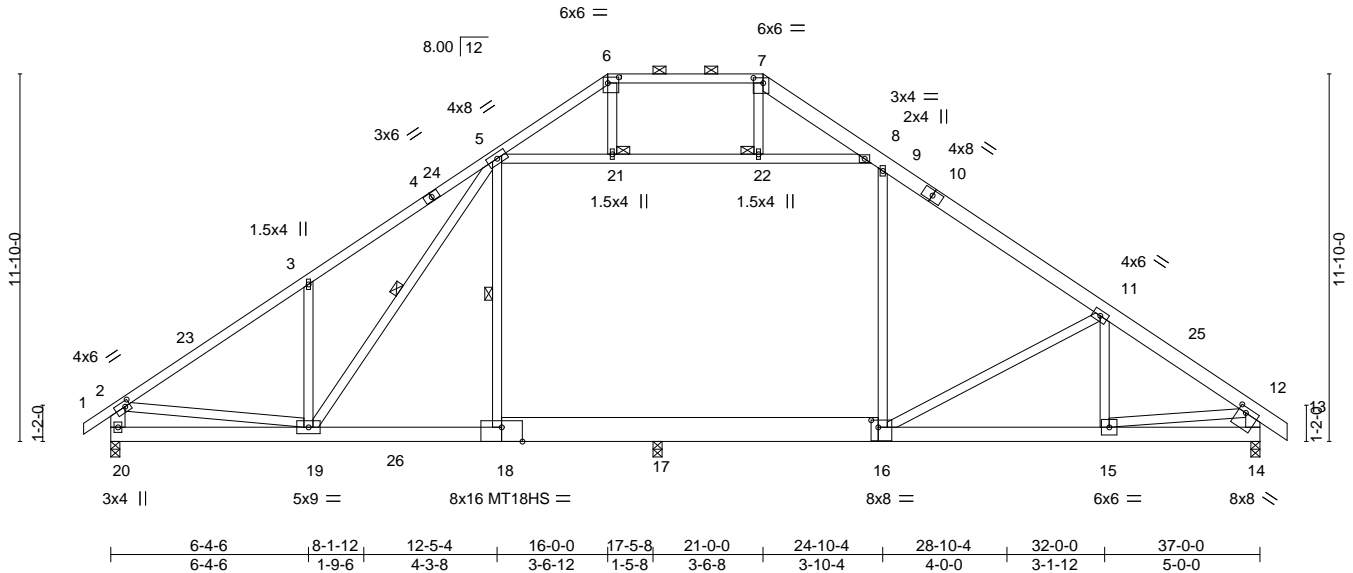


Plate Offsets (X, Y)--	[2:0-2-0,0-2-0], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [14:0-3-0,0-2-0], [16:0-2-12,0-2-12], [18:0-8-0,Edge]
------------------------	---

LOADING (psf)	SPACING-	2-5-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.68	Vert(LL)	-0.40 15-16	>571	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.57 15-16	>402	180	MT18HS	197/144
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.71	Horz(CT)	0.03 14	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Attic	-0.30 17-18	401	360		
								Weight: 299 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10,10-13: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-5-3 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x6 SP DSS *Except* 16-18: 2x10 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 5-18,9-16,5-8: 2x4 SP No.2 or 2x4 SPF No.2, 2-20,12-14: 2x6 SP No.2	WEBS 1 Row at midpt 5-19, 5-18 JOINTS 1 Brace at Jt(s): 21, 22

REACTIONS. (size) 20=0-3-8, 14=0-3-8, 17=0-3-8
 Max Horz 20=295(LC 10)
 Max Grav 20=1781(LC 1), 14=1864(LC 21), 17=1268(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2273/0, 3-5=-2262/93, 5-6=-740/98, 6-7=-538/97, 7-8=-739/95, 8-9=-1616/72, 9-11=-2085/0, 11-12=-2460/0, 2-20=-1673/29, 12-14=-1827/8
 BOT CHORD 19-20=-193/574, 18-19=0/1623, 17-18=0/1643, 16-17=0/1641, 15-16=0/1960, 14-15=0/319
 WEBS 3-19=-451/251, 5-19=-364/674, 5-18=-319/618, 9-16=0/483, 11-16=-565/242, 2-19=0/1449, 12-15=0/1711, 5-21=-1254/58, 21-22=-1244/58, 8-22=-1247/55

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-8 to 2-9-14, Interior(1) 2-9-14 to 16-0-0, Exterior(2) 16-0-0 to 26-2-13, Interior(1) 26-2-13 to 37-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Ceiling dead load (5.0 psf) on member(s). 8-9, 5-21, 21-22, 8-22; Wall dead load (5.0psf) on member(s).5-18, 9-16
 - 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 17-18, 16-17
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 10) Attic room checked for L/360 deflection.




Job 30487-30487A	Truss A7E	Truss Type ROOF TRUSS	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	150248476
---------------------	--------------	--------------------------	----------	----------	------------------------	-----------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:58 2022 Page 1

ID:BLJh1112d3wvZK_wUdDgFCyrbmE-K74SrLk2G3FsvmExycx8AdPRR2btZ9O12NshiXzkw4d



Scale = 1:83.5


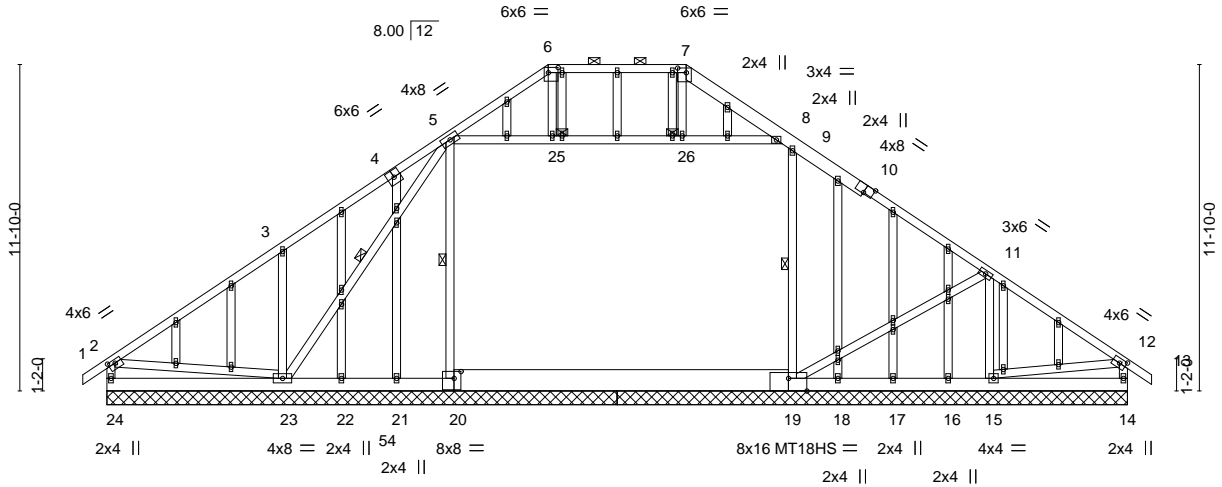


Plate Offsets (X,Y)--	[2:0-3-0,0-1-8], [6:0-4-4,0-2-4], [7:0-3-12,0-2-0], [10:0-4-0,Edge], [12:0-2-14,0-2-0], [19:0-8-0,Edge], [20:0-3-0,0-3-0]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.51	Vert(LL)	-0.11 19-20	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.67	Vert(CT)	-0.15 19-20	>957	180	MT18HS	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.20	Horz(CT)	0.00 14	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Attic	-0.11 19-20	1314	360		
								Weight: 362 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-10: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x6 SP DSS *Except* 19-20: 2x10 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 12-14: 2x4 SP No.2 or 2x4 SPF No.2	WEBS 1 Row at midpt 5-23, 5-20, 9-19
OTHERS 2x4 SP No.3	JOINTS 1 Brace at Jt(s): 25, 26

REACTIONS. All bearings 18-6-0.
 (lb) - Max Horz 24=-243(LC 6)
 Max Uplift All uplift 100 lb or less at joint(s) 15, 16 except 23=-107(LC 8), 21=-619(LC 14), 18=-867(LC 14)
 Max Grav All reactions 250 lb or less at joint(s) 22 except 24=350(LC 1), 20=1528(LC 14), 23=701(LC 1), 19=1774(LC 17), 14=363(LC 1), 15=496(LC 1), 17=264(LC 14)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 5-6=-536/37, 6-7=-385/37, 7-8=-555/46, 8-9=-425/85, 9-11=-369/87, 11-12=-278/33, 2-24=-292/12, 12-14=-318/19
 BOT CHORD 23-24=-229/351, 22-23=-56/259, 21-22=-56/259, 20-21=-56/259, 19-20=-55/254
 WEBS 3-23=-395/203, 5-20=-439/98, 9-19=-636/111, 11-15=-415/65

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 8) Ceiling dead load (5.0 psf) on member(s). 8-9, 5-25, 25-26, 8-26; Wall dead load (5.0psf) on member(s).5-20, 9-19
 - 9) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 19-20
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 16 except (jt=lb) 23=107, 21=619, 18=867.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 12) Attic room checked for L/360 deflection.

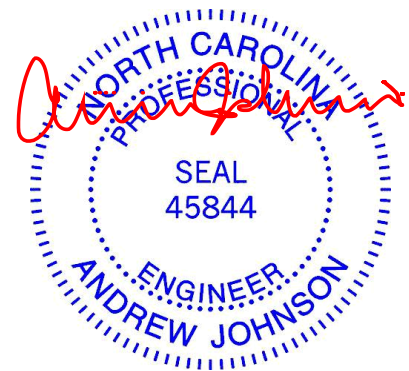


Job 30487-30487A	Truss B1	Truss Type KINGPOST	Qty 4	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248477
---------------------	-------------	------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:41:59 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-oBeq2hlg1NNjWwp8WJSNjryb0S.?le_BG1bEFzkw4c

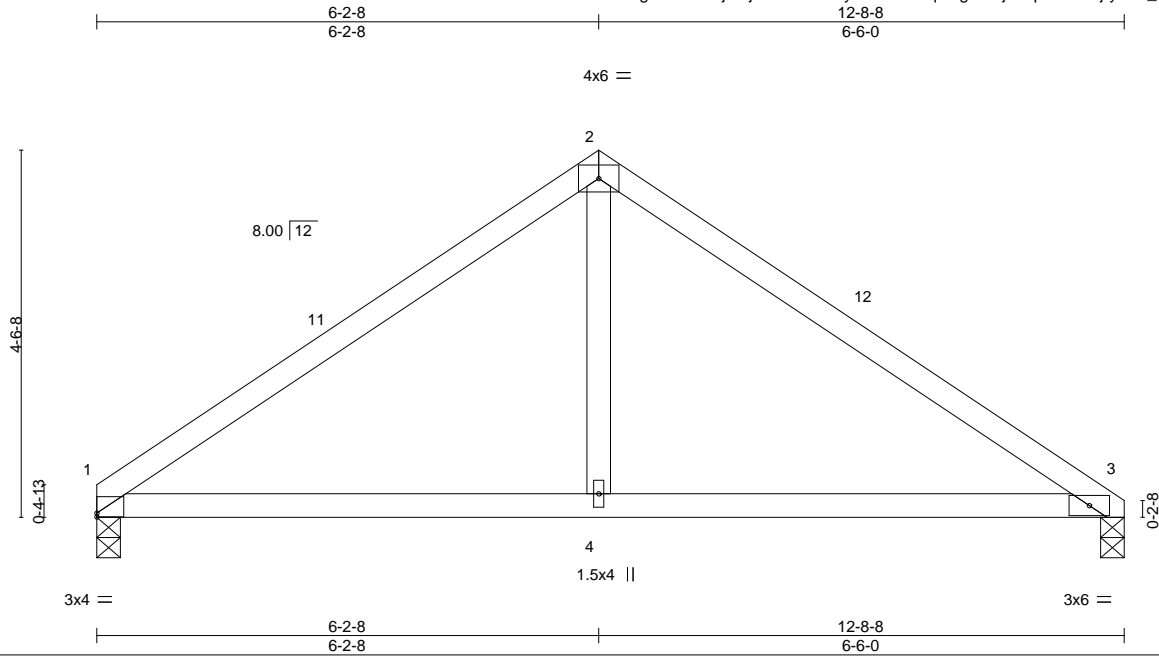

Scale = 1:28.5

Plate Offsets (X,Y)--	[1:0-0,0,0-9]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15		TC 0.52	Vert(LL) -0.06	4-10	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.49	Vert(CT) -0.11	4-10	>999	180		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.11	Horz(CT) 0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 48 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS.	(size) 1=0-3-8, 3=0-3-8
	Max Horz 1=-81(LC 8)
	Max Uplift 1=-9(LC 12), 3=-10(LC 13)
	Max Grav 1=500(LC 1), 3=500(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-618/60, 2-3=-616/61
BOT CHORD	1-4=0/436, 3-4=0/436
WEBS	2-4=0/300

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 6-2-8, Exterior(2) 6-2-8 to 9-2-8, Interior(1) 9-2-8 to 12-5-15 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 3 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
 - Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



February 15, 2022


Job 30487-30487A	Truss C1E	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248478
---------------------	--------------	---------------------	----------	----------	--	-----------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:00 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-HOCCG1llohWa84OK31_cF2UsnsQd15tKVhLonQzkw4b



Scale = 1:38.4

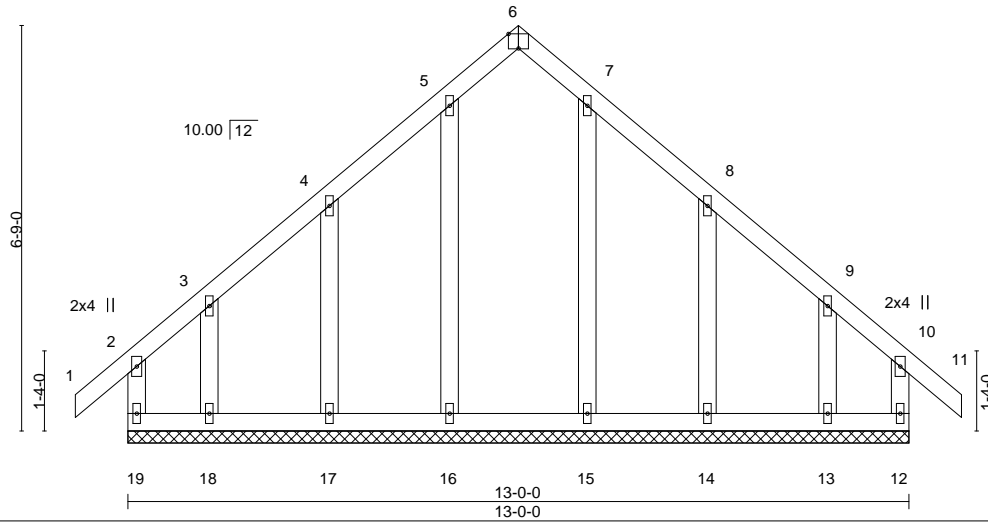


Plate Offsets (X, Y)-- [6:0-2-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	-0.00	11	n/r	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	-0.00	11	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 83 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 13-0-0.
 (lb) - Max Horz 19=151(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 19, 12, 17, 14 except 18=127(LC 12), 13=124(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 19, 12, 16, 17, 18, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-10-8 to 2-1-8, Exterior(2) 2-1-8 to 6-6-0, Corner(3) 6-6-0 to 9-7-12, Exterior(2) 9-7-12 to 13-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19, 12, 17, 14 except (jt=lb) 18=127, 13=124.

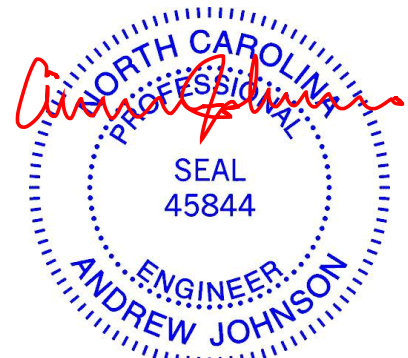

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job 30487-30487A	Truss C2	Truss Type Common Structural Gable	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	150248479
---------------------	-------------	---------------------------------------	----------	----------	------------------------	-----------

84 Components (Dunn),

Dunn, NC - 28334,


8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:01 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-lamaTNmxZ_eRmEzWdkVroG1xNGcamRHTkL4LJsZkw4a



4x4 =

Scale = 1:58.7

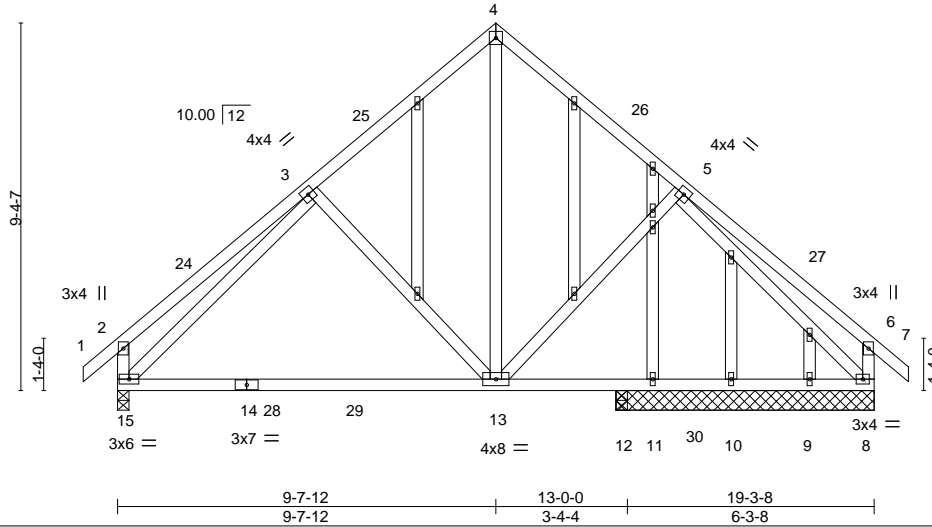

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.53	Vert(LL)	-0.20 13-15	>757	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.74	Vert(CT)	-0.41 13-15	>372	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.58	Horz(CT)	0.02 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 155 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 6-7-0 except (jt=length) 15=0-3-8, 12=0-3-8.
 (lb) - Max Horz 15=201(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 15, 8 except 12=118(LC 3)
 Max Grav All reactions 250 lb or less at joint(s) 11, 10, 9 except 15=804(LC 1), 8=748(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-293/88, 3-4=-621/113, 4-5=-621/113, 2-15=-322/106, 6-8=-268/136
 BOT CHORD 13-15=-55/563, 12-13=0/506, 11-12=0/506, 10-11=0/506, 9-10=0/506, 8-9=0/506
 WEBS 4-13=-57/450, 3-15=-549/28, 5-8=-629/0

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 9-7-12, Exterior(2) 9-7-12 to 12-7-12, Interior(1) 12-7-12 to 20-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 8 except (jt=lb) 12=118.

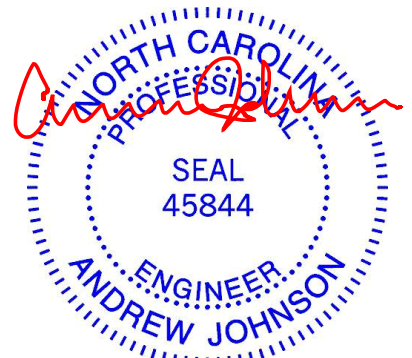

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss C3G	Truss Type FAN	Qty 1	Ply 2	34 PRINCE PLACE - ROOF Job Reference (optional)	150248480
---------------------	--------------	-------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:02 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-DmKzhjnZKlmiNOYjBR04LTa6HfuuVrfdy?qrIzkw4Z



5x9 ||

Scale = 1:57.6

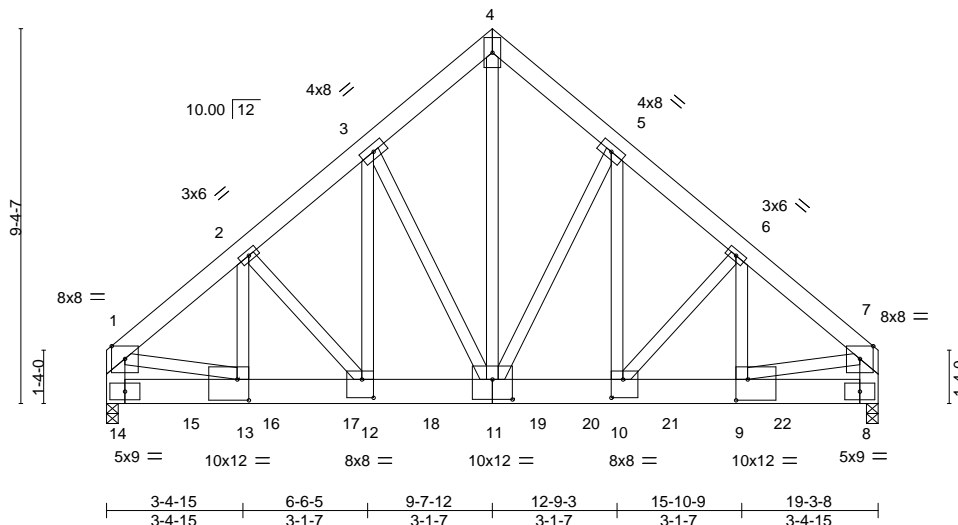


Plate Offsets (X, Y)-- [9:0-3-8,0-6-4], [10:0-3-8,0-5-8], [11:0-6-0,0-6-0], [12:0-3-8,0-5-8], [13:0-3-8,0-6-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	-0.08	12	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.15	11-12	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.76	Horz(CT)	0.04	8	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS						
								Weight: 401 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.2
BOT CHORD 2x8 SP No.2
WEBS 2x4 SP No.3 *Except*
4-11: 2x4 SP No.1, 1-13,7-9: 2x4 SP No.2 or 2x4 SPF No.2
OTHERS 2x6 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-11-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 14=0-3-8, 8=0-3-8
Max Horz 14=-178(LC 4)
Max Grav 14=8878(LC 2), 8=8530(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-9393/0, 2-3=-8543/0, 3-4=-6888/0, 4-5=-6887/0, 5-6=-8512/0, 6-7=-9145/0,
1-14=-7874/0, 7-8=-7671/0
BOT CHORD 13-14=0/1158, 12-13=0/7106, 11-12=0/6524, 10-11=0/6497, 9-10=0/6917, 8-9=0/1111
WEBS 4-11=0/8370, 5-11=-2563/0, 5-10=0/3305, 6-10=-653/0, 6-9=0/835, 3-11=-2623/0,
3-12=0/3373, 2-12=-899/0, 2-13=0/1164, 1-13=0/6193, 7-9=0/6046

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-4-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 14, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1922 lb down at 2-0-12, 1922 lb down at 4-0-12, 1922 lb down at 6-0-12, 1922 lb down at 8-0-12, 1922 lb down at 10-0-12, 1922 lb down at 12-0-12, and 2280 lb down at 14-0-12, and 2280 lb down at 16-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard



February 15, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job 30487-30487A	Truss C3G	Truss Type FAN	Qty 1	Ply 2	34 PRINCE PLACE - ROOF I50248480 Job Reference (optional)
---------------------	--------------	-------------------	----------	-----------------	---

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:02 2022 Page 2
ID:6ghGmW2wjVRjEest?1fGYTyw97h-DmKzhjnZKImINOYjBR04LTa6HfuuVrfdy?qvrlzkw4Z

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-60, 4-7=-60, 8-14=-20

Concentrated Loads (lb)

Vert: 15=-1647(B) 16=-1647(B) 17=-1647(B) 18=-1647(B) 19=-1647(B) 20=-1647(B) 21=-1952(B) 22=-1952(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Job 30487-30487A	Truss D1E	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248481
---------------------	--------------	---------------------	----------	----------	--	-----------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:04 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-99Rj6Ppprv00dhi5Js2YQuFpNtkzuzwQJJ?wBzkW4X

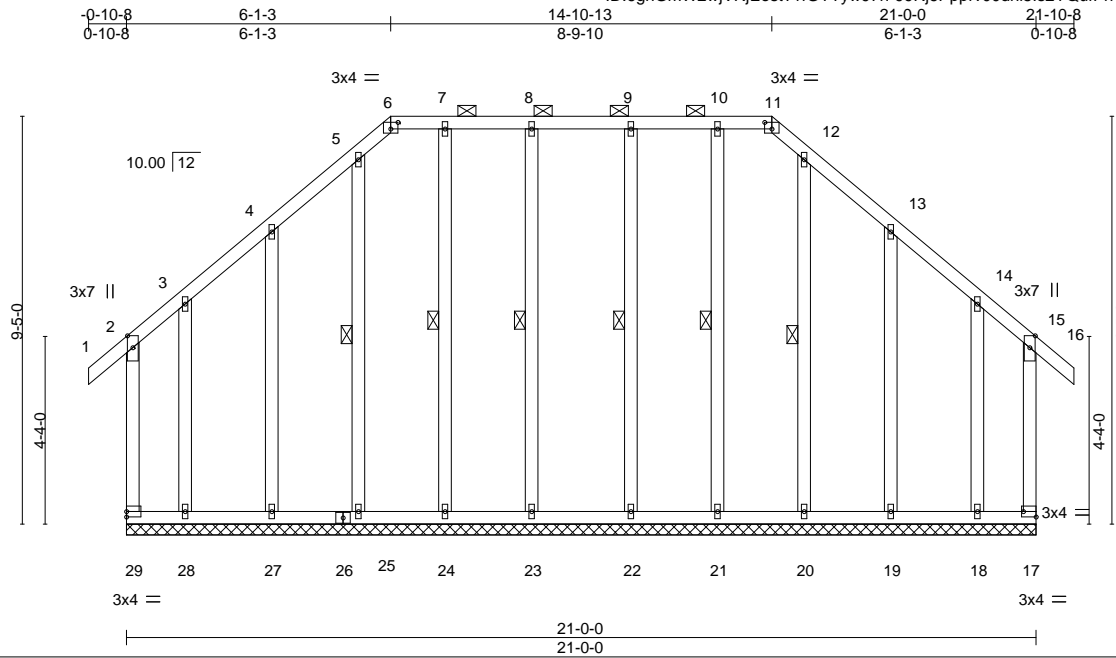

Scale = 1:53.2

Plate Offsets (X,Y)--	[6:0-2-0,0-1-13], [11:0-2-0,0-1-13], [17:Edge,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.71	Vert(LL) -0.00 16 n/r 120	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.31	Vert(CT) -0.00 16 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.13	Horz(CT) -0.00 17 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-R		Weight: 195 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (10-0-0 max.): 6-11.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 8-23, 7-24, 5-25, 9-22, 10-21, 12-20

REACTIONS. All bearings 21-0-0.
 (lb) - Max Horz 29=-230(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 23, 27, 22, 19 except 29=-353(LC 8), 17=-349(LC 9), 28=-359(LC 9), 18=-356(LC 8)
 Max Grav All reactions 250 lb or less at joint(s) 23, 24, 25, 27, 22, 21, 20, 19 except 29=408(LC 11), 17=404(LC 10), 28=470(LC 10), 18=467(LC 11)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-8 to 2-1-8, Exterior(2) 2-1-8 to 6-1-3, Corner(3) 6-1-3 to 9-4-4, Exterior(2) 9-4-4 to 14-10-13, Corner(3) 14-10-13 to 17-7-12, Exterior(2) 17-7-12 to 21-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 23, 27, 22, 19 except (jt=lb) 29=353, 17=349, 28=359, 18=356.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

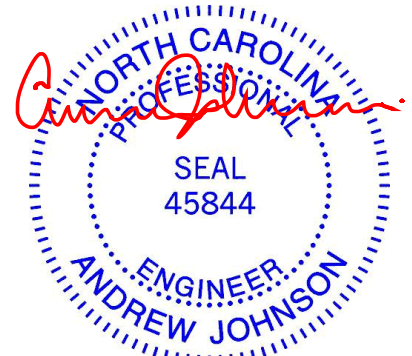

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss D2	Truss Type Common	Qty 4	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248482
---------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:05 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-dL?5JkpRcD8tErGlsaZny6CcVt?KiK23fz2ZSdzkw4W

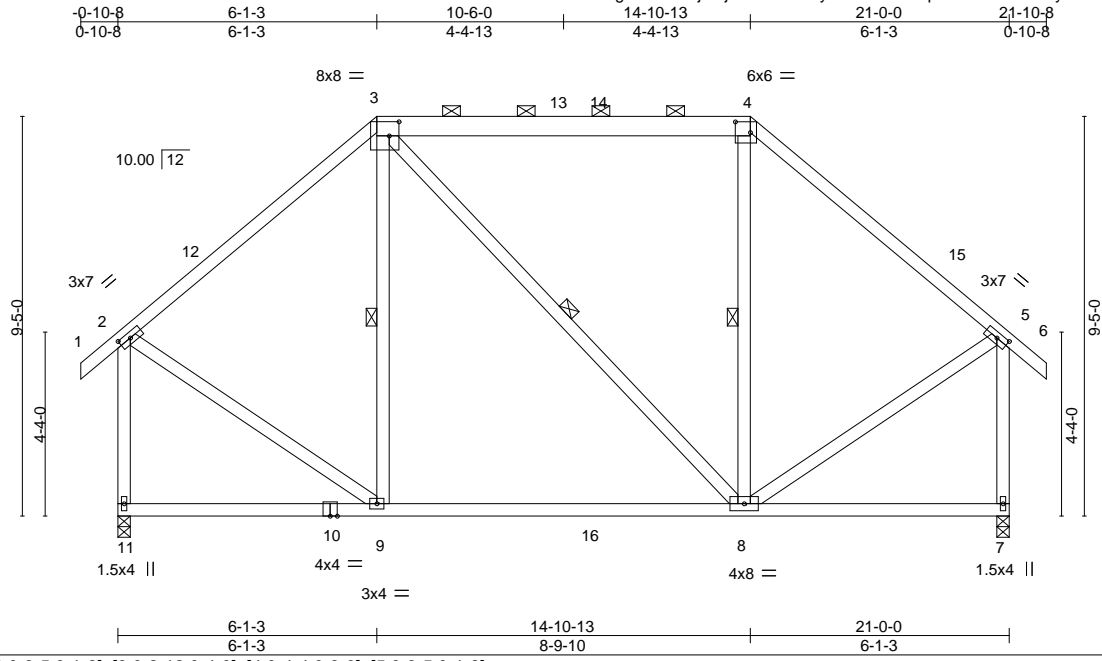


Plate Offsets (X,Y)--	[2:0-3-5,0-1-8], [3:0-2-12,0-4-0], [4:0-4-4,0-3-0], [5:0-3-5,0-1-8]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.59	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.62	Vert(LL) -0.18 8-9 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.21	Vert(CT) -0.28 8-9 >891 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.01 7 n/a n/a		
	Code IRC2015/TPI2014			Weight: 155 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 3-4: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 3-8: 2x4 SP No.2 or 2x4 SPF No.2	WEBS 1 Row at midpt 3-9, 3-8, 4-8

REACTIONS. (size) 11=0-3-8, 7=0-3-8
 Max Horz 11=229(LC 10)
 Max Grav 11=890(LC 1), 7=890(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-652/109, 3-4=-414/135, 4-5=-651/110, 2-11=-842/108, 5-7=-842/106
 BOT CHORD 8-9=-99/478
 WEBS 2-9=-29/497, 5-8=-30/472

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 6-1-3, Exterior(2) 6-1-3 to 10-4-2, Interior(1) 10-4-2 to 14-10-13, Exterior(2) 14-10-13 to 19-1-11, Interior(1) 19-1-11 to 21-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




February 15, 2022

Job 30487-30487A	Truss D3	Truss Type Common	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248483
---------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:06 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTww97h-5XZTW4q3NXGks?rUQH40VJknGHLYRnFCtdo6_4zkw4V

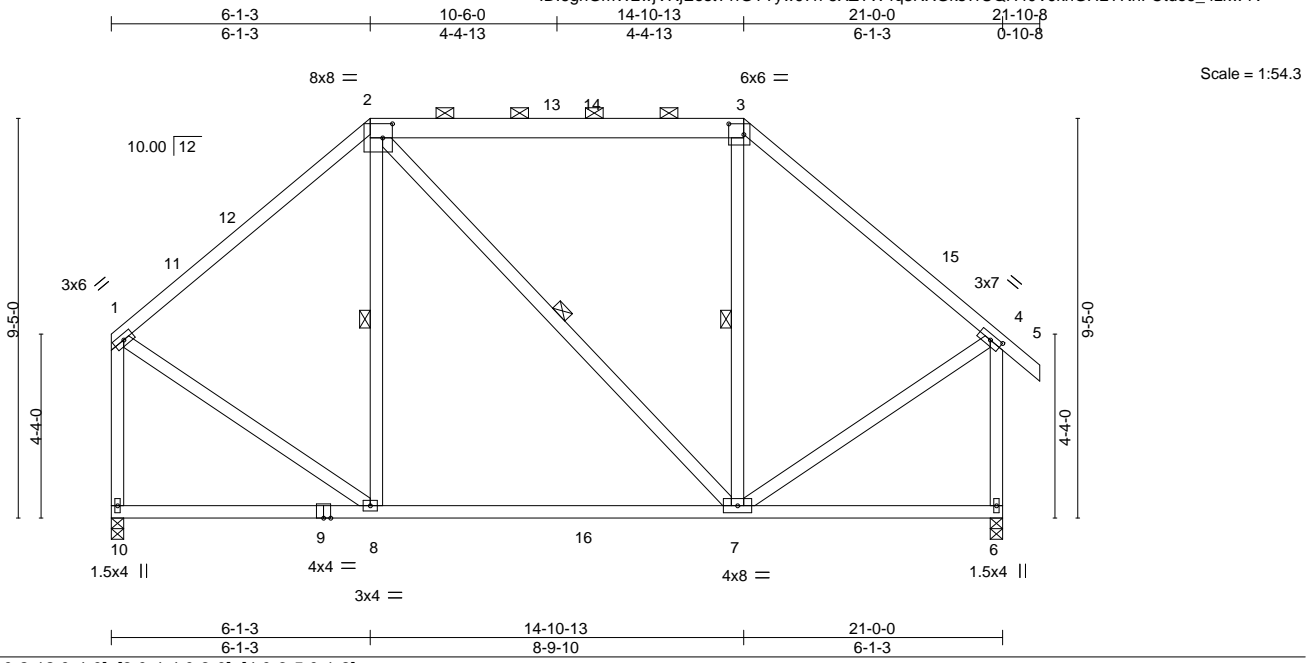

Scale = 1:54.3

Plate Offsets (X,Y)--	[2:0-2-12,0-4-0], [3:0-4-4,0-3-0], [4:0-3-5,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.58	Vert(LL) -0.18 7-8 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.62	Vert(CT) -0.28 7-8 >892 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.21	Horz(CT) 0.01 6 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 154 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
2-3: 2x6 SP No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 *Except*
2-7: 2x4 SP No.2 or 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 2-8, 2-7, 3-7

REACTIONS. (size) 10=0-3-8, 6=0-3-8
Max Horz 10=-224(LC 8)
Max Grav 10=827(LC 1), 6=891(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-651/101, 2-3=-415/132, 3-4=-652/106, 1-10=-779/84, 4-6=-843/104
BOT CHORD 7-8=-97/480
WEBS 1-8=-30/504, 4-7=-28/473

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 6-1-3, Exterior(2) 6-1-3 to 10-4-2, Interior(1) 10-4-2 to 14-10-13, Exterior(2) 14-10-13 to 19-1-11, Interior(1) 19-1-11 to 21-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job 30487-30487A	Truss D4	Truss Type Common	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248484
---------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:06 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-5XZTW4q3NXGks?rUQH40VJknMHLYRnECtdo6_4zkw4V

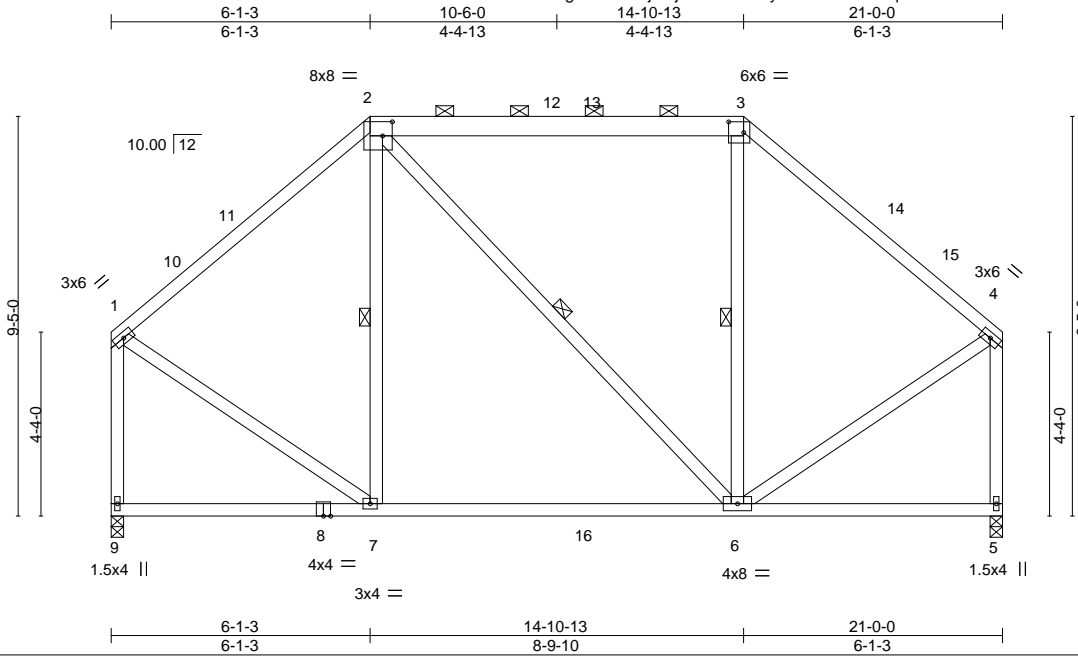


Plate Offsets (X,Y)--	[2:0-2-12,0-4-0], [3:0-4-4,0-3-0]
-----------------------	-----------------------------------

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.58	Vert(LL) -0.18 6-7 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.62	Vert(CT) -0.28 6-7 >892 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.21	Horz(CT) 0.01 5 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 152 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
2-3: 2x6 SP No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 *Except*
2-6: 2x4 SP No.2 or 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 2-7, 2-6, 3-6

REACTIONS. (size) 9=0-3-8, 5=0-3-8
Max Horz 9=-213(LC 8)
Max Grav 9=828(LC 1), 5=828(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-652/98, 2-3=-418/128, 3-4=-651/98, 1-9=-781/82, 4-5=-781/82
BOT CHORD 6-7=-102/473
WEBS 1-7=-29/505, 4-6=-29/480

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 6-1-3, Exterior(2) 6-1-3 to 10-4-2, Interior(1) 10-4-2 to 14-10-13, Exterior(2) 14-10-13 to 19-1-11, Interior(1) 19-1-11 to 20-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job 30487-30487A	Truss E1E	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248485
---------------------	--------------	---------------------	----------	----------	--	-----------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:08 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-2whExmsKv8WR5J?sX17UakpEu49Zvi_VLxHD3yzkw4T

0-10-8	11-0-0	22-0-0	22-10-8
0-10-8	11-0-0	11-0-0	0-10-8

3x4 =

Scale = 1:51.0

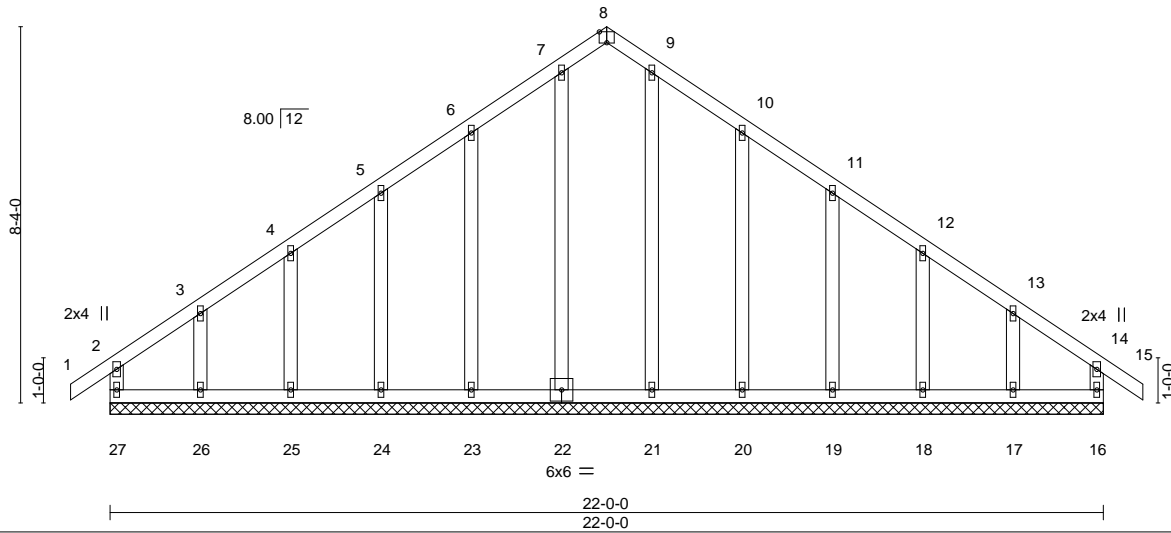


Plate Offsets (X, Y)--	[8:0-2-0,Edge]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	-0.00	15	n/r	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	-0.00	15	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.00	16	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 144 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 22-0-0.


(lb) - Max Horz 27=175(LC 11)

Max Uplift All uplift 100 lb or less at joint(s) 27, 16, 25, 24, 23, 20, 19, 18, 17 except 26=103(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 27, 16, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-8 to 2-0-0, Exterior(2) 2-0-0 to 11-0-0, Corner(3) 11-0-0 to 14-0-0, Exterior(2) 14-0-0 to 22-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 27, 16, 25, 24, 23, 20, 19, 18, 17 except (jt=lb) 26=103.

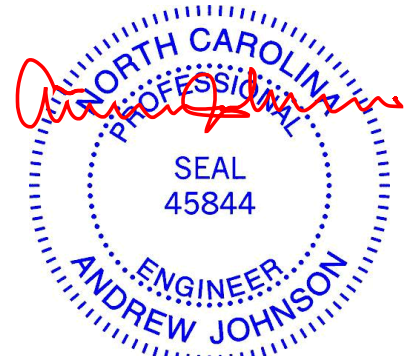

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job 30487-30487A	Truss E2	Truss Type QUEENPOST	Qty 5	Ply 1	34 PRINCE PLACE - ROOF	150248486
---------------------	-------------	-------------------------	----------	----------	------------------------	-----------

84 Components (Dunn),

Dunn, NC - 28334,


8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:09 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-W6Fc96sygSeljTa35Qej7yMI7UJde4UfZb0mbOzkw4S



4x6 =

Scale = 1:52.4

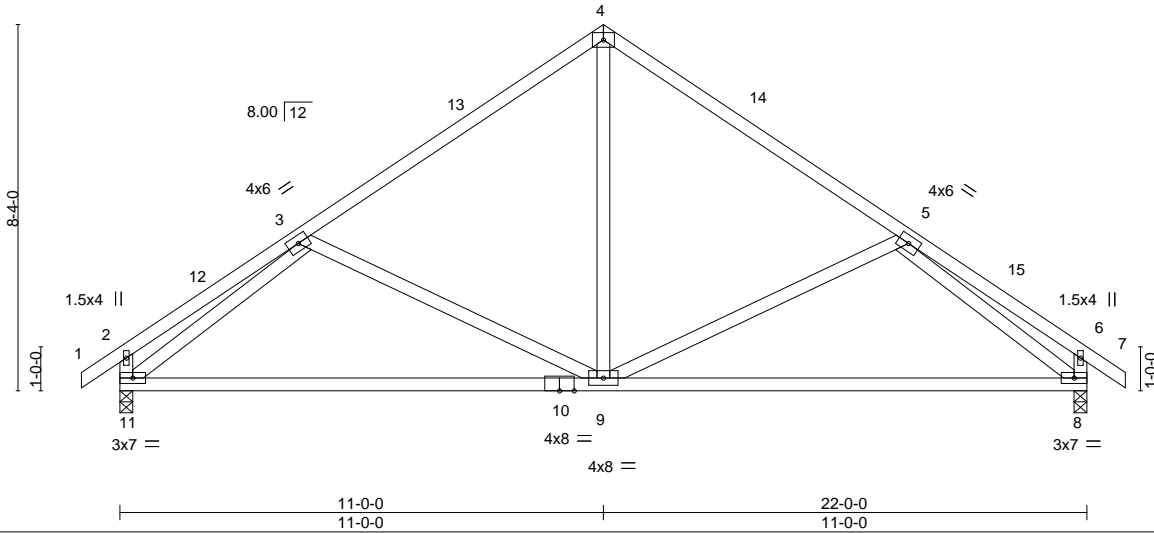

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.27 9-11	>981	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.85	Vert(CT)	-0.54 9-11	>485	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.50	Horz(CT)	0.03 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 126 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 8-10: 2x4 SP No.1
 WEBS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-7-14 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 11=0-3-8, 8=0-3-8
 Max Horz 11=175(LC 11)
 Max Uplift 11=-28(LC 12), 8=-28(LC 13)
 Max Grav 11=930(LC 1), 8=930(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-316/0, 3-4=-880/72, 4-5=-880/72, 5-6=-313/0
 BOT CHORD 9-11=-103/863, 8-9=-19/838
 WEBS 3-9=-266/186, 4-9=0/544, 5-9=-266/187, 3-11=-912/123, 5-8=-913/123

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 11-0-0, Exterior(2) 11-0-0 to 14-0-0, Interior(1) 14-0-0 to 22-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 8.

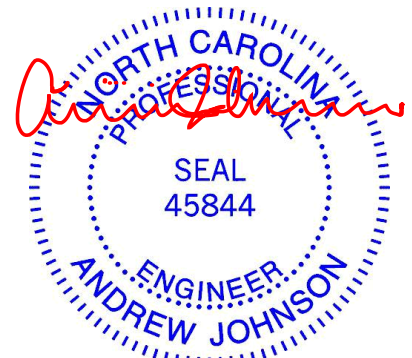

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss FT1	Truss Type FLAT GIRDER	Qty 1	Ply 2	34 PRINCE PLACE - ROOF	I50248487
---------------------	--------------	---------------------------	----------	----------	------------------------	-----------



84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:09 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-W6Fc96sygSeljTa35Qej7yMFLUS6e_vfZb0mbOzkw4S



Scale = 1:18.0

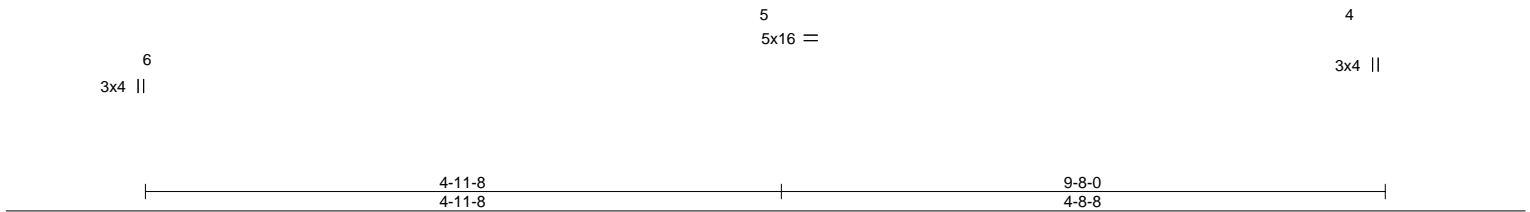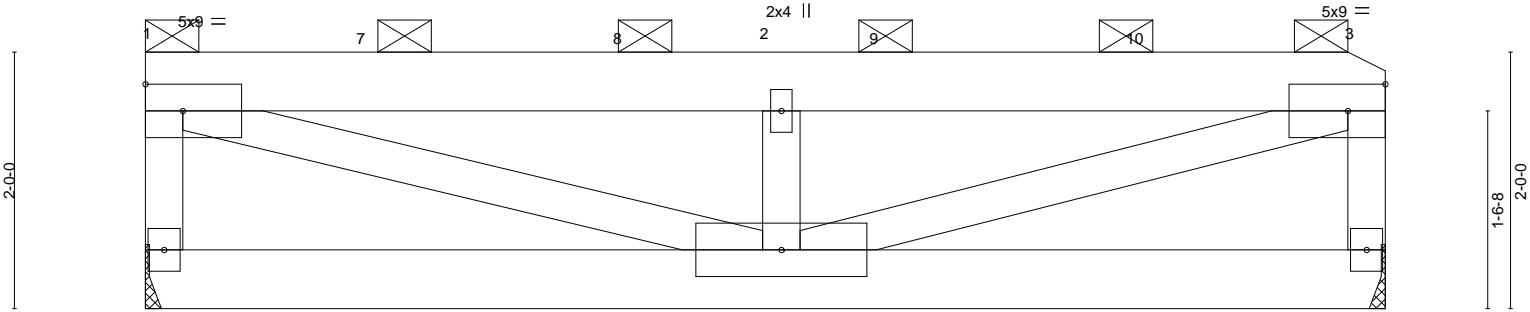

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.79	Vert(LL)	-0.05	5	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.31	Vert(CT)	-0.09	5	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.85	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 127 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD 2-0-0 oc purlins (5-11-5 max.): 1-3, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 6=Mechanical, 4=Mechanical
 Max Horz 6=44(LC 7)
 Max Uplift 6=183(LC 4), 4=182(LC 5)
 Max Grav 6=2311(LC 15), 4=2299(LC 15)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-6=-2126/194, 1-2=-4292/331, 2-3=-4292/331, 3-4=-2111/191
 BOT CHORD 5-6=-59/382, 4-5=-35/327
 WEBS 1-5=-327/4114, 2-5=-2783/290, 3-5=-332/4194

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=183, 4=182.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1026 lb down and 75 lb up at 1-9-12, 1026 lb down and 75 lb up at 3-9-12, and 1026 lb down and 75 lb up at 5-9-12, and 1026 lb down and 75 lb up at 7-9-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-60, 4-6=-20



Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss FT1	Truss Type FLAT GIRDER	Qty 1	Ply 2	34 PRINCE PLACE - ROOF I50248487 Job Reference (optional)
---------------------	--------------	---------------------------	----------	-----------------	---

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:09 2022 Page 2
ID:6ghGmW2wjVRjEest?1fGYTyw97h-W6Fc96sygSejTa35Qej7yMFLUS6e_vfZb0mbOzkw4S

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 7=-957 8=-957 9=-957 10=-957

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 30487-30487A	Truss H1	Truss Type Half Hip	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248488
---------------------	-------------	------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:10 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-_Jp_MStaRIm9Lc9Ff79yf9vbjurDNeUooFmK8rzkw4R



Scale = 1:14.5


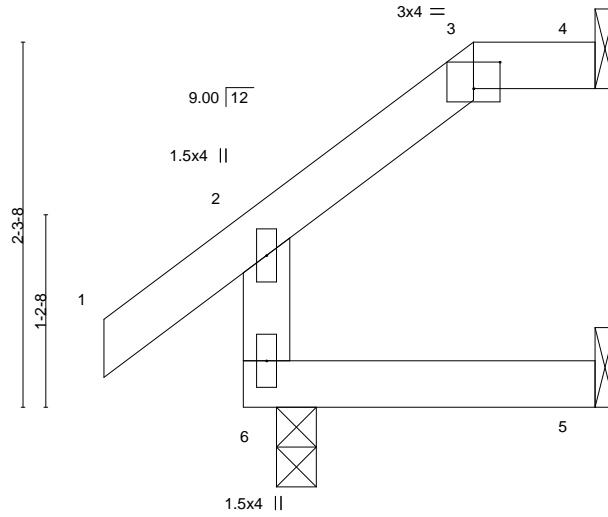


Plate Offsets (X,Y)--	[3:0-2-0,0-2-0]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.00	6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.00	5-6	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR						
								Weight: 10 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 2-2-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 4=Mechanical, 6=0-3-0, 5=Mechanical
 Max Horz 6=39(LC 9)
 Max Uplift 4=-21(LC 9)
 Max Grav 4=46(LC 1), 6=157(LC 1), 5=37(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 15, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 30487-30487A	Truss H2	Truss Type Half Hip	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248489
---------------------	-------------	------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:11 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-SVMMaouCC3u0ymkRDqgBCNRmviBm65ky1vVtGHzkw4Q



Scale = 1:11.9


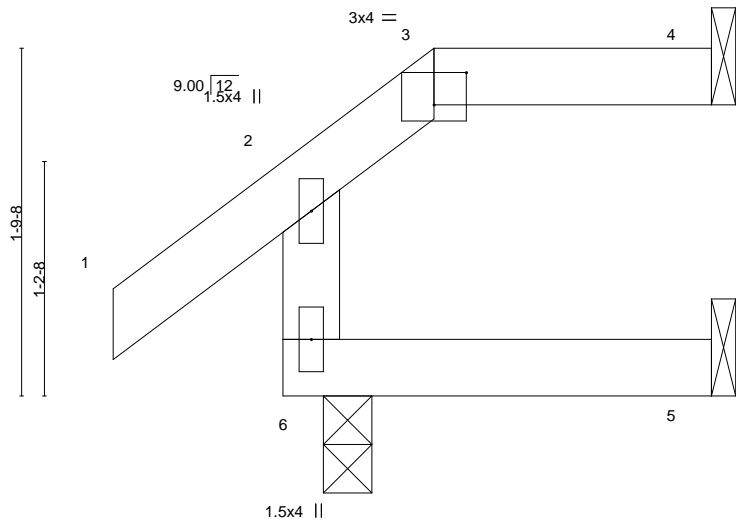


Plate Offsets (X,Y)--	[3:0-2-0,0-2-0]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	-0.00	6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	5-6	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR						
								Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 4=Mechanical, 6=0-3-0, 5=Mechanical
 Max Horz 6=35(LC 11)
 Max Uplift 4=-20(LC 9), 6=-6(LC 12)
 Max Grav 4=50(LC 24), 6=157(LC 1), 5=37(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 6.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




February 15, 2022

Job 30487-30487A	Truss H3	Truss Type Half Hip	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	I50248490
---------------------	-------------	------------------------	----------	----------	------------------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:11 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-SVMMaouCC3u0ymkRDqgBCNRmelBq65ky1vVtgHzkw4Q

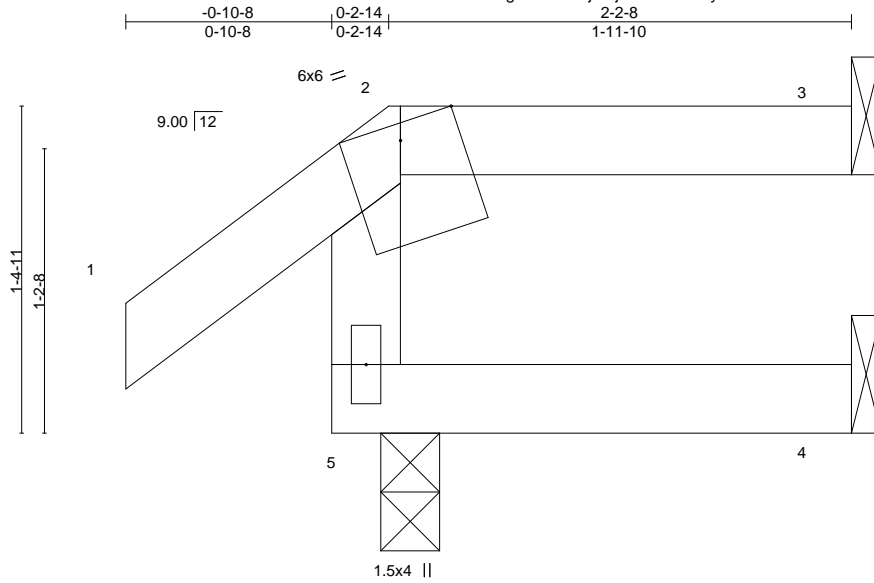

Scale = 1:9.8



LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	5	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR					Weight: 10 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-3.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 5=0-3-0, 4=Mechanical
 Max Horz 5=37(LC 9)
 Max Uplift 3=17(LC 9), 5=15(LC 9)
 Max Grav 3=43(LC 1), 5=157(LC 1), 4=38(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss M1E	Truss Type Monopitch Supported Gable	Qty 1	Ply 1	34 PRINCE PLACE - ROOF I50248491 Job Reference (optional)
---------------------	--------------	---	----------	----------	---

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:12 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-whwkn8vqzN0tawJemYBQla_wxhWarY_5GZFRcjzkw4P

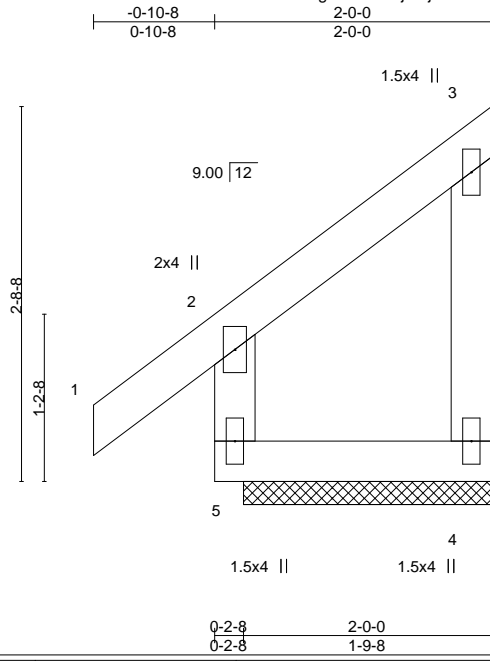

Scale = 1:16.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.12	Vert(LL) 0.00	2	n/r	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT) 0.00	2	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT) 0.00	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R				Weight: 13 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=1-9-8, 4=1-9-8
Max Horz 5=76(LC 9)
Max Uplift 5=5(LC 12), 4=42(LC 9)
Max Grav 5=148(LC 1), 4=74(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
 - 8) Non Standard bearing condition. Review required.



February 15, 2022

Job 30487-30487A	Truss M1G	Truss Type Monopitch Girder	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	I50248492
---------------------	--------------	--------------------------------	----------	----------	------------------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:13 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-OuU7_TwSkg8kC4uqKfifHoX0I5kZazrEUD_kAzkw4O



Scale = 1:17.2

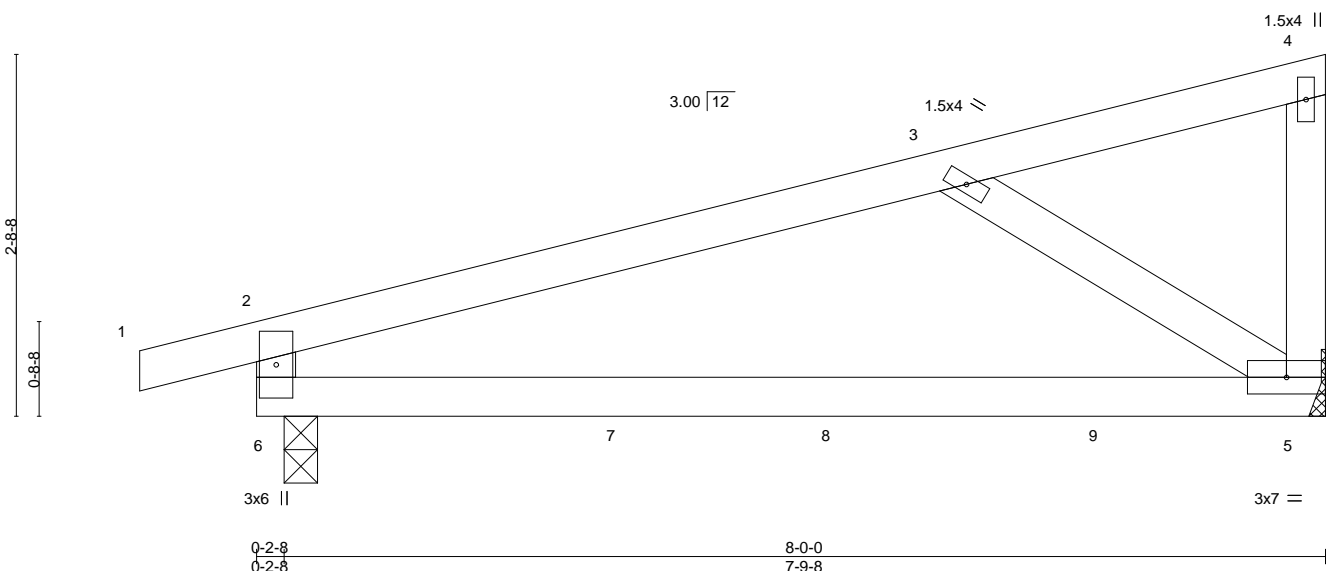

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	-0.12	5-6	>771	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.60	Vert(CT)	-0.24	5-6	>387		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.09	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 33 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 6=0-3-0, 5=Mechanical
 Max Horz 6=78(LC 7)
 Max Uplift 6=-50(LC 4), 5=-29(LC 8)
 Max Grav 6=376(LC 1), 5=307(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-370/66, 2-6=-295/96
 BOT CHORD 5-6=-60/323
 WEBS 3-5=-350/108

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 5.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 9 lb down at 2-9-7, and 9 lb down at 4-4-12, and 12 lb down at 6-4-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-4=-60, 5-6=-20
 Concentrated Loads (lb)
 Vert: 7=-2(B) 8=-2(B) 9=-1(B)



Job 30487-30487A	Truss M2	Truss Type Monopitch	Qty 6	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248493
---------------------	-------------	-------------------------	----------	----------	--	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:13 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-OuU7_TwSkg8kC4uqKFifHoXwi514a_EEUD__kAzkw4O



Scale = 1:17.6

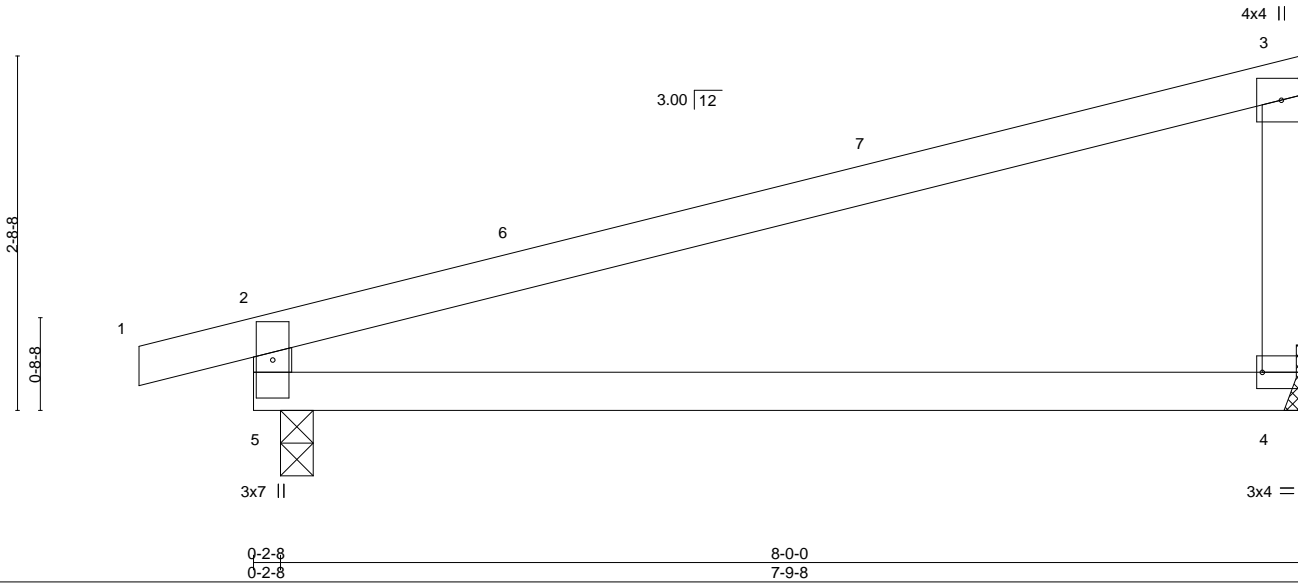

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.83	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.56	Vert(LL) -0.12 4-5 >752 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.26 4-5 >353 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.00 4 n/a n/a		
	Code IRC2015/TPI2014			Weight: 29 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 4=Mechanical, 5=0-3-0
 Max Horz 5=78(LC 9)
 Max Uplift 4=-29(LC 12), 5=-50(LC 8)
 Max Grav 4=304(LC 1), 5=374(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-317/130

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 7-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5.



February 15, 2022

Job 30487-30487A	Truss M3	Truss Type Monopitch	Qty 3	Ply 1	34 PRINCE PLACE - ROOF	I50248494
---------------------	-------------	-------------------------	----------	----------	------------------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:14 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-s42VCpw4V_GbpES0uzEuq?360V0KJPmOjtkXHzkw4N



Scale = 1:19.8

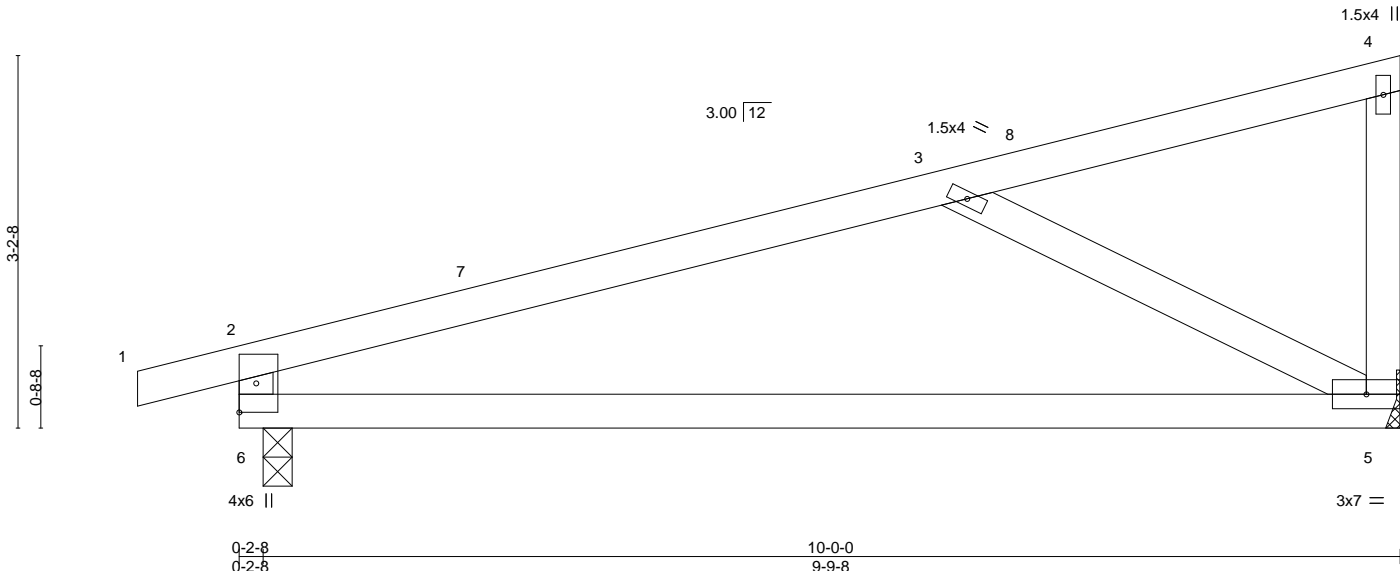

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.73	Vert(LL)	-0.30	5-6	>388	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.88	Vert(CT)	-0.60	5-6	>195		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.17	Horz(CT)	0.01	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 42 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 6=0-3-0, 5=Mechanical
 Max Horz 6=94(LC 9)
 Max Uplift 6=-55(LC 8), 5=-36(LC 12)
 Max Grav 6=453(LC 1), 5=385(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-521/94, 2-6=-354/133
 BOT CHORD 5-6=-130/464
 WEBS 3-5=-480/144

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 9-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 5.




Job 30487-30487A	Truss M6	Truss Type Monopitch	Qty 3	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248495
---------------------	-------------	-------------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:15 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-KGctP9xjGIOSRO1DSgl7MDchPvTW2mwXyXT5p2zkw4M

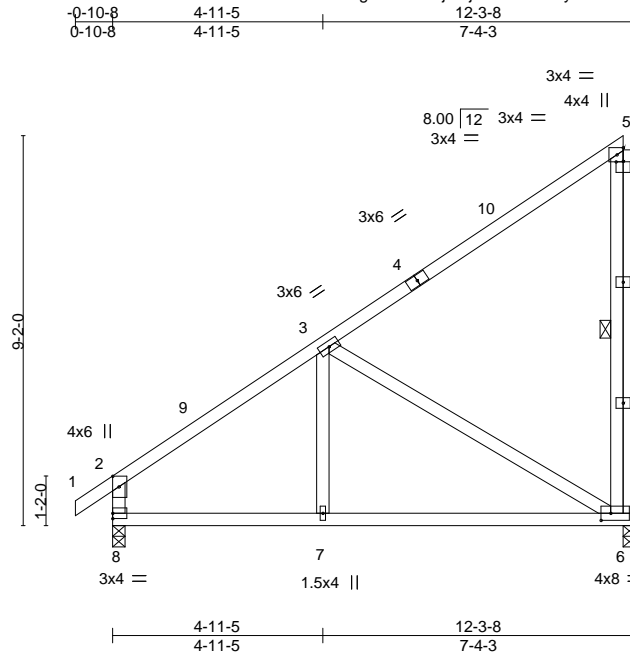

Scale = 1:54.2

Plate Offsets (X, Y)-- [2:0-3-0,Edge], [5:0-2-0,0-0-2], [6:0-2-12,0-2-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.75	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.44	Vert(LL) -0.08 6-7 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.56	Vert(CT) -0.18 6-7 >812 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.01 6 n/a n/a		
	Code IRC2015/TPI2014			Weight: 85 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-6

REACTIONS. (size) 8=0-3-8, 6=0-3-8
Max Horz 8=272(LC 9)
Max Uplift 6=88(LC 12)
Max Grav 8=538(LC 1), 6=517(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-534/56, 2-8=-463/83
BOT CHORD 7-8=-198/499, 6-7=-198/499
WEBS 3-6=-460/147

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 12-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6.



February 15, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job 30487-30487A	Truss M7	Truss Type MONOPIITCH	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	150248496
---------------------	-------------	--------------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:15 2022 Page 1
ID:6ghGmW2wjVRjEest?1fGYTyw97h-KGctP9xjGIOSRO1DSgl7MDclTvSp2muXyXT5p2zkw4M

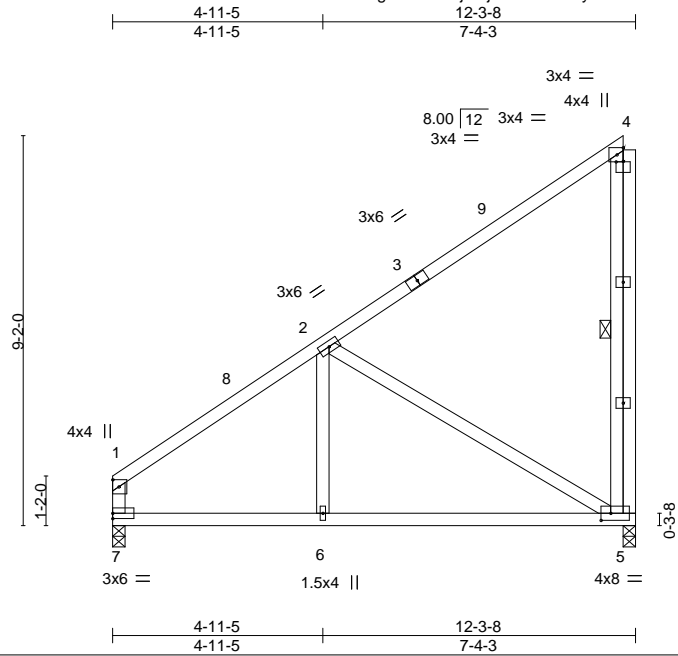

Scale = 1:54.2

Plate Offsets (X,Y)--	[4:0-2-0,0-0-2], [5:0-2-12,0-2-0]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.68	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.48	Vert(LL) -0.08 5-6 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.57	Vert(CT) -0.19 5-6 >757 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.01 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 84 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 4-5
OTHERS 2x4 SP No.3	

REACTIONS. (size) 7=0-3-8, 5=0-3-8
 Max Horz 7=263(LC 9)
 Max Uplift 5=-88(LC 12)
 Max Grav 7=474(LC 1), 5=519(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-529/57, 1-7=-389/51
 BOT CHORD 6-7=-198/500, 5-6=-198/500
 WEBS 2-5=-462/146

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 12-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5.



February 15, 2022


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 30487-30487A	Truss M8	Truss Type Monopitch	Qty 4	Ply 1	34 PRINCE PLACE - ROOF	150248497
---------------------	-------------	-------------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:16 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTYw97h-pTAFdVyl1bXJ3XcP?OGMvQ9RkJrknE?hABDeLUzkw4L

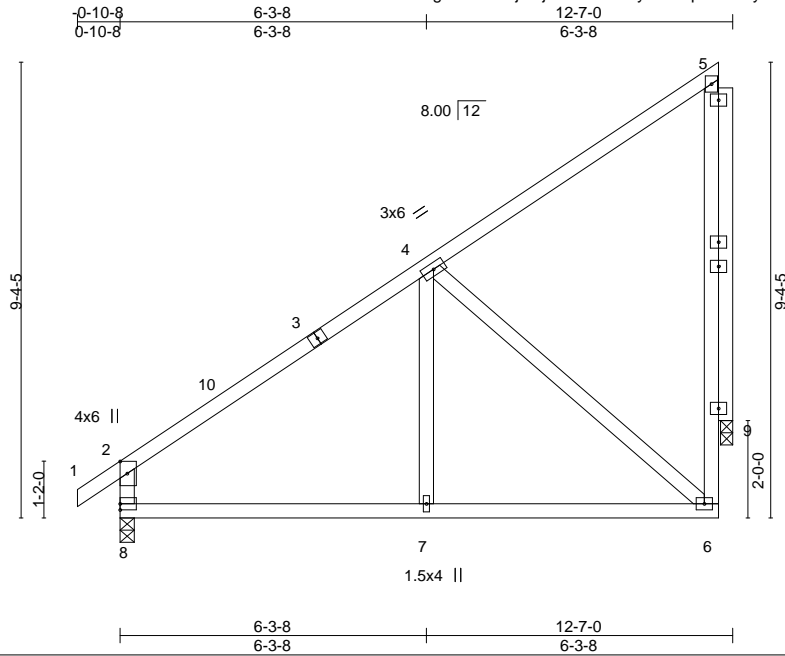

Scale = 1:47.3

Plate Offsets (X,Y)--	[2:0-3-0,Edge]
-----------------------	----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.78	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.31	Vert(LL) -0.03 6-7 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.51	Vert(CT) -0.08 6-7 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.08 9 n/a n/a		
	Code IRC2015/TPI2014			Weight: 84 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 8=0-3-8, 9=0-3-0
 Max Horz 8=272(LC 9)
 Max Uplift 8=-1(LC 12), 9=-88(LC 12)
 Max Grav 8=544(LC 1), 9=512(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-504/63, 6-9=-55/351, 2-8=-473/99
 BOT CHORD 7-8=-170/440, 6-7=-170/440
 WEBS 4-7=0/258, 4-6=-454/143

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 12-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 9.



February 15, 2022

Job 30487-30487A	Truss PB1	Truss Type GABLE	Qty 12	Ply 1	34 PRINCE PLACE - ROOF	150248498
---------------------	--------------	---------------------	-----------	----------	------------------------	-----------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:17 2022 Page 1

ID:BLJh1112d3wvZK_wUdDgFCyrbmE-HfkdqzzovfAhhBbZ5nbSehoriCVWoDqPryBtxzkw4K

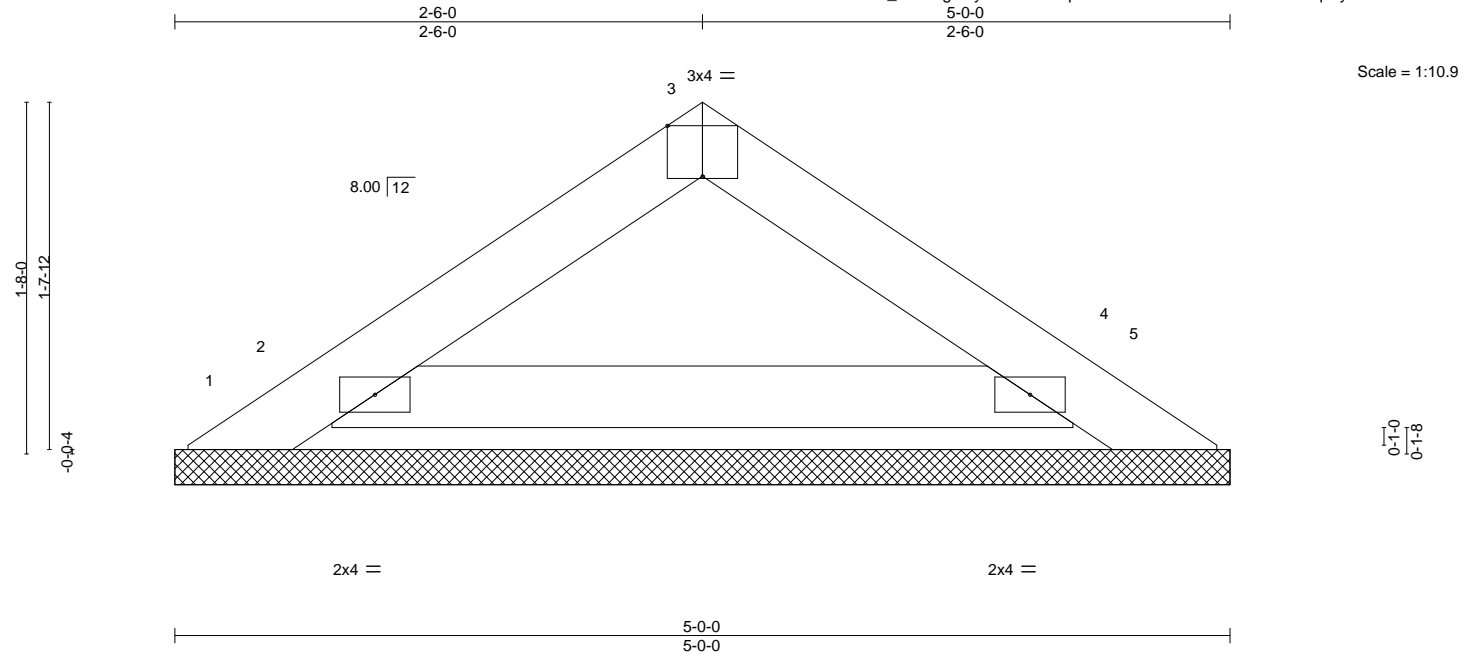


Plate Offsets (X,Y)--	[3:0-2:0,Edge]					PLATES	GRIP
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	MT20	197/144
TCLL 20.0	Plate Grip DOL 1.15	TC 0.05	Vert(LL) n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	BC 0.15	Vert(CT) n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P				Weight: 14 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 5-0-0.
 (lb) - Max Horz 1=-28(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

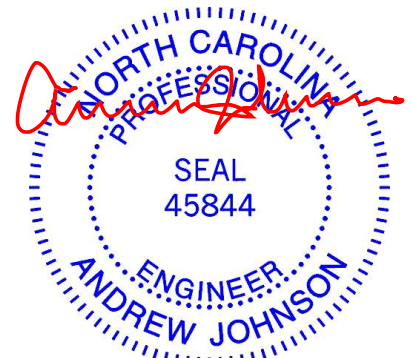

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss PB1GE	Truss Type GABLE	Qty 2	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248499
---------------------	----------------	---------------------	----------	----------	--	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:18 2022 Page 1
ID:BLJh1112d3wvZK_wUdDgFCyrbmE-lrH02BzbYDn1Irmn7oIq_rEze6aZFFG_eUilQnzkW4J



4x4 =

Scale = 1:12.8

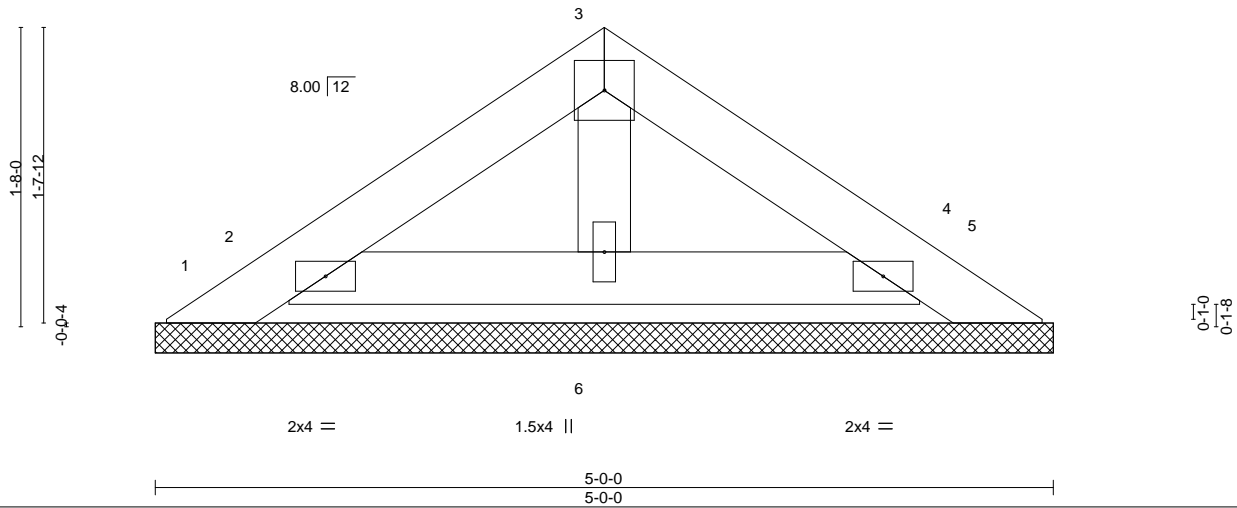

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 15 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 5-0-0.
 (lb) - Max Horz 1=-28(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4, 6

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

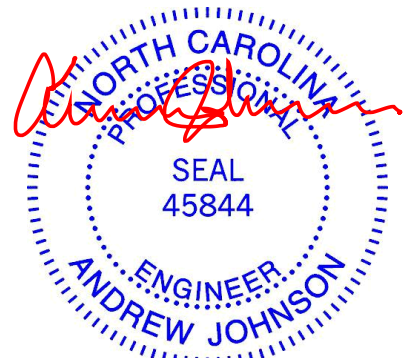

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss PB2	Truss Type GABLE	Qty 1	Ply 2	34 PRINCE PLACE - ROOF 150248500
---------------------	--------------	---------------------	----------	----------	-------------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:19 2022 Page 1

ID:BLJh1112d3wvZK_wUdDgFCyrbmE-D2rOFX_DJWvuw?L_hWp3X3n8kWv7_ij7t8Rlypzkw4l



3x4 =

Scale = 1:12.8

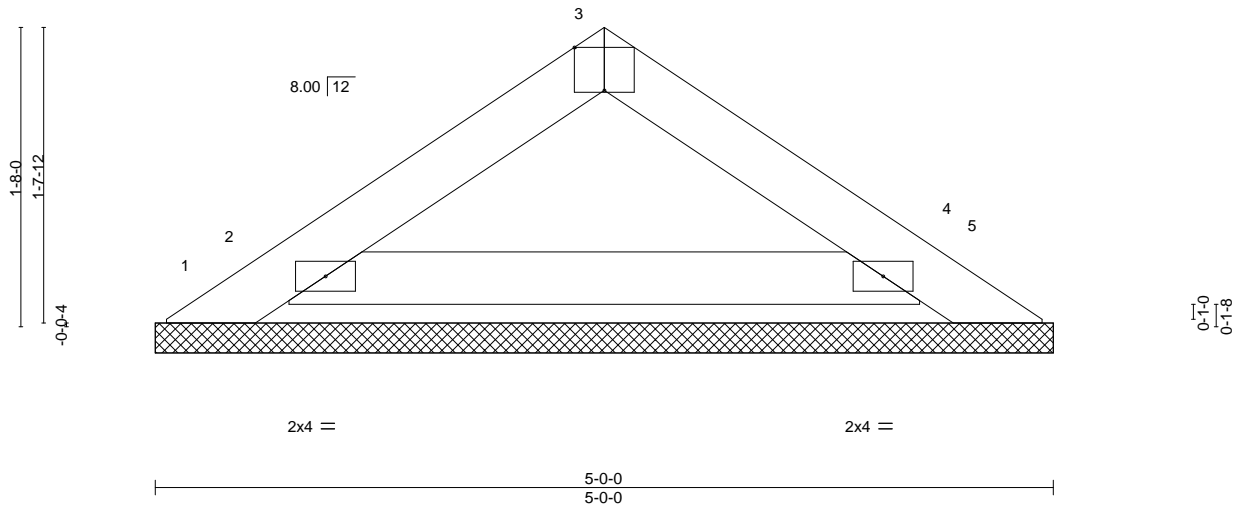


Plate Offsets (X, Y)--	[3:0-2-0,Edge]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.02	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 28 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 5-0-0.
 (lb) - Max Horz 1=28(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 2-ply truss to be connected together as follows:
 Top chords connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss PB3	Truss Type GABLE	Qty 1	Ply 2	34 PRINCE PLACE - ROOF 150248501
---------------------	--------------	---------------------	----------	----------	-------------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:20 2022 Page 1

ID:BLJh1112d3wvZK_wUdDgFCyrbmE-hEPmSt?r4q1kY9wAEDLI3GJJUwFMj9zG5oBsUGzkw4H



3x4 =

Scale = 1:12.8

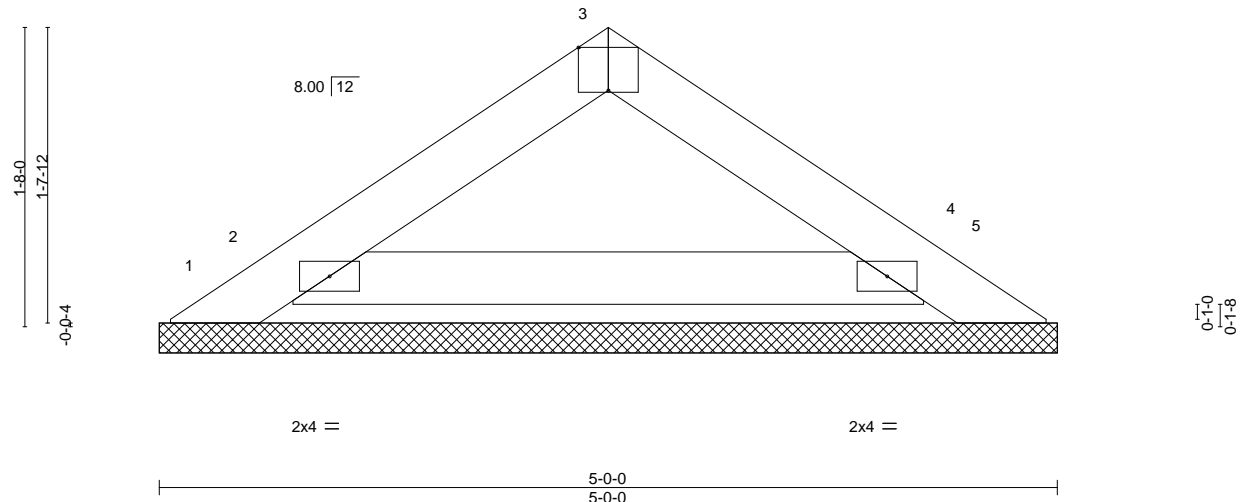



Plate Offsets (X,Y)--	[3:0-2-0,Edge]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES
TCLL 20.0	Plate Grip DOL	1.15	TC 0.02	Vert(LL)	n/a	-	n/a	999
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a	n/a
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					
								Weight: 28 lb FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 5-0-0.
 (lb) - Max Horz 1=28(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 2-ply truss to be connected together as follows:
 Top chords connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

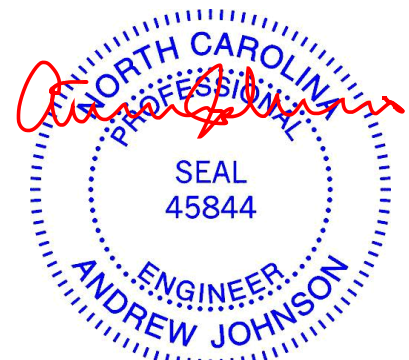

February 15, 2022


Job 30487-30487A	Truss PB4	Truss Type Piggyback	Qty 6	Ply 1	34 PRINCE PLACE - ROOF 150248502
---------------------	--------------	-------------------------	----------	----------	-------------------------------------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:20 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-hEPmSt?r4q1kY9wAEDLI3GJFewEGj9KG5oBsUGzkw4H



Scale = 1:23.6

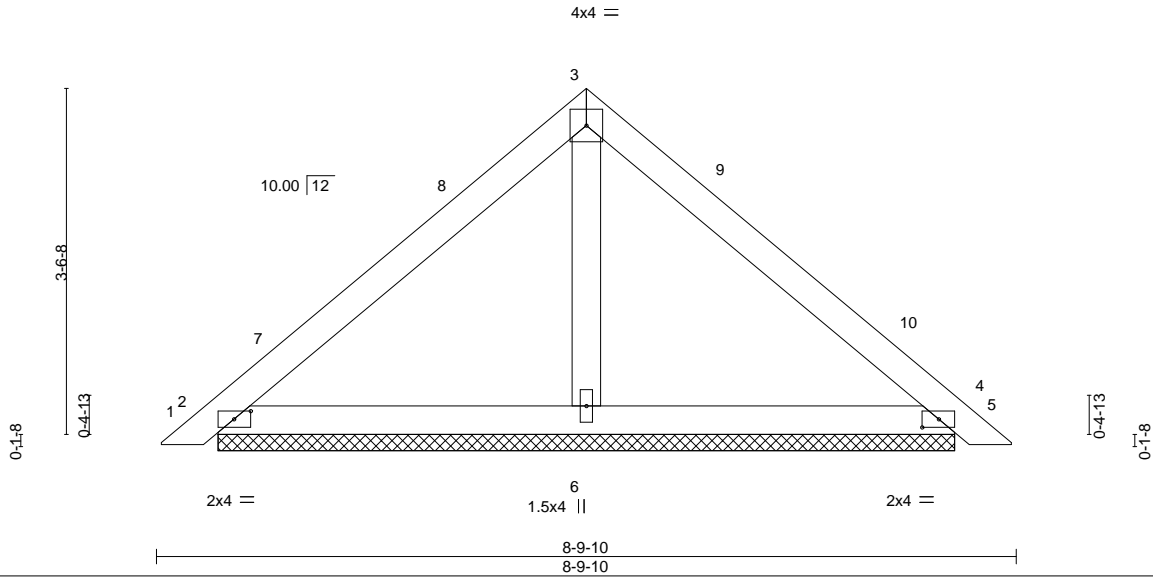


Plate Offsets (X, Y)--	[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]
------------------------	----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.27	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.14	Vert(LL) 0.01 5 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Vert(CT) 0.01 5 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 4 n/a n/a		
	Code IRC2015/TPI2014			Weight: 32 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. (size) 2=7-6-7, 4=7-6-7, 6=7-6-7
 Max Horz 2=67(LC 10)
 Max Uplift 2=24(LC 12), 4=32(LC 13)
 Max Grav 2=196(LC 1), 4=196(LC 1), 6=254(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-3-3 to 3-3-3, Interior(1) 3-3-3 to 4-4-13, Exterior(2) 4-4-13 to 7-4-13, Interior(1) 7-4-13 to 8-6-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.




February 15, 2022

Job 30487-30487A	Truss PB4E	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248503
---------------------	---------------	---------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:21 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-9Qz8gD0Tr89b9JVMoxsXcUsUmKcHscoQKSwP0izkw4G

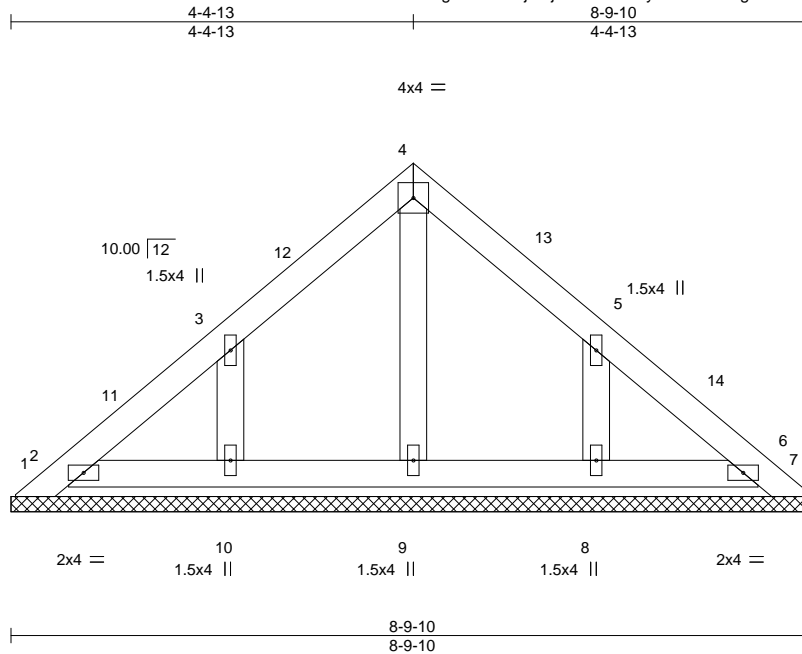

Scale = 1:25.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P						Weight: 36 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 8-9-10.
 (lb) - Max Horz 1=67(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 2, 6, 10, 8
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 2, 6, 9, 10, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-3-3 to 3-3-3, Interior(1) 3-3-3 to 4-4-13, Exterior(2) 4-4-13 to 7-4-13, Interior(1) 7-4-13 to 8-6-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 2, 6, 10, 8.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

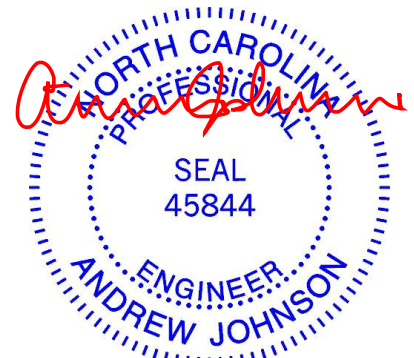

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss V1	Truss Type Valley	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	I50248504
---------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:22 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-dcXWtY06cRHSnS4ZMeNm8hPajjwB2cZZ6gyZ8zkw4F

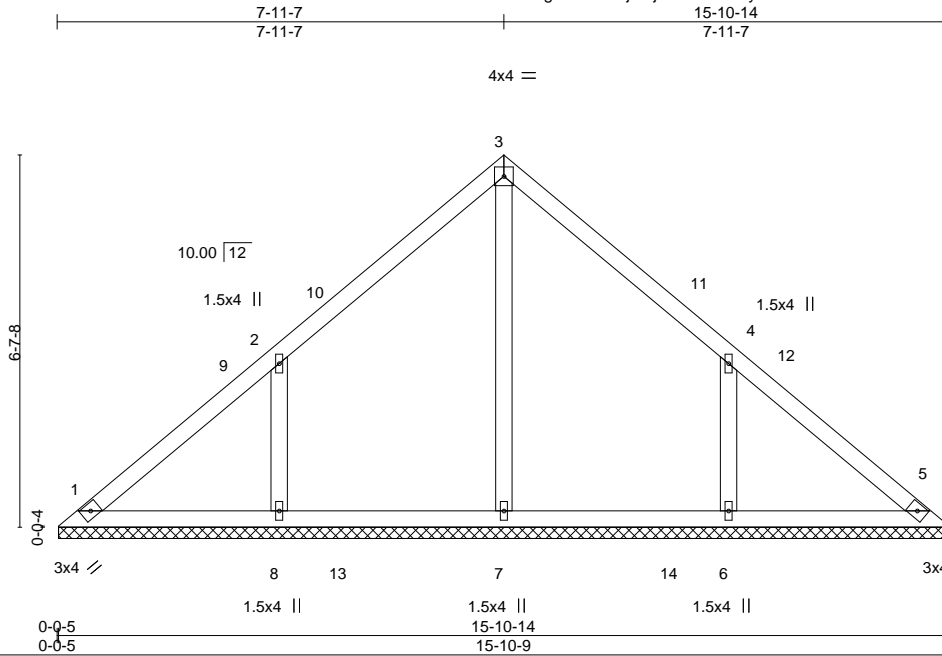

Scale = 1:41.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.36	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 70 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 15-10-4.
 (lb) - Max Horz 1=-122(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-127(LC 12), 6=-127(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=351(LC 22), 8=401(LC 19), 6=401(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-282/172, 4-6=-281/171

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-4-13 to 3-4-13, Interior(1) 3-4-13 to 7-11-7, Exterior(2) 7-11-7 to 10-11-7, Interior(1) 10-11-7 to 15-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=127, 6=127.

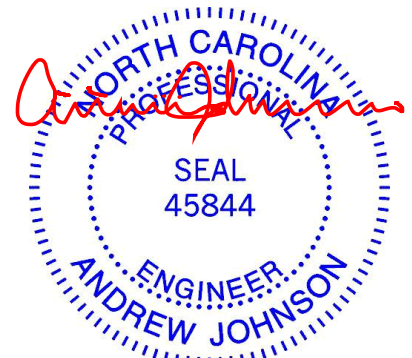

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss V2	Truss Type Valley	Qty 1	Ply 1	34 PRINCE PLACE - ROOF	150248505
---------------------	-------------	----------------------	----------	----------	------------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:23 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-5p5v5u1kNIPJPcflwMu?hvxcy7CewUdjnmPW5azkw4E

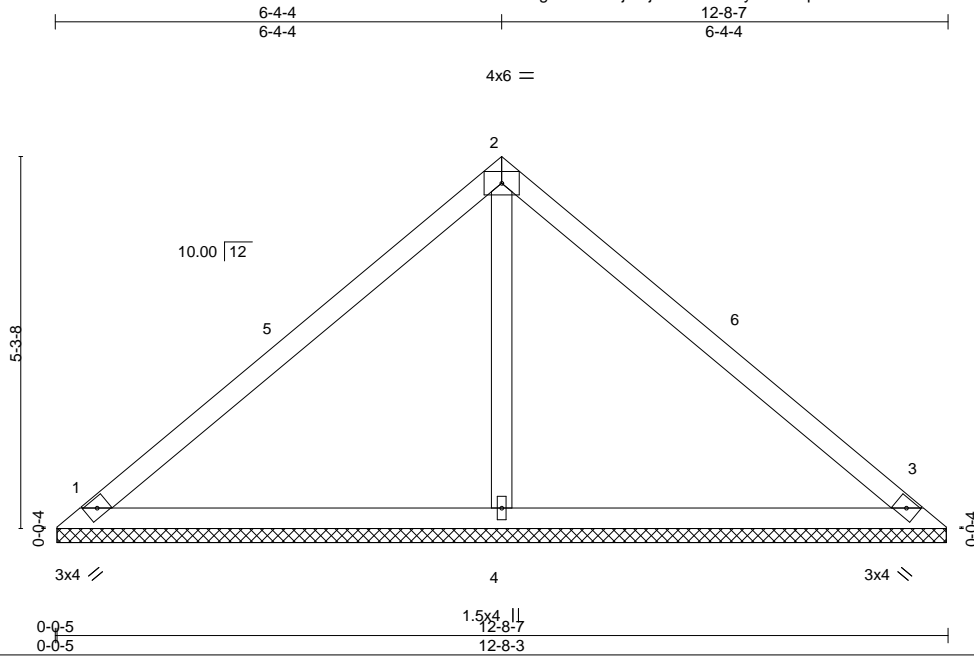

Scale = 1:32.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.91	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.13	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 49 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 1=12-7-14, 3=12-7-14, 4=12-7-14
 Max Horz 1=-96(LC 8)
 Max Uplift 1=-16(LC 12), 3=-28(LC 13)
 Max Grav 1=250(LC 1), 3=250(LC 1), 4=452(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-4=-274/47

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-4-13 to 3-4-13, Interior(1) 3-4-13 to 6-4-4, Exterior(2) 6-4-4 to 9-4-4, Interior(1) 9-4-4 to 12-3-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

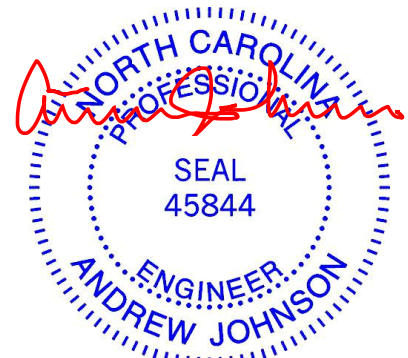

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss V3	Truss Type Valley	Qty 1	Ply 1	34 PRINCE PLACE - ROOF 150248506
---------------------	-------------	----------------------	----------	----------	-------------------------------------

84 Components (Dunn),


Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:24 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-a?fHIE2M83XA0mDxT3PEE6UunXPfz0s0Q93d1zkw4D



Scale = 1:26.0

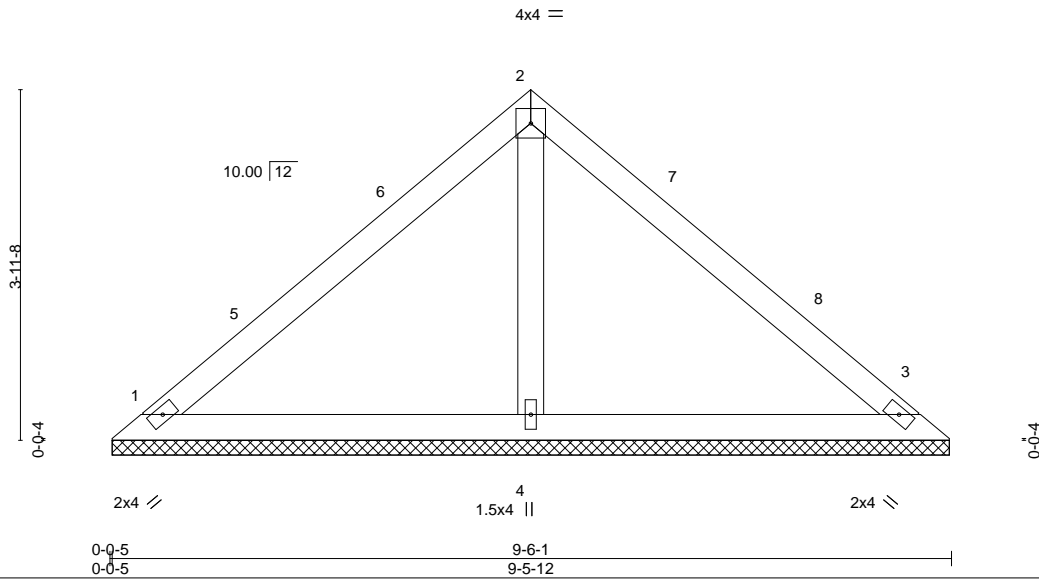

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.45	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.06	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						
	Code IRC2015/TPI2014						Weight: 36 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3
 OTHERS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=9-5-7, 3=9-5-7, 4=9-5-7
 Max Horz 1=-70(LC 8)
 Max Uplift 1=-12(LC 13), 3=-21(LC 13)
 Max Grav 1=182(LC 1), 3=182(LC 1), 4=332(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-4-13 to 3-4-13, Interior(1) 3-4-13 to 4-9-0, Exterior(2) 4-9-0 to 7-9-0, Interior(1) 7-9-0 to 9-1-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

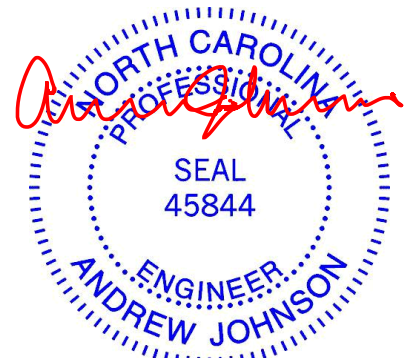

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job 30487-30487A	Truss V4	Truss Type GABLE	Qty 1	Ply 1	34 PRINCE PLACE - ROOF 150248507
---------------------	-------------	---------------------	----------	----------	-------------------------------------

84 Components (Dunn),

Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:24 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-a?fHIE2M83XA0mDxT3PEE6UyAXbQfzYs0Q93d1zkw4D

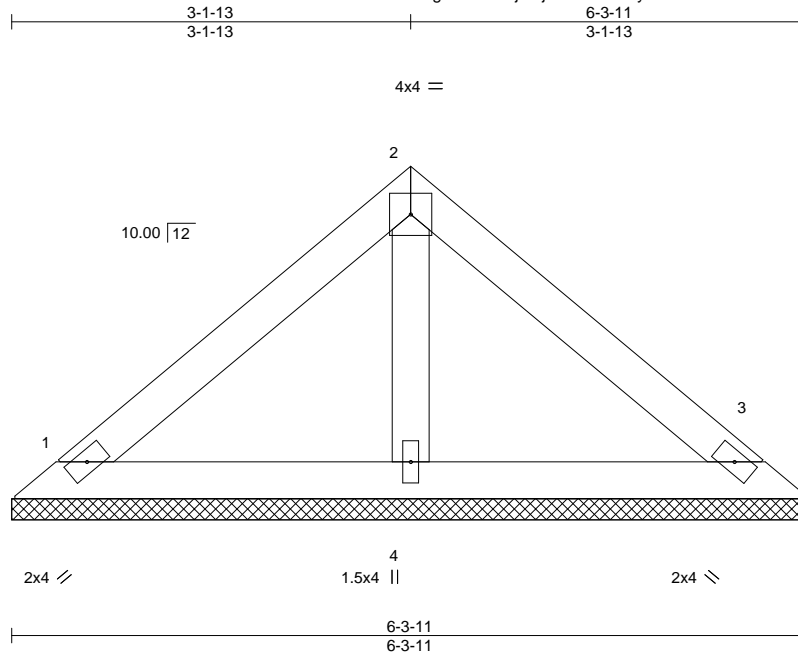

Scale = 1:18.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.24	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.13	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 23 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=6-3-11, 3=6-3-11, 4=6-3-11
 Max Horz 1=44(LC 9)
 Max Uplift 1=-13(LC 13), 3=-19(LC 13)
 Max Grav 1=125(LC 1), 3=125(LC 1), 4=190(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss V5	Truss Type Valley	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248508
---------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:25 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-2BDfWa3_vMf1ewo81nwTmK1A2xy5OQC?F4ud9Tzkw4C

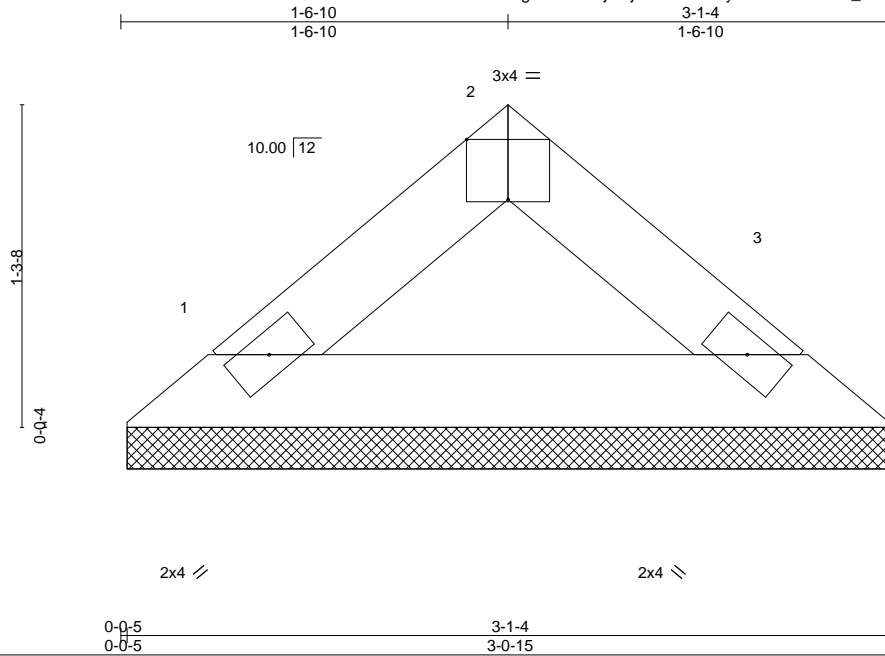

Scale = 1:9.2

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.04	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.10	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2015/TPI2014			Weight: 9 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-1-4 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=3-0-11, 3=3-0-11
 Max Horz 1=-19(LC 8)
 Max Uplift 1=-1(LC 12), 3=-1(LC 13)
 Max Grav 1=92(LC 1), 3=92(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

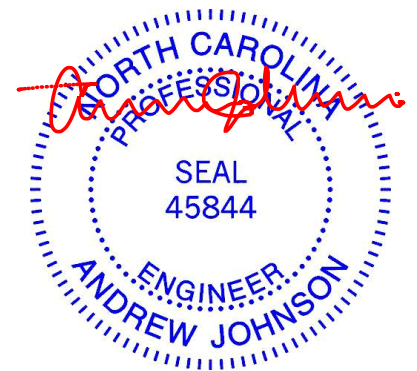

February 15, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 30487-30487A	Truss V6	Truss Type Valley	Qty 1	Ply 1	34 PRINCE PLACE - ROOF Job Reference (optional)	150248509
---------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Feb 15 10:42:26 2022 Page 1

ID:6ghGmW2wjVRjEest?1fGYTyw97h-WOm1jw4cggnuG4NKbURiJXZLcKHp7tS9UkeAivzkw4B

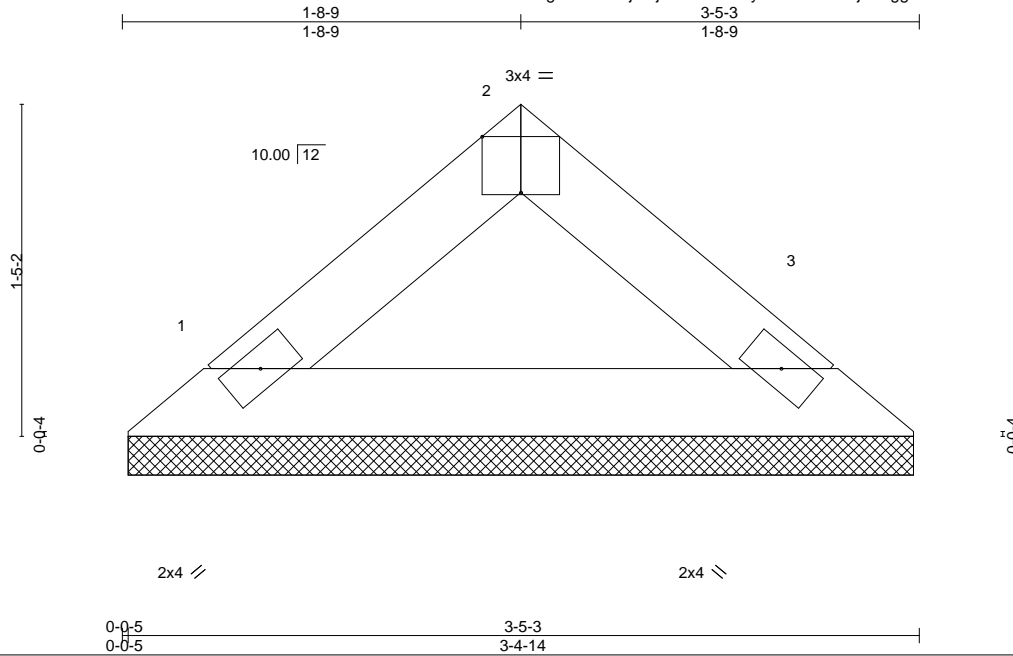

Scale = 1:9.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-P					Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.3	TOP CHORD Structural wood sheathing directly applied or 3-5-3 oc purlins.
BOT CHORD 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=3-4-9, 3=3-4-9
 Max Horz 1=-21(LC 8)
 Max Uplift 1=-1(LC 12), 3=-1(LC 13)
 Max Grav 1=105(LC 1), 3=105(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.




February 15, 2022

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

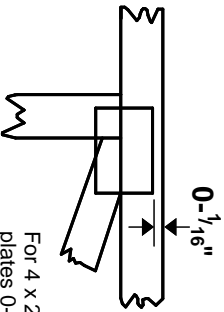

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

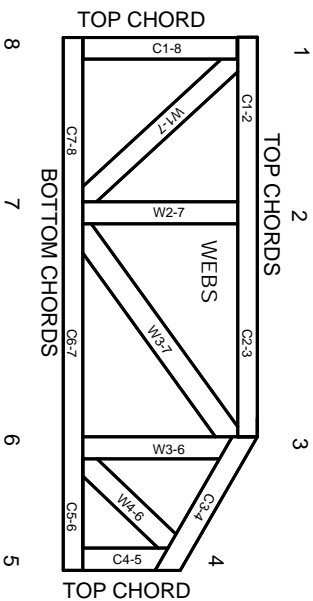

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.