

Harnett County Department of Public Health

PERMIT # SFD2203-0057

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 211 SAINT CLAIR DR

Name: (owner) KB HOME RALEIGH SUBDIVISION BIRCHWOOD GROVE LOT # 72

System Installer: BRANTLEY & SONS

Basement with plumbing: Garage Number of Bedrooms 5


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: III b Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

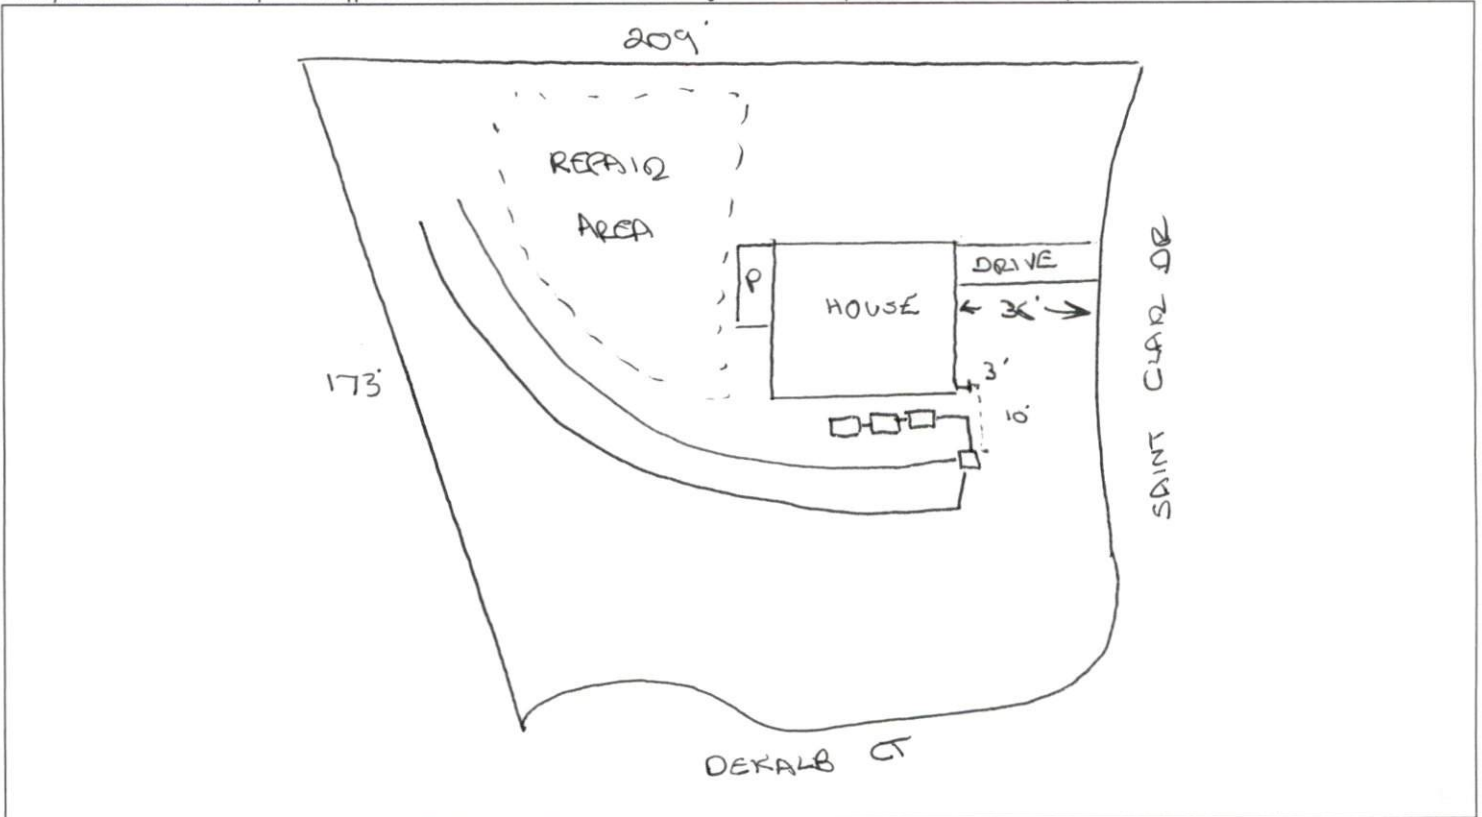

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: THIS IS A FLOW REDUCTION PERMIT

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to EZ Flow Septic Tank: 1000 gallons Pump Tank: 1300 gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches of each ditch ditches ditches
2 175 feet 3 feet 18 inches
 French Drain Required: ~~Linear feet~~

Authorized State Agent ~~_____~~ RCHS Date 10/19/22