



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature Curtis Quick
 Curtis Quick

LOAD CHART FOR JACK STUDS


(BASED ON TABLES R502.5(1) & (b))
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

CITY / CO.	ADDRESS	MODEL	DATE REV.	DRAWN BY	SALES REP.
Cameron / Harnett	226 Kensington Dr.	31500	02/15/22	Curtis Quick	Scott Duncan

BUILDER	JOB NAME	PLAN	SEAL DATE	QUOTE #	JOB #
Caviness & Cates Communities	Lot 199 Anderson Creek	CC-2355 K / 2ND FLOOR 16' SIDING	8/10/21	\$2355K I - J FL	J0222-0561

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

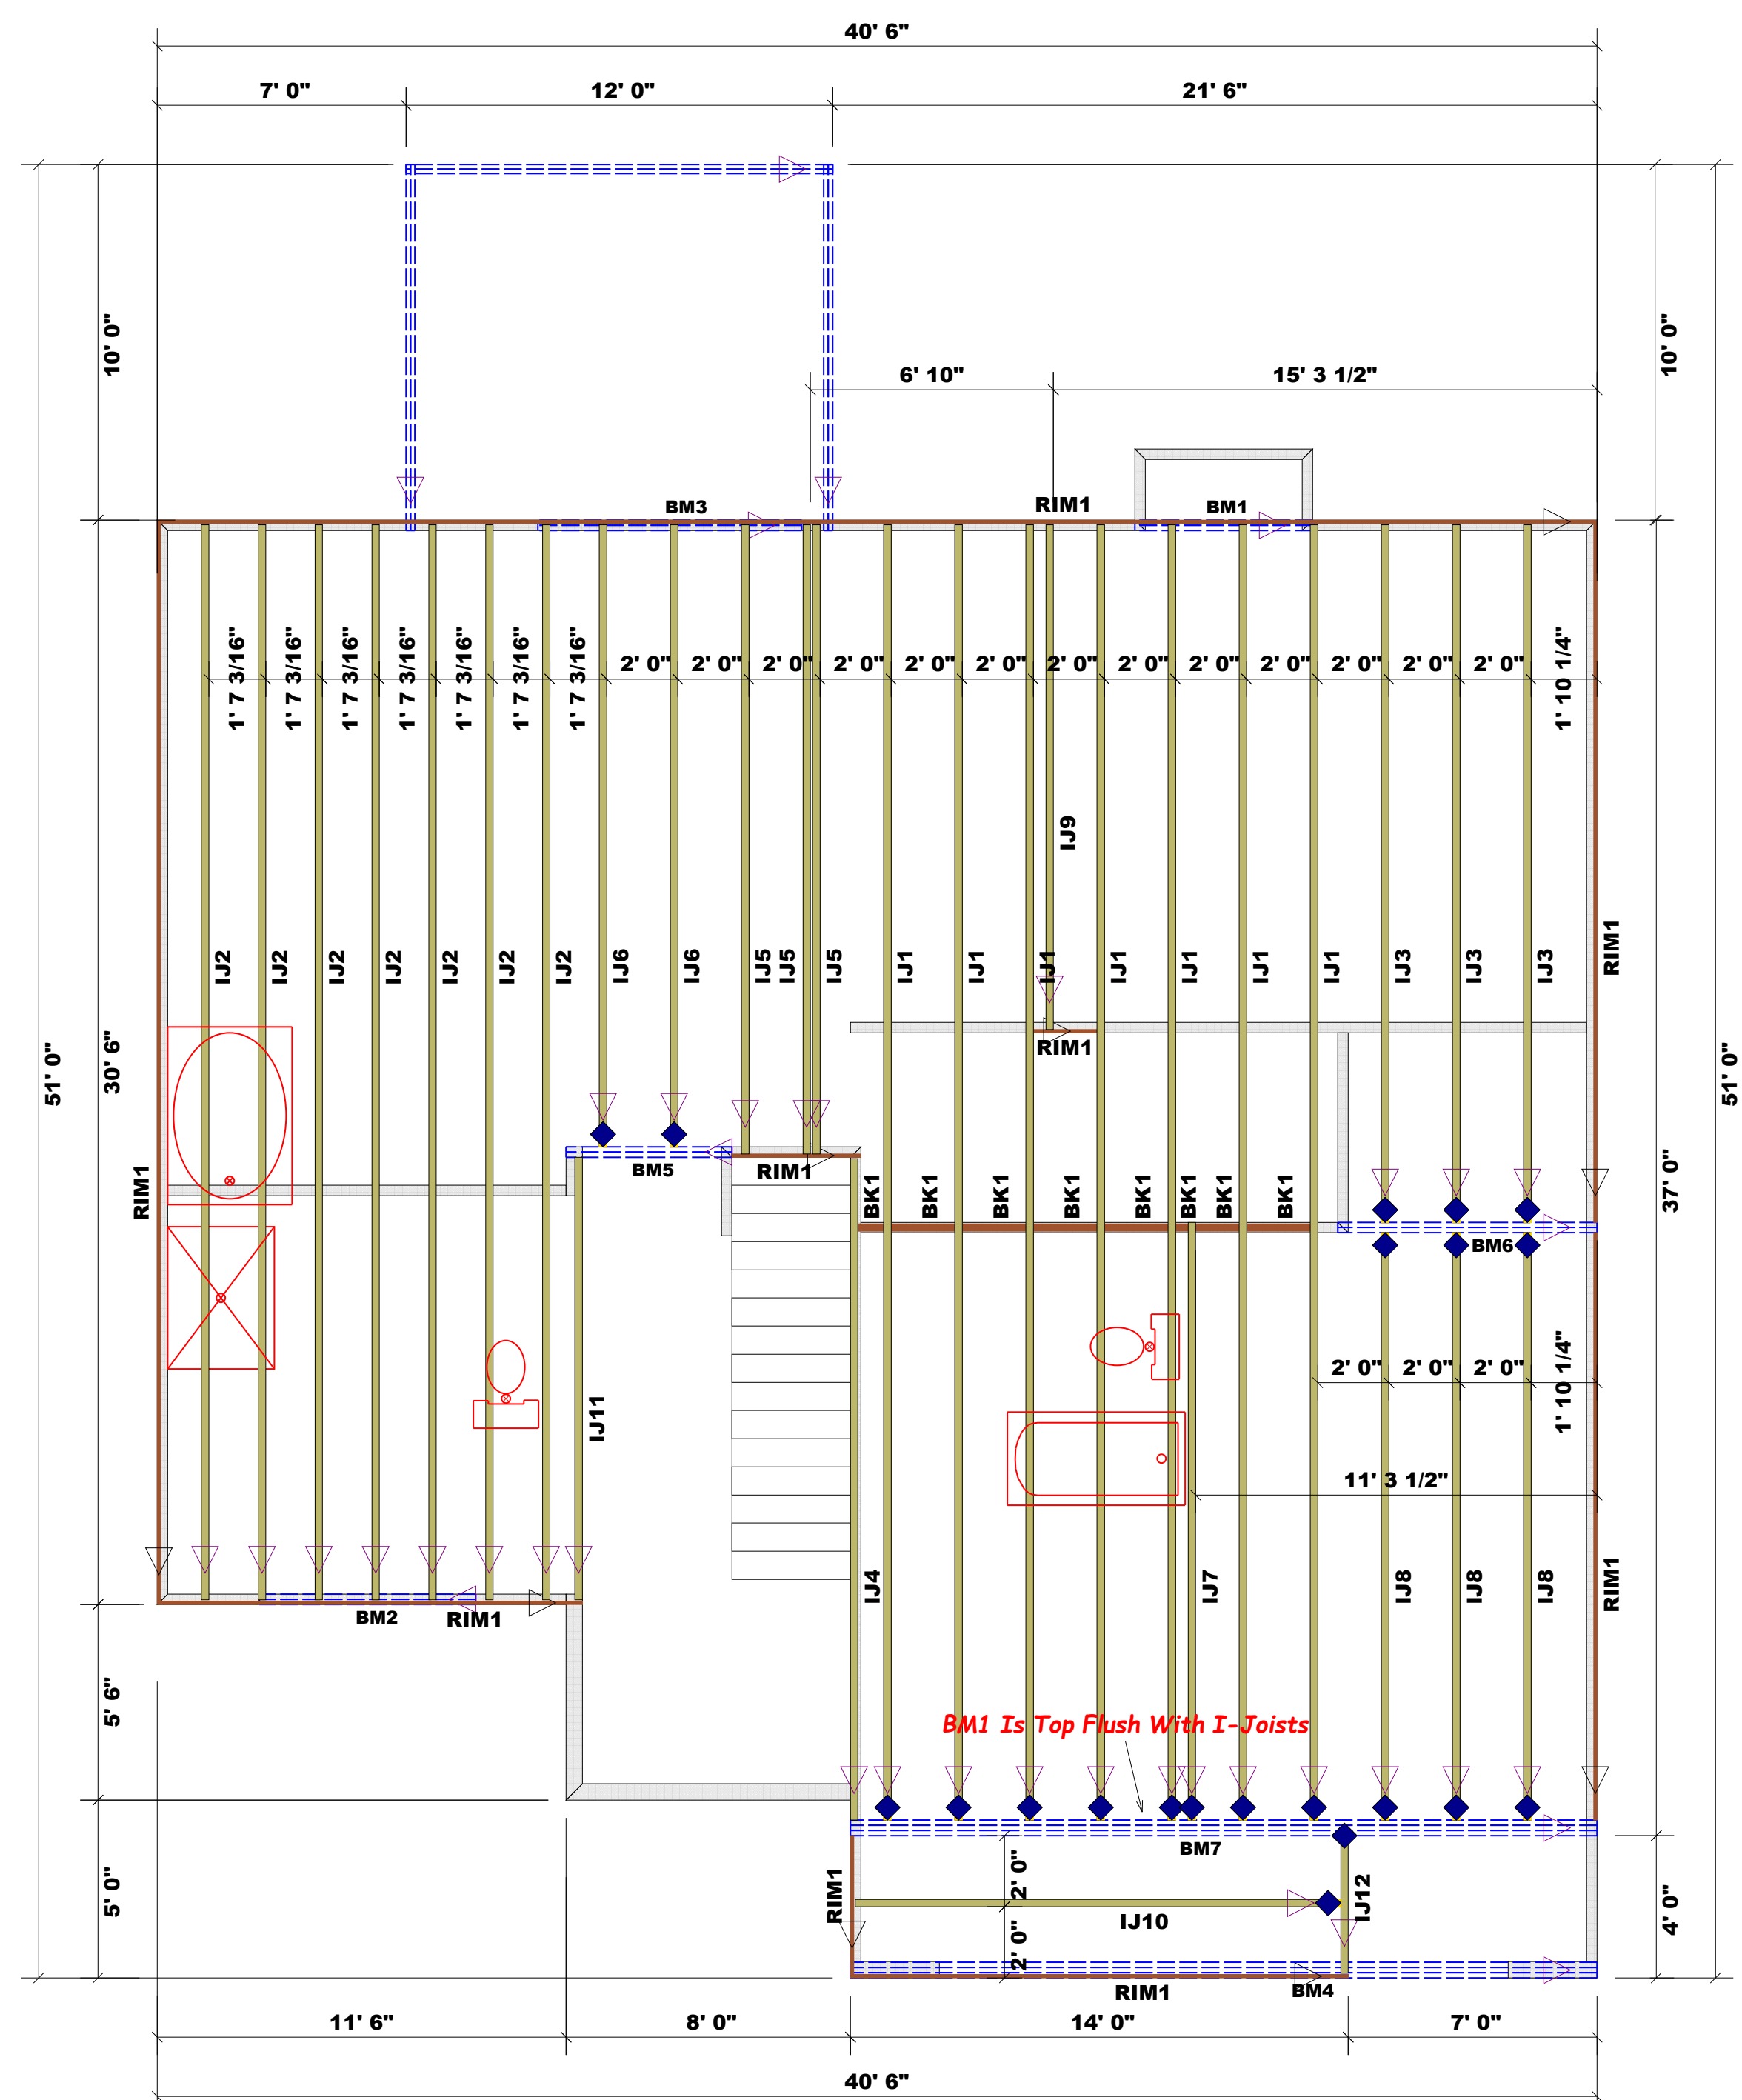

HANGER LEGEND

	= USP THF25140 / Single I-Joist Hanger
--	--

Truss Placement Plan
 SCALE: 1/4" = 1'

Beam Legend

PlotID	Length	Product	Plies	Net Qty	Fab Type
BM3	8-0-0	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM2	7-0-0	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM1	5-0-0	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM4	21-0-0	1-3/4"x 11-7/8" LVL Kerto-S	3	3	FF
BM6	8-0-0	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM5	5-0-0	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM7	21-0-0	1-3/4"x 18" LVL Kerto-S	3	3	FF
DBB08	12-0-0	1 1/2" x 9 1/4" Generic Material	2	2	FF
DBB06	12-0-0	1 1/2" x 9 1/4" Generic Material	2	2	FF
DBB07	12-0-0	1 1/2" x 9 1/4" Generic Material	2	2	FF

I-Joist Legend

PlotID	Length	Product	Plies	Net Qty	Fab Type
IJ1	36-5-4	14" WI 40	1	7	FF
IJ2	30-2-13	14" WI 40	1	7	FF
IJ3	19-7-8	14" WI 40	1	3	FF
IJ4	18-7-5	14" WI 40	1	1	FF
IJ5	17-8-4	14" WI 40	1	3	FF
IJ6	17-6-0	14" WI 40	1	2	FF
IJ7	16-9-12	14" WI 40	1	1	FF
IJ8	16-6-6	14" WI 40	1	3	FF
IJ9	14-2-4	14" WI 40	1	1	FF
IJ10	13-7-14	14" WI 40	1	1	FF
IJ11	12-5-7	14" WI 40	1	1	FF
IJ12	3-10-8	14" WI 40	1	1	FF
RIM1	12-0-0	1 1/8" x 14" Rim Board	1	12	FF
BK1	2-0-0	14" WI 40	1	8	FF
	1-8-0	Backer Blocks (14" WI 40)	1	2	Other
	1-0-0	Backer Blocks (14" WI 40)	1	2	Other
		Web Stiffeners (14" WI 40)	1	40	Other