

# Harnett County Department of Public Health

PERMIT # SPD 2203-1072

## Operation Permit

162 GRAN NAD

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: SR OAK GROVE CHURCH RD

Name: (owner) JUSTIN + CHARLOTTE PIENSTAHLS SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: DENNIS MEDLEN

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: 25% REDUCTION SYSTEM TYPE #16 Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

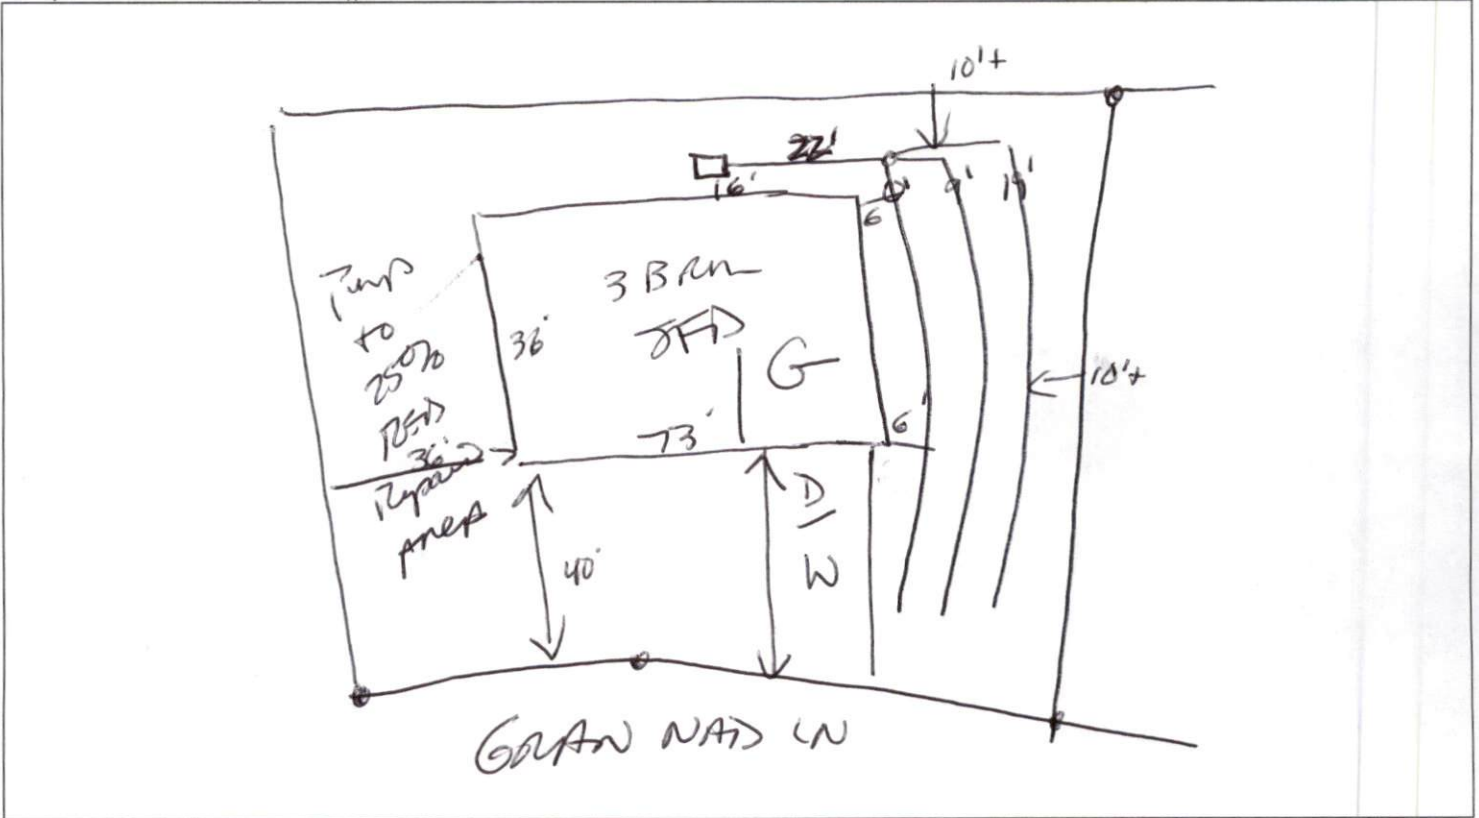

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box  
  \_\_\_\_\_ Pump  
  \_\_\_\_\_ Alarm  
  \_\_\_\_\_ H2O Line  
  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  
  Other 25% REDUCTION  
 Septic Tank: 1000 gallons  
 Pump Tank: \_\_\_\_\_ gallons  
 Subsurface No. of exact length width of depth of  
 Drainage Field ditches 3 of each ditch 80 feet ditches 3 feet ditches 28 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James C. Manhart <sup>SPD 12415</sup> Date 1-11-23