

Harnett County Department of Public Health

PERMIT # SFD2203-0094

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 299 JOHN STARK DR

Name: (owner) KB HOMES RALEIGH SUBDIVISION BIRCHWOOD GROVE LOT # 110

System Installer: BRANLEY & SONS


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: III Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

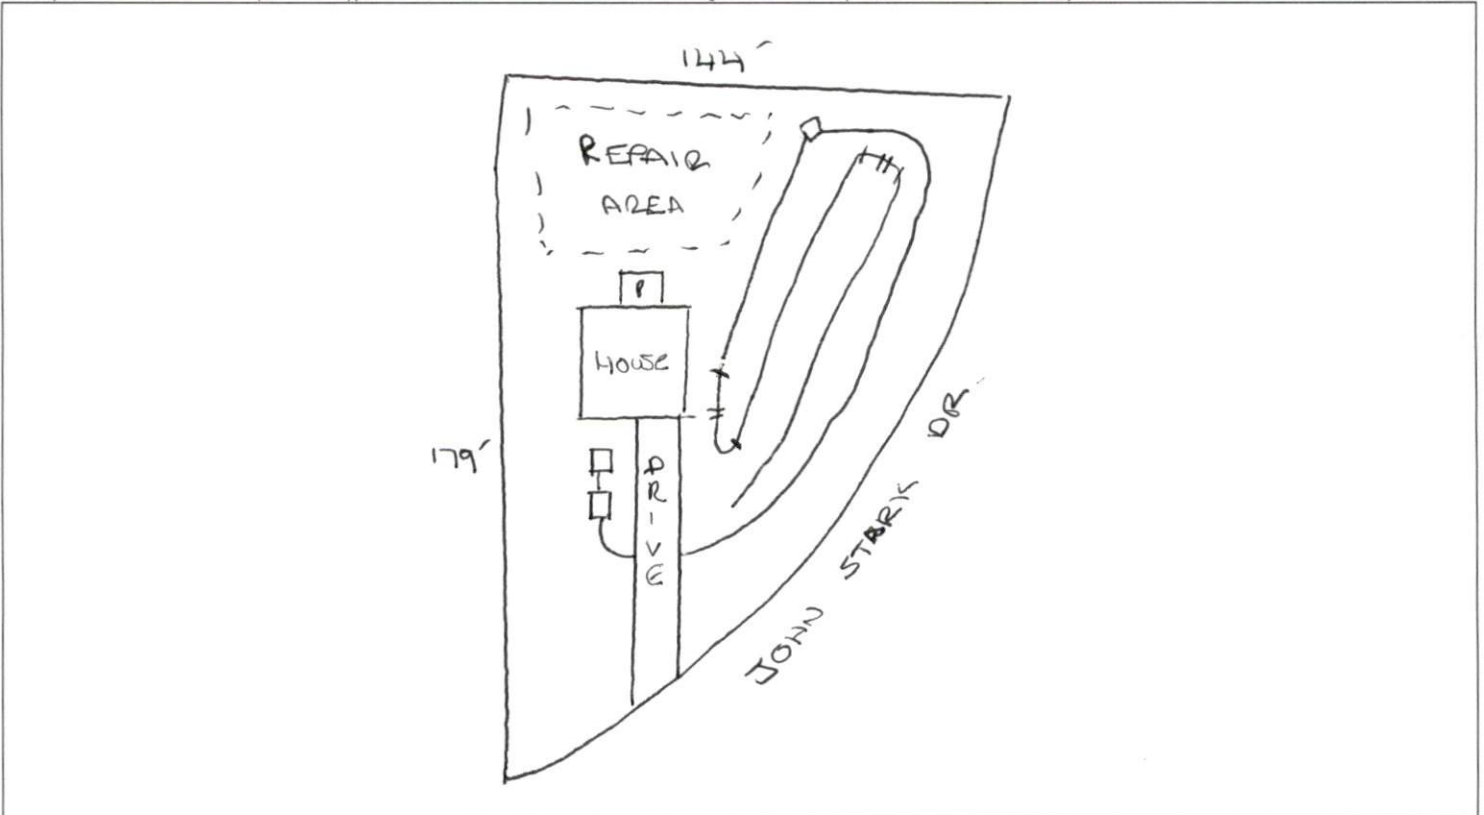

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: SUPPLY LINE 30" UNDER DRIVE AND SLEEVED WITH SCH 40

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other PUMP TO E2 FLOW Septic Tank: 1000 gallons Pump Tank: 1600 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 1 of each ditch 260 feet ditches 3 feet ditches 18 inches
French Drain Required: _____ Linear feet

Authorized State Agent: [Signature] REHS Date 7/29/22