



**ROOF & FLOOR TRUSSES & BEAMS**


Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature **David Landry**  
 David Landry

**LOAD CHART FOR JACK STUDS**  
 (BASED ON TABLES ROU11C1 & 1D1)  
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/STROPS

| END REACTION (IP-TON) | REQ'D STUDS FOR EACH END OF HEADERS/STROPS | END REACTION (IP-TON) | REQ'D STUDS FOR EACH END OF HEADERS/STROPS |
|-----------------------|--|-----------------------|--|
| 1700                  | 1  | 2550                  | 1  |
| 3400                  | 2  | 5100                  | 2  |
| 5100                  | 3  | 7650                  | 3  |
| 6800                  | 4  | 10200                 | 4  |
| 8500                  | 5  | 12750                 | 5  |
| 10200                 | 6  | 15300                 | 6  |
| 11900                 | 7  |                       |  |
| 13600                 | 8  |                       |  |
| 15300                 | 9  |                       |  |

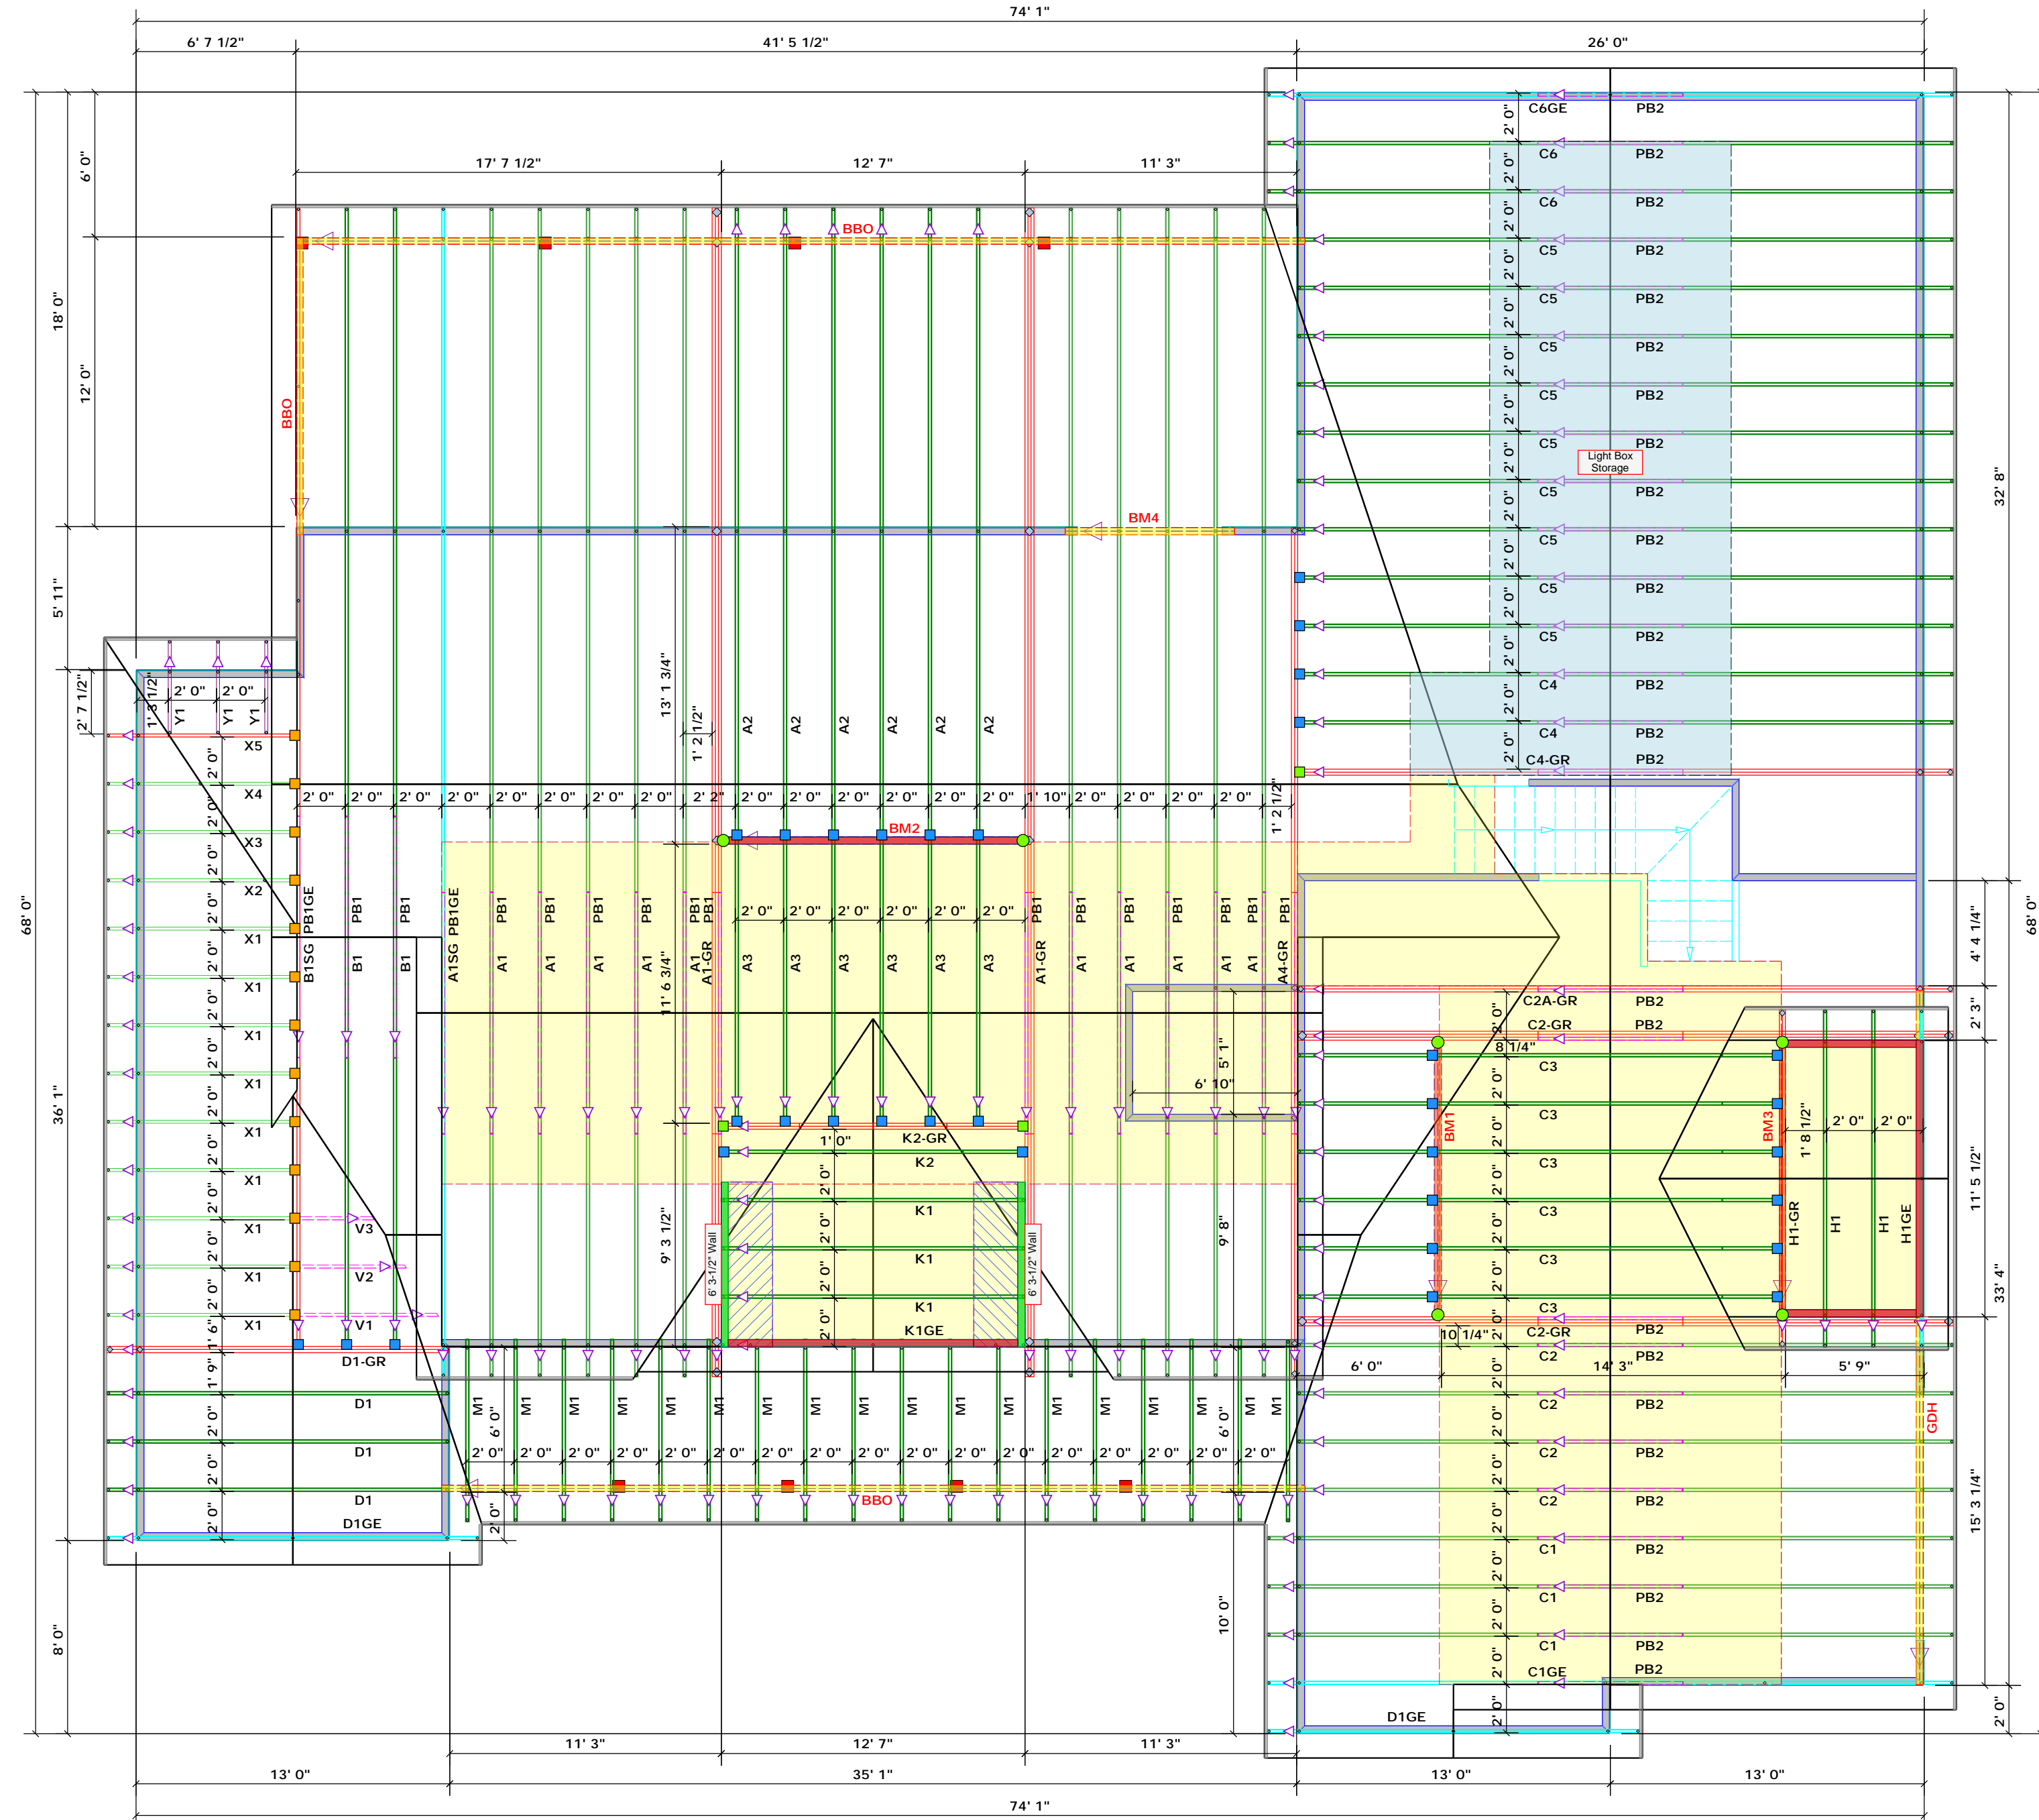

**Products**

| PlotID | Length | Product                     | Plies | Net Qty |
|--------|--------|-----------------------------|-------|---------|
| BM1    | 12' 0" | 1-3/4"x 11-7/8" LVL Kerto-S | 2     | 2       |
| BM2    | 13' 0" | 1-3/4"x 11-7/8" LVL Kerto-S | 2     | 2       |
| BM3    | 12' 0" | 2x10 SPF No.2               | 2     | 2       |
| BM4    | 7' 0"  | 1-3/4"x 9-1/4" LVL Kerto-S  | 2     | 2       |
| GDH    | 29' 0" | 1-3/4"x 16" LVL Kerto-S     | 2     | 2       |

Roof Area = 5829.36 sq.ft.  
 Ridge Line = 155.78 ft.  
 Hip Line = 16.84 ft.  
 Horiz. OH = 281 ft.  
 Raked OH = 207.78 ft.  
 Decking = 200 sheets

**1 Truss Placement Plan**  
 Scale: 3/16"=1'

All Walls Shown Are Considered Load Bearing

**Dimension Notes**  
 1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise.  
 2. All interior wall dimensions are to face of frame wall unless noted otherwise.  
 3. All exterior wall to truss dimensions are to face of frame wall unless noted otherwise.

**Hatch Legend**

|           |                 |
|-----------|-----------------|
| [Hatched] | Vaulted Ceiling |
| [Green]   | 6' 3-1/2" Walls |
| [Red]     | 2nd Floor Walls |
| [Blue]    | Box Storage     |
| [Orange]  | Flush Beam      |
| [Yellow]  | Drop Beam       |

**Connector Information**

| Sym      | Product | Manuf | Qty | Supported Member | Header     | Truss      |
|----------|---------|-------|-----|------------------|------------|------------|
| [Blue]   | HUS26   | USP   | 33  | NA               | 16d/3-1/2" | 16d/3-1/2" |
| [Orange] | JUS26   | USP   | 13  | NA               | 10d/3"     | 10d/3"     |
| [Green]  | THD410  | USP   | 6   | NA               | 16d/3-1/2" | 10d/3"     |
| [Yellow] | THD26-2 | USP   | 3   | NA               | 16d/3-1/2" | 10d/3"     |

**▲ = Indicates Left End of Truss**  
 (Reference Engineered Truss Drawing)  
 Do NOT Erect Truss Backwards

|           |                 |            |                   |
|-----------|-----------------|------------|-------------------|
| BUILDER   | Mike Bauer      | CITY / CO. | Harnett / Harnett |
| JOB NAME  | Bauer Residence | ADDRESS    | Site Address      |
| PLAN      | Bauer Residence | MODEL      | Roof              |
| SEAL DATE | Seal Date       | DATE REV.  | 03/09/22          |
| QUOTE #   | Quote #         | DRAWN BY   | David Landry      |
| JOB #     | J0222-0946      | SALES REP. | David Landry      |

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com.