

# Harnett County Department of Public Health

PERMIT # SFD2204-0027

## Operation Permit

New Installation     Septic Tank     Nitrification Line     Repair     Expansion

PROPERTY LOCATION: SR 1403 (Cokesbury RD)

Name: (owner) Sandra Grott      SUBDIVISION DIONICED ? DEAZ      LOT # 3

System Installer: JUNIOR CARDEWAS


Basement with plumbing:     Garage     Number of Bedrooms 3

Type of Water Supply:  Community     Public     Well    Distance from well \_\_\_\_\_ feet

System Type: 25% Reduction system 122 lay    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

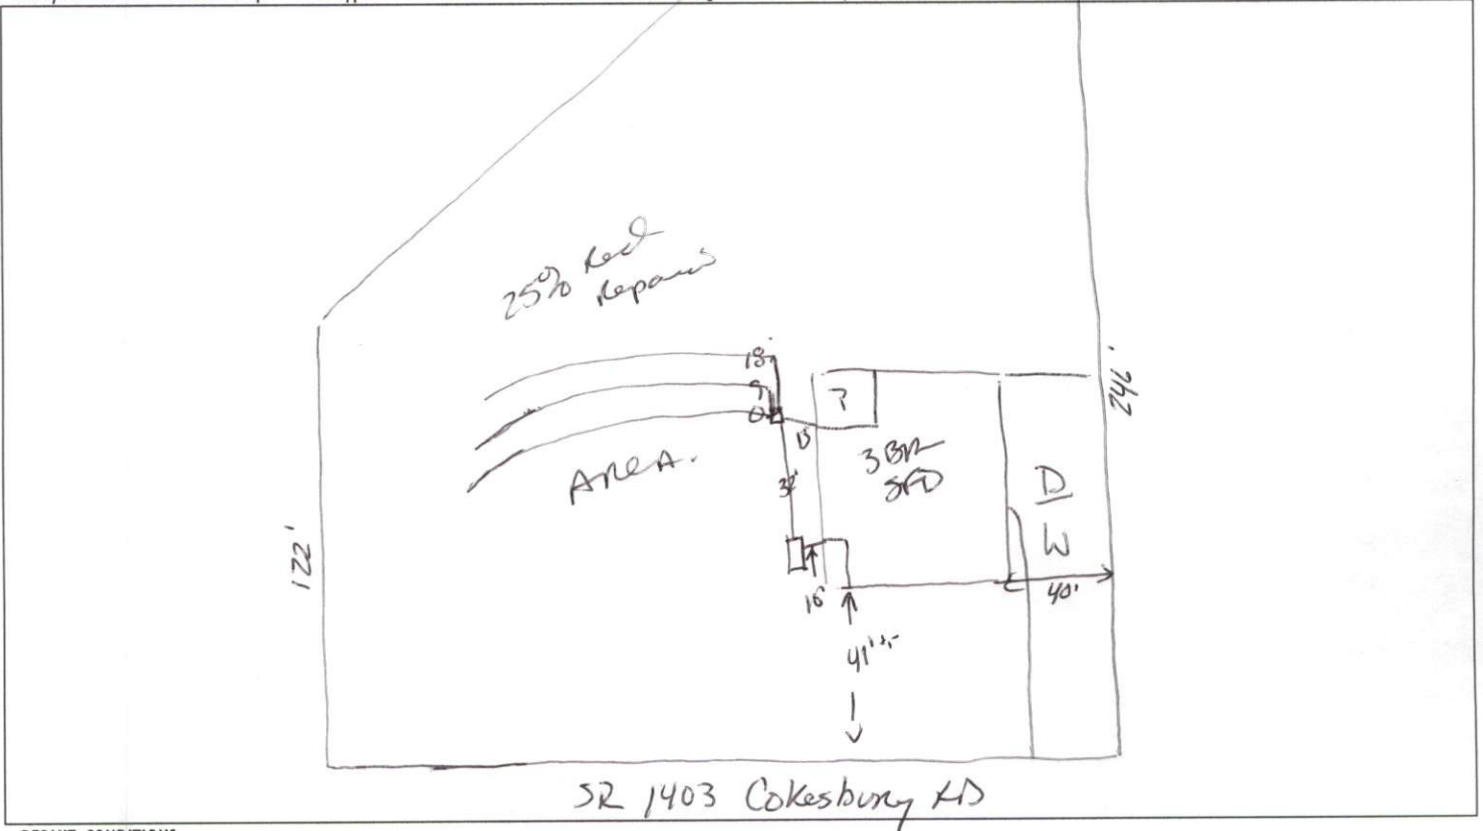

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_  
 \_\_\_\_\_

V. Other: \_\_\_\_\_  
 \_\_\_\_\_

\_\_\_\_\_ D-Box     \_\_\_\_\_ Pump     \_\_\_\_\_ Alarm     \_\_\_\_\_ H2O Line     \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.  
 Type of system:  Conventional     Other 25% REDUCTION 122 LAY    Septic Tank: 1000 gallons    Pump Tank: \_\_\_\_\_ gallons  
 Subsurface      No. of      exact length      width of      depth of  
 Drainage Field    ditches 3      of each ditch 100 feet      ditches 3 feet      ditches 18" inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. Manhart JR. ABAS      Date 9-26-22