

# Harnett County Department of Public Health

PERMIT # SFD 2204-0069

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 159 Rolling Pasture Way (SR 1215)

Name: (owner) Lanco Custom Builders      SUBDIVISION Fair Ridge Farm      LOT # 1

System Installer: Elvis Fancloth


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community    Public    Well      Distance from well \_\_\_\_\_ feet

System Type: TYPE III B      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

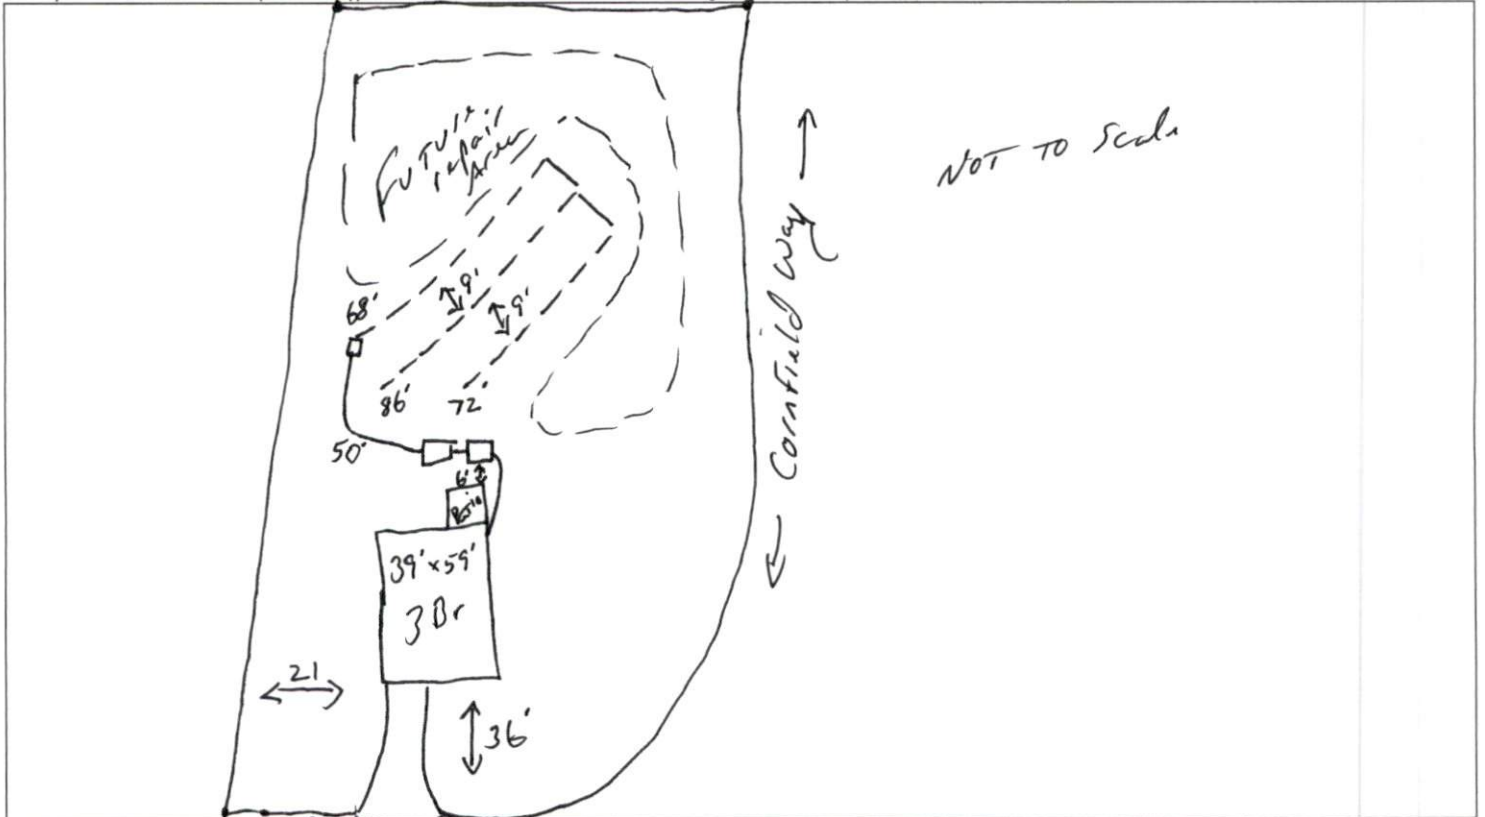

PERMIT CONDITIONS: ← Rolling Pasture →

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  
  Pump  
  Alarm  
  H2O Line  
  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 25% reduction I & Q      Septic Tank: 1000 gallons      Pump Tank: 1000 gallons

Subsurface      No. of      exact length      width of      depth of

Drainage Field      ditches 1      of each ditch 226 feet      ditches 3 feet      ditches 24 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent Mah REHS      Date 12-1-22