0018


Harnett County Department of Public Health

Improvement Permit
nit cannot be issued with only an Improvement Permit

PROPERTY LOCATION: SX 1418 The Ex TWS
ISSUED TO: / Hi Cheman & Hickman Buter SUBDIVISION Thomas L Brush Cay LOT # TRG
NEW REPAIR EXPANSION Site Improvements required prior to Construction Authorization Issuance:
Type of Structure: 3FD
Proposed Wastewater System Type: Low Profile CHAMBER
Projected Daily Flow: 340 GPD
Number of bedrooms:3Number of Occupants:6max
Basement Yes No
Pump Required: Yes No May be required based on final location and elevations of facilities
Type of Water Supply: Community Public Well Distance from well feet Permit valid for: Five years
Permit conditions: No expiration
CALLET TREHS
Authorized State Agent: Same & Manhant Date: 4-17-23 SEE ATTACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This
site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of
the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.
Construction Authorization
(Required for Building Permit)
The construction and installation requirements of Rules .1950, .1954, .1955, .1956, .1957, .1958. and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.
ISSUED TO: Hickman + Hickman Euta PROPERTY LOCATION: 5/1418 PEUCARD SUBDIVISION Thomas L production LOT # Tiels
Facility Type: New Expansion Repair
Basement? Yes No Basement Fixtures? Yes No
Type of Wastewater System** Low Profele CHAMBER (Initial) Wastewater Flow: 360 GPD
(See note below, if applicable)
Low Protete CHAnger (Repair)
Installation Requirements/Conditions Number of trenches
Septic Tank Size 1000 gallons Exact length of each trench 300 feet Trench Spacing: Feet on Center
Pump Tank Sizegallons
Maximum Trench Depth of: 12 inches (Maximum soil cover shall not exceed
(Trench bottoms shall be level to $\pm \frac{1}{4}$ " 36" above the trench bottom)
in all directions)
Pump Requirements:ft. TDH vsGPMinches below pipe
Aggregate Depth: inches above pipe
Conditions:
WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.
**If applicable: 1 understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.
Owner/Legal Representative Signature: Date:
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.
E MA 1 LAW DESTS
Authorized State Agent: Date: 4-17-23
Authorized State Agent: Date: 4-17-23 Construction Authorization Expiration Date: 4-17-28
Construction Authorization Laphation Date.

Application # 50 2005 - 0018

Harnett County Department of Public Health Site Sketch

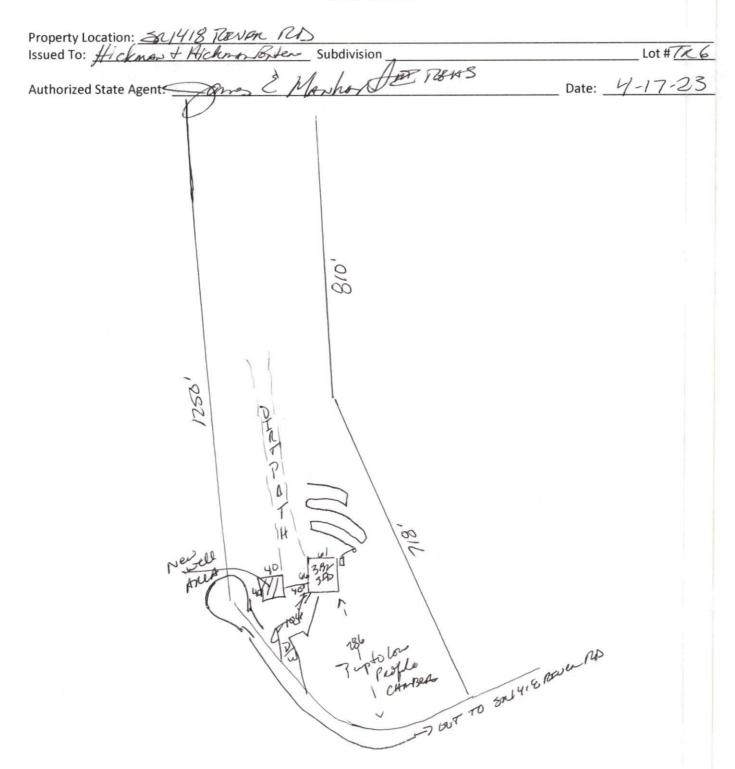

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.